



S.No.	STD. SOR Drawings
1	Installation Details 15 KI Tank in Earthen Pit
2	Installation Details 15 KI Tank in Earthen Pit with Holding down Arrangement.
3	Installation Details 15 KI Tank in Masonry Pit
4	Installation Details 15 KI Tank in Masonry Pit with Holding Down Arrangement
5	Installation Details 15 KI Tank in Masonry Pit with Sleeper Beam on top
6	Installation Details 15 KI Tank in Masonry Pit with RCC Slab on top
7	Installation Details 20 KI Tank in Earthen Pit
8	Installation Details 20 KI Tank in Earthen Pit with Holding down Arrangement.
9	Installation Details 20 KI Tank in Masonry Pit
10	Installation Details 20 KI Tank in Masonry Pit with Holding Down Arrangement
11	Installation Details 20 KI Tank in Masonry Pit with Sleeper Beam on top
12	Installation Details 20 KI Tank in Masonry Pit with RCC Slab on top
13	Installation Details 45 KI Tank in Earthen Pit
14	Installation Details 45 KI Tank in Masonry Pit
15	Installation Details 45 KI Tank in Masonry Pit with Holding down Arrangement
16	Installation Details 45 KI Tank in Masonry Pit with RCC Slab on top
17	Monolith Foundation
18	Hume Pipe Culvert for various Spans
19	Septic Tank 10 to 100 users
20	Soak Pit
21	Detail of Retaining Wall
22	Plate Farthing
23	Chain link & Barbed Wire Fencing
24	Emblem Pole Foundation
25	Fabrication details of 1/2 Y Pole.
26	Slab Culvert for various span
	Other STD Drawings
27 1	Sales Room B0
28 2	Sales Room Structure & Electrical
29 3	Electric Panel
30 4	Detail of Compound Wall
31 5	Canopy Foundation
32 6	Manhole details
33 7	Detail of Pump Pedestal
34 8	Slab Culvert
35 9	Detail of Building Foundations
36 10	Detail of PVC Pipe Caseing.

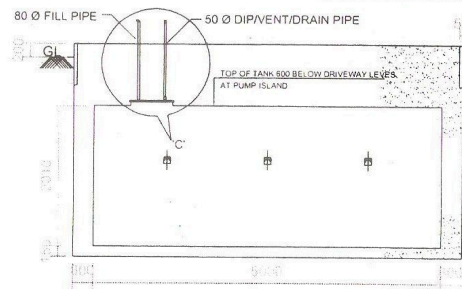


SECTION A-A

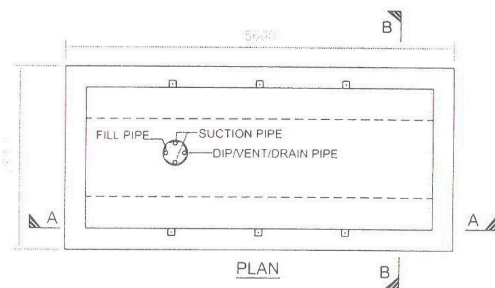


PLAN

815 SIDE 610 HIGH
50 THK. R.C.C. SLAB AS CURB
FILLING SOFT EARTH FREE
OF STONES WELL RAMMED

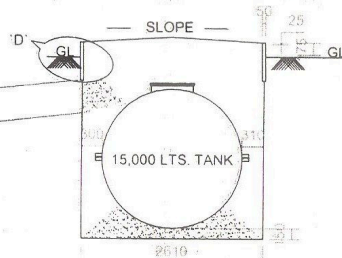

SECTION B-B

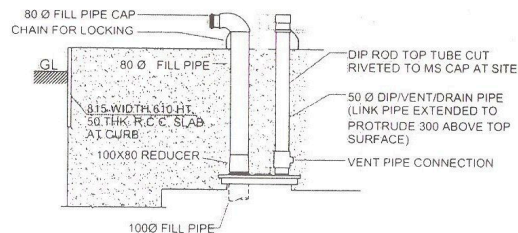


DETAILS AT 'C'

NOTES:-


- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG. INSTEAD OF STANDARD 2350.

TANK IN EARTH PIT


BHARAT PETROLEUM CORPORATION LTD.				DATE	DRAWING NO.
TITLE: INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK IN EARTHEN PIT				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE :-	DRAWN:	CHECKED	SHEET NO.	DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1	RE DRG. 401	

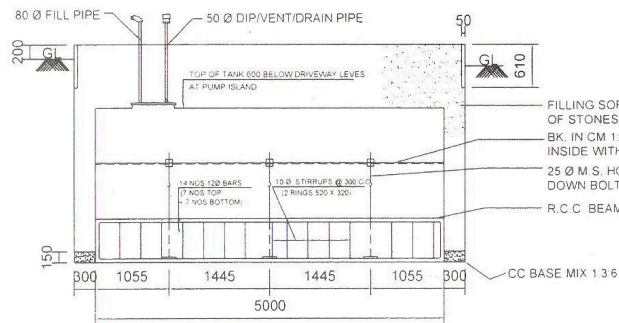


SECTION A-A

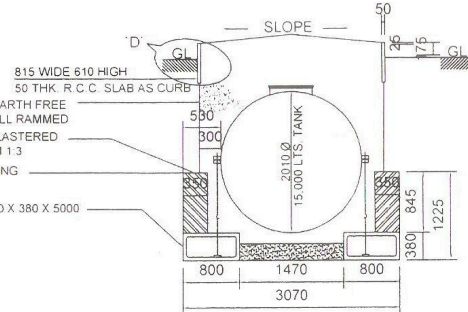

SECTION B-B

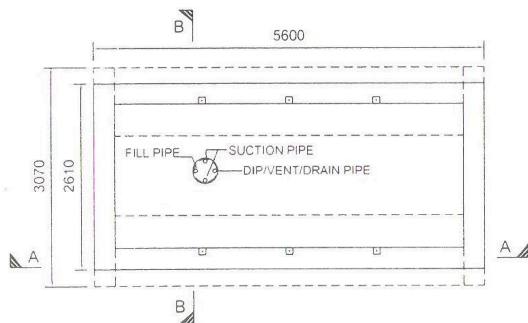

PLAN

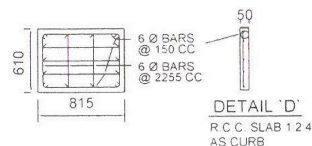

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG INSTEAD OF STANDARD 2350
- 3) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMULTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL AND RCC CURB
- 4) RCC BEAM SHOULD BE CAST FIRST BEFORE LAYING C.C. BASE

TANK INEARTH PIT WITH HOLDING DOWN ARRANGEMEANT

BHARAT PETROLEUM CORPORATION LTD.				DATE	DRAWING NO.
TITLE INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK IN EARTHEN PIT WITH HOLDING DOWN ARRENGMENT				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE --	DRAWN	CHECKED	SHEET NO.	DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr (DESIGN & DEVP)		1 OF 1	RE DRG 401	



TANK IN MASONRY PIT



NOTES:-


- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. CM FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LON
- 3) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMULTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL.

BHARAT PETROLEUM CORPORATION LTD.					
TITLE: INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK IN MASONRY PIT				DATE	DRAWING NO
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE --	DRAWN:	CHECKED	SHEET NO	DRAWING NO	
DATE 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1	RE DRG. 401	



- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMULTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL
- 3) R.C.C. BEAMS SHOULD BE CAST FIRST BEFORE LAYING C.C. BASE

BHARAT PETROLEUM CORPORATION LTD.					
TITLE: INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK IN MASONRY PIT WITH HOLDING DOWN ARRANGEMENT				DATE	DRAWING NO.
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE --	DRAWN:	CHECKED	SHEET NO	DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1	RE DRG. 401	

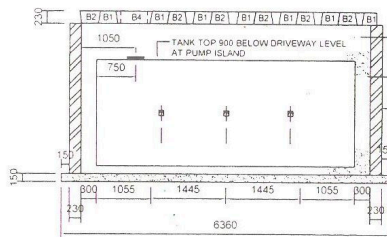


SECTION A-A


B3 230X300X70
2 NOS. R.C.C. BEAM

FILLING SOFT EARTH FREE
OF STONES WELL RAMMED
BRICK IN C.M. 1:5 PLASTERED
INSIDE WITH C.M. 1:3



50X50X6 ANGLE IRON
520 LONG. BOLTED TO
BRACKETS









SECTION B-B



B4

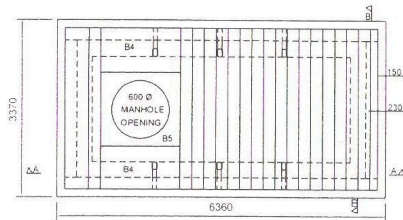

PLAN



2 NOS.
10 Ø LINKS
TOP & BOTTOM


4 NOS.
6 Ø LINKS
TO THE MAIN
STEEL

16 Ø BARS
4 NOS.

600 Ø
OPENING

930

DETAILS OF BEAMS

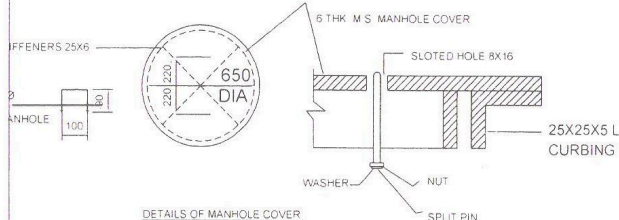

DETAILS OF MANHOLE COVER

TANK IN MASONRY PIT WITH
R.C.C. SLEEPER SLAB ON TOP

NOTES:

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH IS HARD NON-YIELDING LAYER IN SUCH CASE ONLY 530 WIDE X 150 THK. FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED.
- 3) BEAMS B1 B2 B4 & B5 MAY BE CAST IN SITU BEAM B1 SHOULD BE CAST FIRST & AFTER CURING PAPER SEPARATOR SHOULD BE GLUED TO THE FACES ADJOINING BEAMS B2 B4 & B5 BEFORE THESE BEAMS ARE CAST


BHARAT PETROLEUM CORPORATION LTD.

TITLE: INSTALLATION DETAILS OF 15,000 LITRES
CYLINDRICAL UNDERGROUND TANK IN MASONRY
PIT WITH SLEEPER BEAM


DATE: DRAWING NO.

NUMBERS CROSSED OUT ARE
SUPERSEDED DRAWINGS


SCALE: --	DRAWN:	CHECKED:	SHEET NO:
DATE: 20/12/1999	Sr Mgr. (DESIGN & DEVP.)		1 OF 1
			RE DRG 401

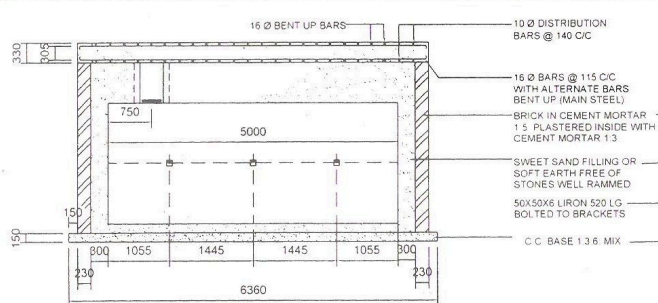



SECTION A-A

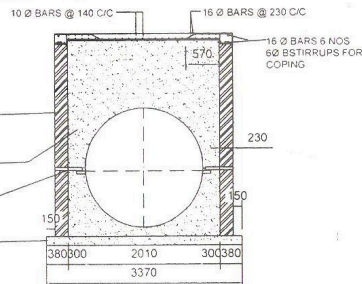


SECTION B-B



CROSS SECTION OF R.C.C. SLAB

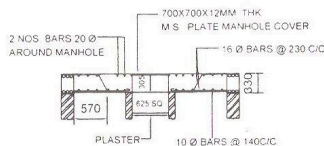

CROSS SECTION THROUGH MANHOLE

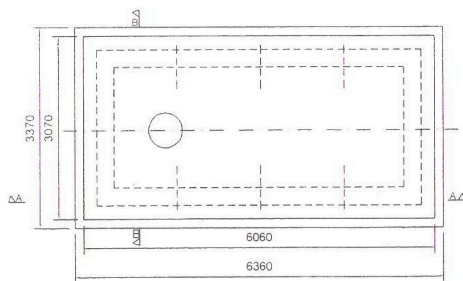


TANK IN MASONRY PIT WITH R.C.C. SLAB ON TOP



NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. CM. FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH, IS HARD NON YIELDING LAYER. IN SUCH CASE ONLY 530 WIDE X 150 THK. FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED.

BHARAT PETROLEUM CORPORATION LTD				DATE	DRAWING NO.
TITLE INSTALLATION DETAILS OF 15,000 LITRES CYLINDRICAL UNDERGROUND TANK IN MASONRY PIT WITH RCC TOP				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE :-	DRAWN	CHECKED	SHEET NO.	DRAWING NO.	
DATE 20/12/1999	Sr. Mgr. (DESIGN & DEVP)		1 OF 1	RE.DRG 401	

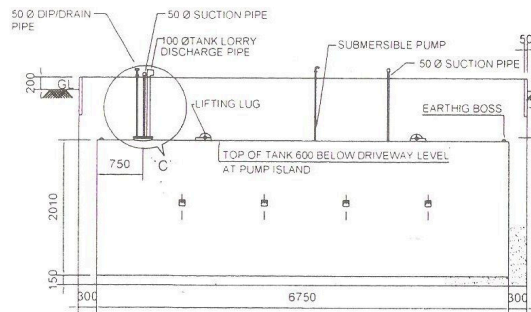


SECTION A-A

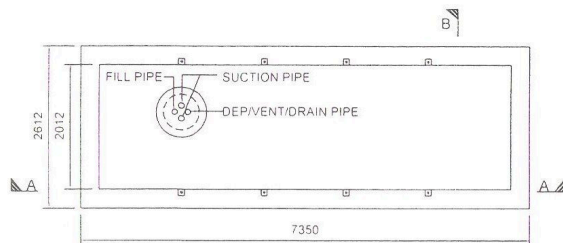


DETAIL 'D'
R.C.C. SLAB

TANK IN EARTH PIT

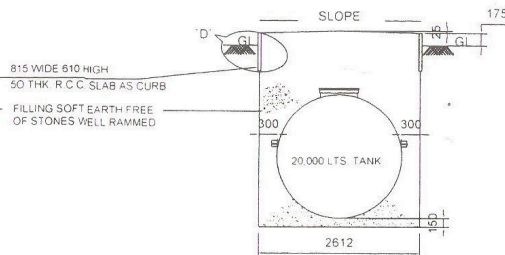

SECTION B-B

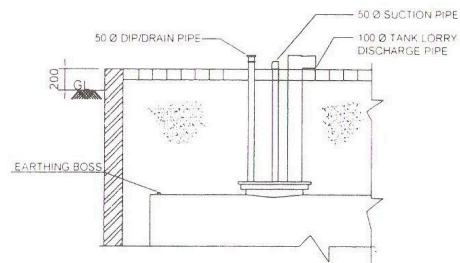


DETAILS AT 'C'
(REFER DETAIL DRG NO RE 382)


NOTES:

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. CM FOR 2 HOURS.
- 2) DIP R.C.C. SUPPLIED WITH THE TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG INSTEAD OF STANDARD 2350


BHARAT PETROLEUM CORPORATION LTD.					
TITLE: INSTALLATION DETAILS OF 20,000 LITRES CYLINDRICAL UNDERGROUND TANK IN EARTHEN PIT				DATE	DRAWING NO.
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE --	DRAWN	CHECKED	SHEET NO	DRAWING NO.	
DATE: 20/12/1999	Sr Mgr (DESIGN & DEVP.)		1 OF 1	RE DRG 402	

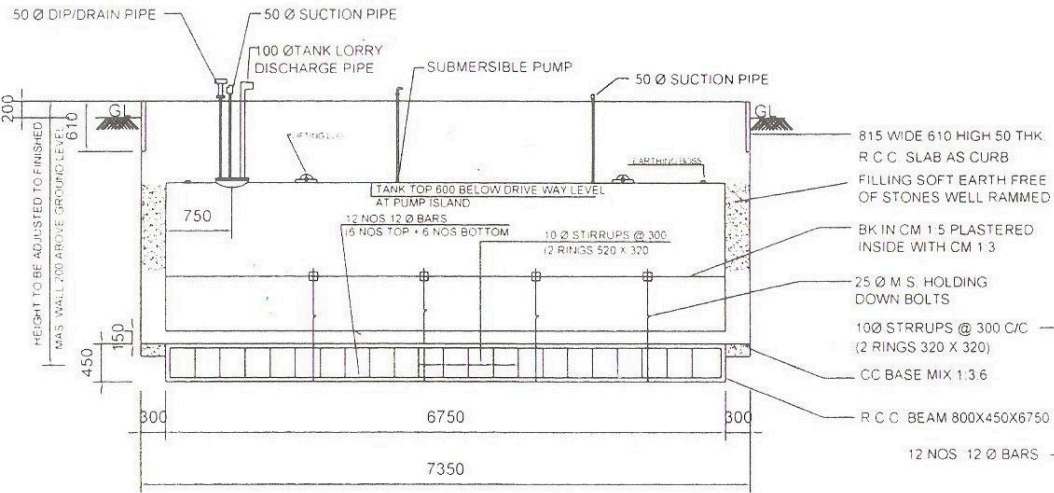


SECTION A-A

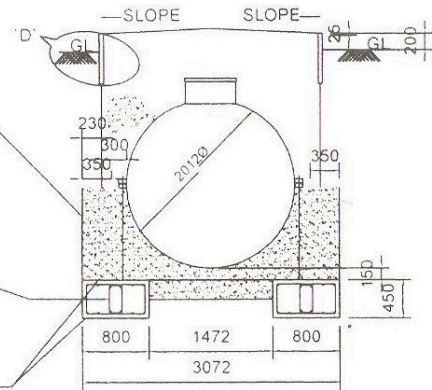


SECTION B-B

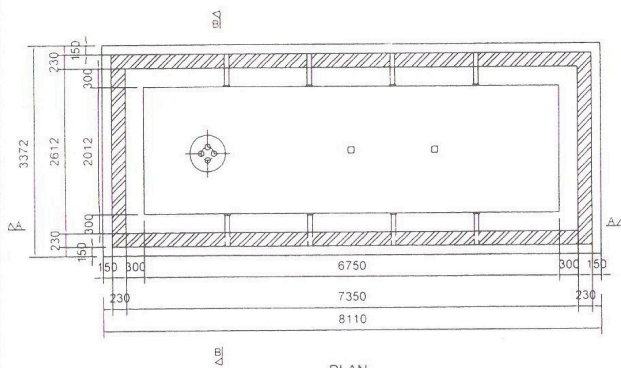

TANK IN MASONRY PIT

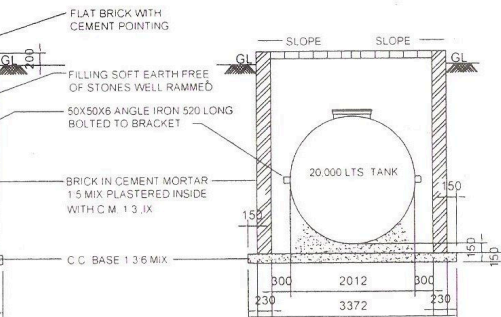

SECTION B-B

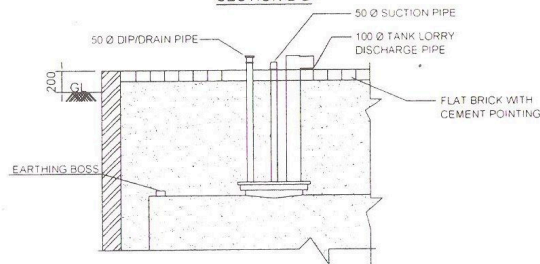

DETAILS AT 'C'
(FERER DTAIL DRG NO RE 382)

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. CM. FOR 2 HOURS
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE
- 3) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMULTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL



BHARAT PETROLEUM CORPORATION LTD.					
TITLE INSTALLATION DETAILS OF 20,000 LITRES CYLINDRICAL UNDERGROUND TANK IN MASONARY PIT				DATE	DRAWING NO.
				NUMBERS CROSSED OUT AND SUPERSEDED DRAWINGS	
SCALE --	DRAWN	CHECKED	SHEET NO.	DRAWING NO.	
DATE 20/12/1999	Sr Mgr (DESIGN & DEVP.)		1 OF 1	RE.DRG. 402	



NOTES:-


- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED. THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. CM. FOR 2 HOURS.
- 2) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMULTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL.
- 3) RCC BEAM SHOULD BE CAST FIRST BEFORE LAYING C.C. BASE

BHARAT PETROLEUM CORPORATION LTD.				DATE		DRAWING NO.	
TITLE INSTALLATION DETAILS OF 20,000 LITRES CYLINDRICAL UNDERGROUND TANK IN MASONARY PIT WITH HOLDING ARGUMENT				NUMBERS CROSSED OUT AND SUPERSEDED DRAWINGS			
SCALE --		DRAWN		CHECKED		SHEET NO.	
DATE : 20/12/1999		Sr Mgr (DESIGN & DEVP.)		1 OF 1		DRAWING NO. RE DRG 402	




- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/CM² C.M FOR 2 HOURS
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH, IS HARD NON YIELDING LAYER. IN SUCH CASE ONLY 530 WIDE X 150 THICK FOOTING UNDER MASONRY WALLS SHOULD BE PROVIDED
- 3) BEAMS B1 B2 B4, & B5 MAY BE CAST IN SITU. BEAM B1 SHOULD BE CAST FIRST & AFTER CURING, PAPER SEPARATOR SHOULD BE GLUED TO THE FACES ADJOINING BEAMS B2 B4 & B5 BEFORE THESE BEAMS ARE CAST


BHARAT PETROLEUM CORPORATION LTD					
TITLE INSTALLATION DETAILS OF 20,000 LITRES CYLINDRICAL UNDERGROUND TANK IN MASONARY PIT WITH SLEEPER BEAM TOP				DATE	DRAWING NO.
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE	DRAWN	CHECKED	SHEET NO.	DRAWING NO.	
DATE 20/12/1999	Sr Mgr (DESIGN & DEVP)		1 OF 1	RE DRG. 402	

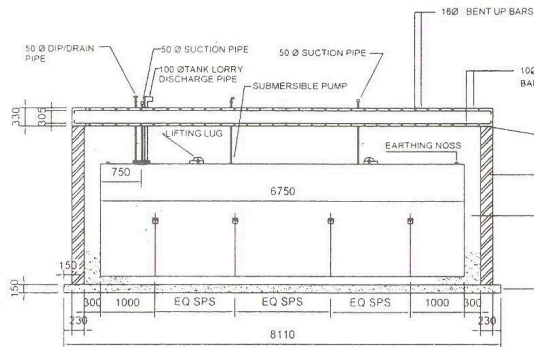


SECTION A-A

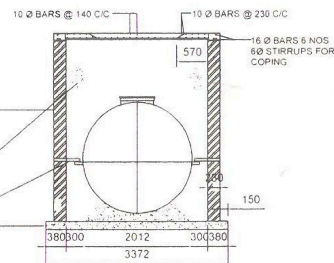


SECTION B-B

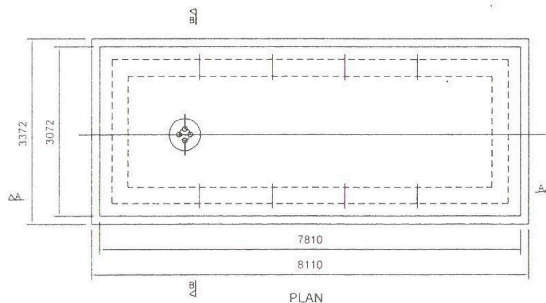


PLAN




CROSS SECTION OF R.C.C. SLAB




BAR 'a'

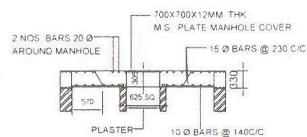

CROSS SECTION THROUGH MANHOLE



BAR 'b'



BAR 'c'

BAR 'c'

NOTES -


- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M FOR 2 HOURS.
- 2) C.C. BASE MAY BE ELIMINATED WHERE THE SOIL MET WITH IS HARD NON YELDING LAYER, IN SUCH CASE ONLY 530 WIDE X 150 THK. FLLTNG UNDER MASONRY WALLS SHOULD BE PROVIDED.

BHARAT PETROLEUM CORPORATION LTD.


TITLE
INSTALLATION DETAILS OF 20,000 LITRES
CYLINDRICAL UNDERGROUND TANK WITH RCC TOP

DATE
DRAWING NO.
NUMBERS CROSSED OUT ARE
SUPERSEDED DRAWINGS
DRAWING NO.
RE DRG. 402


SCALE --
DATE 20/12/1999
DRAWN
Sr. Mgr. (DESIGN & DEVP.)
CHECKED
SHEET NO.
1 OF 1

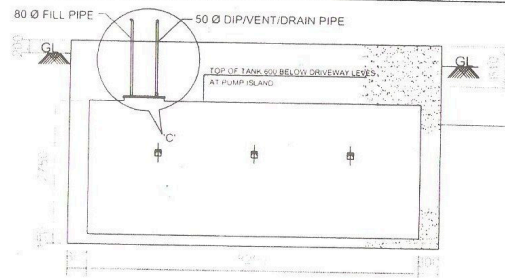


SECTION A-A

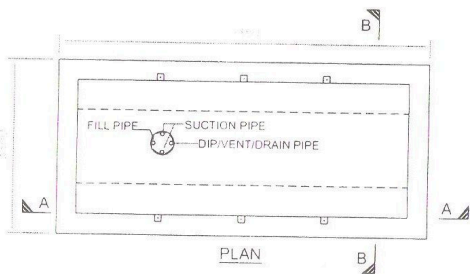

PLAN

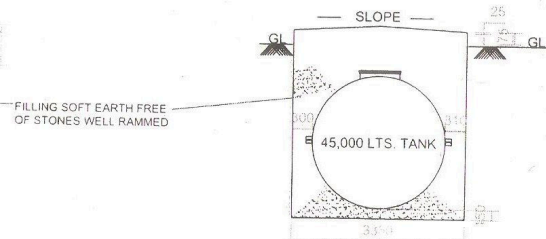

SECTION B-B

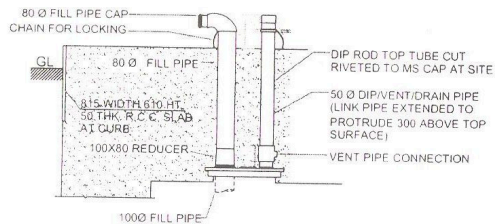


DETAILS AT 'C'

NOTES:-

- 1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
- 2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LONG. INSTEAD OF STANDARD 2350

TANK IN EARTH PIT



BHARAT PETROLEUM CORPORATION LTD				DATE	DRAWING NO.
TITLE: INSTALLATION DETAILS OF 45,000 LITRES CYLINDRICAL UNDERGROUND TANK IN EARTHEN PIT				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE	DRAWN	CHECKED	SHEET NO.	DRAWING NO.	
DATE: 20/12/1999	Sr Mgr. (DESIGN & DEVP.)		1 OF 1	RE.DRG. 401	

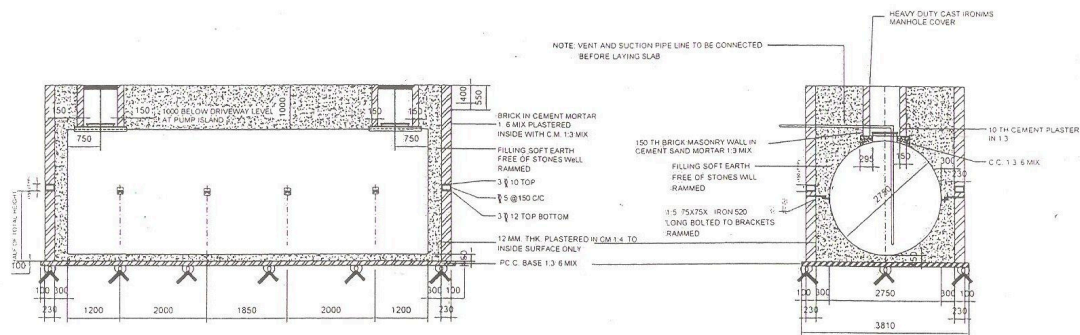


NOTE:

1. Tanks should be given hydraulic pressure test prior to installation & before protective coat is applied. The test should be maintained at a controlled pressure of 0.5 kg/Sq. cm. for 1 Hr.
2. Back filling of the earth should be carried out simultaneously outside & inside the Masonry wall.
3. C.C. base may be eliminated where the soil met with is hard non yielding layer in such cases only 53 mm x 150 mm thick footing under masonry walls should be provided.


BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT: MASONARY PIT					
INSTALLATION DRAWING FOR 45 KL U/G TANK				DATE	DRAWING NO.
SCALE: NTS	DRAWN:	TRACED	CHECKED	DRAWING NO.	
DATE: 02/03/98	G.M. (E&P) / A.E. TTRACED			E&P/RET/T104	

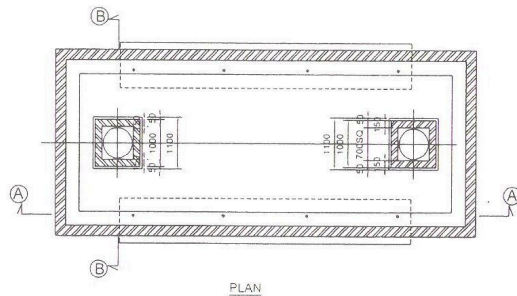



BHARAT PETROLEUM CORPORATION LTD.						
SUBJECT: MASONARY PIT WITH HOLDING DOWN						
INSTALLATION DRAWING FOR 45 KL U/G TANK					DATE	DRAWING NO.
SCALE	NTS	DRAWN	TRACED	CHECKED	DRAWING NO.	
DATE	02/03/98	G M (E&P)	A E	TRACED	E&P/RET/T103	



BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT: MASONARY P/T WITH R.C.C. SLAB ON TOP					
INSTALLATION DRAWING FOR 45 KL U/G TANK				DATE	DRAWING NO.
SCALE: NTS	DRAWN:	TRACED	CHECKED	DRAWING NO.	
DATE 02/03/98	G.M. (E&P) / A.E. TRACED			E&P/RET/IT/04	

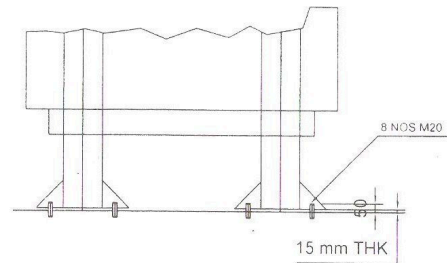


BHARAT PETROLEUM CORPORATION LTD.						
TITLE FOUNDATION DETAILS FOR MONOLITH				DATE 1 DRAWING NO		
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS		
SCALE --	DRAWN	CHECKED		SHEET NO	DRAWING NO	
DATE 25/05/1999 Sr Mgr (DESIGN & DEVP.)			1 OF 1	DR REG 320		

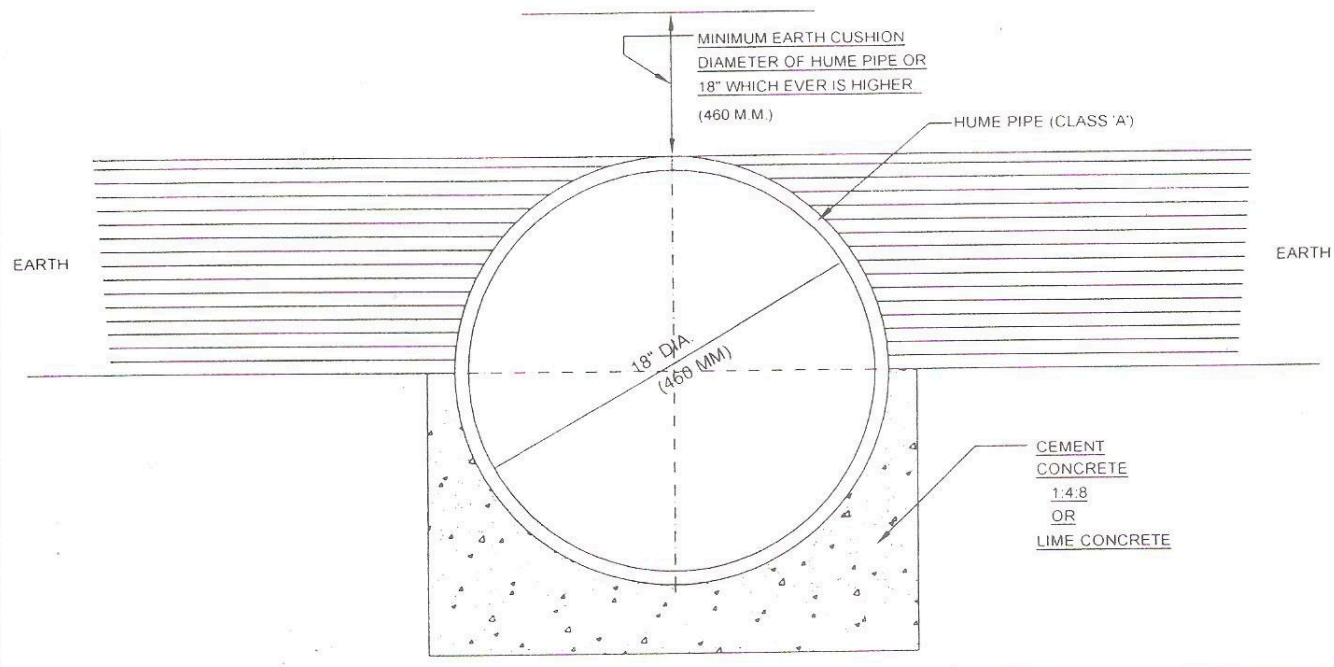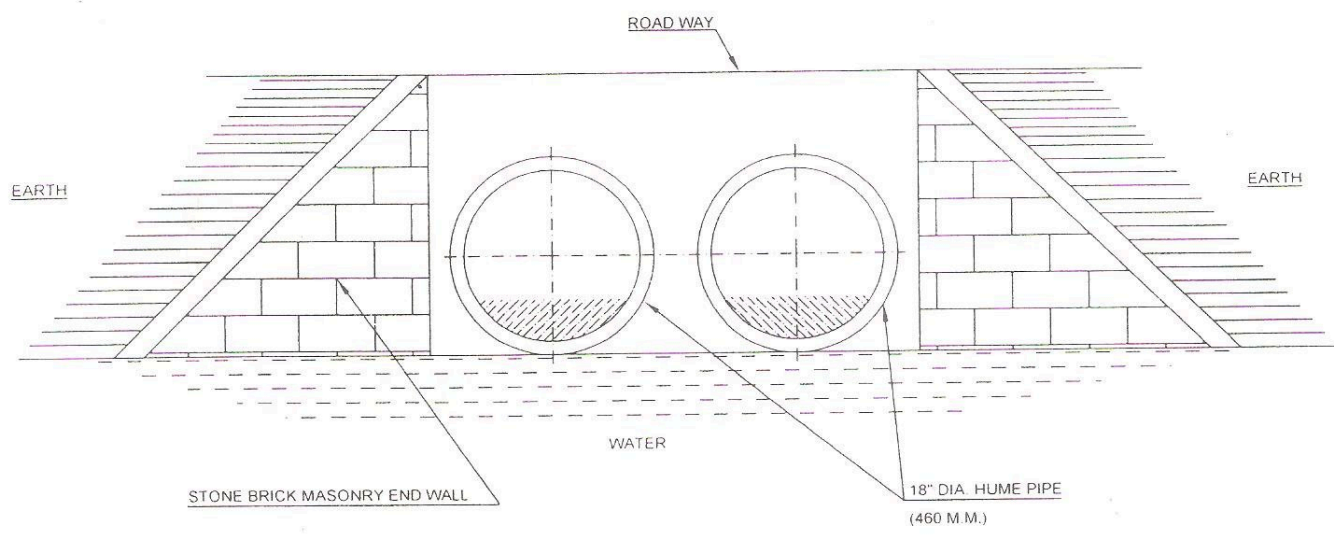


DETAILS OF HUME PIPE FOUNDATION

BHARAT PETROLEUM		
SUBJECT :- RETAIL OUTLET FACILITIES		
HUME PIPE CULVERT		
O.M (E & P)		
DRAWN - M.S.H	DATE 1-9-87	SCALE-
FEB 88	E. 1A. 01. 014	
DATE	ORG. NO	

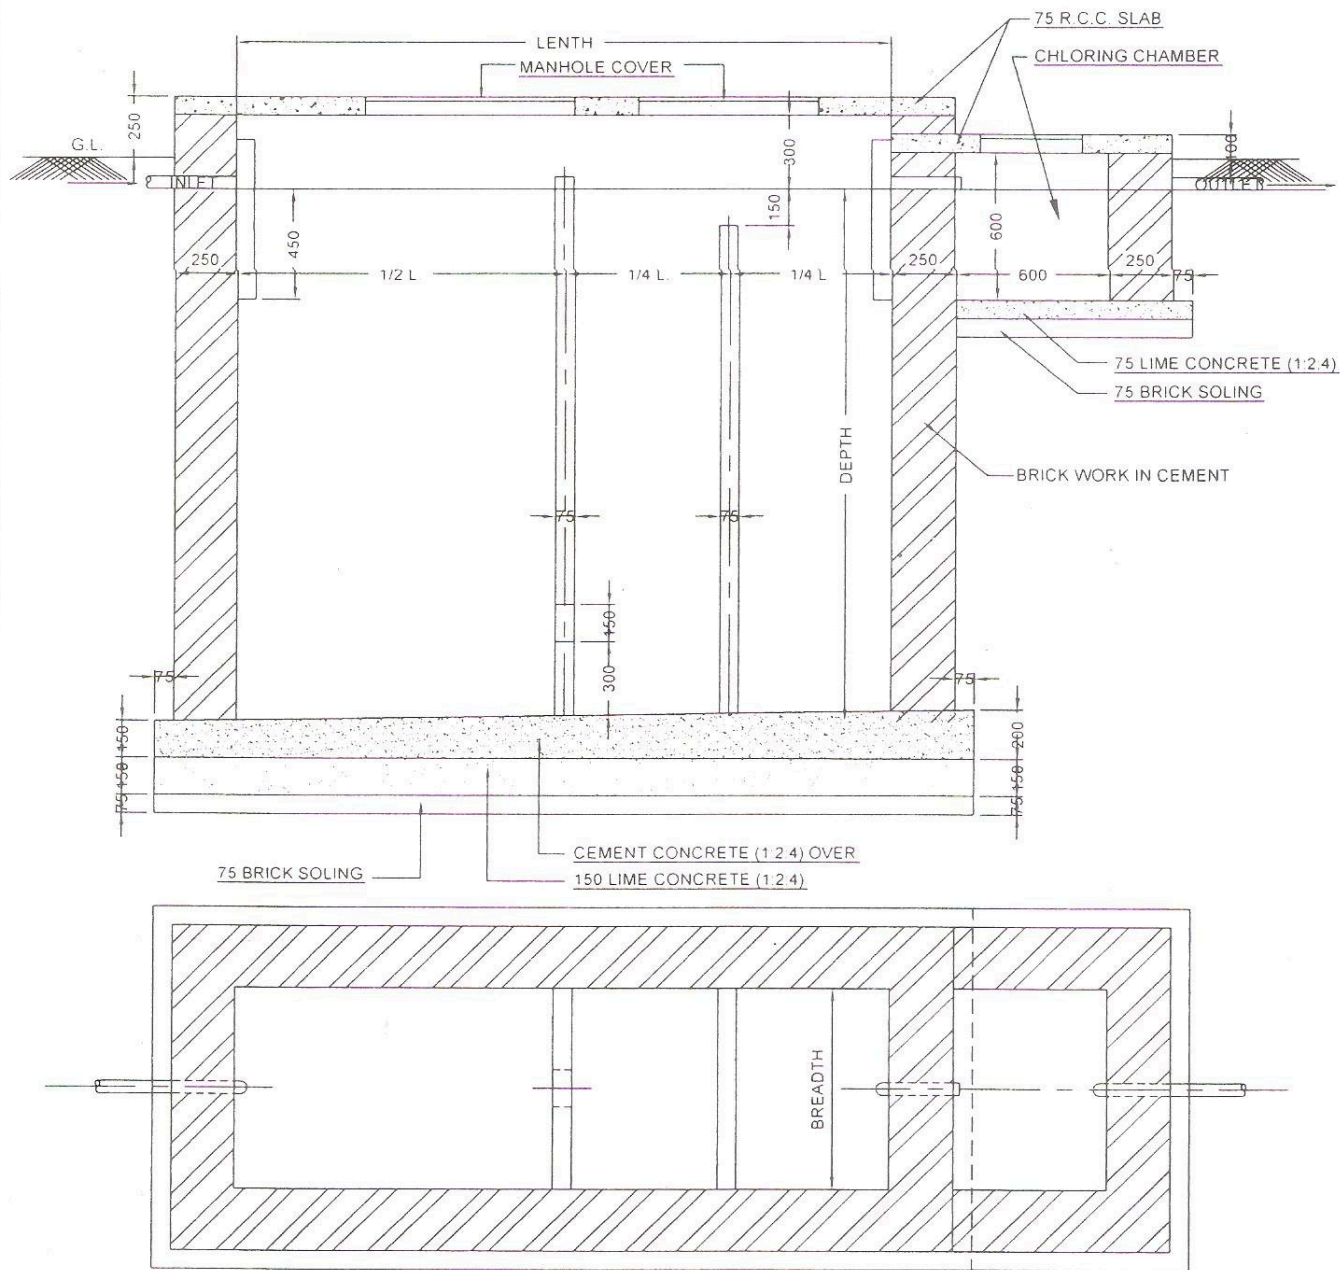


USERS	LENGTH	BTEADTH	LIQUID DEPTH
10	1500	600	1250
15	1700	.600	1400
20	1850	600	1550
30	2150	750	1700
40	2450	750	1850
50	2750	750	2000
100	3350	1050	2150

BHARAT PETROLEUM		
SUBJECT :- RETAIL OUTLET FACILITIES		
DETAIL OF SEPTIC TANK		
		C O / R 4
DRAWN - M.S.H	TRCD - S.R.P	DATE - 1-9-87

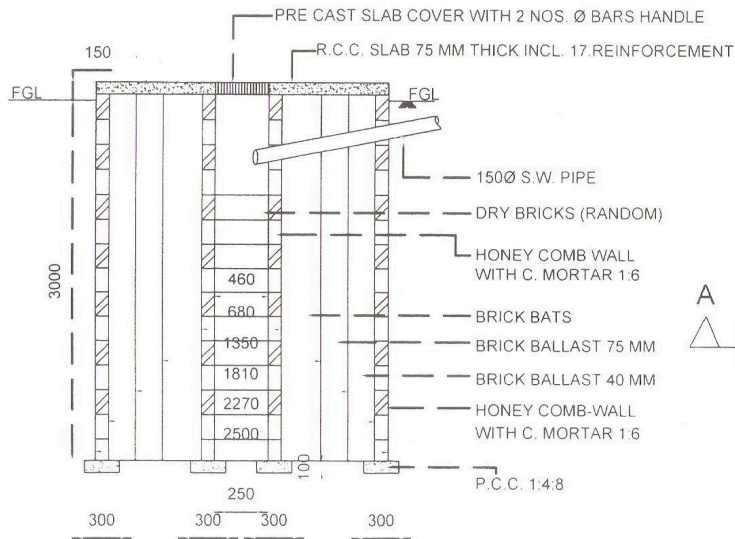

SECTION AT A-B

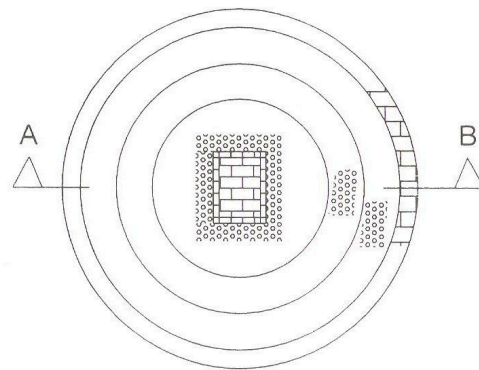


PLAN


BHARAT PETROLEUM CORPORATION LTD					
SOAK PIT				DATE	DRAWING NO.
STANDARAD DF 3				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE --	DRAWN	TRACTD	CHECKED	DRAWING NO.	
DATE	G.M (E & P) / A.E.M.				

Diagram illustrating the cross-section of a retaining wall. The wall is shown with a stepped profile. Key dimensions and labels include:

- Top Level:** F.L. (Finish Level)
- Bottom Level:** G.L. (Ground Level)
- Height:** $h < 6' (1.83)$
- Top Thickness:** 12"
- Base Thickness:** 300
- Base Material:** LIME CONCRETE (1:2:4) OR CEMENT CONCRETE (1:3:6)
- Base Dimensions:** 75 3" (left) and 3" 75 (right)
- Vertical Dimensions:** 18" (top section) and 450 (main section)

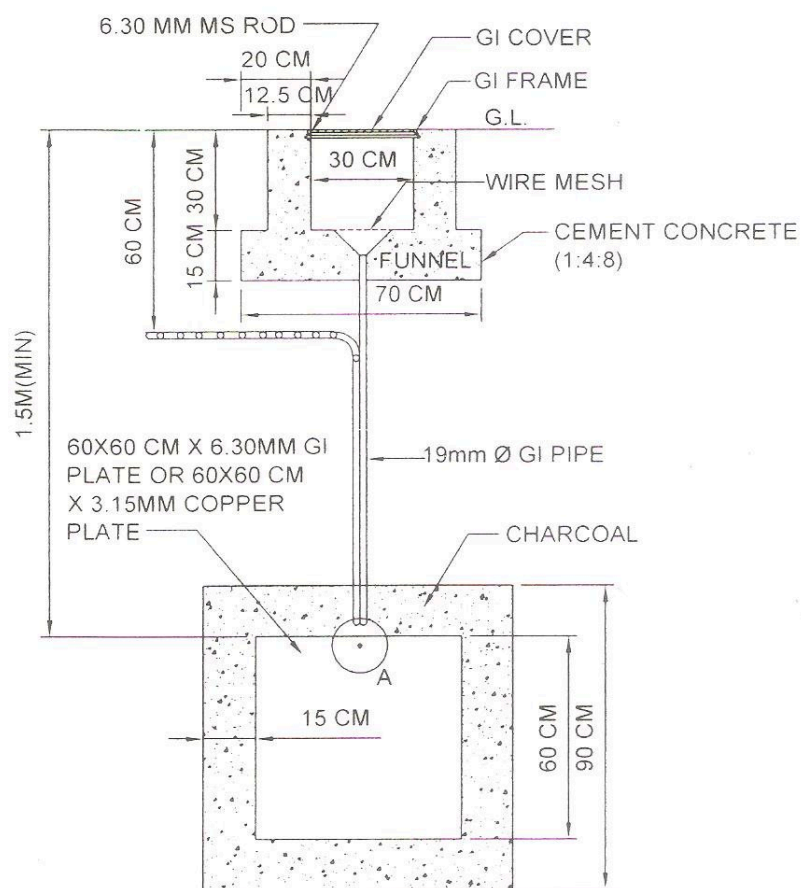


BOLT, NUT, CHECK NUT AND WASHER TO BE OF COPPER FOR COPPER PLATE AND GI FOR GI PLATE

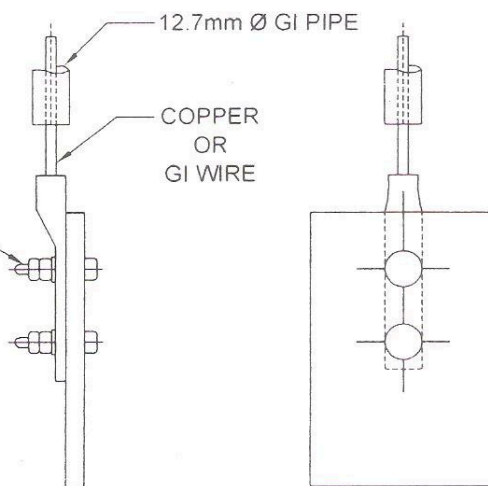



ENLARGED DETAIL-A

NOTE:- Three or four buckets of water to be poured into sump every few days to keep the soil surrounding the earth plate permanently moist.



BHARAT PETROLEUM		
SUBJECT :- RETAIL OUTLET FACILITIES		
TYPICAL ILLUSTRATION OF		
PLATE EARTH ELECTRODE		

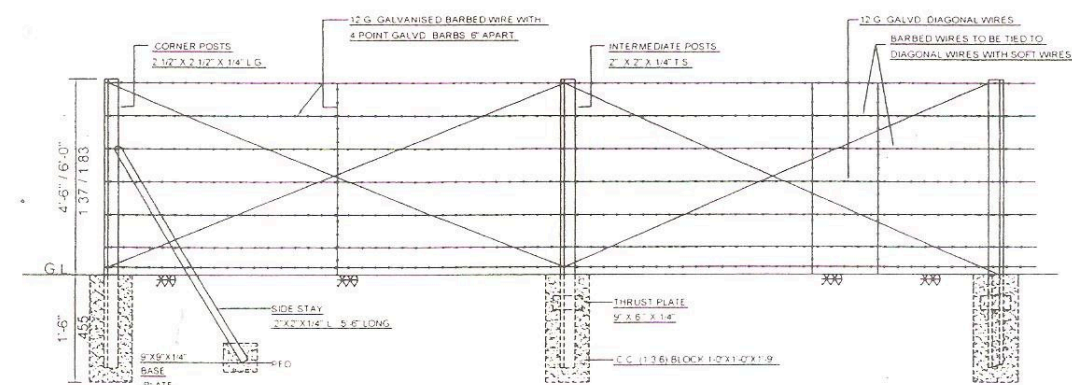


BARBED WIRE FENCING

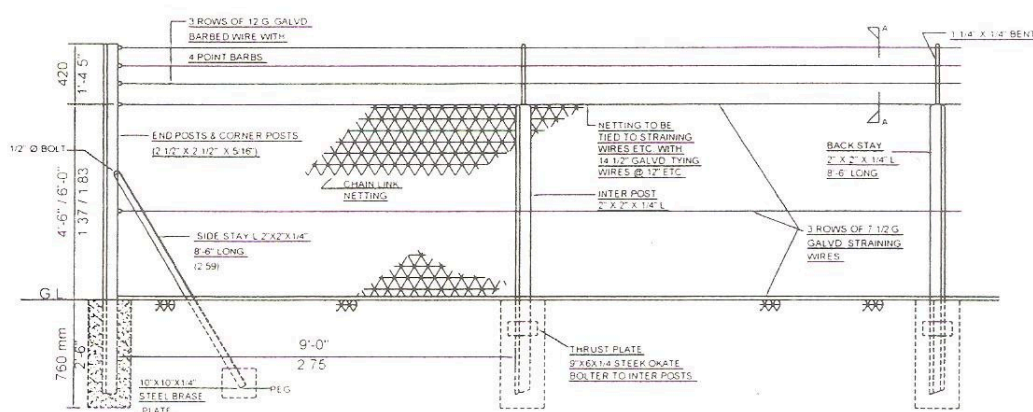


CHAIN LINK FENCING

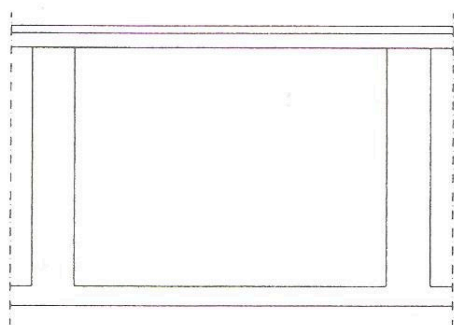


ELEVATION

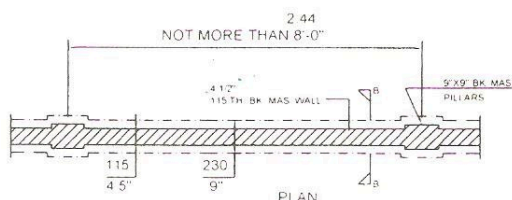

BRICK MASONRY COMPOUND WALL

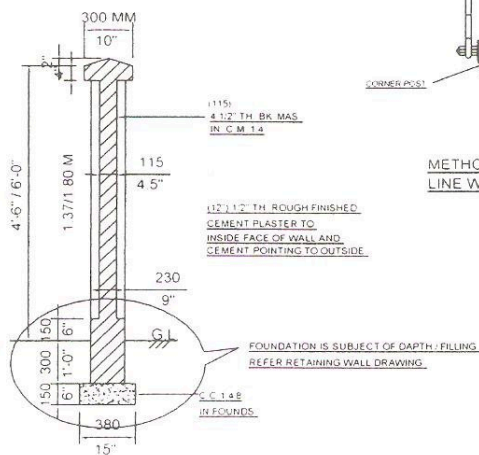


SECTION B B

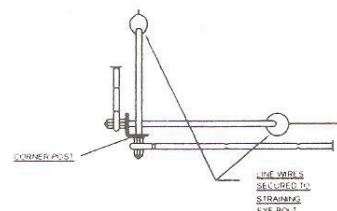


METHOD OF SECURING LINE WIRES TO POSTS


BHARAT PETRO. CORPOP. LTD.		
SUBJECT :- RETAIL OUTLET FACILITIES		
RFENCING AND COMPOUND WALL		
DRAWN - J.M.V.	DATE - 1-9-87	SCALE - 1:40
FEB. 88	E.1S.01.001	
DATE	Drg. NO.	

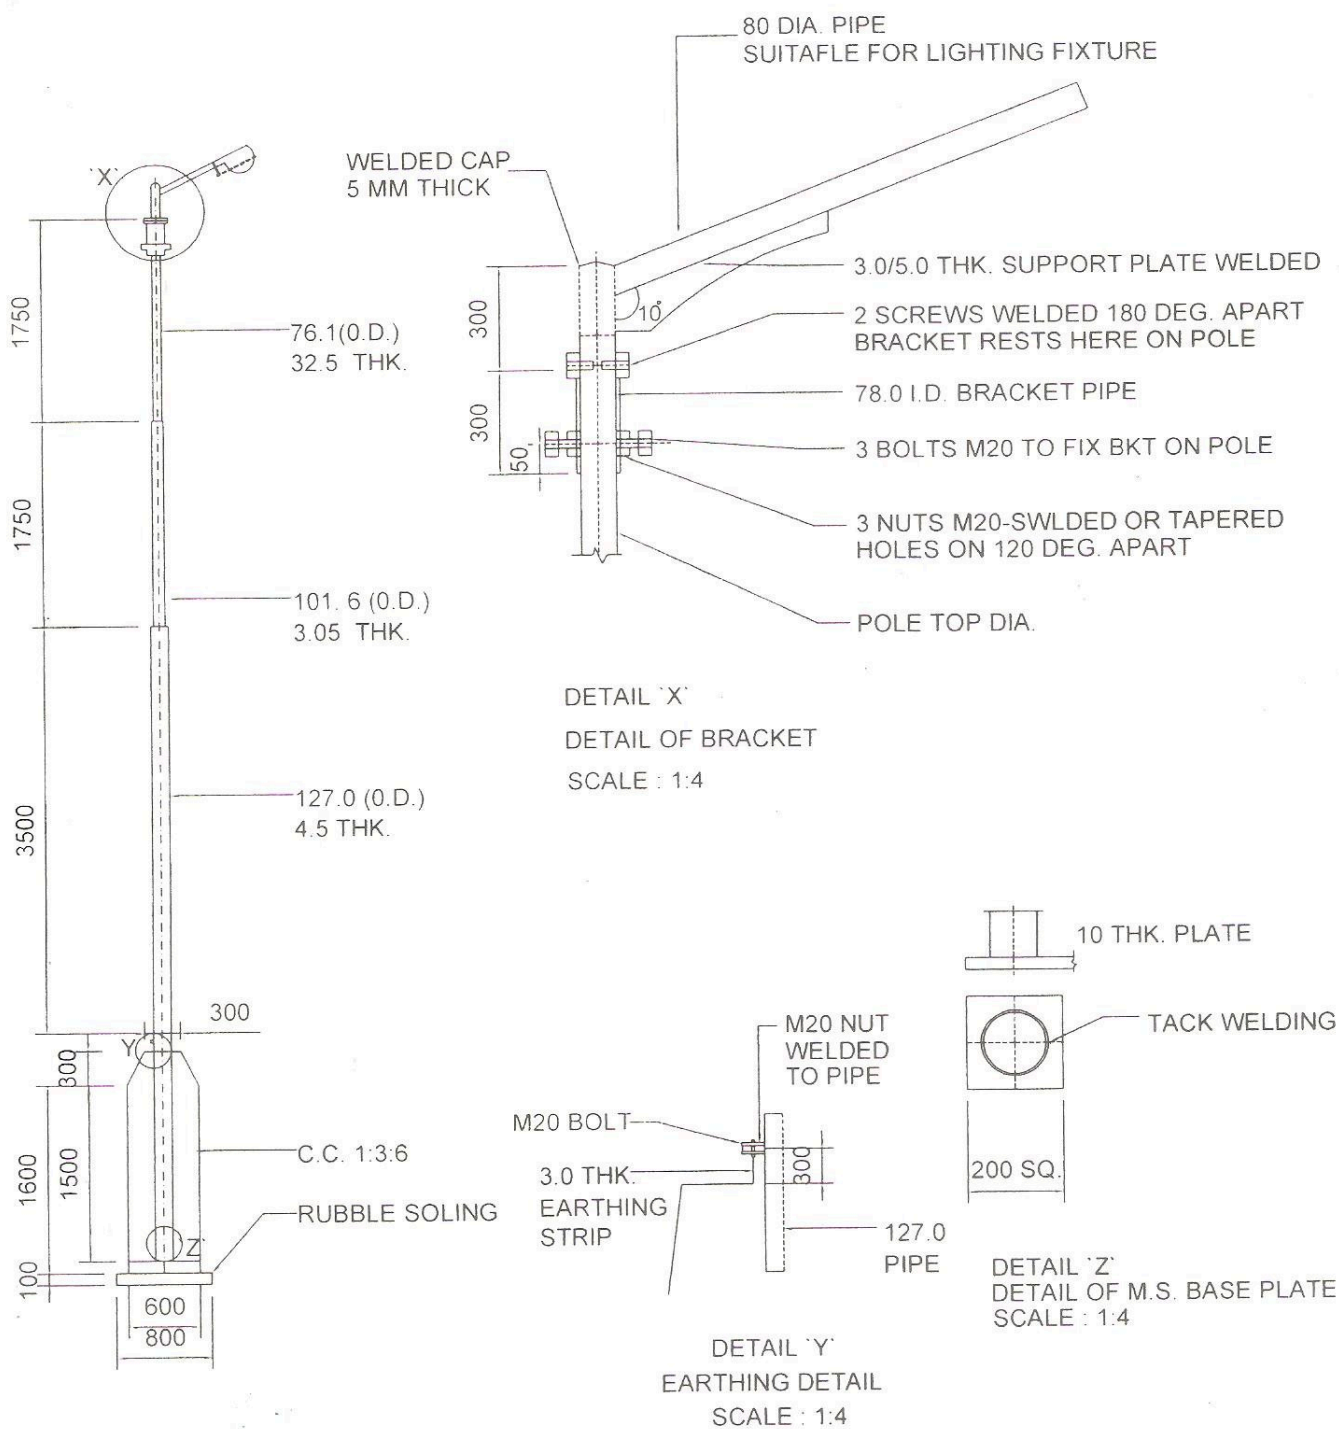

BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT LIGHT POLE				DATE	DRAWING NO
TUBULER SWAGED POLE CONFORMING TO IS 2713:-----				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE 1:10	DRAWN	TRACTD	CHECKED	DRAWING NO.	
DATE	G.M (E. & P.) / A.E.M				

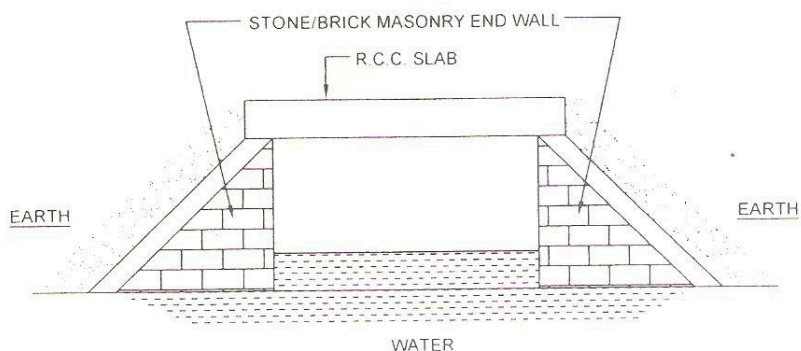

MINIMUM WIDTH SAME AS
THE TOTAL THICKNESS OF
THE SLAB OR 230 MM (9")
WHICHEVER IS HIGHER

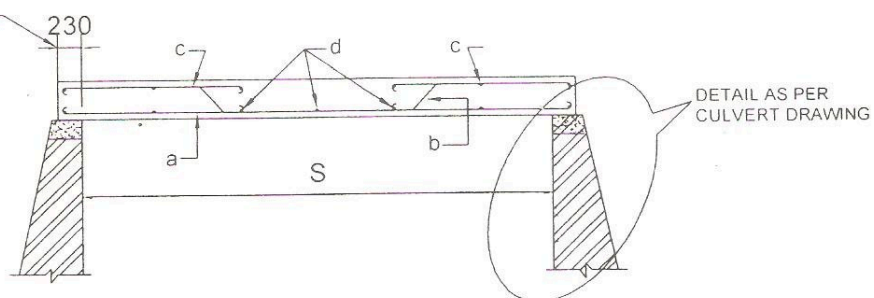

DETAILS OF DESIGN FOR SLAB CULVERT


SLAB CULVERT FOR VARYING SPANS FROM 1220 (4') TO 3660 (12')


SPAN S	THICK- NESS OF SLAB	STR.&BENT ALT. MAIN REINFORCEMENT	REINFORCEMENTS			
			a	b	c	d
1220	190	12 Ø @ 75 C.C.	12 Ø @ 150 C.C.	12 Ø @ 150 C.C.	12 Ø @ 150 C.C.	10 Ø @ 300 C.C. TOP & BOTTOM
1530	200	12 Ø @ 75 C.C.	12 Ø @ 150 C.C.	12 Ø @ 150 C.C.	12 Ø @ 150 C.C.	10 Ø @ 300 C.C. "
1830	215	12 Ø @ 75 C.C.	12 Ø @ 150 C.C.	12 Ø @ 150 C.C.	12 Ø @ 150 C.C.	10 Ø @ 300 C.C. "
2440	255	20 Ø @ 140 C.C.	20 Ø @ 280 C.C.	20 Ø @ 280 C.C.	20 Ø @ 280 C.C.	12 Ø @ 300 C.C. TOP & BOTTOM
3050	265	20 Ø @ 115 C.C.	20 Ø @ 230 C.C.	20 Ø @ 230 C.C.	20 Ø @ 230 C.C.	12 Ø @ 300 C.C. "
3660	300	20 Ø @ 100 C.C.	20 Ø @ 200 C.C.	20 Ø @ 200 C.C.	20 Ø @ 200 C.C.	12 Ø @ 300 C.C. "


BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT				DATE	DRAWING NO
SLAB CULVERT				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE --	DRAWN	TRACED	CHECKED	DRAWING NO.	
DATE	G.M.(E & P.) / A.E.M.				
			FEB. 88 DATE	E.1S.01.029 DRG.NO	

DSM/Sales Room : Johnson (Spl White) Salt (Pepper)
 Toilet : Somany : Blue (600x600)
 Yellow (600x300)
 white
 P.I. : Rustile 600x600 : SG 246


27

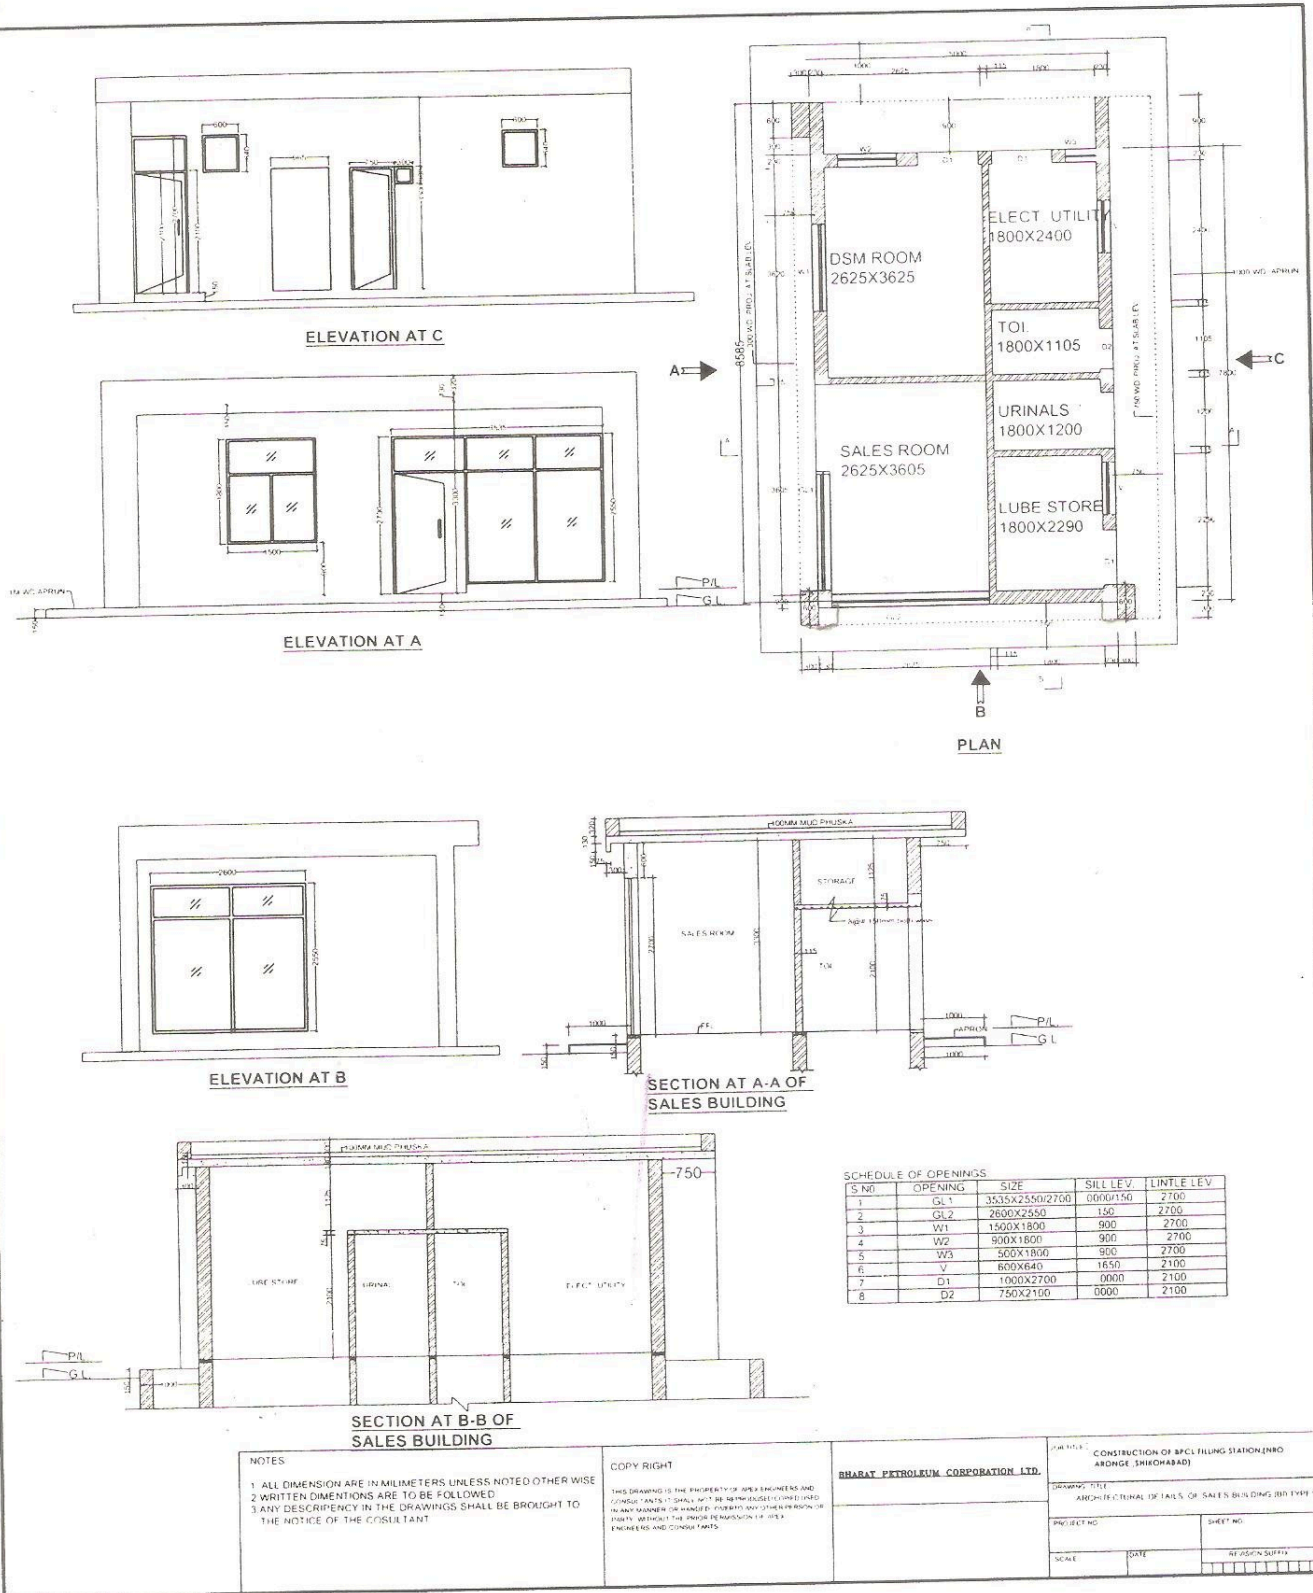

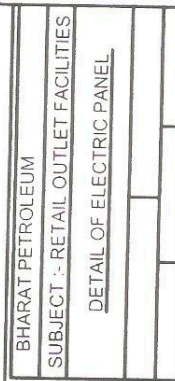


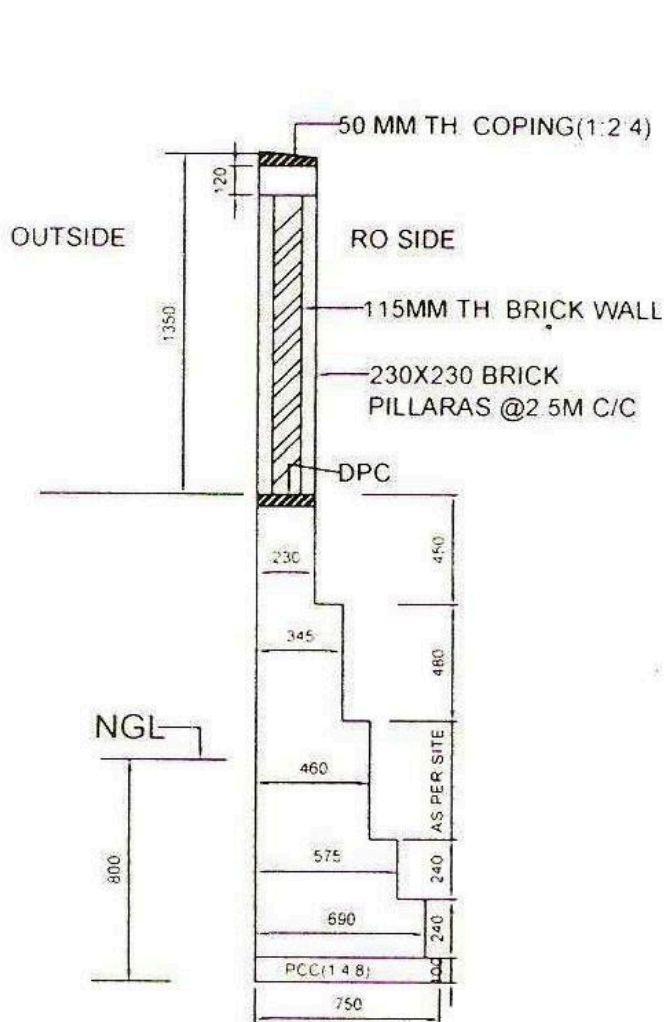



**SECTION OF COMPOUND
WALL (FILLING UPTO
1200MM)**

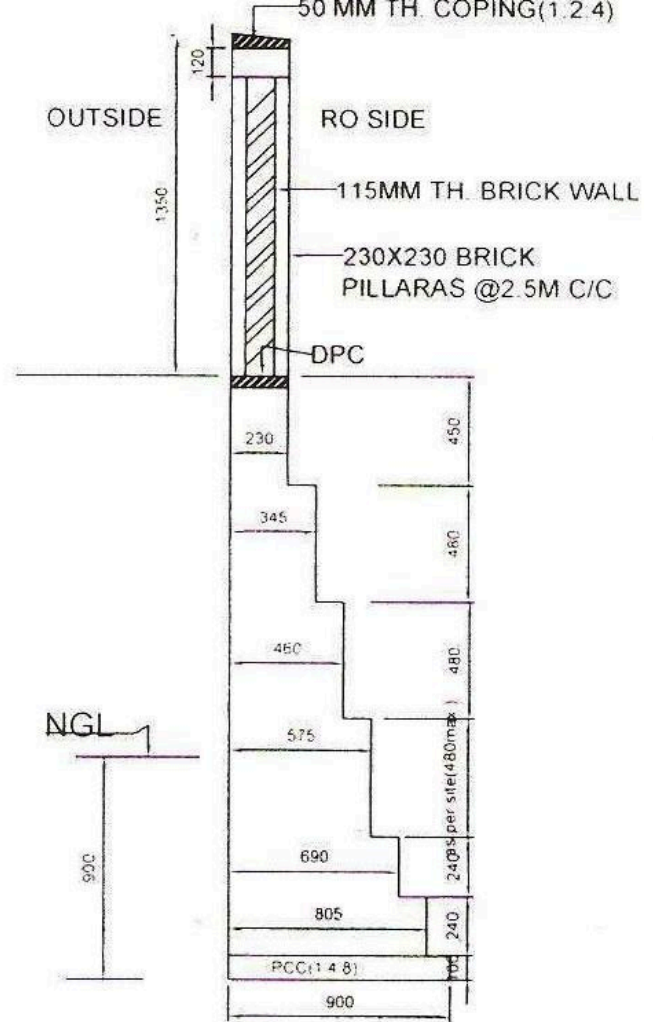


**SECTION OF COMPOUND
WALL (FILLING UPTO
1800MM)**

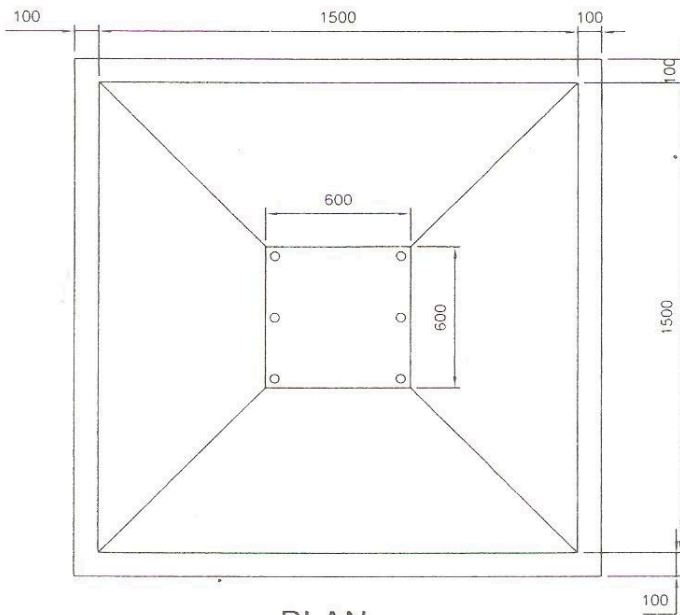


PLAN

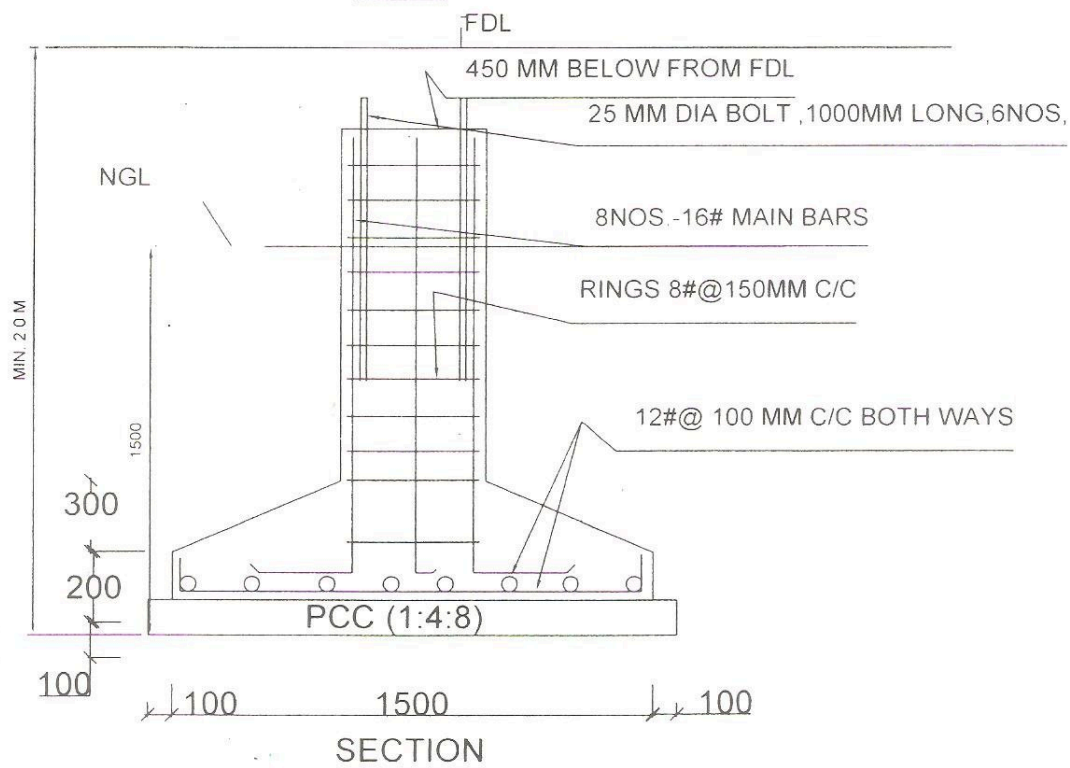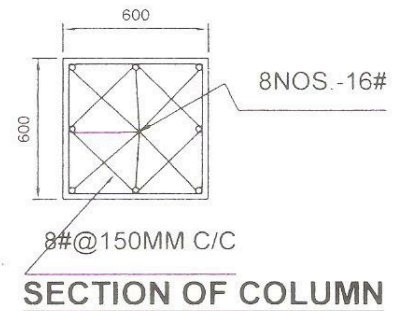


BHARAT PETROLEUM
SUBJECT :- RETAIL OUTLET FACILITIES
STRUCTURAL DETAIL OF
CANOPY FOOTING

32

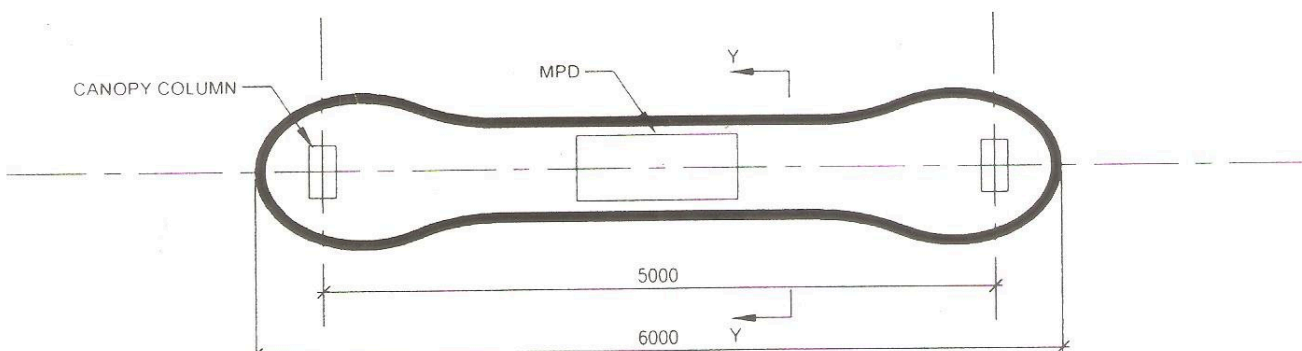


PLAN OF PUMP ISLAND

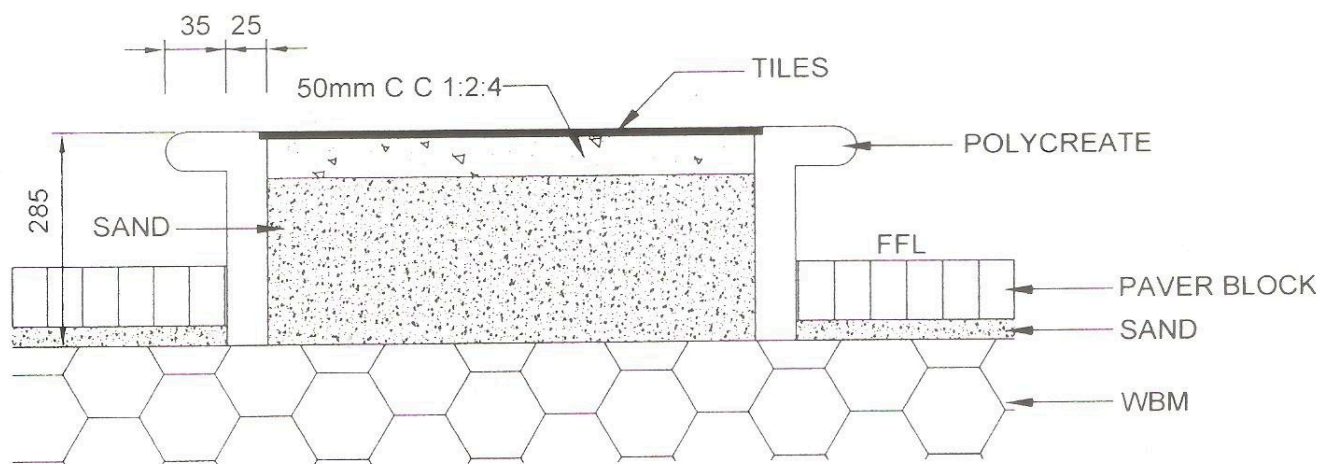

SECTION AT Y-Y

BHARAT PETROLEUM		
SUBJECT :- RETAIL OUTLET FACILITIES		
DETAIL OF PUMP ISLAND		

RCC SLAB(1:2:4),REINFORCEMENT AS PER
STANDARD DRG.NO. E.IS.01.029

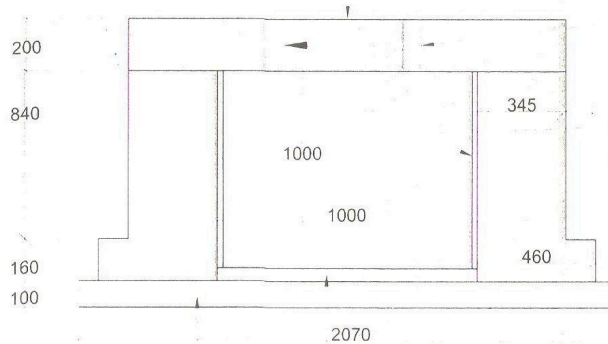


50 MM DIA PVC PIPE
600MM C/C IN STAGARRED
POSITION

12 MM TH PLASTER IN
CM(1:6) WITH NEAT CEMENT


50 MM TH PCC(1:2:4)
PCC(1:4:8)

SECTION OF OPEN DRAIN/ CULVERT SLAB


BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT				DETAIL OF CULVERT	
				DATE	DRAWING NO.
SCALE :NTS	DRAWN:	TRACED	CHECKED	DRAWING NO.	
DATE :					

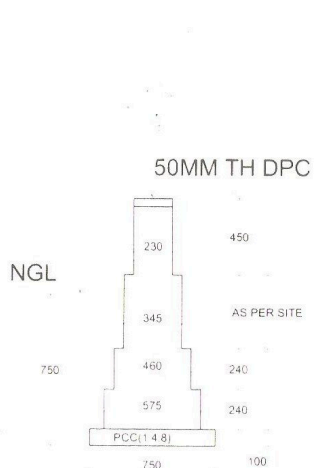

**SECTION OF SALES
BUILDING
FOUNDATON(FILLING
UP TO 600MM)**

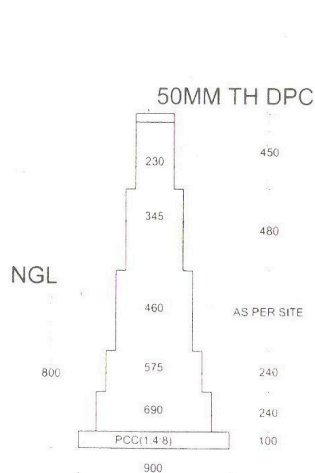


**SECTION OF SALES
BUILDING
FOUNDATON(FILLING
UPTO 1200MM)**

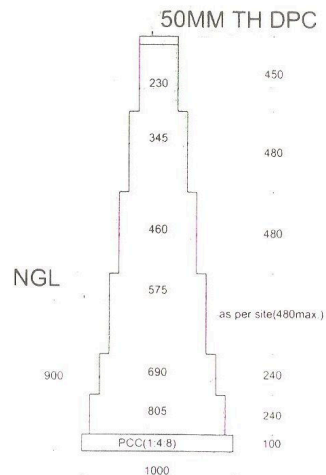


**SECTION OF SALES
BUILDING
FOUNDATON(FILLING
UPTO 1800MM)**

BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT FOUNDATION PLAN					
				DATE	DRAWING NO.
SCALE NTS	DRAWN	TRACED	CHECKED	DRAWING NO.	
DATE	G. M. (E&P) / A. E. T. TRACED			E&P/RET/TI04	




LAYING OF HUME PIPE




100 MM DIA
PVC PIPE

PCC(1:4:8)
GROUTING OF PVC
PIPES




150 MM DIA
PVC PIPE

PCC(1:4:8)



KERB STONE(IN 1:2:4)



SECTION OF KERB
WALL FOR TANKS

BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT PVC PIPE CASING					
				DATE	DRAWING NO.
SCALE NTS	DRAWN	TRACED	CHECKED	DRAWING NO.	
DATE					