

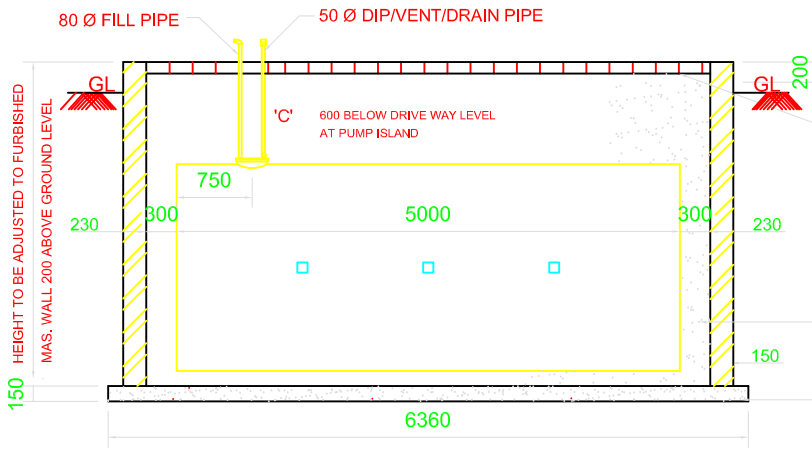


SECTION A-A

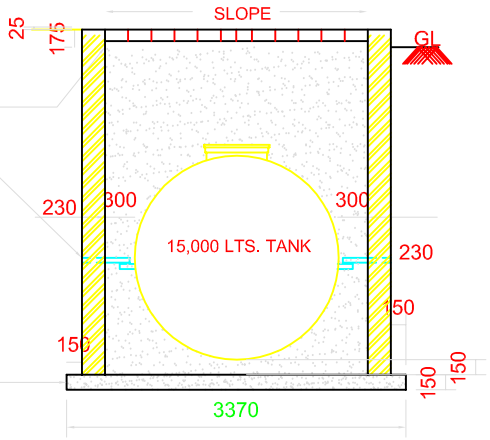


SECTION B-B

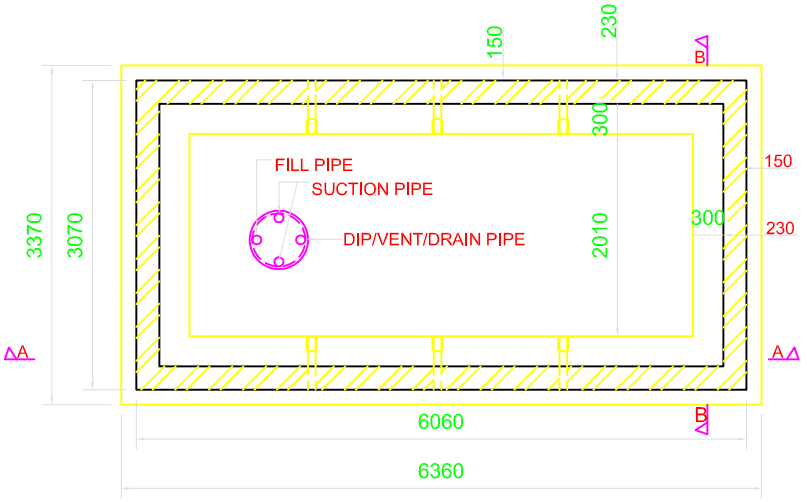

PLAN

TANK IN MASONRY PIT

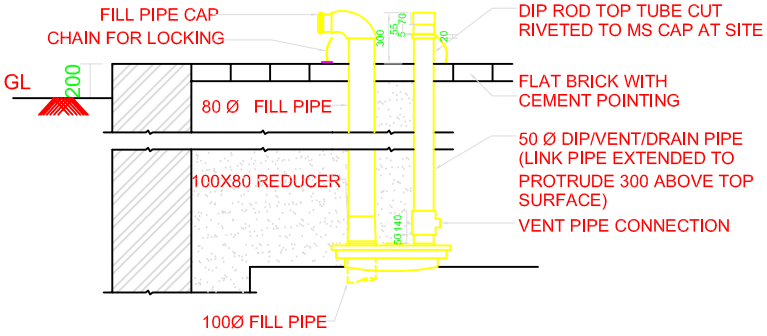

DETAILS AT `C`

NOTES:-

1) TANKS SHOULD BE GIVEN HYDRAULIC PRESSURE TEST PRIOR TO INSTALLATION AND BEFORE ANY PROTECTIVE COATING IS APPLIED THE TEST SHOULD BE MAINTAINED AT A CONTROLLED PRESSURE OF 0.36 KG/SQ. C.M. FOR 2 HOURS.
2) DIP ROD SUPPLIED WITH TANK FOR THIS TYPE OF INSTALLATION SHOULD BE 3220 LON
3) BACK FILLING OF EARTH SHOULD BE CARRIED OUT SIMALTANEOUSLY OUTSIDE AND INSIDE MASONRY WALL

BHARAT PETROLEUM CORPORATION LTD.					
TITLE: INSTALLATION DETAILS OF 15,OOO LITRES CYLINDRICAL UNDERGROUND TANK				DATE	DRAWING NO.
				NUMBERS CROSSED OUT ARE SUPERSEDED DRAWINGS	
SCALE :–	DRAWN:	CHECKED	SHEET NO.	DRAWING NO.	
DATE : 20/12/1999	Sr. Mgr. (DESIGN & DEVP.)		1 OF 1	RE.DRG. 401	