

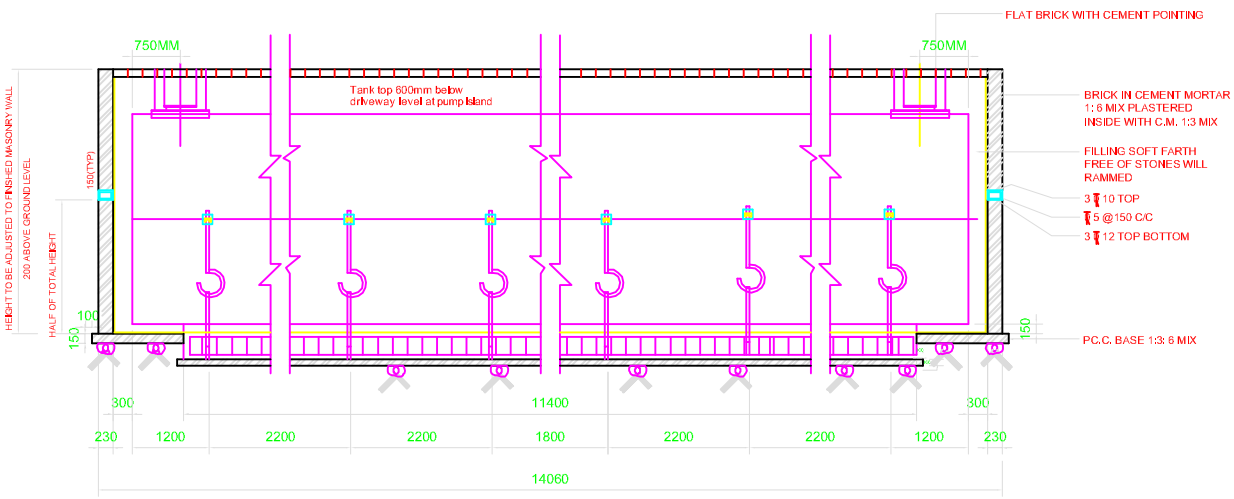


SECTION A-A

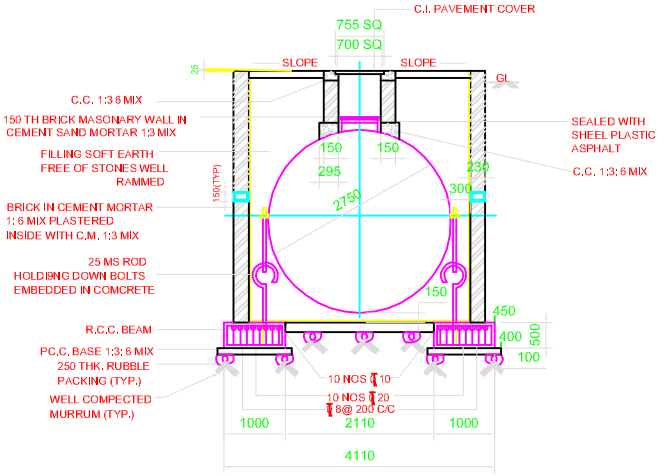

SECTION B-B

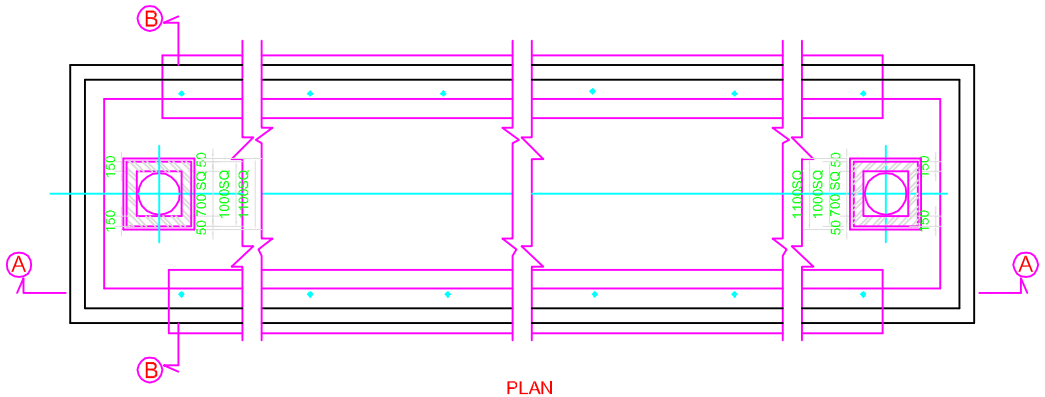

PLAN

NOTE:

1. Tanks should be given hydraulic pressure test prior to installation & before protective coat is applied. The test should be maintained at a controlled pressure of 0.5 kg/Sq.cm. for 1 Hr.
2. Back filling of the earth should be carried out simultaneously outside & inside the Masonry wall.
3. RCC Beams should be cost before laying CC base.

BHARAT PETROLEUM CORPORATION LTD.					
SUBJECT MASONARY PIT WITH HOLDING DOWN ARRANGEMENT					
INSTALLATION OF 70 KL U/G TANK				DATE	DRAWING NO.
SCALE :NTS	DRAWN:	TRACED	CHECKED	DRAWING NO.	
DATE :02/03/98	G.M. (E&P) / A.E. TTRACED			E&P/RET/TI01	