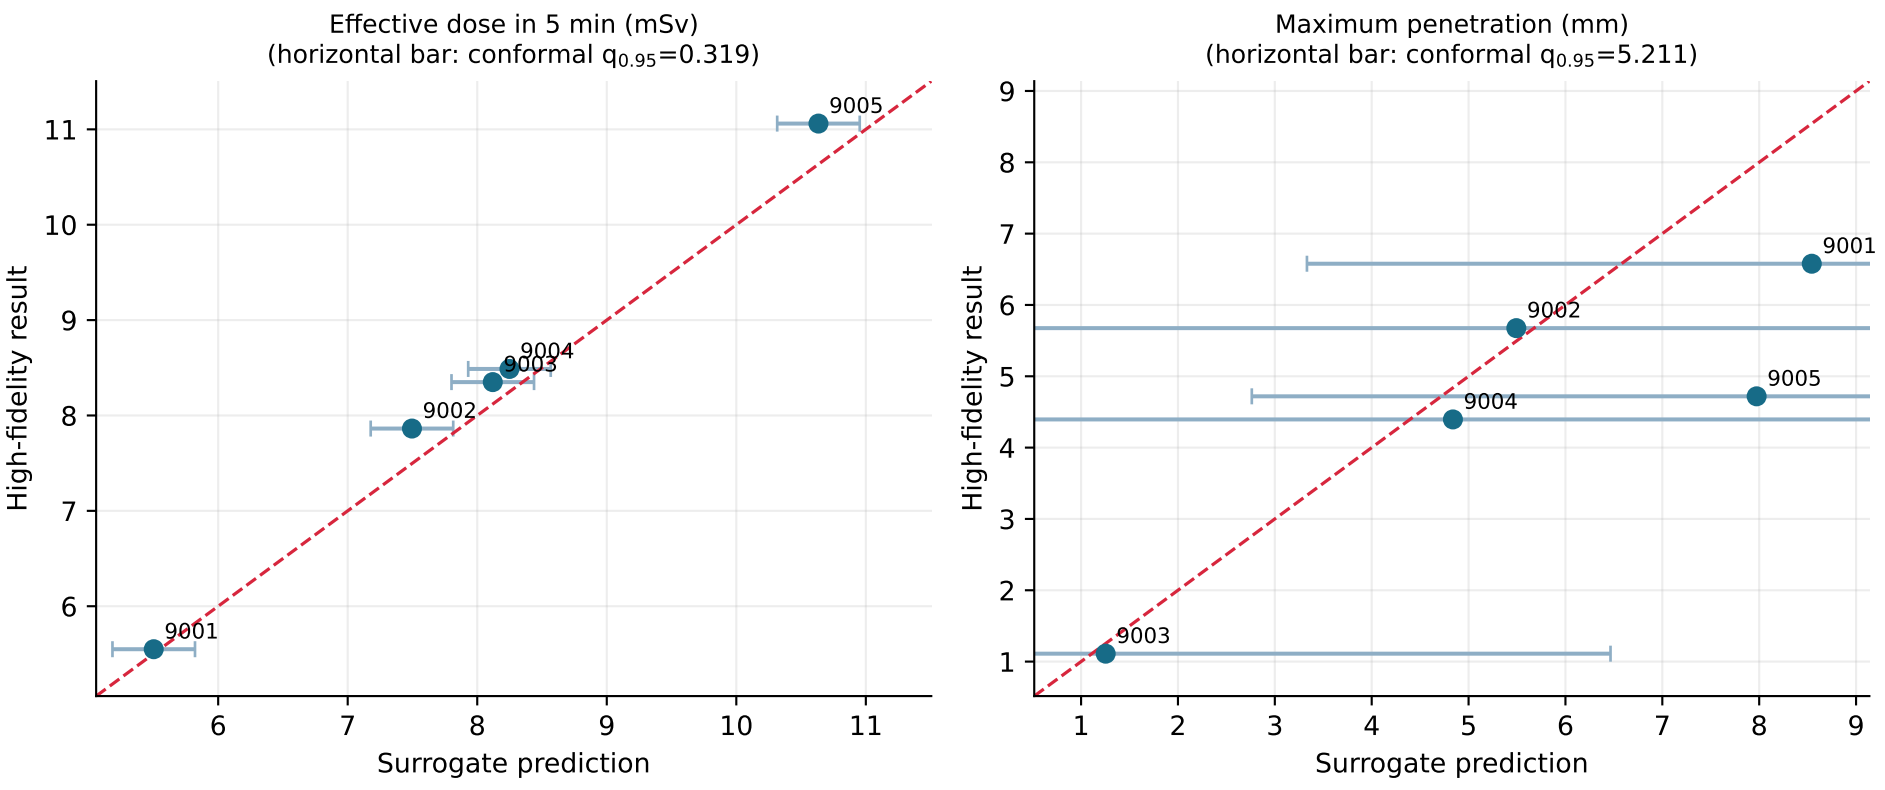
Effective dose in 5 min (mSv)
(horizontal bar: conformal $q_{0.95}$=0.319)
High-fidelity result
Surrogate prediction
9001
9002
9003
9004
9005
Maximum penetration (mm)
(horizontal bar: conformal $q_{0.95}$=5.211)
High-fidelity result
Surrogate prediction
9001
9002
9003
9004
9005