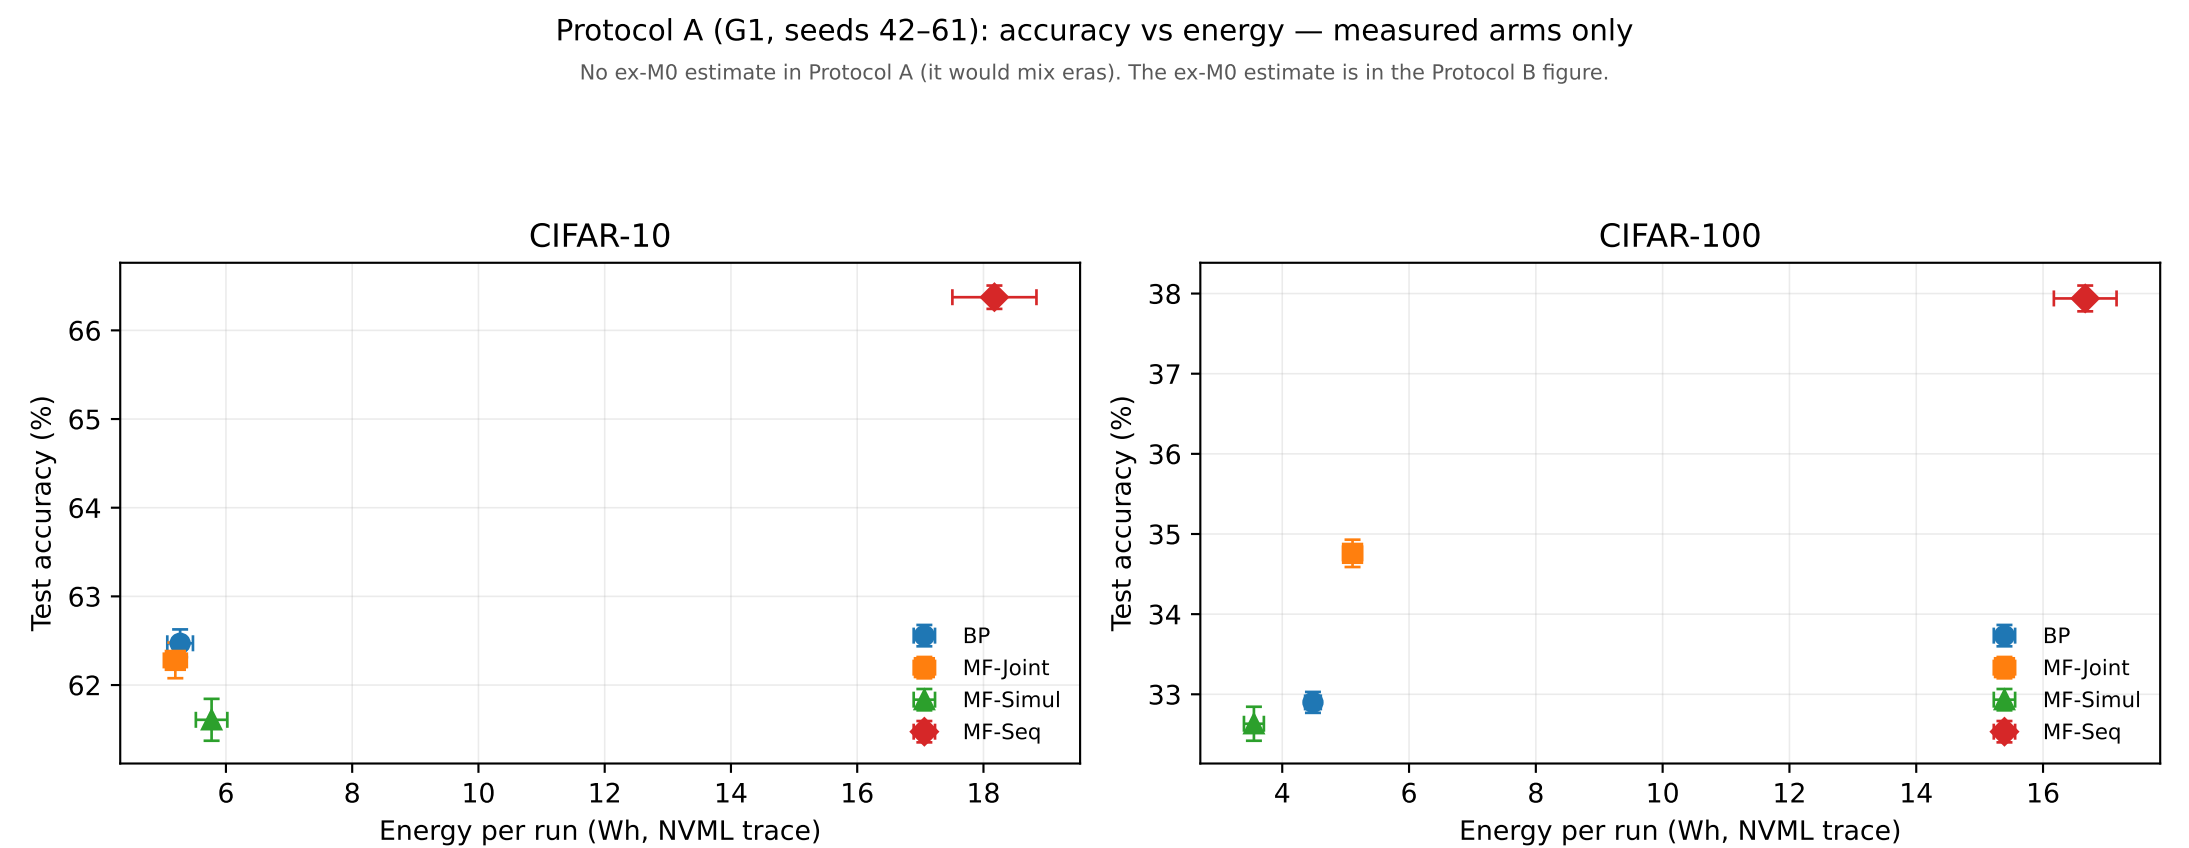
Protocol A (G1, seeds 42–61): accuracy vs energy — measured arms only
No ex-M0 estimate in Protocol A (it would mix eras). The ex-M0 estimate is in the Protocol B figure.
CIFAR-10
CIFAR-100
Test accuracy (%)
Energy per run (Wh, NVML trace)
BP
MF-Joint
MF-Simul
MF-Seq
Sources: G1 2026-10 (Protocol A) and PPAM 2026-09 (Protocol B, M0 share). No W1 data.