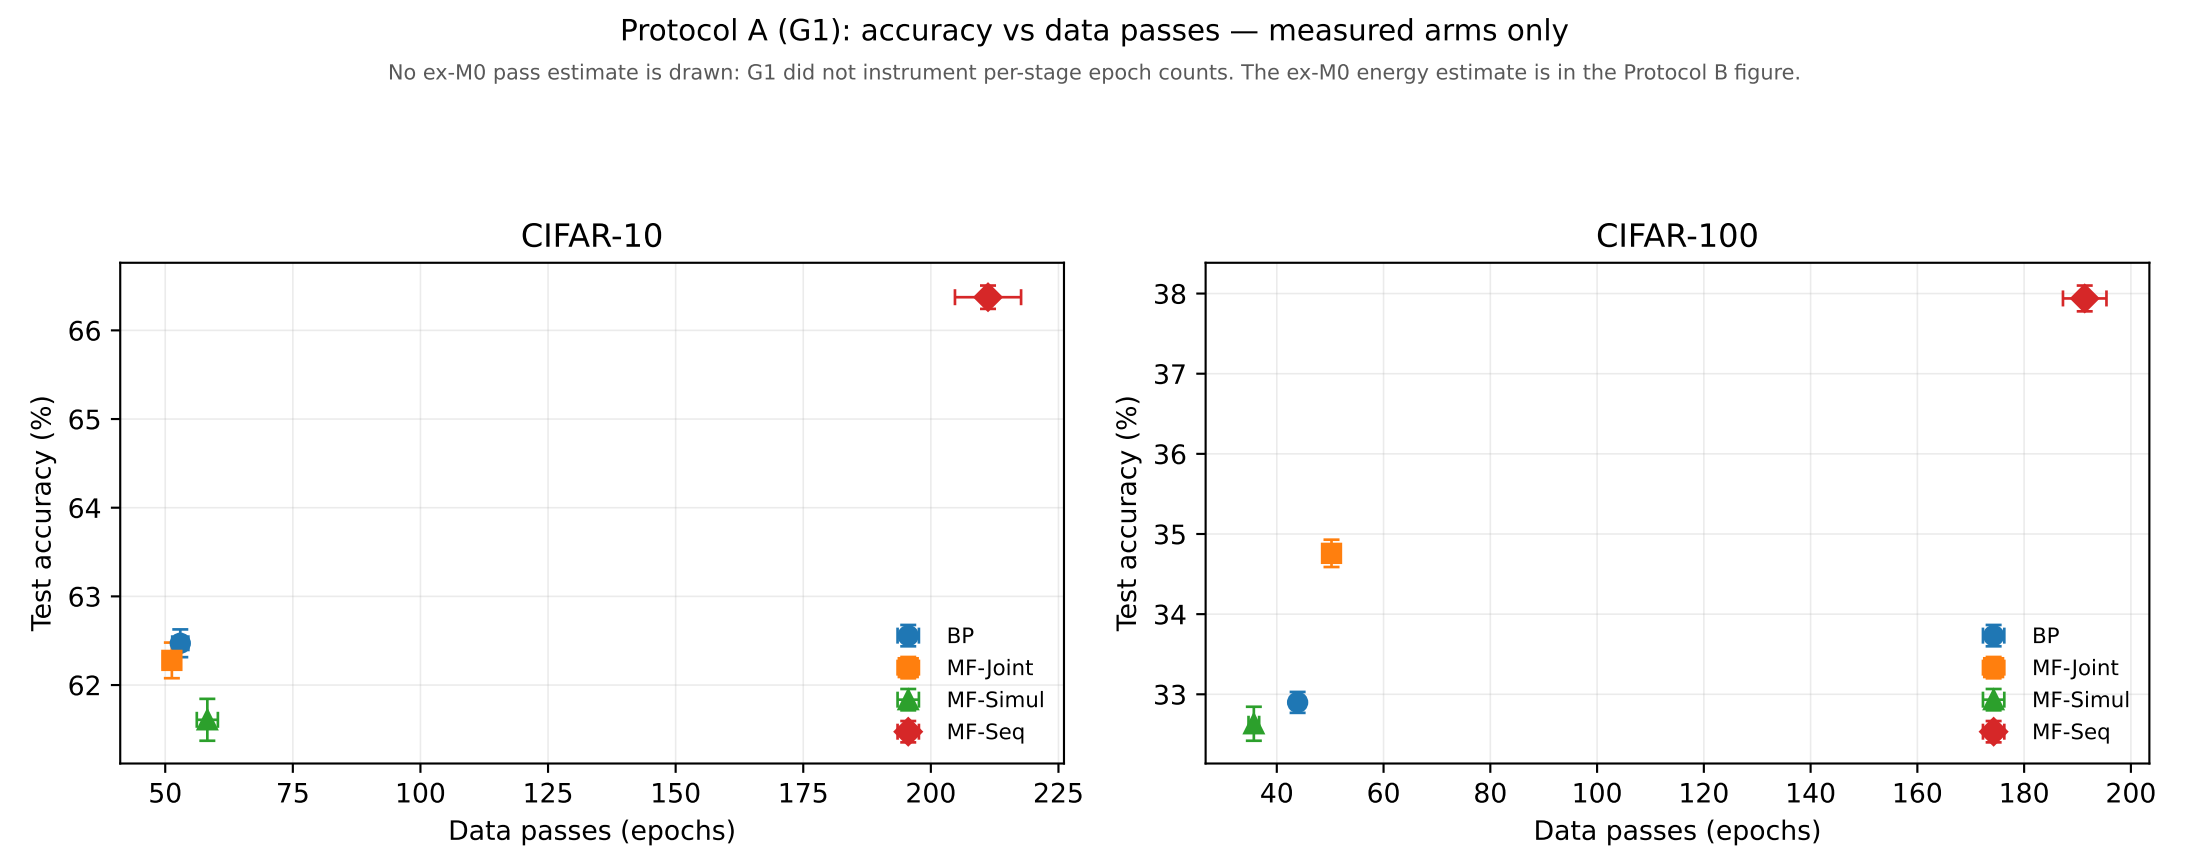
Protocal A (G1): accuracy vs data passes — measured arms only
No ex-M0 pass estimate is drawn: G1 did not instrument per-stage epoch counts. The ex-M0 energy estimate is in the Protocol B figure.
CIFAR-10
CIFAR-100
Test accuracy (%)
Data passes (epochs)
BP
MF-Joint
MF-Simul
MF-Seq
Sources: G1 2026-10 (Protocol A) and PPAM 2026-09 (Protocol B, M0 share). No W1 data.