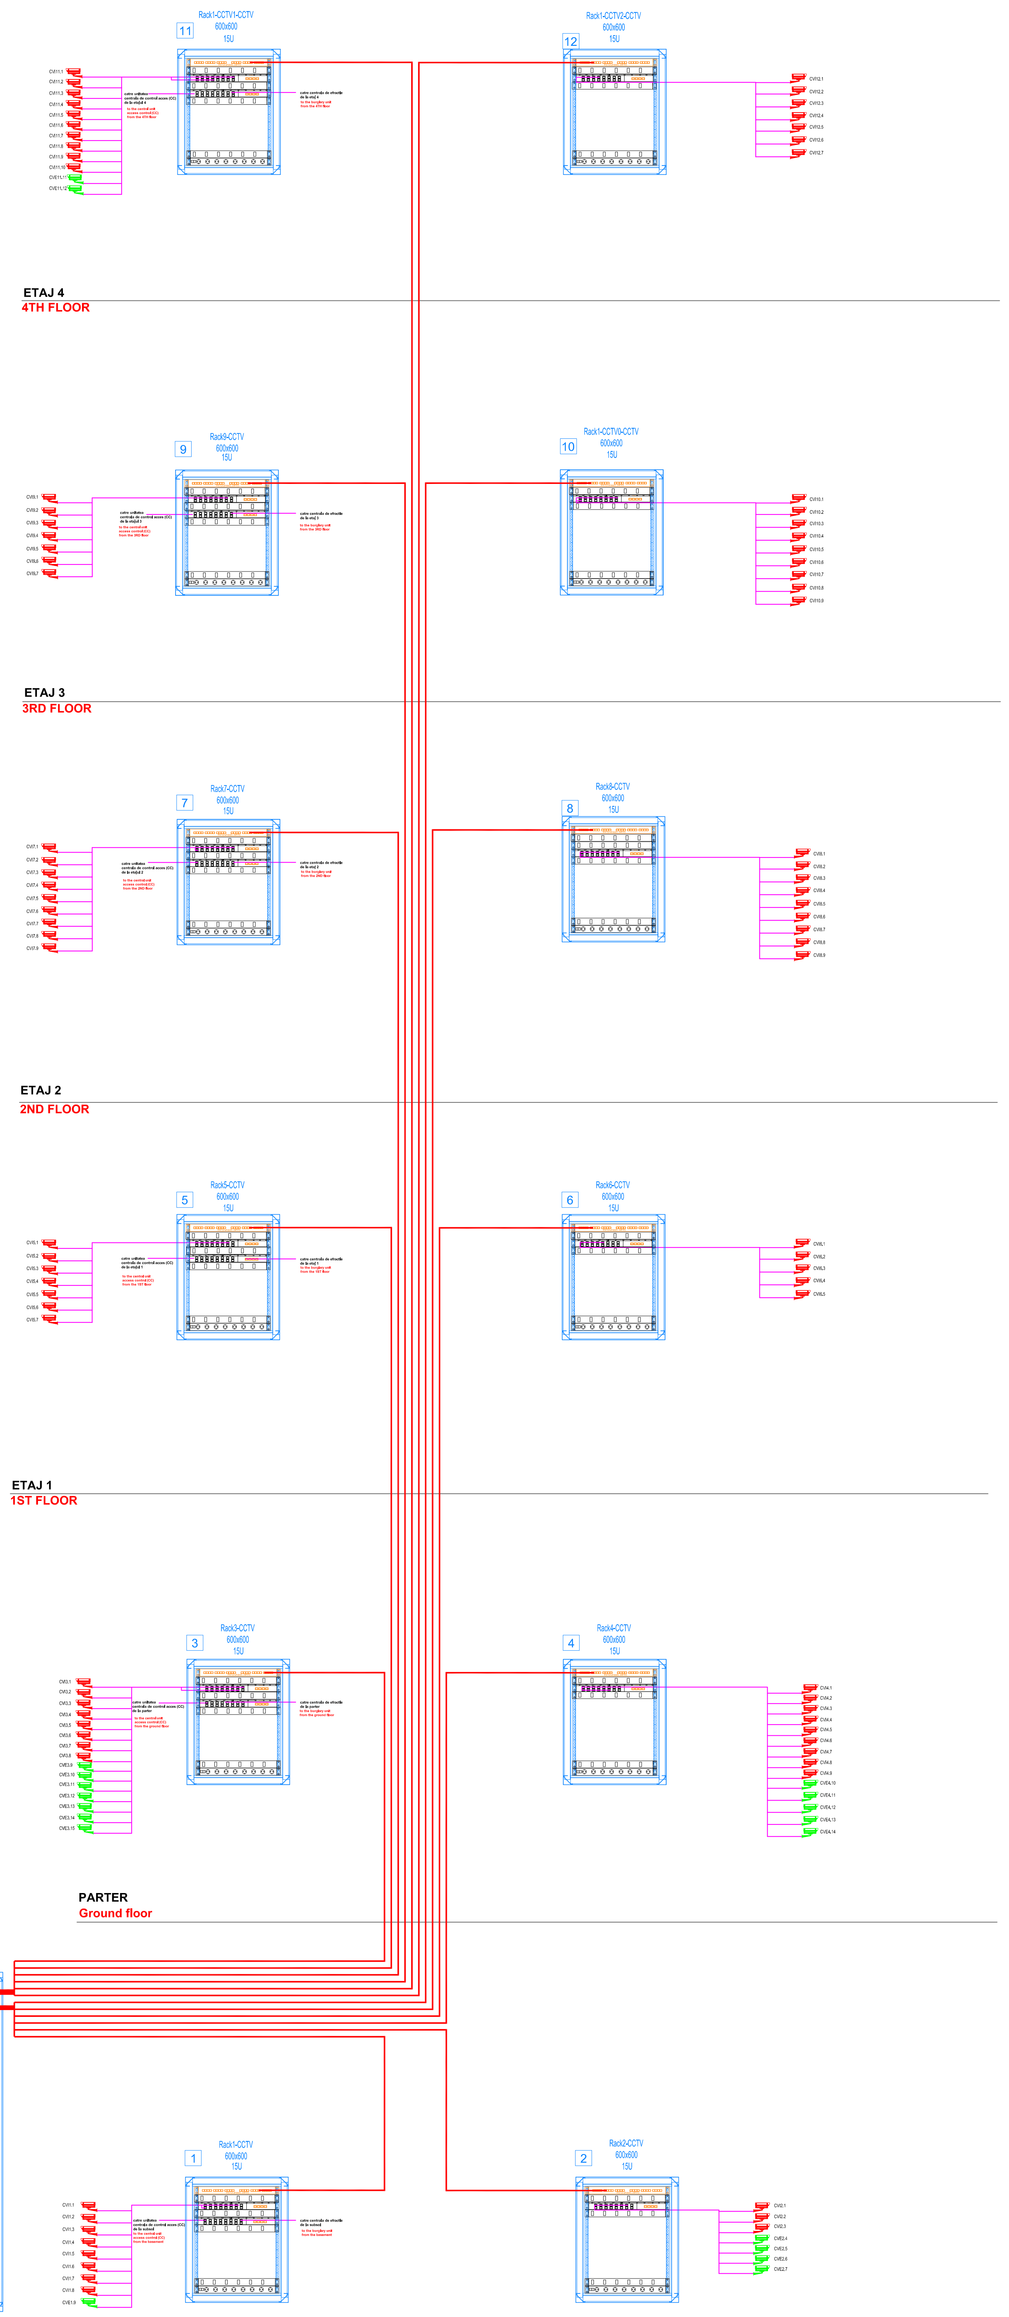

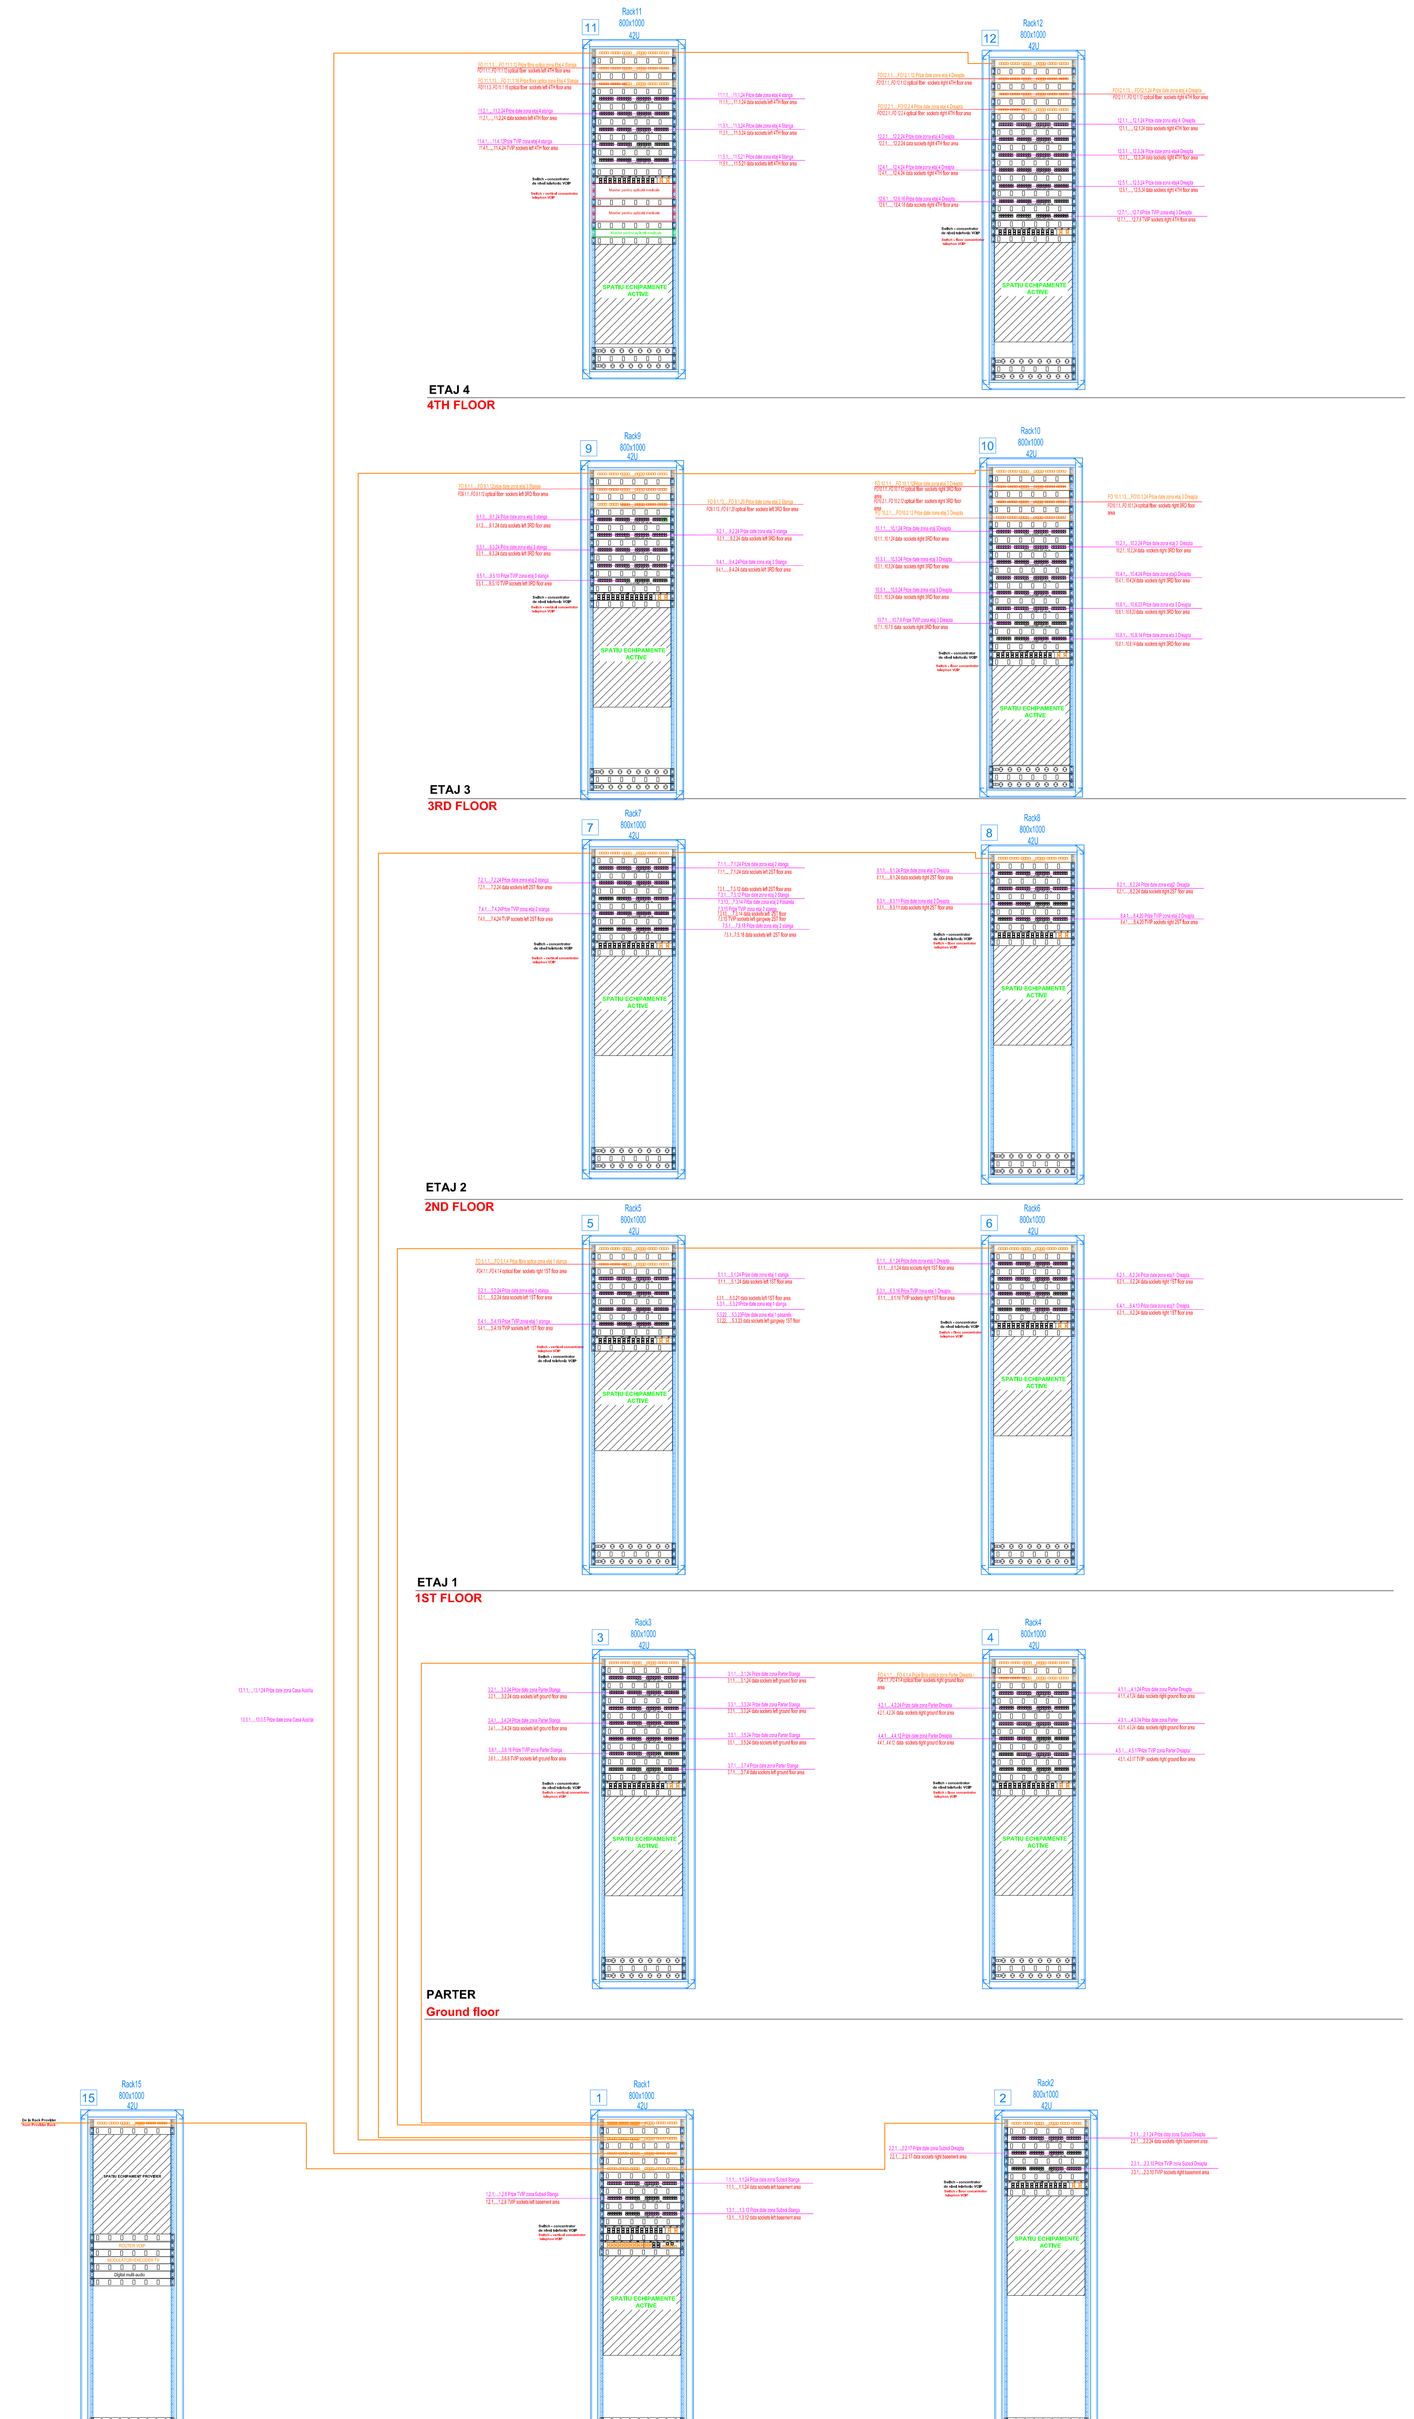

LEGENDA

- Cablu date FTP ecranizat Bt/Wire LSZH — *FTP cattle, SW WIRE, LSZH, data cable*
- Cablu fibra optica MM OM3 50/125, 12 fibre,LSZH — *MM OM3 50/125, 12 fibre LSZH, optical fiber cable*
- Cablu fibra optica MM OM3 50/125, 4 fibre,LSZH — *MM OM3 50/125, 4 fibre LSZH, optical fiber cable*
- Organizator orizontal — *Horizontal organizer*
- Patch-panel FO 24 porturi — *FO patch-panel, 24 ports*
- Patch-panel CU 24 porturi — *CU patch-panel, 24 ports*
- PDU (power distribution unit) cu 8 prize — *PDU(power distribution unit) with 8 sockets*
- Switch cu 16 porturi RJ45 POE si cu 4 porturi fibra optica — *Switch with 16 POE RJ45 ports and 4 optical fiber ports*
- Switch cu 24 porturi RJ45 POE si cu 4 porturi fibra optica — *Switch with 24 POE RJ45 ports and 4 optical fiber ports*
- Switch cu 20 porturi fibra optica 1Gb , 4 porturi RJ45 POE, 4 porturi fibra optica 10Gb — *Switch with 20 optical fiber ports 1Gb, 4 RJ45 POE ports, 4 10Gb optical fiber ports*
- Master pentru aplicatii medicale cu receptor GPS Include antenna dedicat hulurilor si blourl — *Master for medical application with GPS receiver ,including antenna dedicated to halls and offices*
- Master pentru aplicatii medicale cu receptor GPS Include antenna dedicata sailor de operatii — *Master for medical application with GPS receiver ,including antenna dedicated to surgery*
- Player audio digital Integrat cu dvd player, USB si card de memorie — *Digital audio player with dvd player integrated, USB and memory card*
- NVR 32 de canale ,rezolutie maxima 12 MP,20 Mbps pe canal ,echipat cu 2 HDD de 4 TB — *NVR with 32 channels, maximum resolution 12Mbps on , equipped with 2 HDD ,4TB*
- Camera video POE, pentru INTERIOR, 3 MP,20 de fps@3M,IR 30 m,IP66 — *POE indoor video camera,IP66*
- Camera video POE, pentru EXTERIOR, 3 MP,20 de fps@3M,IR 30 m,IP66 — *POE video camera, outdoor, with thermisolated housing, IP66*

CATEGORIA DE IMPORTANTA	- A	(cnf. H.G.R.NR.766-1997)
CLASA DE IMPORTANTA	- I	(cnf. Normativ P100-06)
GRAD DE REZISTENTA LA FOC	- I - II	(cnf. Normativ P118-1999)
RISC DE INCENDIU	- MIC	(cnf. Normativ P118-1999)

VERIFICATOR / EXPERT	NUME	SEMNATURA	CERINTELE
TRACTEBEL			
SPECIFICATIE	NUME	SEMNATURA	
SEF PROIECT	Arh.Christian TANASESCUX		
MANAGER PROIECT	Ing. Luiza POPA-BELEGANTE		
VERIFICAT	Ing. Aurelian NITA		
DESENAT	Ing. Florin Tanase		
PROIECTAT	Ing. Florin Tanase		

REFERAT de verificare RAPORT de expertiza tehnica
Nr. – Data: –

Proiect : Intervenirea cladirilor existente si construirea noua in incinta Spitalul Clinic Judetean de Urgente «Pius Brinzeu» Timisoara, in vederea recuperarii situatiei de fapt a functiunilor prevazute de LPU, Ordonanta 470 de Centru de Mari Arsi

Locatie: Bulevardul Liviu Rebreanu 156, Timisoara 300723
Beneficiar: Consiliul Judetean Timis
Investitor: Ministerul Sanatatii–Romania

Document desen:

SCHEMA BLOC VIDEO-DATE SI CCTV
CCTV and data video block diagram

Scara: –
Format: A0+
Data: FEBRUARIE 2021
Nr desen: P-013049_DR_BC03001

Pr. Nr: P-013049
Faza: PT+DE
Rev.: 00
Pagina: 1/1