

1. THE TELECOMMUNICATION INSTALLATION HEREIN SHALL BE DONE IN ACCORDANCE WITH THE PROVISIONS OF THE LATEST EDITION OF THE PHILIPPINE LONG DISTANCE TELEPHONE CO., AND OTHER EXISTING LOCAL ORDINANCES, POLICIES, AND REGULATIONS.

2. THE TELEPHONE COMMUNICATION SYSTEM SHALL CONSISTS OF CAT5e CABLE, 4 PAIRS, FOR OUTLET POINTS OR TELEPHONE RECEPTACLES LOCATIONS, DIFFERENT SIZES OF CONDUITS, METAL PULLBOXES, QUICK-CONNECT TERMINAL BLOCKS, AUXILIARIES AND ANCILLIARIES AS SHOWN ON THE DRAWINGS AND/ OR IN ACCORDANCE WITH THE COMPLETE REQUIREMENTS SHOWN OR NOT SHOWN.

3. OUTLET BOXES FROM THE TELEPHONE INSTRUMENTS ARE THE TYPE AND SIZE TO SUIT INDIVIDUAL LOCATIONS AND APPLICATIONS.

4. MATERIALS SHALL BE NEW AND SHALL BE NEW AND SHALL CONFORM WITH THE STANDARD AMERICAN UNDER-WRITER'S LABORATORIES, INC., IN EVERY CASE WERE SUCH A STANDARD HAS BEEN ESTABLISHED FOR THE PARTICULAR TYPE OF MATERIAL IN QUESTION.

5. TERMINAL CABINETS OR PANEL BOXES SHALL BE PROVIDED WITH SNAP CATCH AND BASIN LOCK, ALL KEYED ALIKE. CONDUIT TERMINATION IN PANEL BOXES SHALL BE AS SHOWN IN THE DRAWINGS. EACH PANEL BOX SHALL BE PROVIDED WITH 19mm THICK PRESSURE-TREATED WOODEN BACKBOARD.

6. ELECTRICAL TRADE SIZE SHALL BE USED. UNLESS OTHERWISE SPECIFIED, MINIMUM SIZE OF CONDUIT SHALL BE 20mm DIAMETER.

7. STANDARD RADIUS OF CONDUIT BEND SHALL NOT BE LESS THAN TEN (10) TIMES THE OUTSIDE DIAMETER OF THE CABLE TO BE PLACED INSIDE IT.


8. LABELING OF STATION OUTLETS OUTSIDE THE COVER SHALL BE IN ACCORDANCE WITH THE STRUCTURED CABLING SYSTEM STANDARDS.

9. SPARE CONDUITS FOR CABLE SHALL BE PROVIDED WITH PULLING-IN WIRES.


10. UNLESS OTHERWISE INDICATED, MEASUREMENTS SHALL BE IN MILLIMETERS (mm).

11. ALL WORKS SHALL BE DONE IN A SAFE AND WORKMANLIKE MANNER AND SHALL COMPLY WITH ALL EXISTING APPLICABLE CODES, REGULATIONS, AND PRESCRIBED STANDARD FOR THE CONSTRUCTION AND INSTALLATION OF BUILDING TELEPHONE CABLE FACILITIES NOT COVERED ON WHICH SUPERSEDES PROVISIONS, AND REGULATIONS MENTIONED ABOVE.

12. FIELD CHANGES AND ALTERATIONS ON THE PLANS SHALL BE REVIEWED AND COORDINATED WITH THE BUILDING PROPERTY MANAGER AND TELEPHONE SYSTEMS DEPARTMENT.

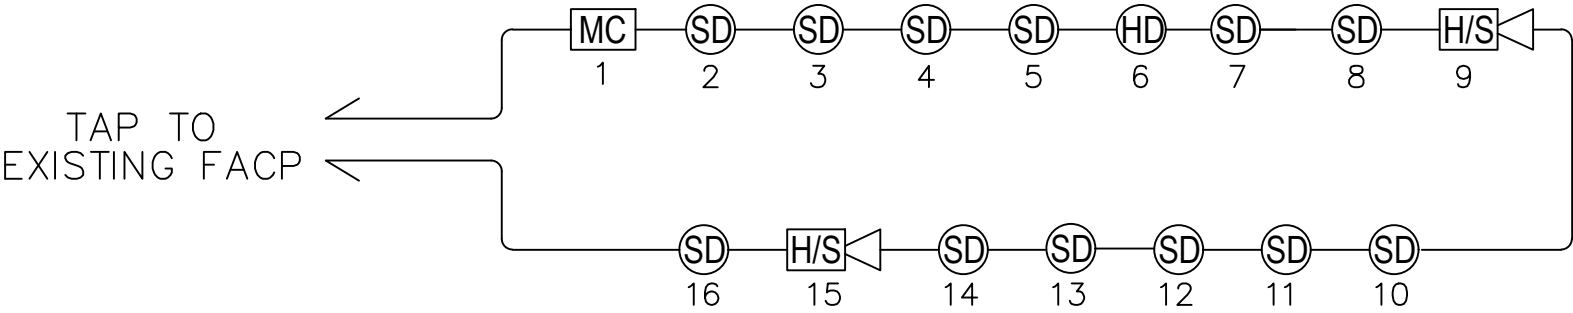

FDAS SINGLE LINE DIAGRAM

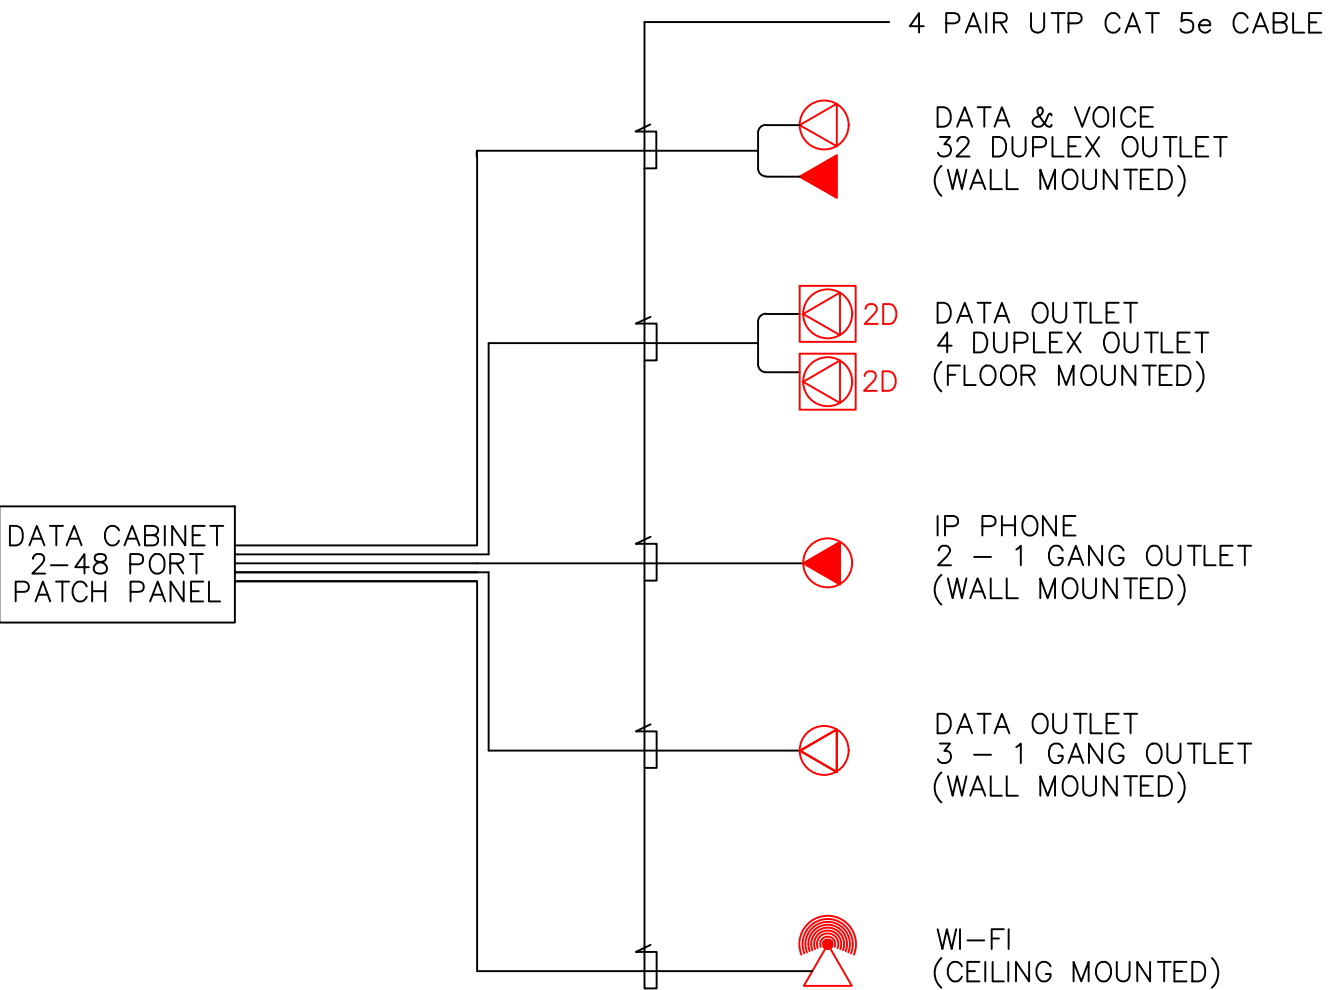




DATA & VOICE SINGLE LINE DIAGRAM

UHG FINANCE

TELECOM NOTES, LAN & FDAS SLD

SCALE

NTS.

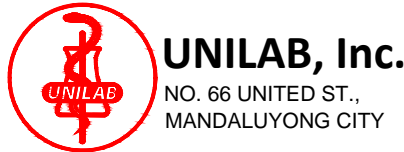

PREPARED BY :
PSG - BUILD
PSG OFFICE, BLDG 1 UNILAB CORPORATE CENTER,
NO. 66 UNITED STREET, MANDALUYONG CITY,
PHILIPPINES
TEL. NO. 8858-1000

PROJECT TITLE & LOCATION:
2ND. FLOOR ADMIN. BLDG.
2ND. FLOOR ADMIN. BLDG., ULCC MAIN COMPOUND

MAINTENANCE SECTION:
ELECTRICAL :
SANITARY/PLUMBING :
MECHANICAL :
DRAWN BY :
VIC C. S. ANTONIO
DATE: 3/8/2024
CHECKED BY:
AML / JJP / LLO
DATE:

CONFORME:
END-USER

PLATE NO.:
REV. 02: DATE: 3/8/2024
UPDATE OF LAYOUT
BASED ON REVISED FLR. PLAN.

SHEET NO:
E
10 11