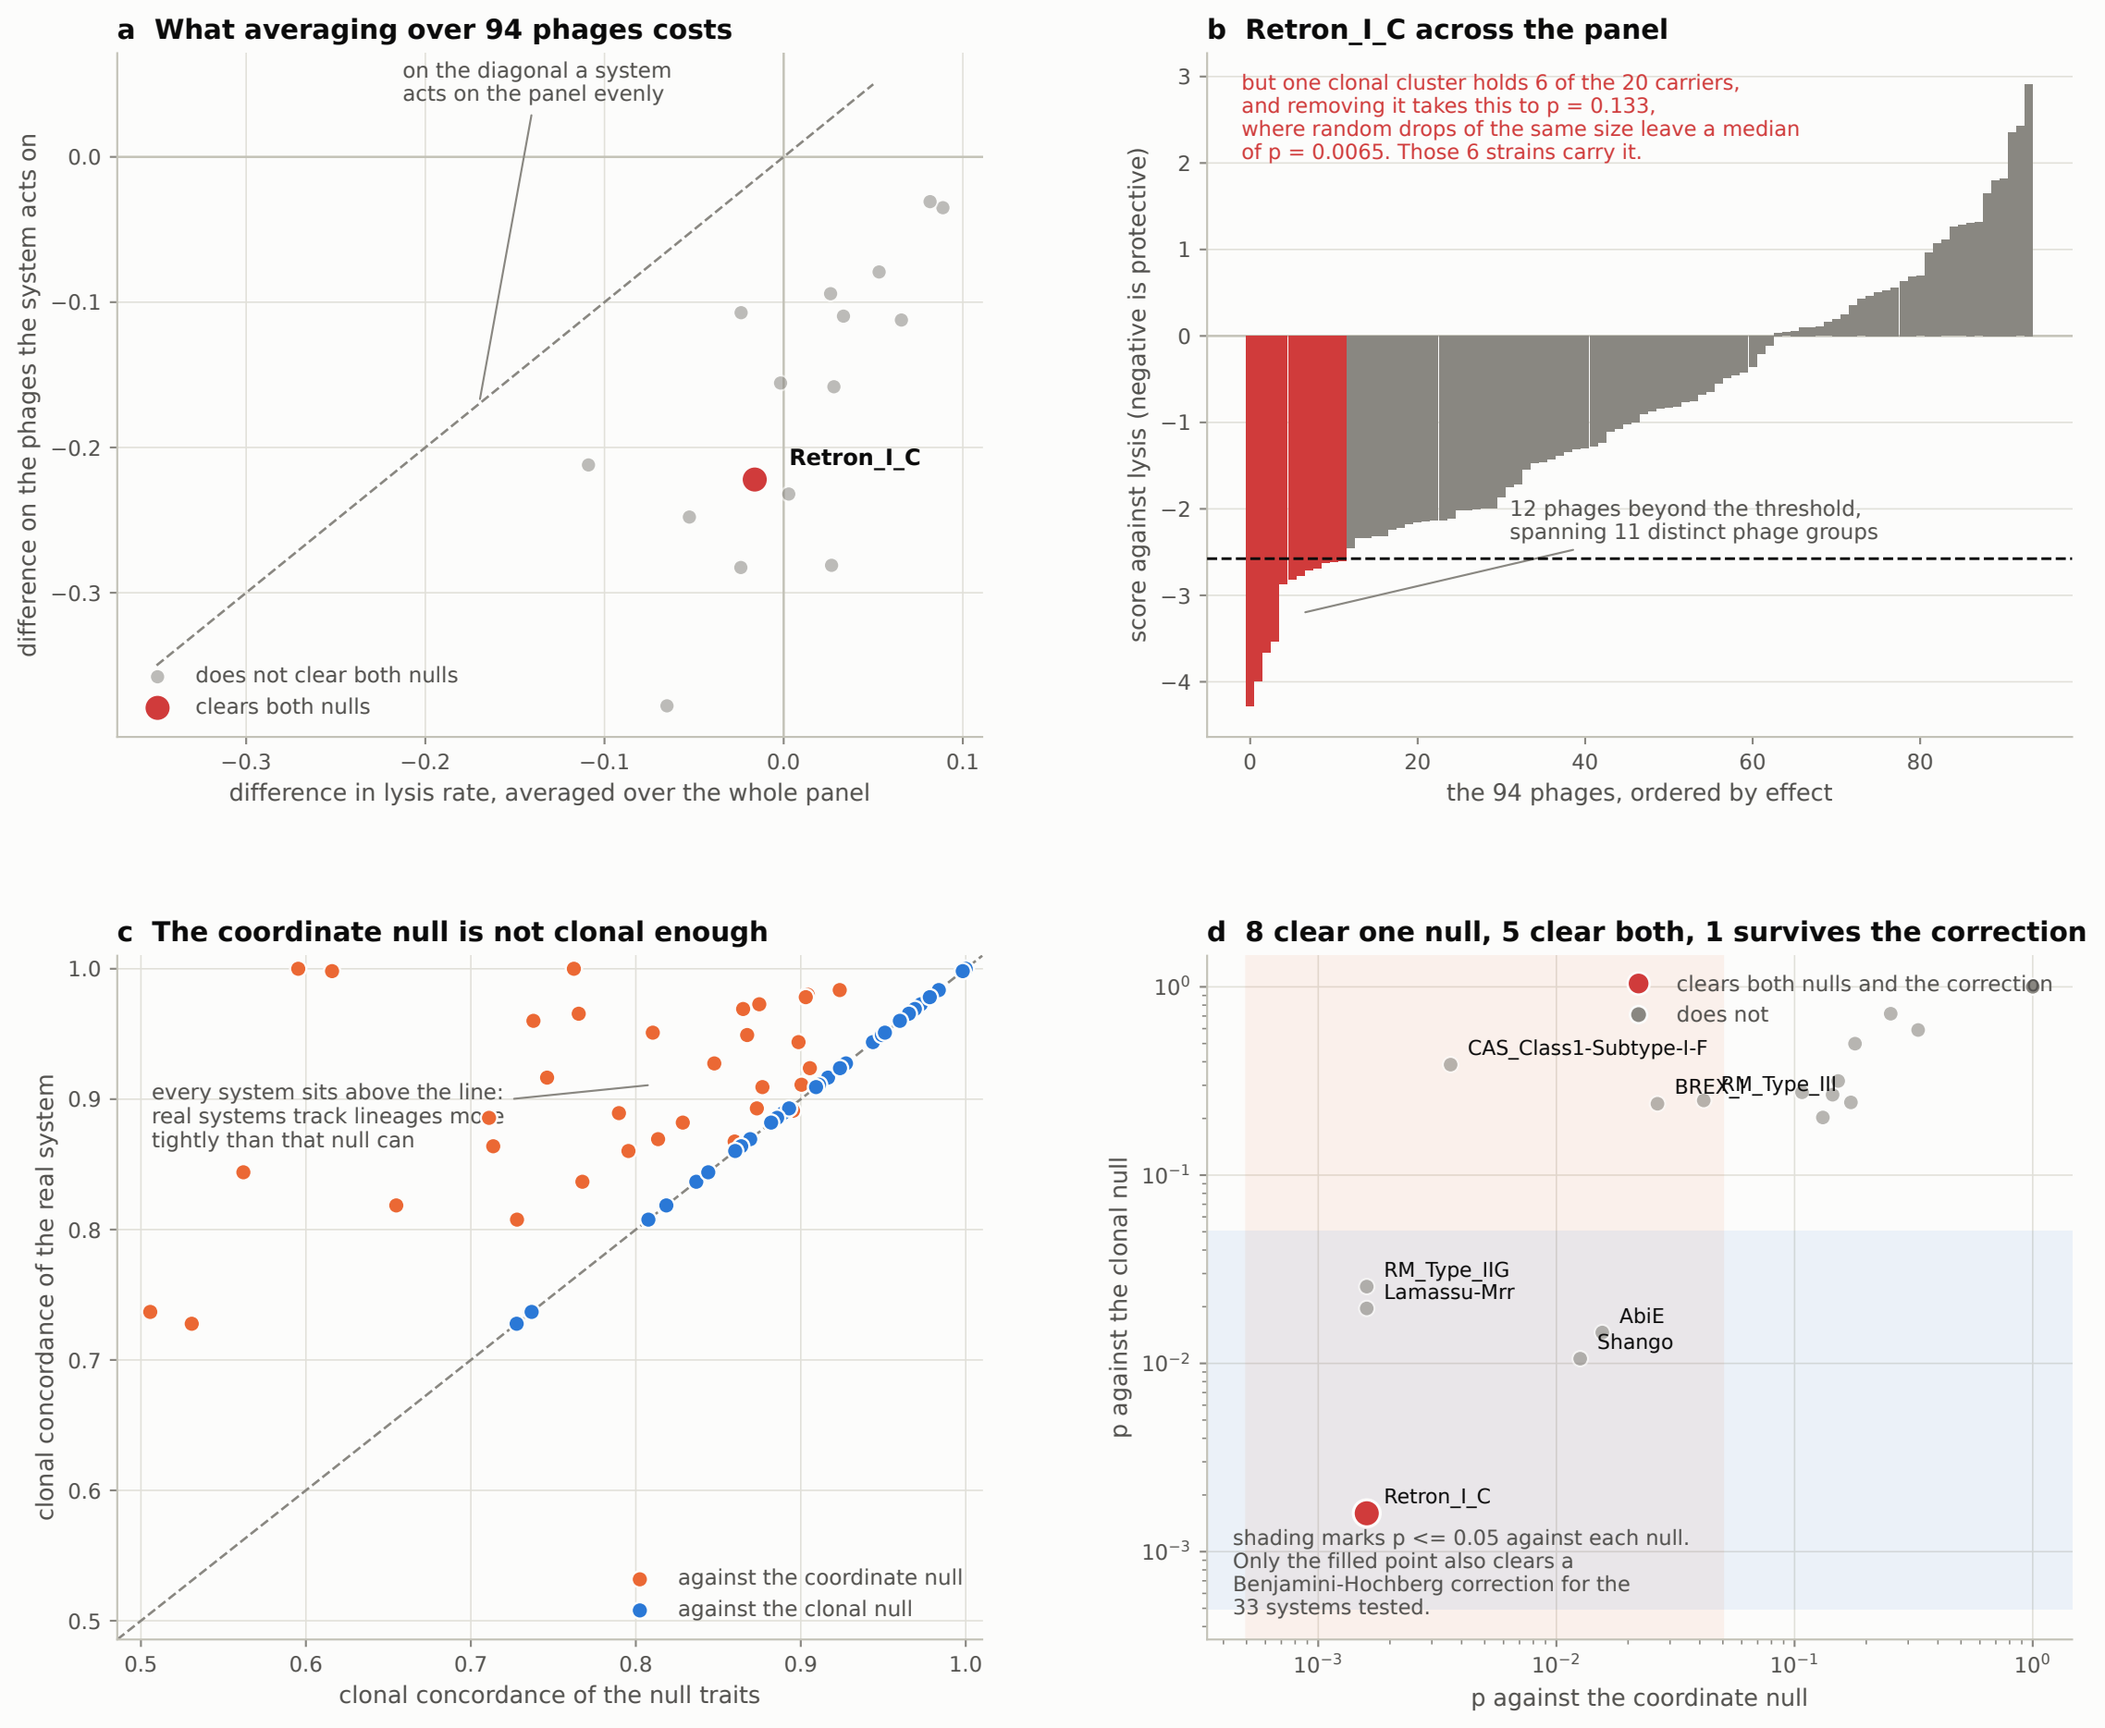
a What averaging over 94 phages costs
on the diagonal a system
acts on the panel evenly
Retron_I_C
does not clear both nulls
clears both nulls
difference on the phages the system acts on
difference in lysis rate, averaged over the whole panel
b Retron_I_C across the panel
but one clonal cluster holds 6 of the 20 carriers,
and removing it takes this to p = 0.133,
where random drops of the same size leave a median
of p = 0.0065. Those 6 strains carry it.
12 phages beyond the threshold,
spanning 11 distinct phage groups
score against lysis (negative is protective)
the 94 phages, ordered by effect
c The coordinate null is not clonal enough
every system sits above the line:
real systems track lineages more
tightly than that null can
against the coordinate null
against the clonal null
clonal concordance of the real system
clonal concordance of the null traits
d 8 clear one null, 5 clear both, 1 survives the correction
clears both nulls and the correction
does not
CAS_Class1-Subtype-I-F
BREX
RM_Type_III
RM_Type_IIG
Lamassu-Mrr
AbiE
Shango
Retron_I_C
shading marks p <= 0.05 against each null.
Only the filled point also clears a
Benjamini-Hochberg correction for the
33 systems tested.
p against the clonal null
p against the coordinate null