


GROUND FLOOR ELECTRICAL PLAN
scale 1 : 75

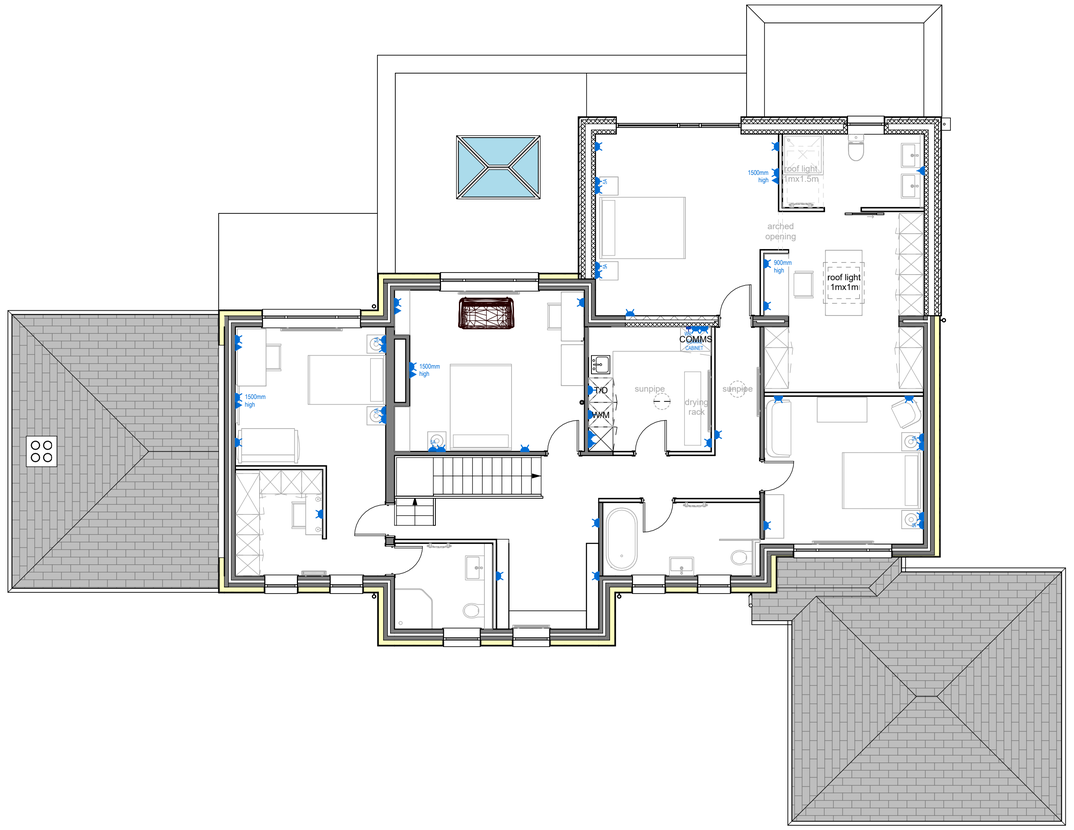

FIRST FLOOR ELECTRICAL PLAN
scale 1 : 75

ELECTRICAL LEGEND	
SD	DOUBLE SOCKET OUTLET
H/L	CONNECTION POINT AT HIGH LEVEL I.E. BEHIND COOKER EXTRACTOR FAN HOOD
L/L	CONNECTION POINT AT LOW LEVEL I.E. BEHIND LARGER FITTED APPLIANCES
B/H	CONTROL POINTS WITH COMBINED SWITCH PLATE FOR BOILER & UF HEATING MANIFOLD
F/W/D	CONTROL POINTS WITH COMBINED SWITCH PLATE FOR FREEZER, WASHING MACHINE & DRYER
F/F	CONTROL POINTS WITH COMBINED SWITCH PLATE FOR FRIDGE & EXTRACTOR FAN
C/O	CONTROL POINTS WITH COMBINED SWITCH PLATE FOR COOKER & OVENS
R	CONTROL POINT SWITCH PLATE FOR RADIATOR
TV	TV OUTLET POINT WIRE WITH COAXIAL CABLE FOR TV AERIAL AT ROOF LEVEL
SKY	SKY OUTLET POINT WITH CABLES WIRED TO ROOF FOR FUTURE CONNECTIONS TO EXTERNAL DISH
WR	CAT6 OUTLET POINTS LINKED BACK TO MAIN ROUTER
HC	CONTROL PANEL FOR HEATING

FIRE LEGEND	
HD	AUTOMATIC HEAT DETECTOR WITH COMBINED SOUNDER
SD	AUTOMATIC SMOKE DETECTOR WITH COMBINED SOUNDER
CO	AUTOMATIC SMOKE DETECTOR WITH COMBINED SOUNDER

Scale 1 : 100

0 1 2 5 10m

ELECTRICAL NOTES:

All electrical works shall be carried out by NICEIC registered electrician in strict accordance with the latest 18th Edition of IET Wiring Regulations.

Provide and install all necessary circuits, switches, power outlets, lighting points, earthing and fittings to layout provided. All to be housed in PVC conduits and metal backing boxes, fully recessed into walls before plastering. Include for all tracking and cutting holes etc.

All fittings shall be MK Range or equal approved by client.

All bespoke light fittings to be chosen by client.

Provide for all electrical connections to complete mechanical installation, including ventilation and heating.

The contractor shall include for general attendance, installation of ducts and use of plant and equipment to facilitate these.

POSITIONING OF OUTLETS

Generally outlets unless otherwise stated to be positioned 450mm from floor level to bottom of outlet

Kitchen outlets above workshop to be positioned 1100mm from floor level to bottom of outlet.

Light switches to be positioned 1200mm above floor level to top of switch.

ALLOW FOR ALL EXISTING SOCKETS AND SWITCHED IN LOCATIONS WHERE WALLS ARE TO BE DRYLINED TO BE MOVED TO ACCOMMODATE NEW WALL BUILD UP. POSITION OF ALL SOCKETS AND SWITCH TO BE RETAINED UNLESS OTHERWISE STATED.

OUTLET FINISHES:

Generally unless otherwise stated outlet finish and colour to be white pvc.

All connection points hidden behind appliances etc to be white pvc.

Visible outlets and control switches to kitchen and living areas to be white pvc with white inserts. TBC by cleint.

LIGHTING:

All light fittings to client specification. Provide fixed energy efficient light fittings throughout.

VENTILATION:

Rapid ventilation provision is required in each habitable room and should be capable of extracting a minimum of four air changes per hour per room directly to outside via openable windows or doors.

Provide intermittent extract ventilation to the following areas:

Kitchen	=	30 l/s adjacent to hob or 60 l/s elsewhere.
Utility Room	=	30 l/s
Bathroom	=	15 l/s

FIRE ALARM AND DETECTION:

Smoke alarms to comply with BS 5446-1 and heat alarms to comply with BS 5446-2

At least one smoke alarm should be provided to

a) in the circulation route on each storey an
b) in the principal habitable room

Heat alarm to be located in the Kitchen

Smoke and heat alarms should be interconnected so that they all give an audible alarm when any one of them is activated.

Smoke alarms and heat alarms should be permanently wired to either -

a) a regularly used lighting circuit; or
b) a circuit which -

i) is separately fused at the distribution board
ii) serves only smoke and heat alarms and
iii) where a residual current device is used - is not connected to a residual current device which is also used by any other circuit.

A back-up power source to each smoke alarm and heat alarm should be provided by either -

a) a primary or secondary battery; or
b) a capacitor

DRAINAGE:

- Foul drainage
- Manhole 600 x 600
- Inspection chamber 450 x 450
- SVP — Soil Vent Pipe
- UPS — Upstand
- 150 x 150mm Back Inlet Gully Trap
- Exisitng supply pipes
- CW — Cold water
- HW — Hot water

REV:	DATE:	COMMENTS:	DRWN:	CHKD:
P05	27.08.25	ISSUE FOR CLIENT REVIEW	JPG	OSE
P04	06.08.25	ISSUED TO BUILDING CONTROL	OSE	JPG
P03	23.07.25	ISSUED TO CONTRACTOR	OSE	JPG
P02	18.07.25	ISSUE FOR CLIENT REVIEW	OSE	JPG
P01	04.06.25	ISSUED FOR REVIEW	OSE	JPG

DRAWING STATUS:

PRELIMINARY

PROJECT:

DRAWING TITLE:
ELECTRICAL PLANS

CLIENT:			DATE:	STATUS:
			FEB 2025	
25/102	DRAWN BY: OSE	CHECKED: JPG	SCALE: As indicated	SHEET SIZE: A1
DRAWING NUMBER: 25-102-A121				REVISION: P05