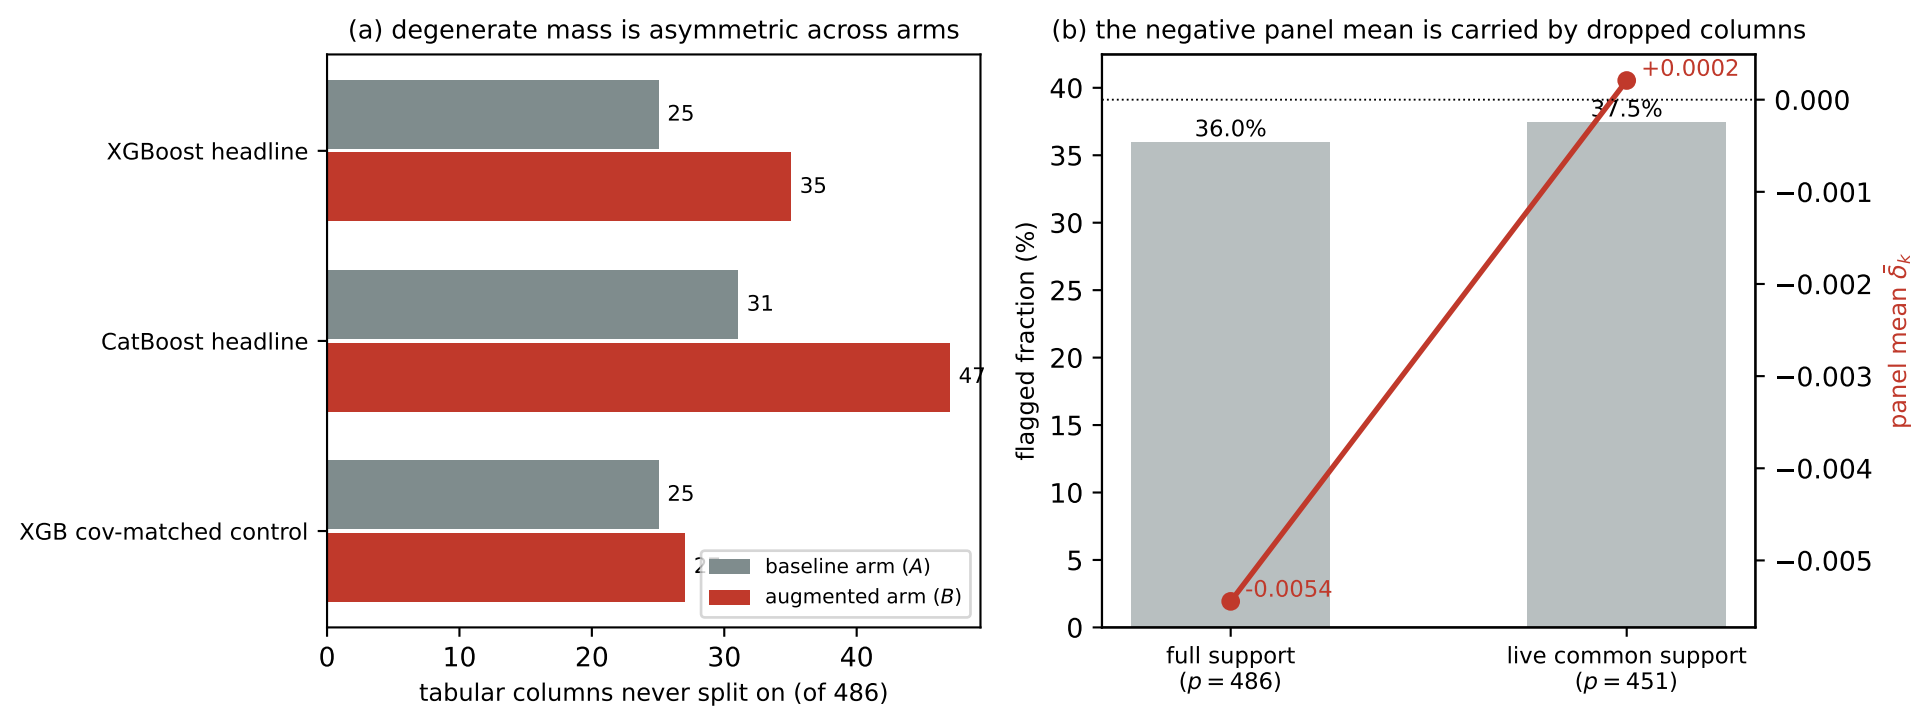
(a) degenerate mass is asymmetric across arms
XGBoost headline
CatBoost headline
XGB cov-matched control
25
35
31
47
25
baseline arm (A)
augmented arm (B)
0
10
20
30
40
tabular columns never split on (of 486)
(b) the negative panel mean is carried by dropped columns
flagged fraction (%)
panel mean $\bar{\delta}_k$
36.0%
37.5%
+0.0002
-0.0054
0.000
−0.001
−0.002
−0.003
−0.004
−0.005
full support
($p = 486$)
live common support
($p = 451$)