


DRAWING LOCATION: c:\users\p...
PLOT DATE: ...
PLOT BY: ...

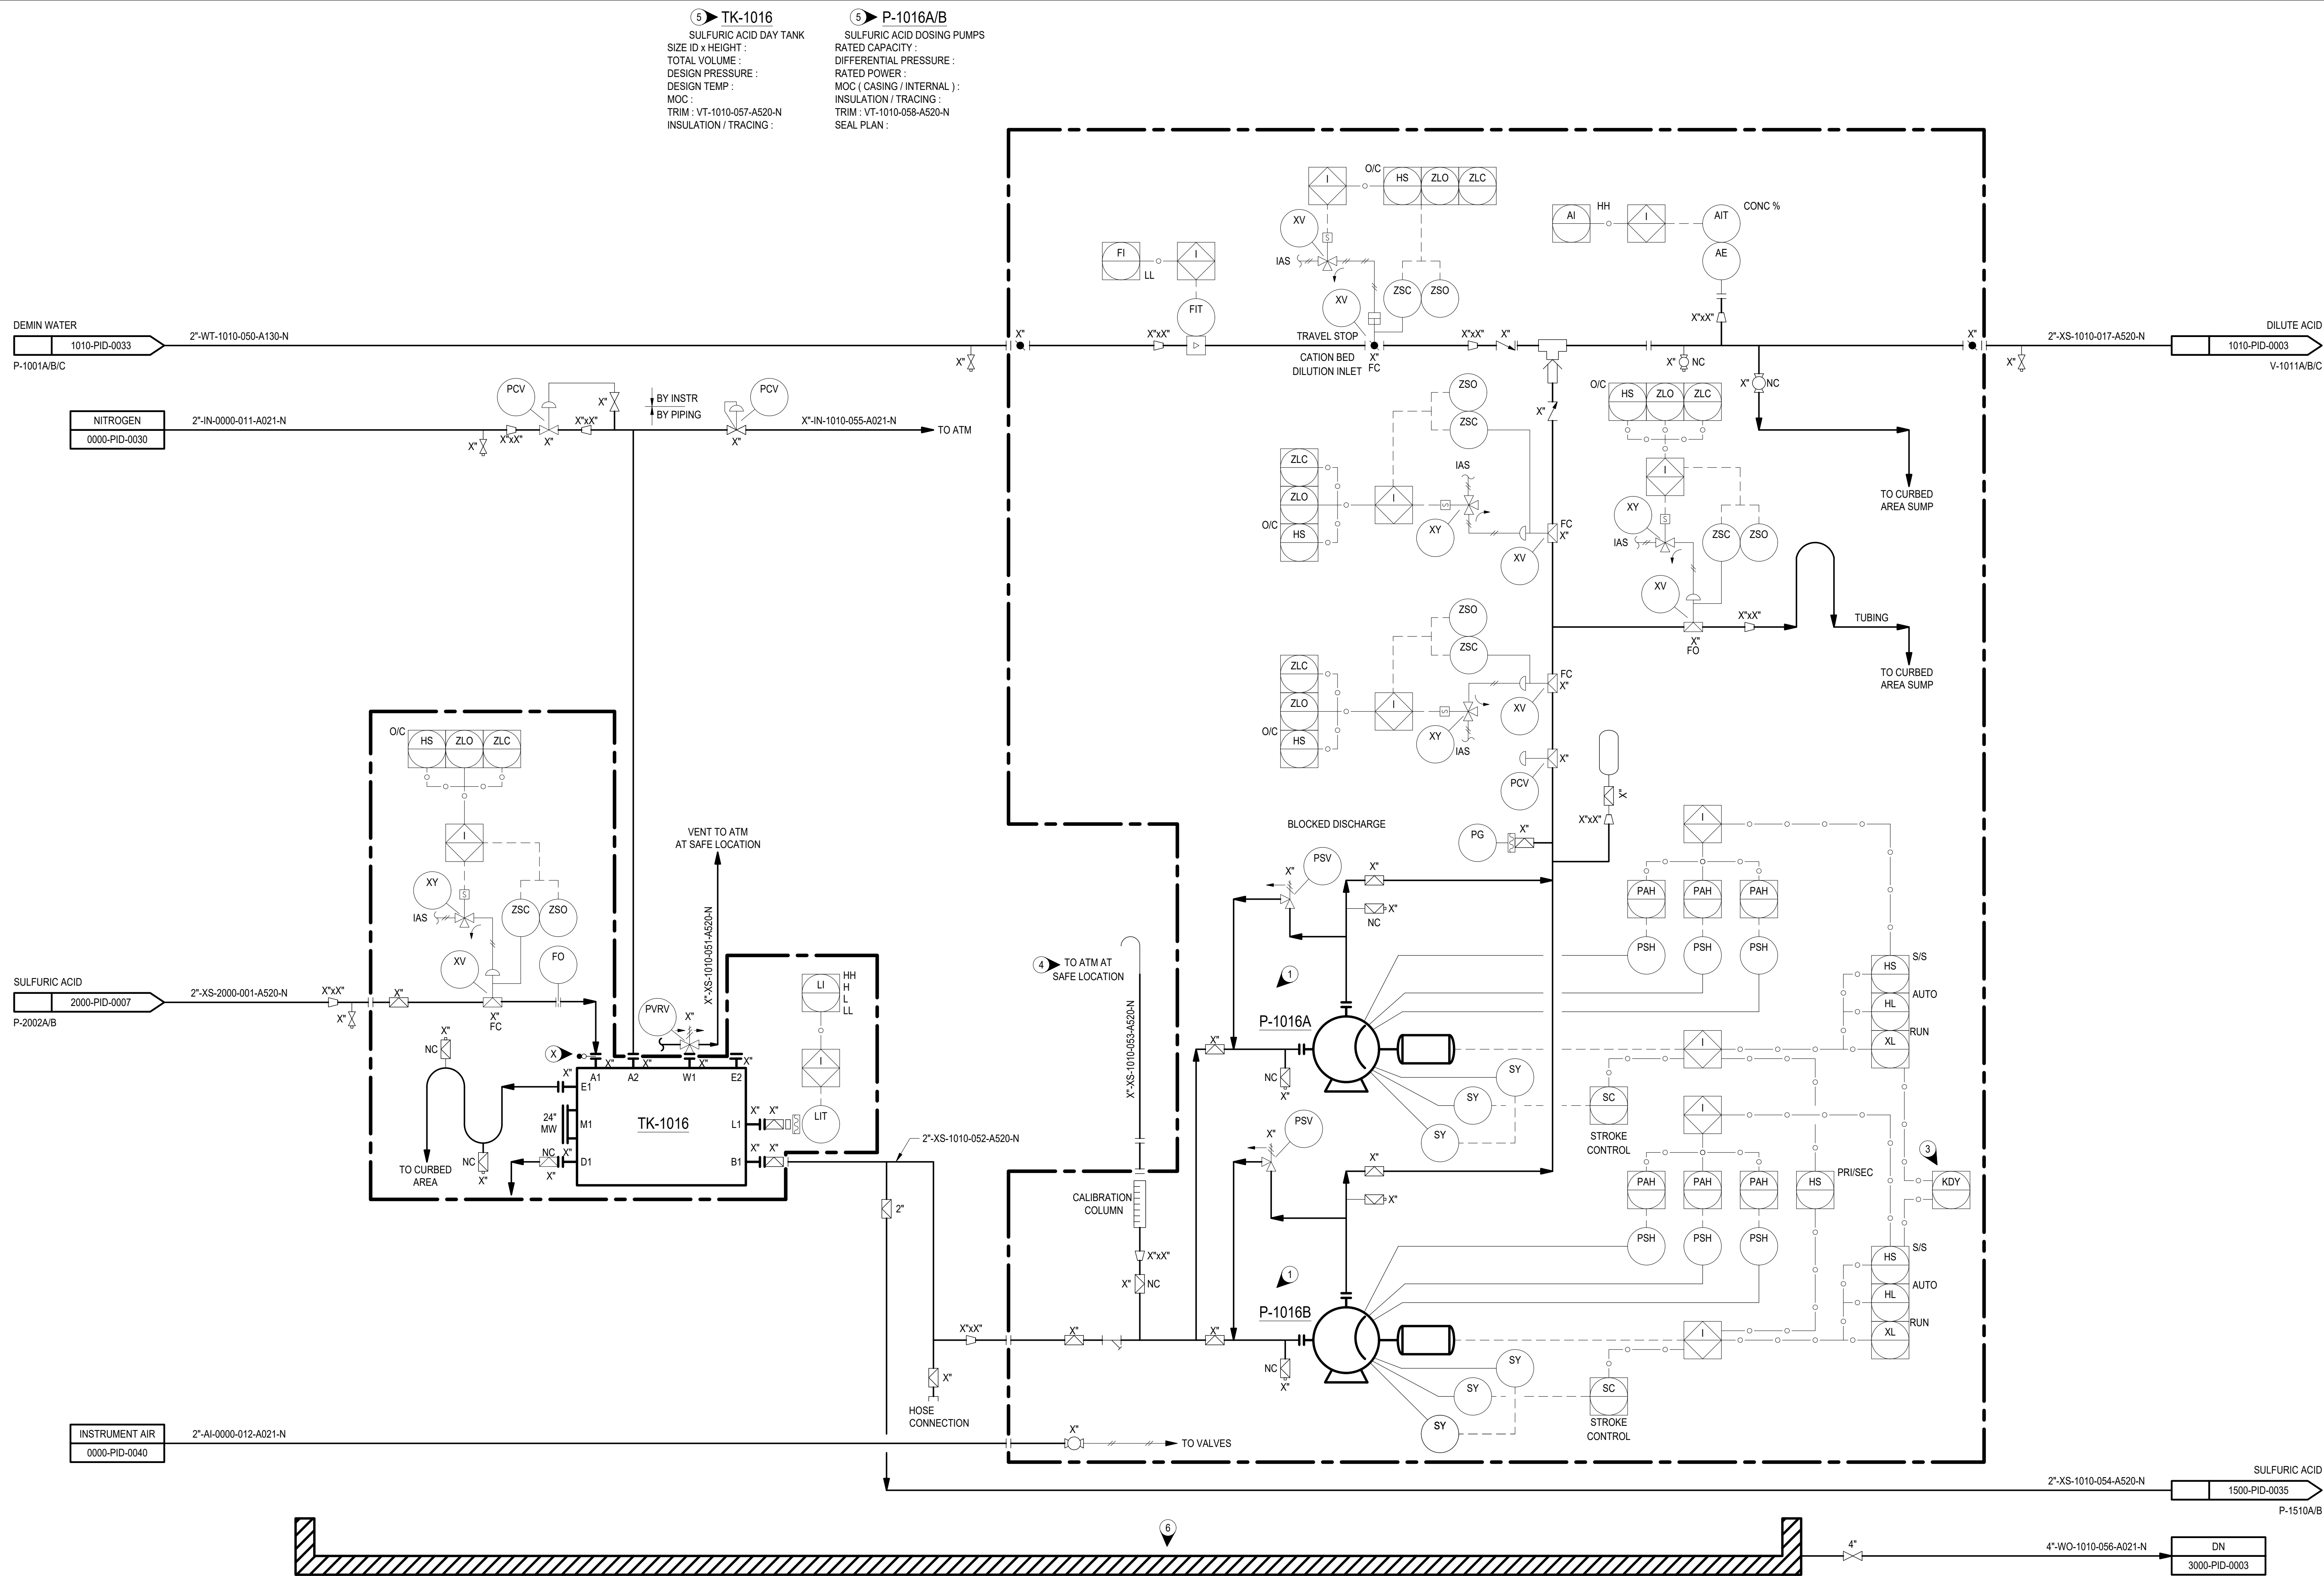

- GENERAL NOTES
- A. FOR PIPING AND INSTRUMENTATION LEGENDS AND SYMBOLS, SEE P&IDs 0000-PID-0001 THRU 0000-PID-00XX.
 - B. INSTRUMENT NUMBERS ON THIS P&ID ARE PREFIXED BY THE UNIT NUMBER ASSOCIATED WITH THIS P&ID UNLESS OTHERWISE SPECIFIED.
 - C. CONTROL VALVES AND BYPASS SIZES ARE PRELIMINARY AND WILL BE CONFIRMED DURING DETAIL DESIGN.
- NOTES
- 1. CHECK VALVES ARE INTERNAL TO THE PUMP.
 - 2. VALVE STEM IS ACCESSIBLE FROM GRADE.
 - 3. DOSING PUMPS ALTERNATE DUTY AFTER EACH REGEN.
 - 4. CALIBRATION COLUMN VENT IS EXTENDED ABOVE THE MAXIMUM TANK ELEVATION.
 - 5. SULFURIC ACID DILUTION SYSTEM SHOWN IS TYPICAL. EXACT CONFIGURATION WILL BE REVISED ONCE SYSTEM IS SELECTED.
 - 6. ACID RESISTANT LINING.

NOT PUBLISHED. ALL RIGHTS RESERVED BY THE ENGINEER. DRAWINGS AND SPECIFICATIONS, AS INSTRUMENTS OF SERVICE, ARE ISSUED TO DESCRIBE DESIGN INTENT. THEY ARE NOT TO BE USED ON OTHER PROJECTS OR EXTENSIONS TO THIS PROJECT, EXCEPT BY AGREEMENT IN WRITING AND WITH APPROPRIATE COMPENSATION TO THE ENGINEER, CONTRACTOR, SUB-CONTRACTORS & SUPPLIERS ARE RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AND CONDITIONS AT THE JOB SITE, AND SHALL NOTIFY THE ENGINEER IMMEDIATELY OF ANY ERRORS OR DISCREPANCIES IN REGARD TO SUCH DRAWINGS. DESCRIBING DESIGN INTENT, SHALL NOT INDICATE EVERY DETAIL OR SYSTEM FOR CONSTRUCTION. CONTRACTOR, SUB-CONTRACTORS, AND SUPPLIERS SHALL BE RESPONSIBLE TO PROVIDE ADDITIONAL DRAWINGS AS NECESSARY FOR PERMITS, ERECTION, INSTALLATION, AND COORDINATION OF ALL WORK. CONTRACTOR, SUB-CONTRACTORS, AND SUPPLIERS SHALL BE RESPONSIBLE FOR ALL LABOR AND MATERIALS REQUIRED IN ACCORDANCE WITH DESIGN INTENT. ALL MATERIALS SHALL BE NEW, UNLESS SPECIFIED OTHERWISE, AND SHALL BE INSTALLED LEVEL, PLUMB, STRAIGHT, AND TRUE TO LINE, IN ACCORDANCE WITH THE BEST PRACTICES OF THE TRADES. THE ENGINEER SHALL NOT BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES OR PROCEDURES, OR FOR SAFETY PRECAUTIONS AND PROGRAMS IN CONNECTION WITH THE WORK. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH APPLICABLE CODES AND ORDINANCES.

REFERENCE DRAWINGS:

REV #	DATE	DESCRIPTION	DRWN	CHKD	APVD
A	12-05-25	ISSUED FOR APPROVAL	GS	APB	PDN
B	01-09-26	ISSUED FOR FEL2B REPORT	GS	APB	PDN

REV #	DATE	DESCRIPTION	DRWN	CHKD	APVD
A	12-05-25	ISSUED FOR APPROVAL	GS	APB	PDN
B	01-09-26	ISSUED FOR FEL2B REPORT	GS	APB	PDN

MOTIVA

CLIENT: MOTIVA ENTERPRISES LLC
PLANT: PORT ARTHUR REFINERY
JOB NO:

PIPING & INSTRUMENTATION DIAGRAM

DEMINERALIZER WATER PACKAGE
ACID DILUTION SYSTEM

PROJ TITLE: AROMATICS UTILITY SCOPE REVIEW

SSP ENGINEERING & CONSULTING

13100 NORTHWEST FREEWAY
SUITE 625
HOUSTON, TEXAS 77040

PROJECT NO: 25MA02
SCALE: NONE
DRAWN BY: GS
CHECKED: APB
DESIGN BY:
ENG APVL: PDN
DRAWING NO: **1010-PID-0011**
REV **B**