

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION
WITH FEATURE SURVEYOR PLAN PREPARED BY:
H&I CONSULTING ENGINEERS

REPORT NO: 25565-24
DATE: 03/06/2024
PH: (03) 9375 755

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION
WITH SOIL REPORT PREPARED BY:
H&I CONSULTING ENGINEERS

REPORT NO: 25565-24
DATE: 05/06/2024
PH: (03) 9375 755

ARCHITECTURAL DRAWINGS TO BE READ IN CONJUNCTION
WITH ENERGY RATING REPORT PREPARED BY:
ARCHI SUSTAINABILITY

PH: 0478 088 493

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the
Building Act 1993 & Building Regulations
2018

24 HOURS NOTICE REQUIRED FOR INSPECTIONS

DRAWING NO. DESCRIPTION		
	01	COVER SHEET
	02	NOTES N/A
	03	SITE & ROOF PLAN 1:125
	04	ROOF PLAN 1:100
	05	SITE NOTES N/A
	06	SLAB SETOUT PLAN 1:100
	07	GROUND FLOOR PLAN 1:100
	08	FIRST FLOOR PLAN 1:100
	09	ELEVATIONS 1:100
	10	ELEVATIONS 1:100
	11	WINDOW & DOOR SCHEDULE 1:100
	12	SECTION A-A 1:50
	13	SECTION NOTES N/A
	14	ELECTRICAL PLAN 1:100
	15	INTERNAL DETAILS 1:50
	16	INTERNAL DETAILS 1:50
	17	INTERNAL DETAILS 1:50
	18	INTERNAL DETAILS 1:50
	19	INTERNAL DETAILS 1:50
	20	ENERGY RATING REQUIRMENTS N/A
	21	NOTES & DETAILS N/A
	22	DETAILS N/A
	23	DETAILS N/A
	24	DETAILS N/A
	25	DETAILS N/A
	26	SHADOW DIAGRAM 9:00AM 1:125
	27	SHADOW DIAGRAM 10:00AM 1:125
	28	SHADOW DIAGRAM 11:00AM 1:125
	29	SHADOW DIAGRAM 12:00PM 1:125
	30	SHADOW DIAGRAM 1:00PM 1:125
	31	SHADOW DIAGRAM 2:00PM 1:125
	32	SHADOW DIAGRAM 3:00PM 1:125


NEW DWELLING AT LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS

AREA SCHEDULE		
SITE	366.00	
HOUSE	SQM	SQS
GROUND FLOOR AREA	151.15	16.27
FIRST FLOOR AREA	168.14	18.09
PORCH	4.99	0.54
ALFRESCO	18.60	2.00
GARAGE	43.85	4.72
TOTAL AREA	386.73	41.62
SITE COVERAGE	218.59	59.72%
HARD SURFACE AREA	-	
TOTAL HARD SURFACE AREA	-	-
PERMEABILITY	147.41	40.28%
PRIVATE OPEN SPACE	85.73	

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

NOTE:
*BOF NOT DETERMINED DUE TO LIMITED
CAPABILITY OF MANUAL EXCAVATION


FOOTING EXPOSURE:
NGL: RL 10.61
BOF: RL <9.84
O/S: 295mm

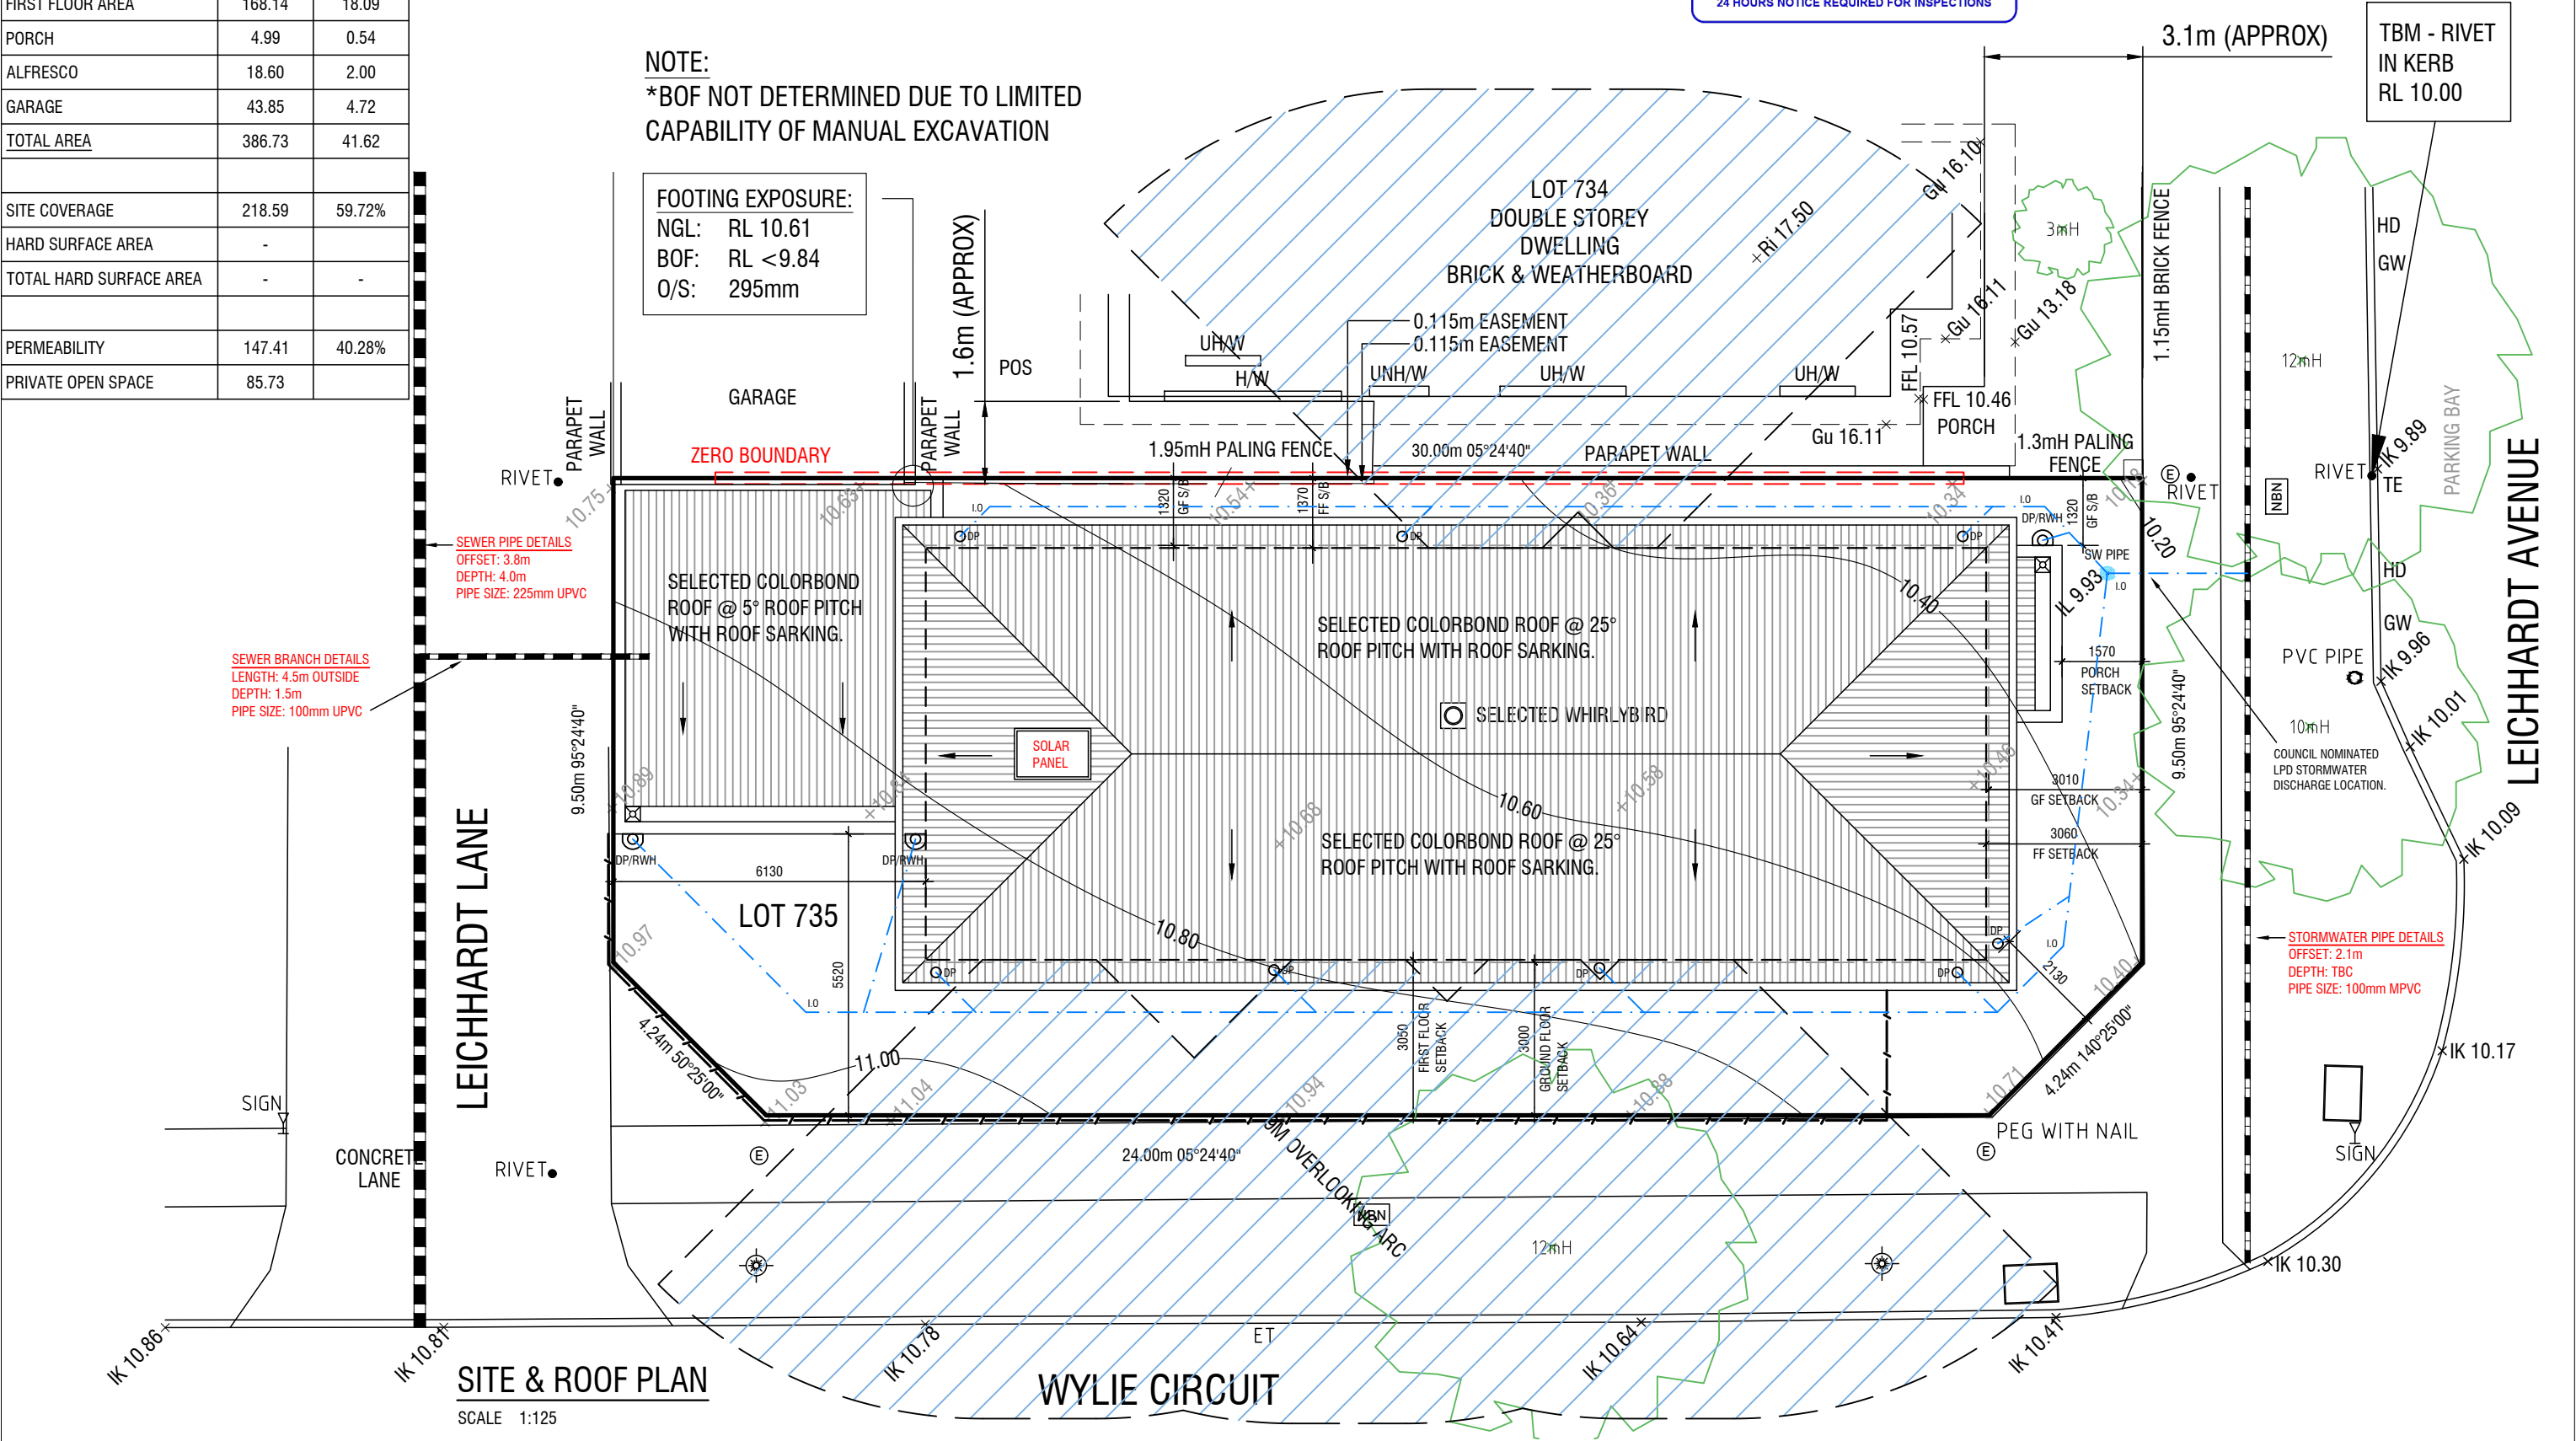


REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT: NEW DWELLING	CLIENT:
ADDRESS: LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS.	DRAWING NAME: SITE & ROOF PLAN

ISSUE DATE: 16.01.2024
SCALE: 1:125 @ A3
DRAWN: E.C.
CHECKED: E.C.



PROJECT NO: 042224
SHEET NO: 03

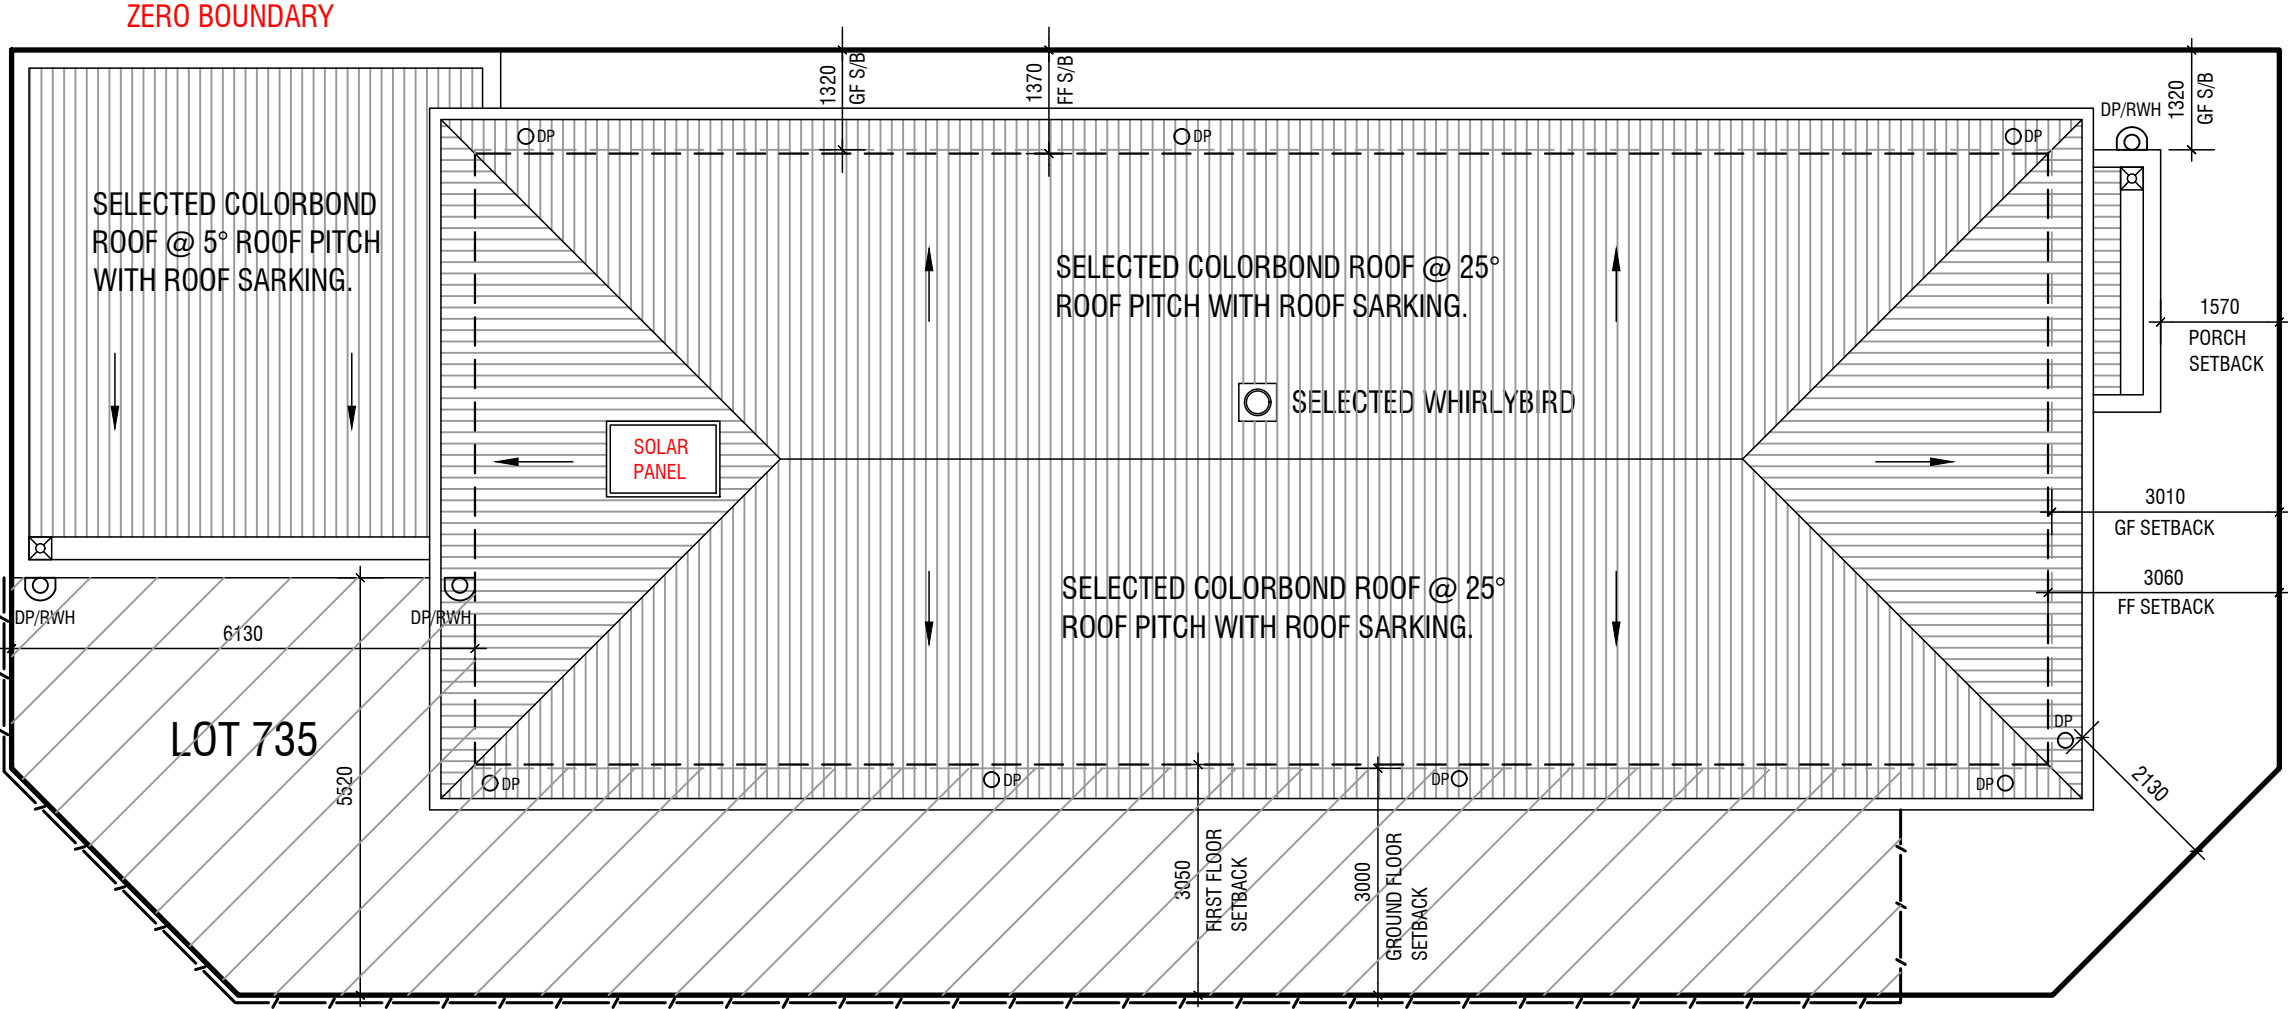

SITE & ROOF PLAN

SCALE 1:100



Private Open Space = 85.73 sqm

AREA SCHEDULE

SITE	366.00	
HOUSE	SQM	SQS
GROUND FLOOR AREA	151.15	16.27
FIRST FLOOR AREA	168.14	18.09
PORCH	4.99	0.54
ALFRESCO	18.60	2.00
GARAGE	43.85	4.72
TOTAL AREA	386.73	41.62
SITE COVERAGE	218.59	59.72%
HARD SURFACE AREA	-	
TOTAL HARD SURFACE AREA	-	-
PERMEABILITY	147.41	40.28%
PRIVATE OPEN SPACE	85.73	

REVISION	DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024 E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
ROOF PLAN

ISSUE DATE: 16.01.2024

SCALE: 1:100 @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:
04

SITE NOTES

DIAL 1100 dial before you dig.
Builder/contractor to confirm location of existing services prior to commencement of any works.

Levels relating to ground levels are indicative only and should be checked and verified on site by Builder/Contractor prior to commencement of any building works.

Required fill and compaction to be in accordance with A.S.2870-2011.

Provide site and work place protection (fences / hoarding /safety barriers etc. as required by local authority by-laws, and worksafe practices, to be provided by owner.

Chemical toilet and rubbish bin with lid to be provided during construction when required.

All oh&s safe work practices & procedures must be followed & adhered to, & to include, but is not limited to, electrical leads tagged, protective clothing & equipment used, provision of complete first aid kit, & site kept clean.

Builder to be supplied with method statement prior to commencement onsite by contractors & sub contractors.

The builder/contractor shall be totally responsible for and at all times to provide a safe working environment in the vicinity of the site of works in full compliance with the occupational health and safety regulations.

Tree root protection, where required, shall be in accordance with TN61, and constructed in accordance with engineer's design.

Barriers are to be provided by owner or contract variation.

Retaining walls to be constructed immediately after excavation. Allow 5kpa surcharge on boundary U.N.O. Retaining walls to be constructed & protection notice served in accordance with building act 1993.

Owner/contractor is to provide insurance, survey of existing conditions & neighbour's consent for construction in accordance with act. Batters are at 45° & thatched or landscaped U.N.O. cut off drains at base of excavation to connect to storm water drains via silt pit with grated cover by builder/contractor.

Walls on boundaries to comply with rescode clause 54 a.11-13. max ave. height 3.2m on or within 200mm of boundary title. min 1.0m light court to neighbours habitable windows no part of building to encroach boundary title.

Fire separation of buildings on boundary to NCC 2019 Volume 2

Buildings adjacent to easement to have footings directed to a depth past angle of repose of pipes and to have footing system designed to comply accordingly. Refer to engineer's design, attached detail &/or as directed by local authority.

The location of existing stormwater and sewer pipes to be checked and confirmed for location and depth prior to commencement of any work. This extends to any pipework whether within easement on the property, and or easements that adjoin the subject property.If any discrepancies occur contact the relevant authority immediately.

Rainwater tanks to be installed as per plumbing regulation and local authorities. The rainwater tank must have a minimum capacity of 2000 litres, have a catchment area of at least 50m2 and be connected to all sanitary flushing systems.

Tanks to be provided with an automatic or manual interchange device to provide a continual supply of water for sanitary flushing.

Provide 100mm thick paving with SL82 mesh top with 20mm layer of fine crushed rock under. The entire site to be drained so that no water be shed to adjoining property whether it council or otherwise. (refer to eng's paving detail if required.)

All new crossings to be approved and constructed in accordance with responsible local authority specification.

Driveway grades, owners are advised that driveway gradients within the property should be at 1 in 5 maximum and that transitions may be required at changes of grades. Refer to A.S. 2890 for design requirements.

Eaves within 900mm (but no closer than 450mm) of the title boundary shall be constructed of noncombustable materials

Eaves exposed to within 450mm of the title boundary shall be protected by either a wing wall or corbelled brickwork

Rainwater heads, fascias, gutters, downpipes and the like within 450mm of the boundary shall be constructed of noncombustible materials.

Flues, chimneys, pipes, domestic fuel tanks, cooling or heating appliances or other services must not be built within 450mm of boundary.

Openings in external walls within 900mm from the side boundary require to be protected, ie. windows shall be fixed, fire rated windows no less than --/60/--.

DRAINAGE NOTES

Sites should be drained so that water cannot pond against or near the building. The ground immediately adjacent to the building should be graded to fall 50mm over the first metre. Where this is impracticable (i.e. on several sloping sites) use A.G. drains adjacent to footings where the ground falls towards the building. Good drainage and paving around house is recommended to ensure long term performance of building. Provide min. 90mm dia U.P.V.C. stormwater drains with 1:100 fall, connected to legal point of discharge. Stromwater drain and down pipe layout shown is to be installed as follows:

- SW pipes to be minimum 800mm from slab edge.
- AG drains to be minimum 100mm from base cut.
- Silt pits are to be installed min 15 meters apart and at change of AG pipe direction.

All drainage to be in accordance with plans prepared by drainage engineer and connected to legal point of discharge as advised by responsible authority. Design and construction of storm water drainage system to comply with AS 3500.3. Storm water drains min 100mm to a min gradient of 1:00 downpipes a min 90mm diameter. Roof drainage design is the responsibility of the licensed roof plumber. The area around the perimeter footing shall be graded to prevent ponding of water either directly beside or adjacent to footings.

STORMWATER & SEWER CONNECTIONS

The owner builder/builder/contractor is to ensure that all connection points are to comply to all relevant authorities requirements. If not certain you must contact the local authorities for recommendations.

LEGAL POINT OF DISCHARGE

Plumbing contractor is to connect stormwater drains to council nominated legal point of discharge. (Storm water systems is to comply with AS/NZS 3500.5.)

- ☐ dp. Location of new downpipes.
- i.o. Location of inspection openings at 9.0m cts max. & at each change of direction.

TEMPORARY DOWNPIPES

Temporary downpipes are to be used until downpipes are connected. This is to prevent water ponding next to slab .

BUSHFIRE ATTACK LEVEL: BAL. LOW

The proposed design must be constructed in accordance with AS 3959 and NCC 2019 Volume 2.

SITE SURVEY

The builder/owner is to ensure that all title boundary pegs are located prior to set out, if title boundary cannot be identified, the builder/owner is to engage a licensed land surveyor to re-establish the title boundaries.

VEHICLE CROSSINGS

New vehicle crossings must be constructed to the standards and specifications to the satisfaction of the responsible authority.

WARNING: UNDERGROUND SERVICES

Beware of underground services, take extreme care. The exact location of underground services shall be investigated on site. No guarantee is given that all existing services are shown.

SITE ASSETS

It is the responsibility of the owner/builder during construction to remove, retain, relocate or protect existing and proposed assets, i.e. kerbs, crossovers, power poles etc, whilst conforming to all relevant authorities requirements.

ROOF PLUMBER

Roof plumber is responsible for design, construction and certification of roof drainage.

PROPERTY INFORMATION

Termite prone area: NO
Flood prone area: NO
Bushfire prone area: NO
Designated land to water: NO
Snow fall area: NO

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the

Building Act 1993 & Building Regulations

2018

24 HOURS NOTICE REQUIRED FOR INSPECTIONS

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

CLIENT:

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

DRAWING NAME:
SITE NOTES

ISSUE DATE: 16.01.2024		
SCALE:	N/A	@ A3
DRAWN:	E.C.	
CHECKED:	E.C.	



PROJECT NO: 042224

SHEET NO:

05


SLAB SETOUT NOTES
Site cut required as per nominated levels shown on plan.
Builder is to confirm site.
F.F.L. to be confirmed on site by building supervisor after the completion of site works.
Levels relating to ground level are approximate only and are to be checked and verified on site by builder prior to commencement of any building works.
Required fill and compaction to be in accordance with A.S. 2870 - 2011.
All works including bricks, concrete slabs and footings shall comply with the requirements of the relevant Australian Standards and the NCC 2019 Volume 2.

DRAINAGE NOTES
Clause 5.6.3 (AS2870-2011) – Drainage Requirements for moderately, highly & extremely reactive sites).
The base of trenches shall be sloped away from the building.
Trenches shall be backfilled with clay in the top 300mm within 1.5m of the building. The clay used for backfilling shall be compacted.
Where pipes pass under the footing system, the trench shall be backfilled full depth with clay or concrete to restrict the ingress of water beneath the footing system.
Where pipes pass under the footing system, the trench shall be back filled full depth with clay to act as a barrier to the ingress of water beneath the footing system.
Alternatively, a plastic membrane across the cross – section of the trench, taped to the pipe and keyed into the side and base of the trench may be used.
Subsurface drains to remove groundwater shall not be used within 1.5m of the building unless designed in accordance with engineering principles.

Surface water drainage.
The external finished surface surrounding the slab must be graded to give a slope of not less than
(i) 25 mm over the first 1 m from the building for surfaces that are reasonably impermeable or
(ii) 50 mm over the first 1 m from the building.

SURFACE WATER DRAINAGE
The external finished surface surrounding the slab must be graded to give a slope of not less than:
- 25 mm over the first 1 m from the building for surfaces that are reasonably impermeable or
- 50 mm over the first 1 m from the building.

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

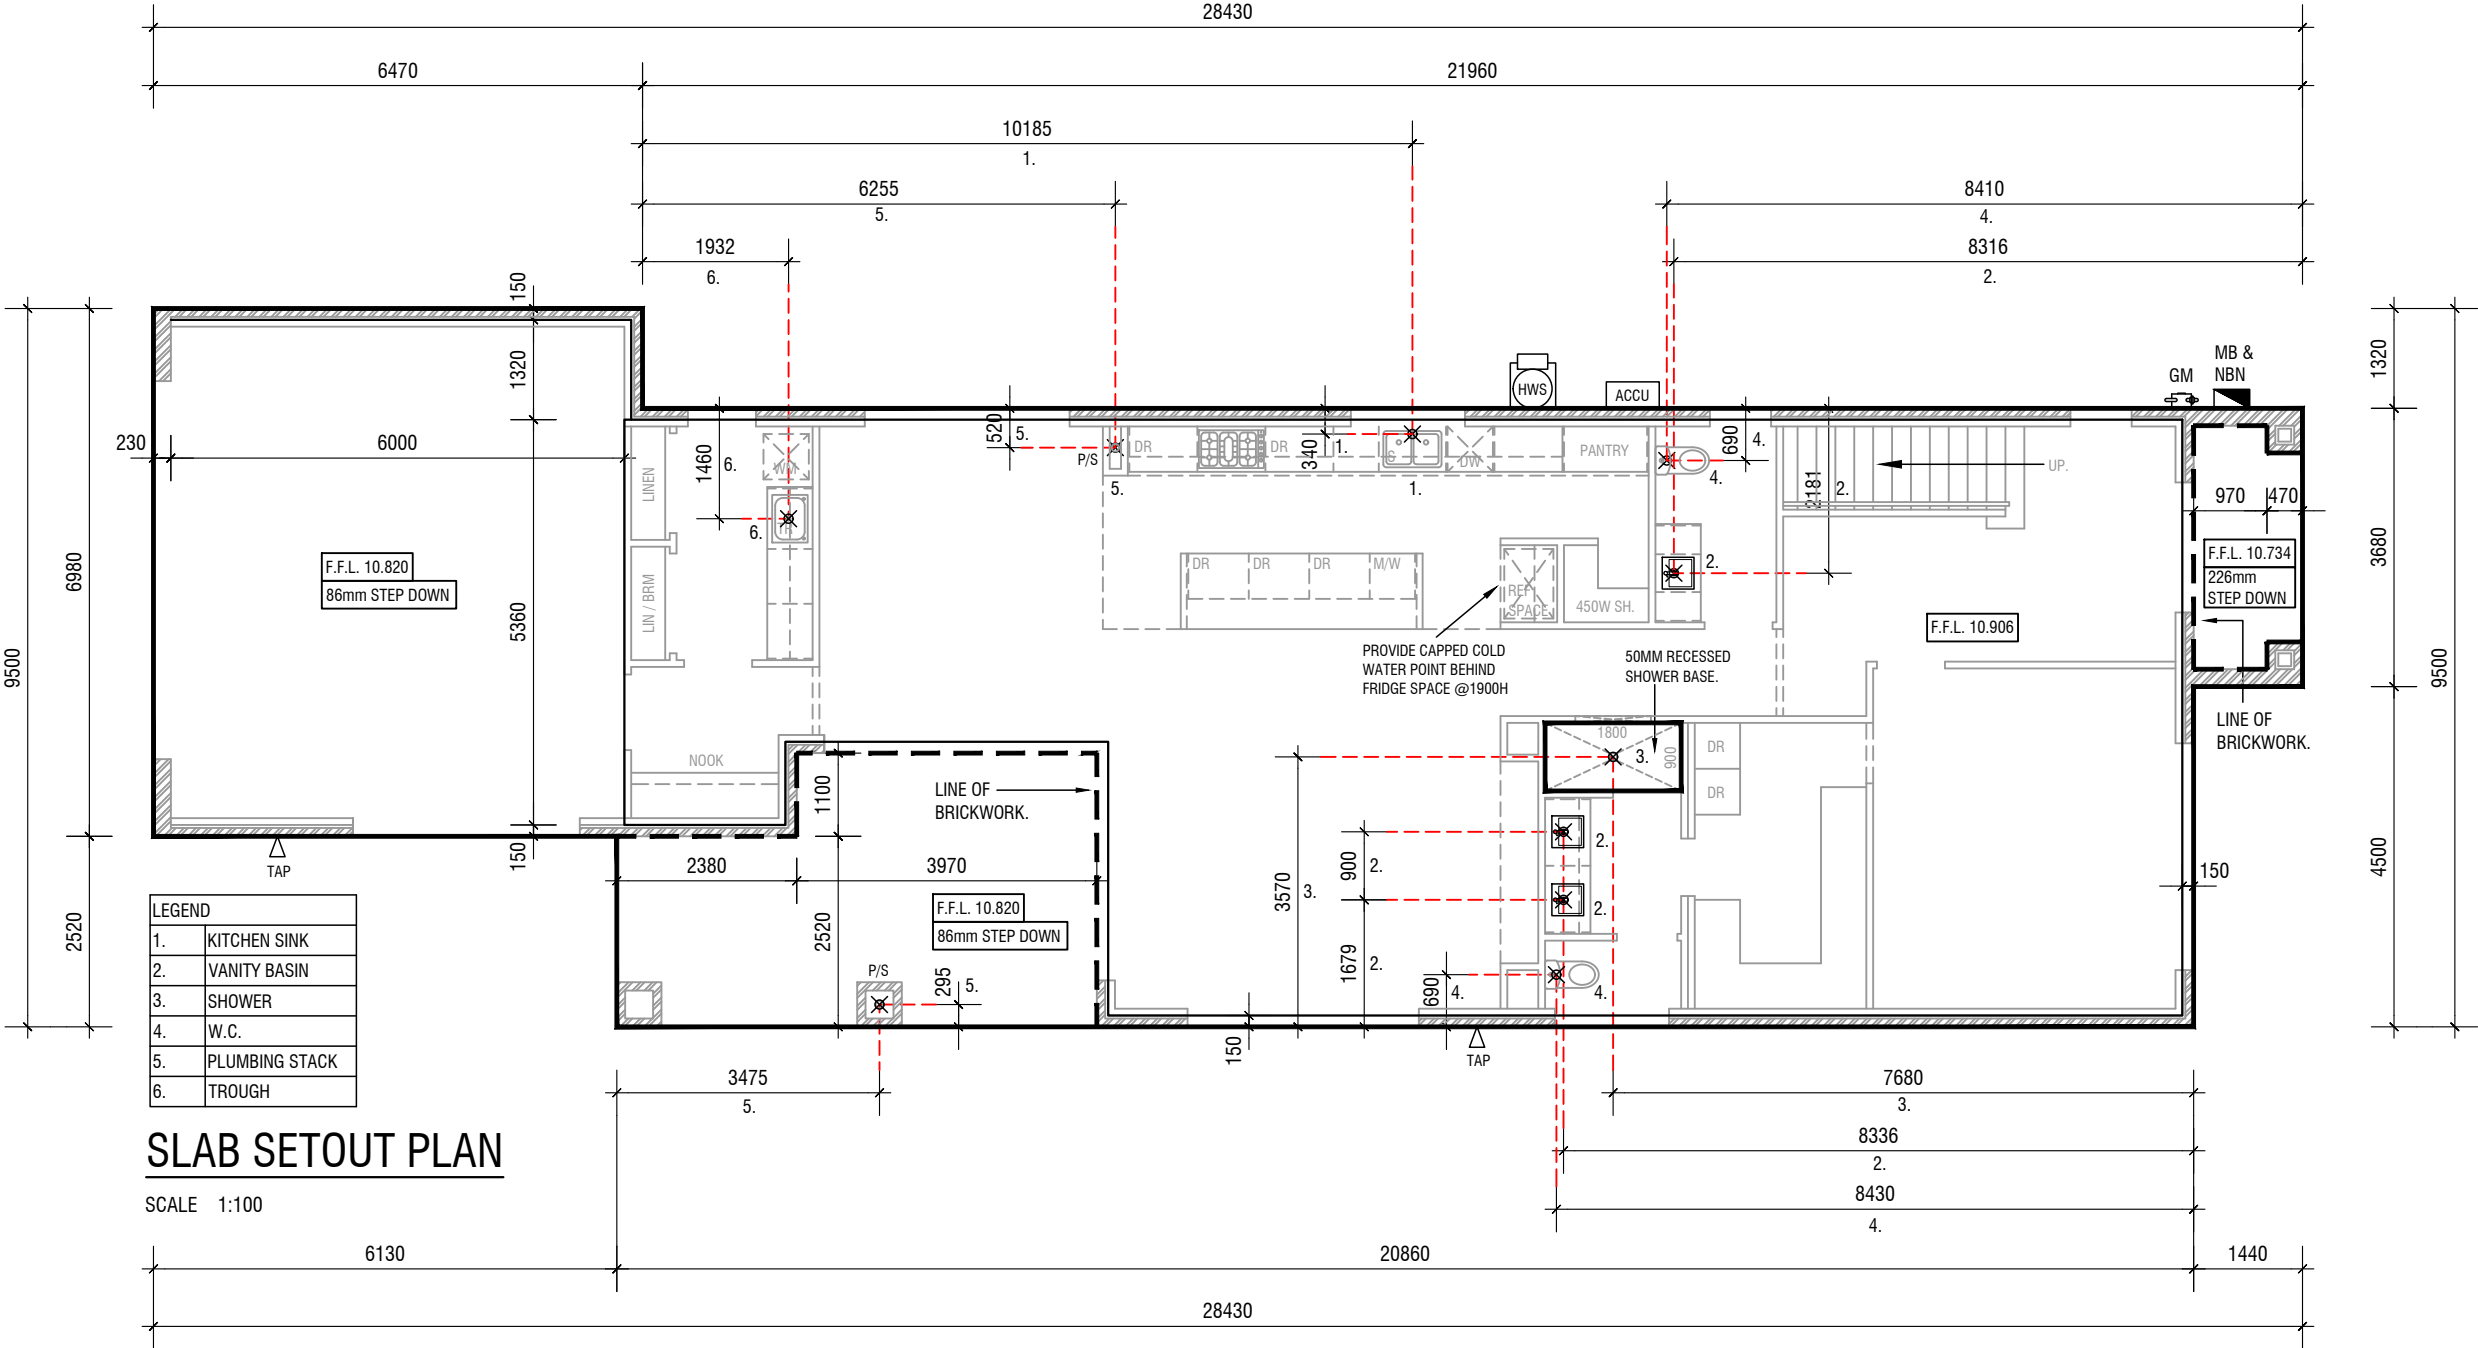

SLAB SETOUT PLAN

SCALE 1:100

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:
SLAB SETOUT PLAN

ISSUE DATE:	16.01.2024
SCALE:	1:100 @ A3
DRAWN:	E.C.
CHECKED:	E.C.



PROJECT NO: 042224

SHEET NO:
06


GENERAL NOTES/LEGEND

-  F EXHAUST FANS REQUIREMENTS. MECHANICAL EXHAUSTS ARE REQUIRED IN THE SANITARY FACILITY ROOMS: 25L/S FOR BATHROOM OR SANITARY COMPARTMENTS. VENTED EXTERNALLY
-  F EXHAUST FANS REQUIREMENTS. MECHANICAL EXHAUSTS ARE REQUIRED IN THE SANITARY FACILITY ROOMS: 40L/S FOR KITCHEN AND LAUNDRY. VENTED EXTERNALLY
-  S/D LOCATION OF SMOKE DETECTORS.
-  HWS LOCATION OF THE HOT WATER SERVICE, WITH GAS BOOSTERS & ROOF PANELS.
-  MB LOCATION OF THE METER BOX.
-  F.F.L. 00.00 FINISH FLOOR LEVELS.

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

GENERAL NOTES/LEGEND


-  DP LOCATION OF NEW DOWN PIPES.
-  S/DP LOCATION OF NEW DOWNPIPES/SPREADER.
-  DP/RWH LOCATION OF NEW DOWN PIPES & RAIN WATER HEAD CONNECTED TO STORM WATER SYSTEM.
-  300MMSQ X 150MM DEEP SUMP WITHIN BOX GUTTER
-  W 01 D 01 REFER TO WINDOW & DOOR SCHEDULE.
-  TAP LOCATION OF EXTERNAL WATER TAP
-  W/H L/V LOCATION OF ROOF ACCESS MAN HOLE. TO BE CONFIRMED ON SITE.

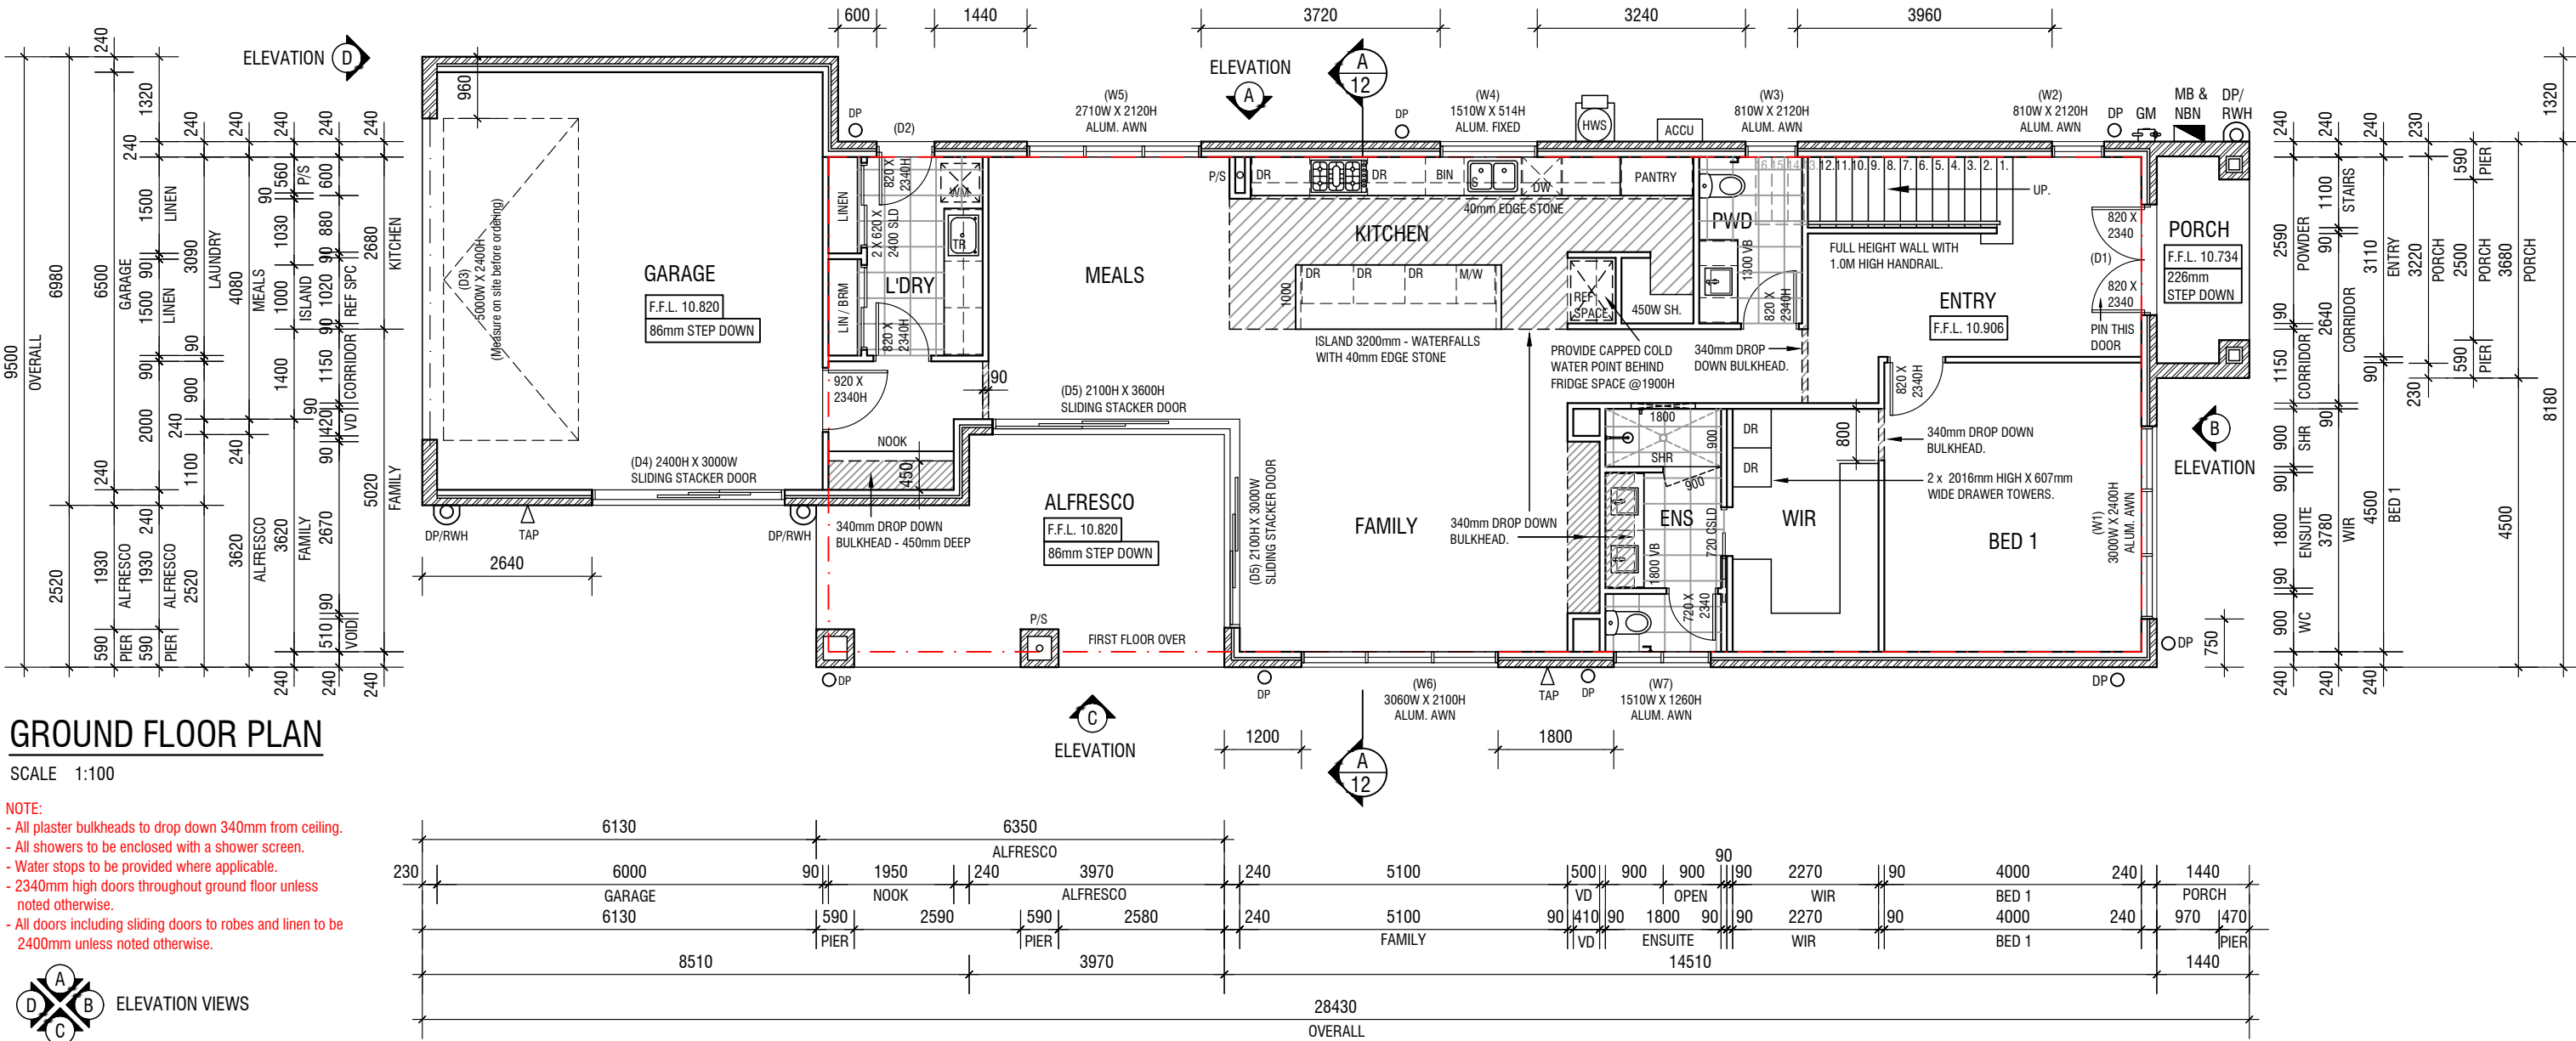

	EXHAUST FANS REQUIREMENTS. MECHANICAL EXHAUSTS ARE REQUIRED IN THE SANITARY FACILITY ROOMS: 25L/S FOR BATHROOM OR SANITARY COMPARTMENTS. VENTED EXTERNALLY
	EXHAUST FANS REQUIREMENTS. MECHANICAL EXHAUSTS ARE REQUIRED IN THE SANITARY FACILITY ROOMS: 40L/S FOR KITCHEN AND LAUNDRY. VENTED EXTERNALLY
	LOCATION OF SMOKE DETECTORS.
	LOCATION OF THE HOT WATER SERVICE, WITH GAS BOOSTERS & ROOF PANELS.
	LOCATION OF THE METER BOX.
	FINISH FLOOR LEVELS.

GENERAL NOTES/LEGEND

- DP LOCATION OF NEW DOWN PIPES.
- S/DP LOCATION OF NEW DOWNPIPES/SPREADER.
- Ⓒ DP/RWH LOCATION OF NEW DOWN PIPES & RAIN WATER HEAD CONNECTED TO STORM WATER SYSTEM.
- ☒ 300MMS X 150MM DEEP SUMP WITHIN BOX GUTTER
- Ⓜ/01 Ⓛ/01 REFER TO WINDOW & DOOR SCHEDULE.
- ◁ TAP LOCATION OF EXTERNAL WATER TAP
- Ⓜ/H/1 LOCATION OF ROOF ACCESS MAN HOLE. TO BE CONFIRMED ON SITE.

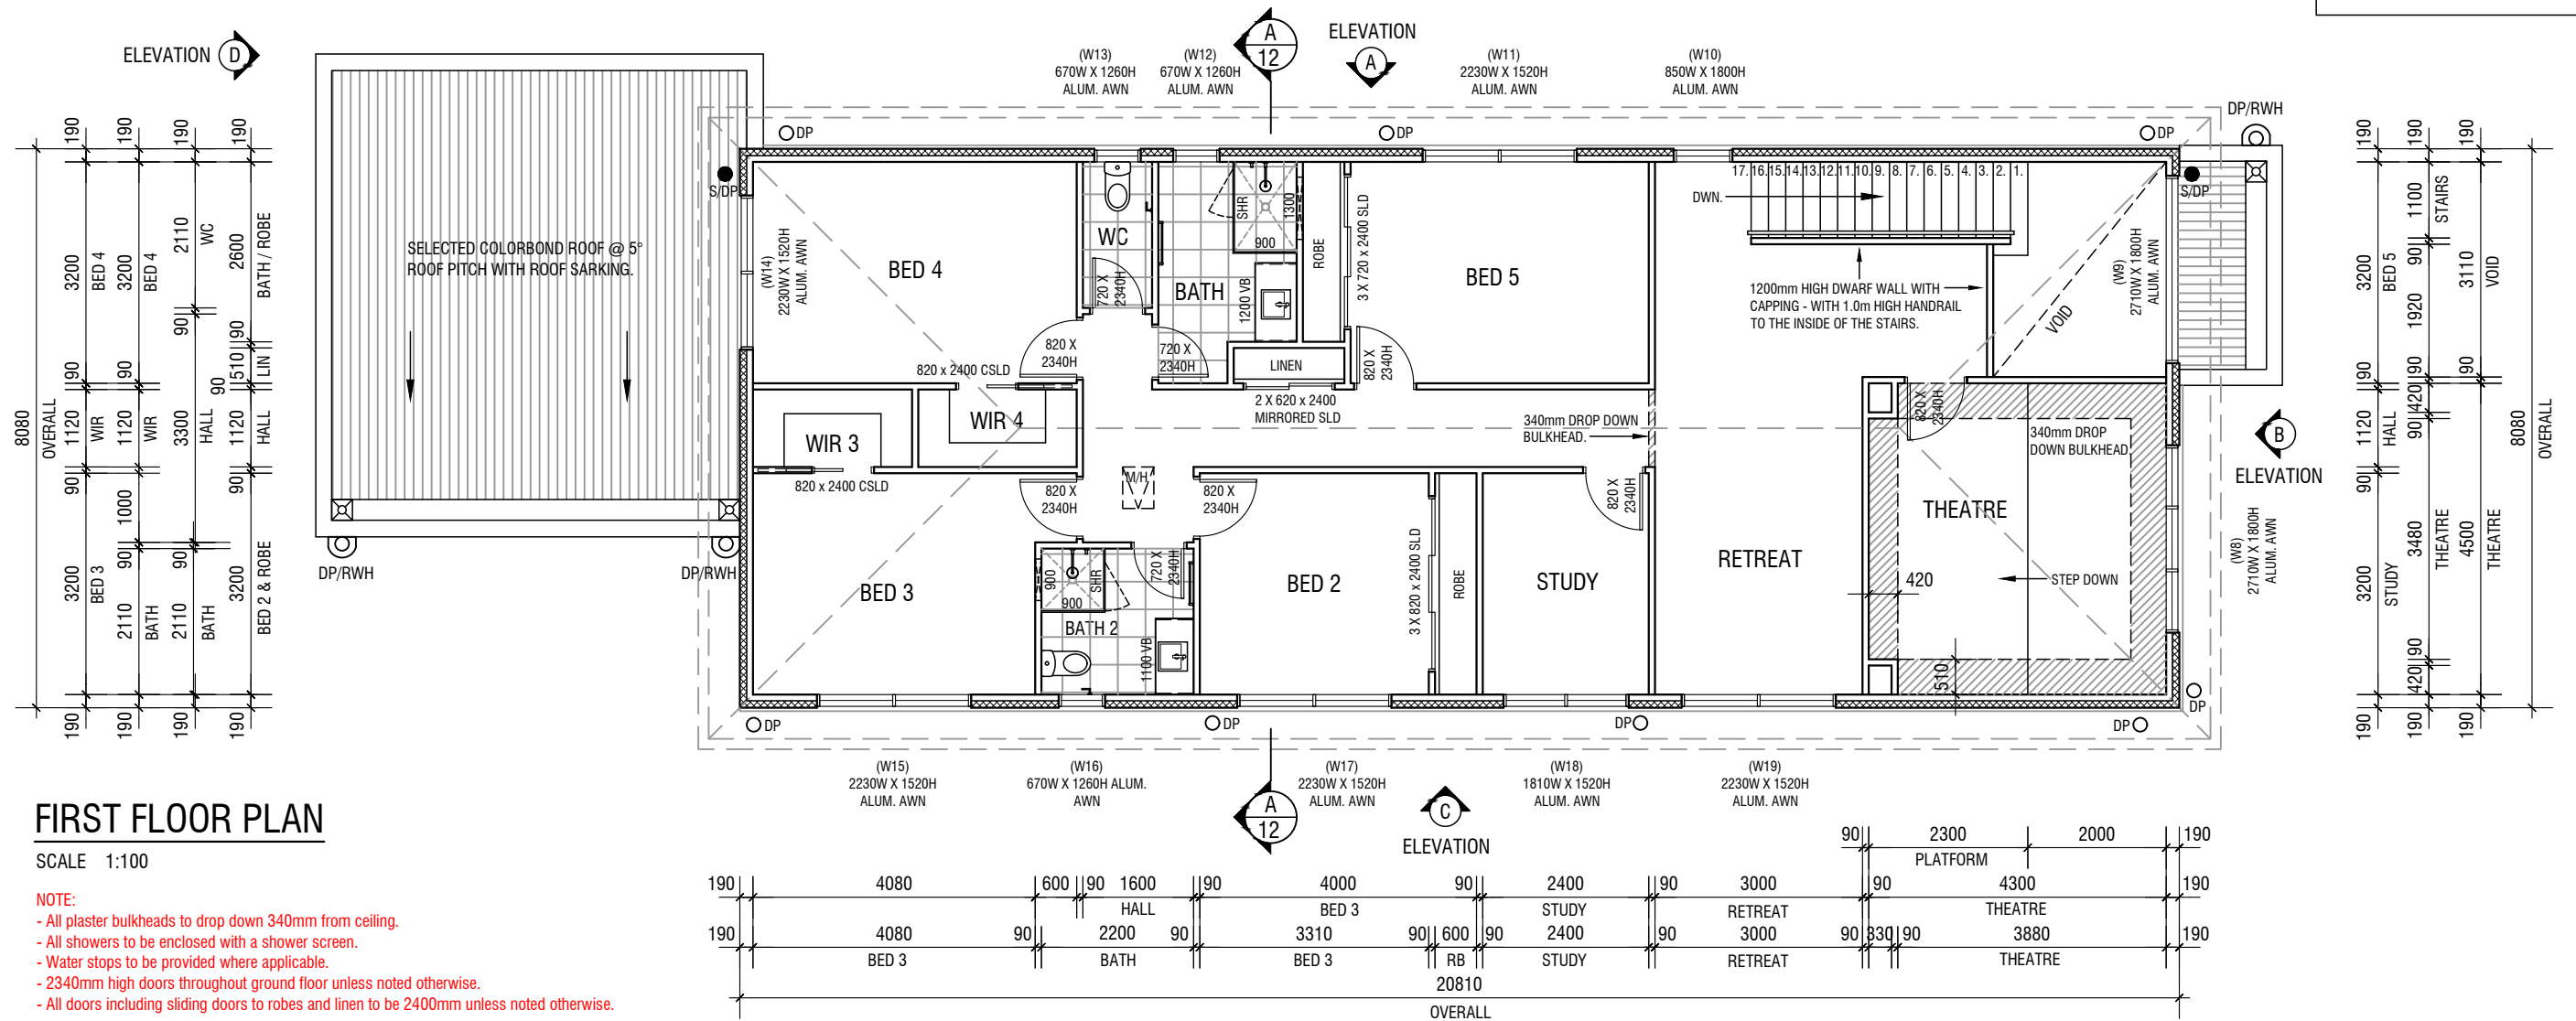

NOTE:

- All plaster bulkheads to drop down 340mm from ceiling.
- All showers to be enclosed with a shower screen.
- Water stops to be provided where applicable.
- 2340mm high doors throughout ground floor unless noted otherwise.
- All doors including sliding doors to robes and linen to be 2400mm unless noted otherwise.

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:
FIRST FLOOR PLAN

ISSUE DATE: 16.01.2024	
SCALE:	1:100 @ A3
DRAWN:	E.C.
CHECKED:	E.C.



PROJECT NO: 042224

SHEET NO:

08

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations 2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS


- ELEVATION NOTES**
- Levels relating to ground levels are indicative only and should be checked and verified on site by Builder/Contractor prior to commencement of any building works.
 - Obscure glazing or film to be provided to 1.7m above FFL. (Finished Floor Level) to applicable windows where overlooking issues arise.
 - Grade soil away from building towards drains.
 - Extent & number of steps, landings handrails to be determined on site by builder/contract.
 - Articulation joints are to be located in accordance with technical notes and to the satisfaction of the geotechnical structural engineer.
 - Garage doors sizes are to be measured prior to installation.
 - Cavity flashing & weep holes above all openings in brickwork.

CONCRETE STEP NOTE
Concrete steps & landings to be max of 3 risers (570mm) above finished ground level. Concrete steps max riser 190mm min going 250mm

- PROTECTION OF OPENABLE WINDOWS**
- (a) A window opening must be provided with protection, where the floor below is 2m or more above the surface beneath.
- (b) Where the lowest level of the window opening covered by (a) is less than 1.7m above the floor, the window opening must comply with the following:
- (i) The opening portion of the window must be protected with -
- (a) a device capable of restricting the window opening or;
- (b) a screen with secure fittings.
- (ii) A device or screen required by (i) must -
- (a) not permit a 125mm sphere to pass through the window opening or screen.


SOUTH ELEVATION - B

SCALE 1:100

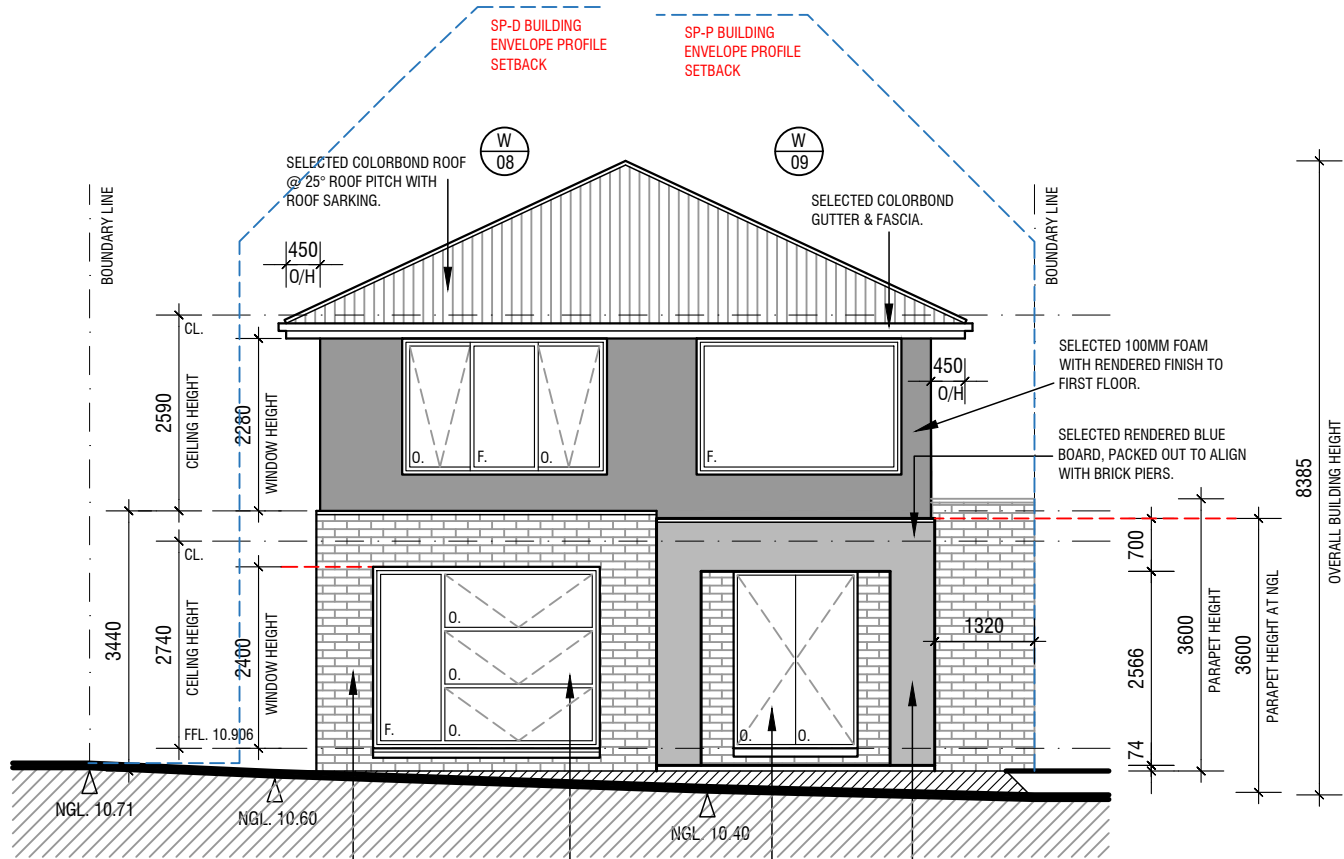

EAST ELEVATION - A

SCALE 1:100

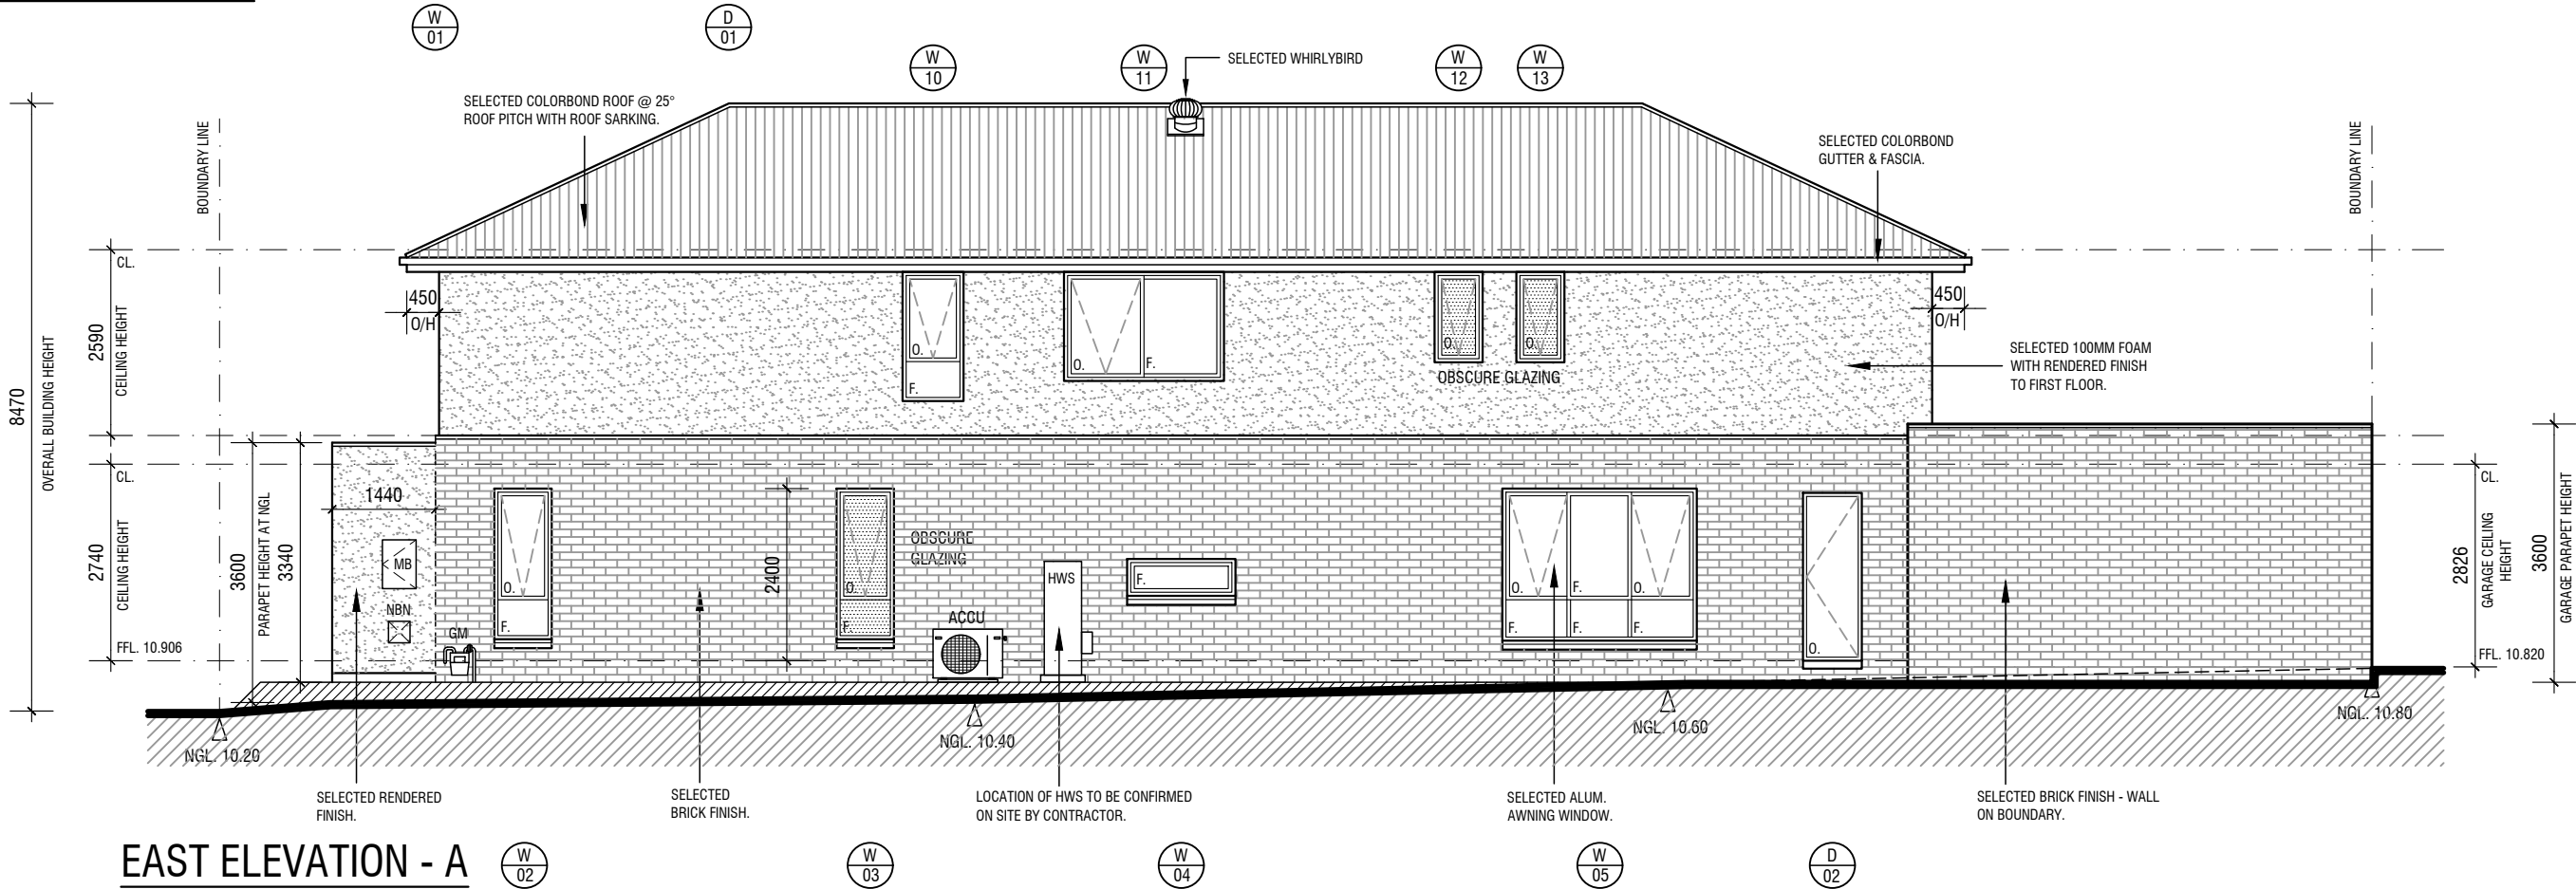

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:
EXISTING ELEVATIONS


ISSUE DATE:	16.01.2024
SCALE:	1:100 @ A3
DRAWN:	E.C.
CHECKED:	E.C.



PROJECT NO: 042224


SHEET NO:

09

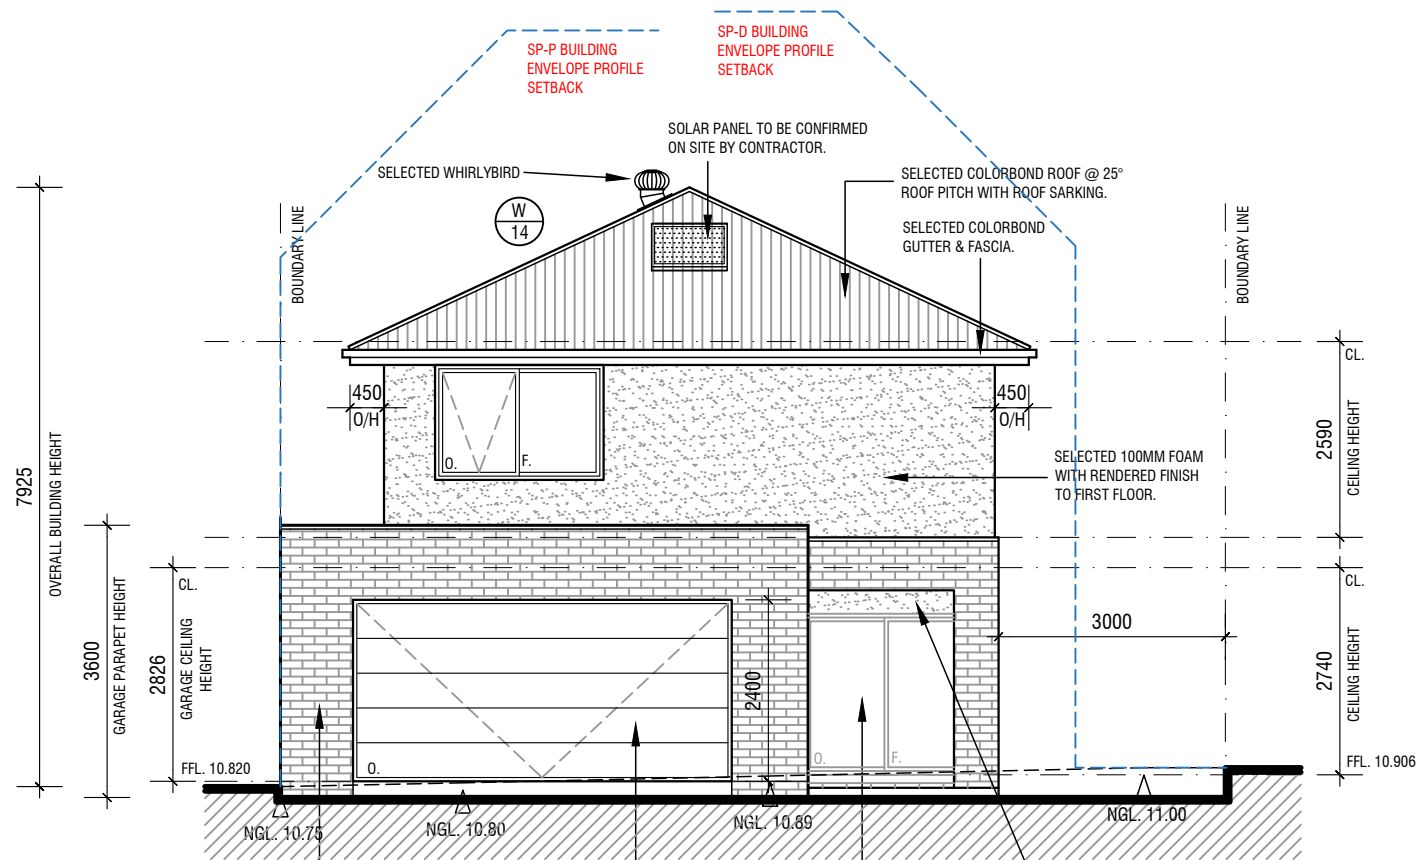

NORTH ELEVATION - D

SCALE 1:100

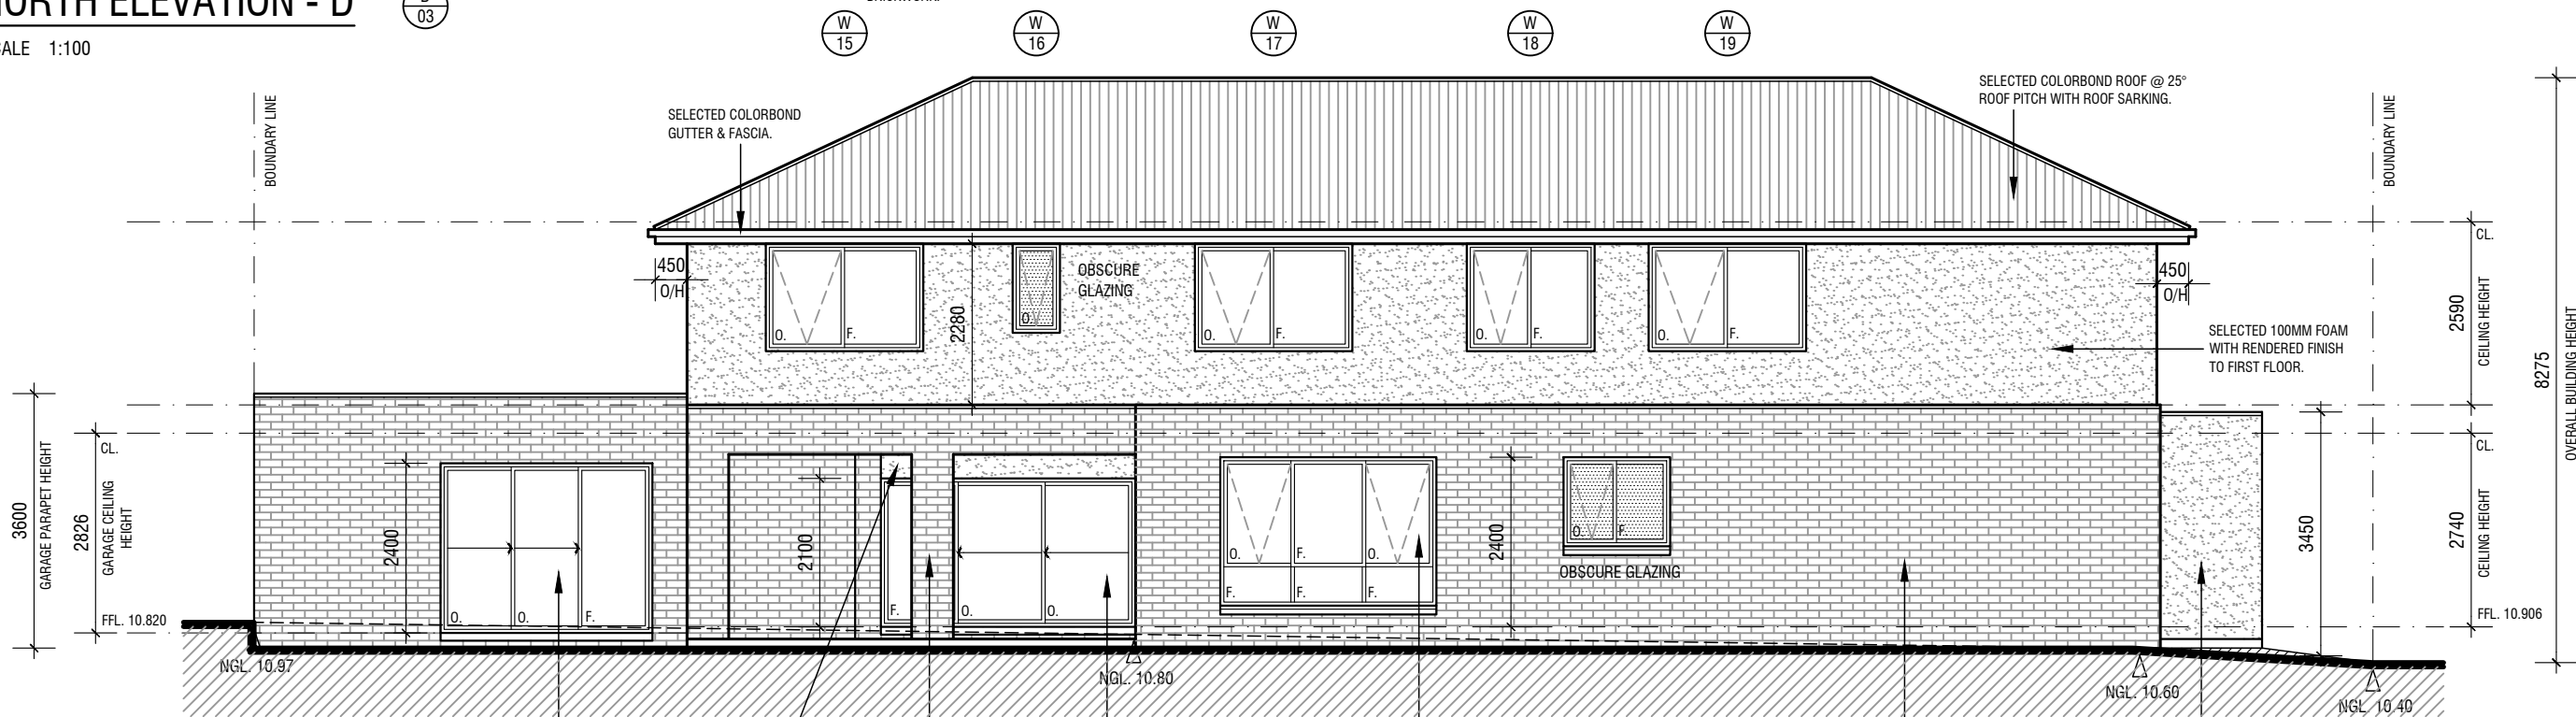

WEST ELEVATION - C

SCALE 1:100

GLAZING NOTE

Glazing to be in accordance with AS1288-2021 and AS2047-2014. All full glazed doors, sidelights, including any glazing capable of being mistaken for a doorway or opening, shall be clearly marked to indicate that they are glazing. The marking shall be a solid non transparent contrasting line. The contrasting line shall be not less than 75mm wide and shall extend across the full width of the glazing panel. The lower edge of the strip shall be located 900mm from the finished floor level. Any contrasting line on the glazing shall provide a minimum of 30% luminance contrast when viewed against the floor surface or surface within 2m of the glazing on the opposite side.

All framed glazing where the lowest sight line of the glazing panel is less than 500mm from the highest abutting FFL must be grade A safety glass or ordinary annealed glass not less than 5mm nominal thickness provided that the area of the glazing panel is not more than 1.2m².

If the presence of glazing in a door, side panel or panel capable of being mistaken for a doorway or opening, the glass must be marked to make it readily visible in the form of an opaque band not less than 20 mm in height located so that –

- the upper edge is not less than 700 mm above the floor; and
- the lower edge is not more than 1.2 m above the floor.

First floor bedroom windows must to be provided with protection as per the requirements of NCC 2019 Volume 2. This is to be provided in the form of:

- A device capable of restricting window opening to a maximum of 125mm, or
- A screen with secure fittings.

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the Building Act 1993 & Building Regulations 2018. The glazing shall be clearly marked to indicate that they are glazing. The marking shall be a solid non transparent contrasting line. The contrasting line shall be not less than 75mm wide and shall extend across the full width of the glazing panel. The lower edge of the strip shall be located 900mm from the finished floor level. Any contrasting line on the glazing shall provide a minimum of 30% luminance contrast when viewed against the floor surface or surface within 2m of the glazing on the opposite side.

Safety glazing to be used in the following cases:-

- All rooms - within 500mm vertical of floor level.
- All glazing in bathrooms, ensuites, spa rooms or showers. Within 2000mm vertical from the bath base. Within 500mm horizontal from bath/shower to shower doors, shower screens and bath enclosures. (including mirrors etc.)
- Laundry - within 1200mm vertical from floor level. Within 300mm vertical of trough.
- Doorways within 300mm horizontal from all doors.
- Ensuite as for shower screens shall be "grade a" safety glass.

Glazing including safety glazing shall be installed to a size, type and thickness so as to comply with:

NCC 2019 Volume 2 for class 1 and 10 buildings within a design wind speed of not more than N3.

Denotes: Window / Doors sizes that must be checked on site by thebuilder/contractor for clearances & fit before ordering/manufacturing.

Window / Door sizes to be checked on site.

- Portion of window / door that is openable.
- Portion of window / door that is fixed.

REVISION

-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

DATE:

20.01.2024

BY:

E.C.

PROJECT:

NEW DWELLING

ADDRESS:

LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:


ELEVATIONS

ISSUE DATE: 16.01.2024

SCALE: 1:100 @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:

10

WINDOW & DOOR SCHEDULE


ALL GLAZING TO COMPLY WITH A.S. 1288-2006 SAA GLASS INSTALLATION CODE
ALL WINDOW, DOOR SIZES & TYPES TO BE CONFIRMED BY CLIENT & BUILDER BEFORE ORDERING.

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the
Building Act 1993 & Building Regulations
2018

24 HOURS NOTICE REQUIRED FOR INSPECTIONS

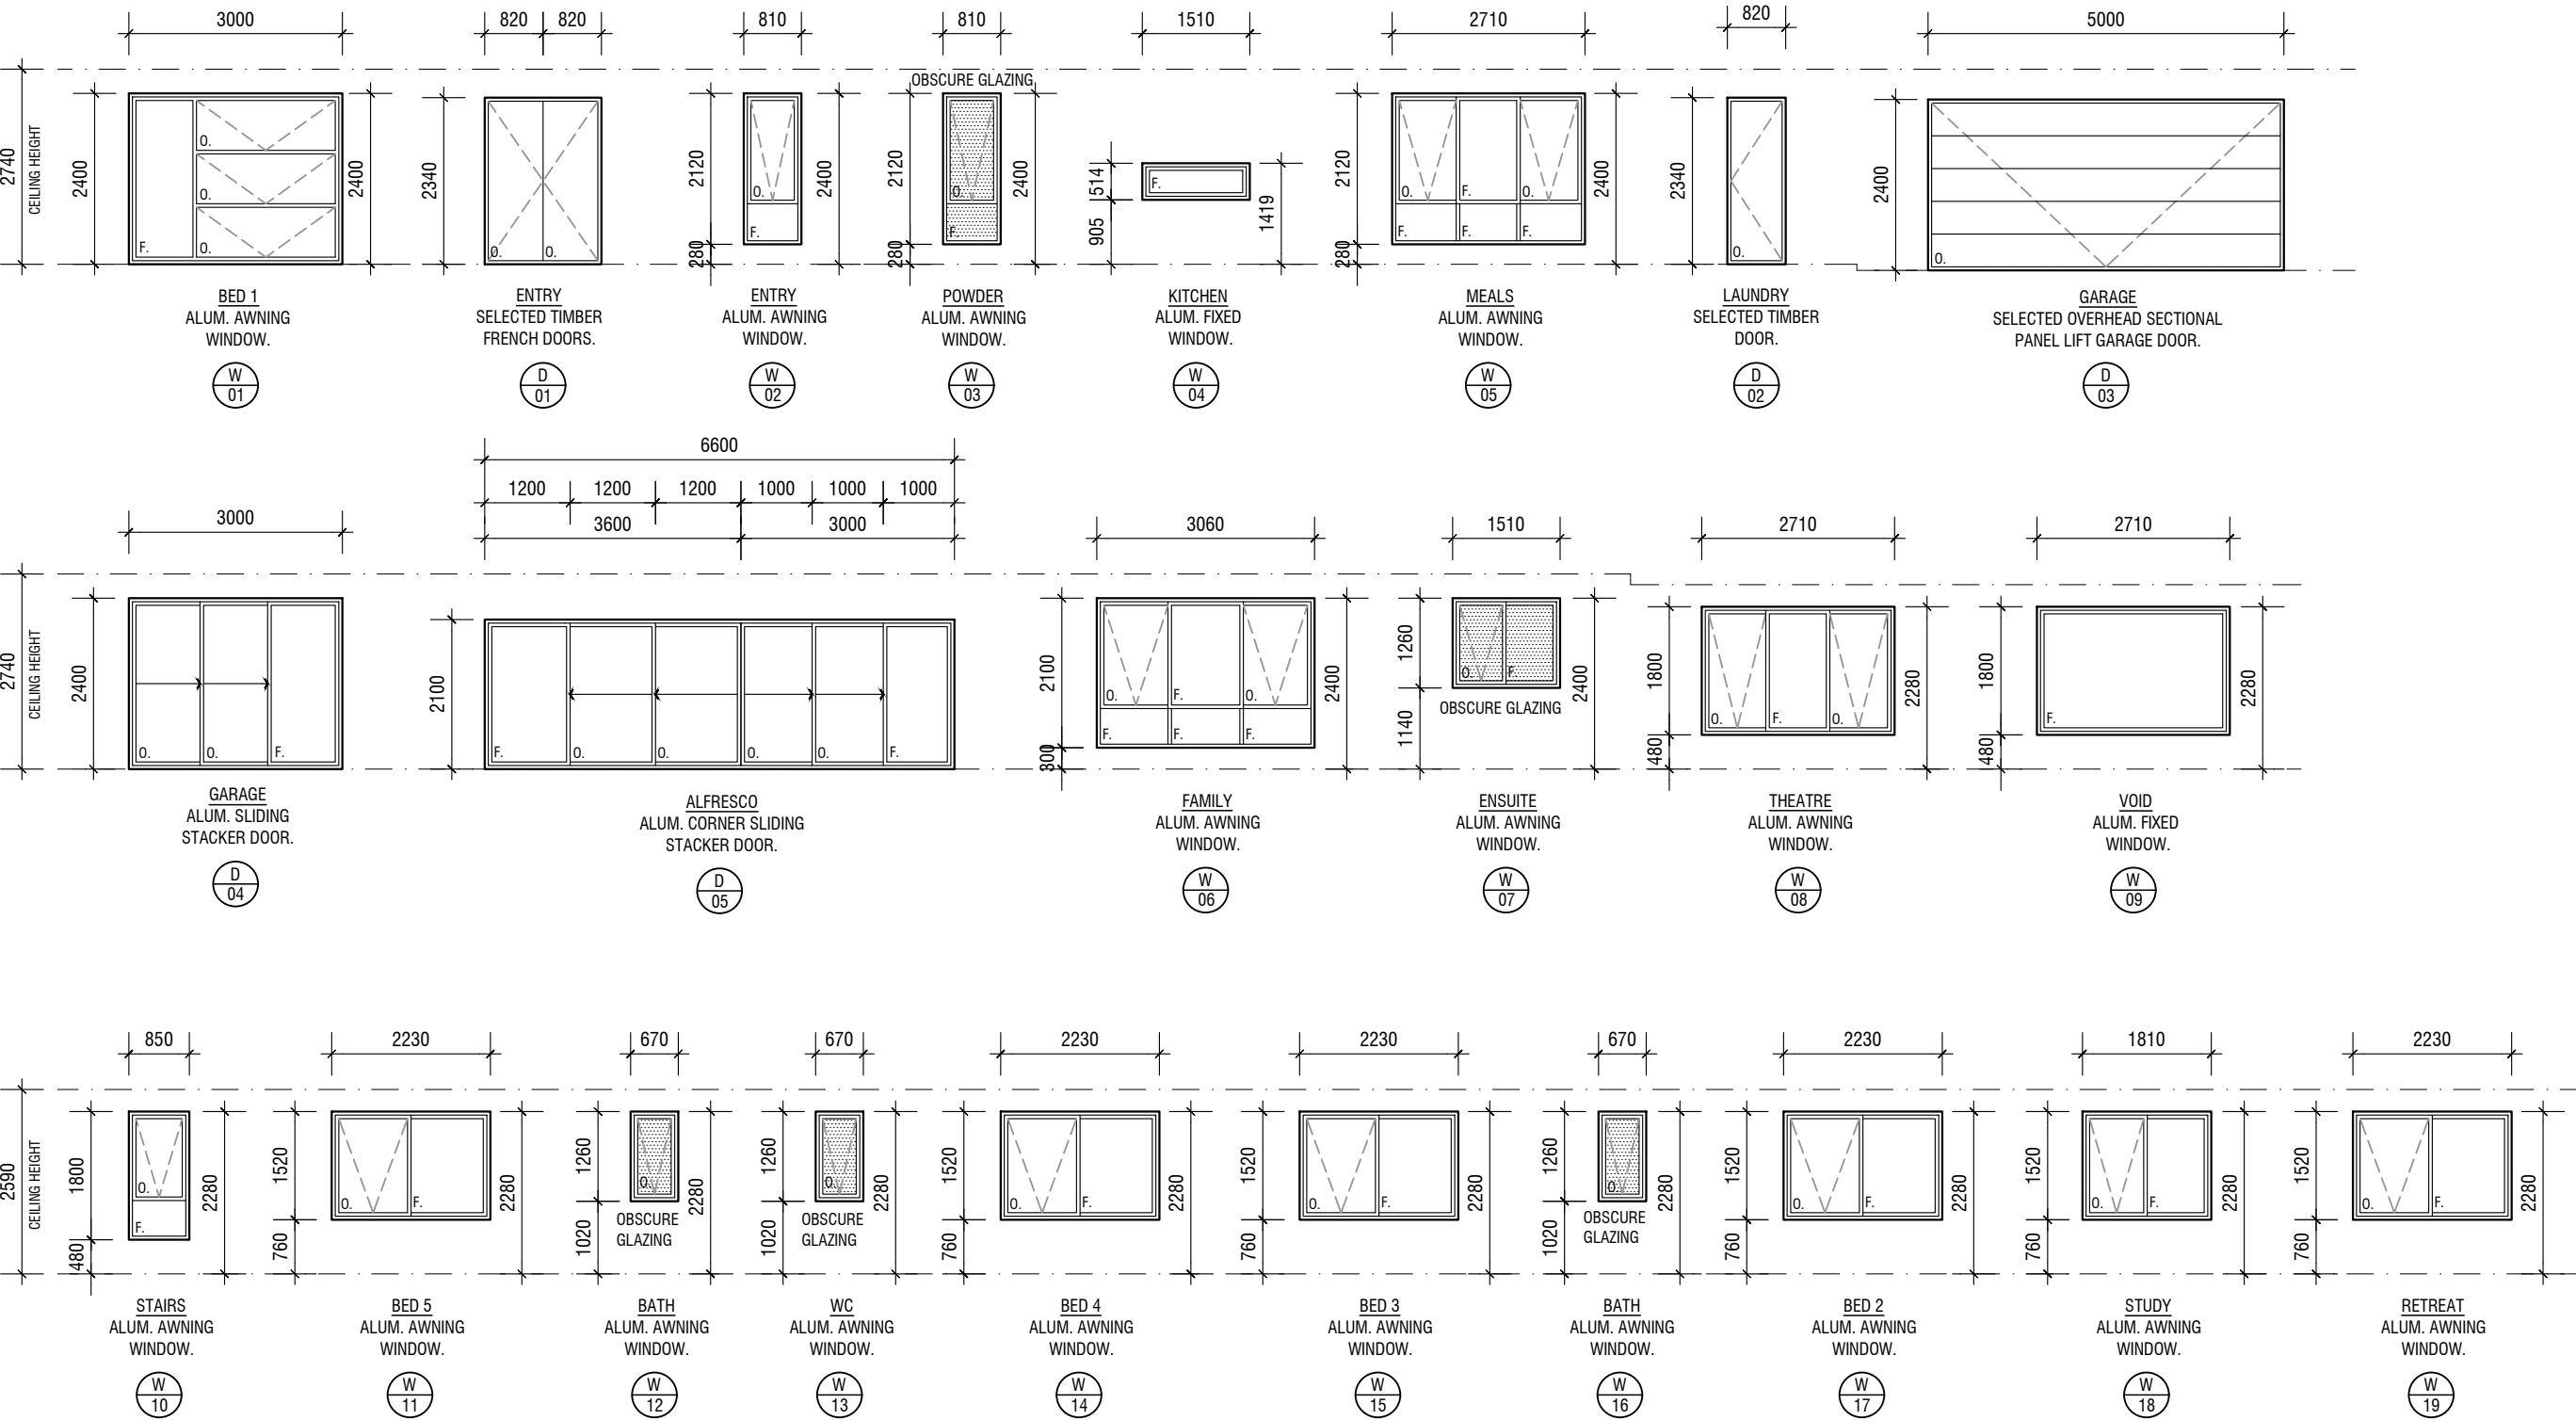

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
WINDOW & DOOR SCHEDULE

ISSUE DATE:	16.01.2024
SCALE:	1:100 @ A3
DRAWN:	E.C.
CHECKED:	E.C.



PROJECT NO: 042224

SHEET NO:
11

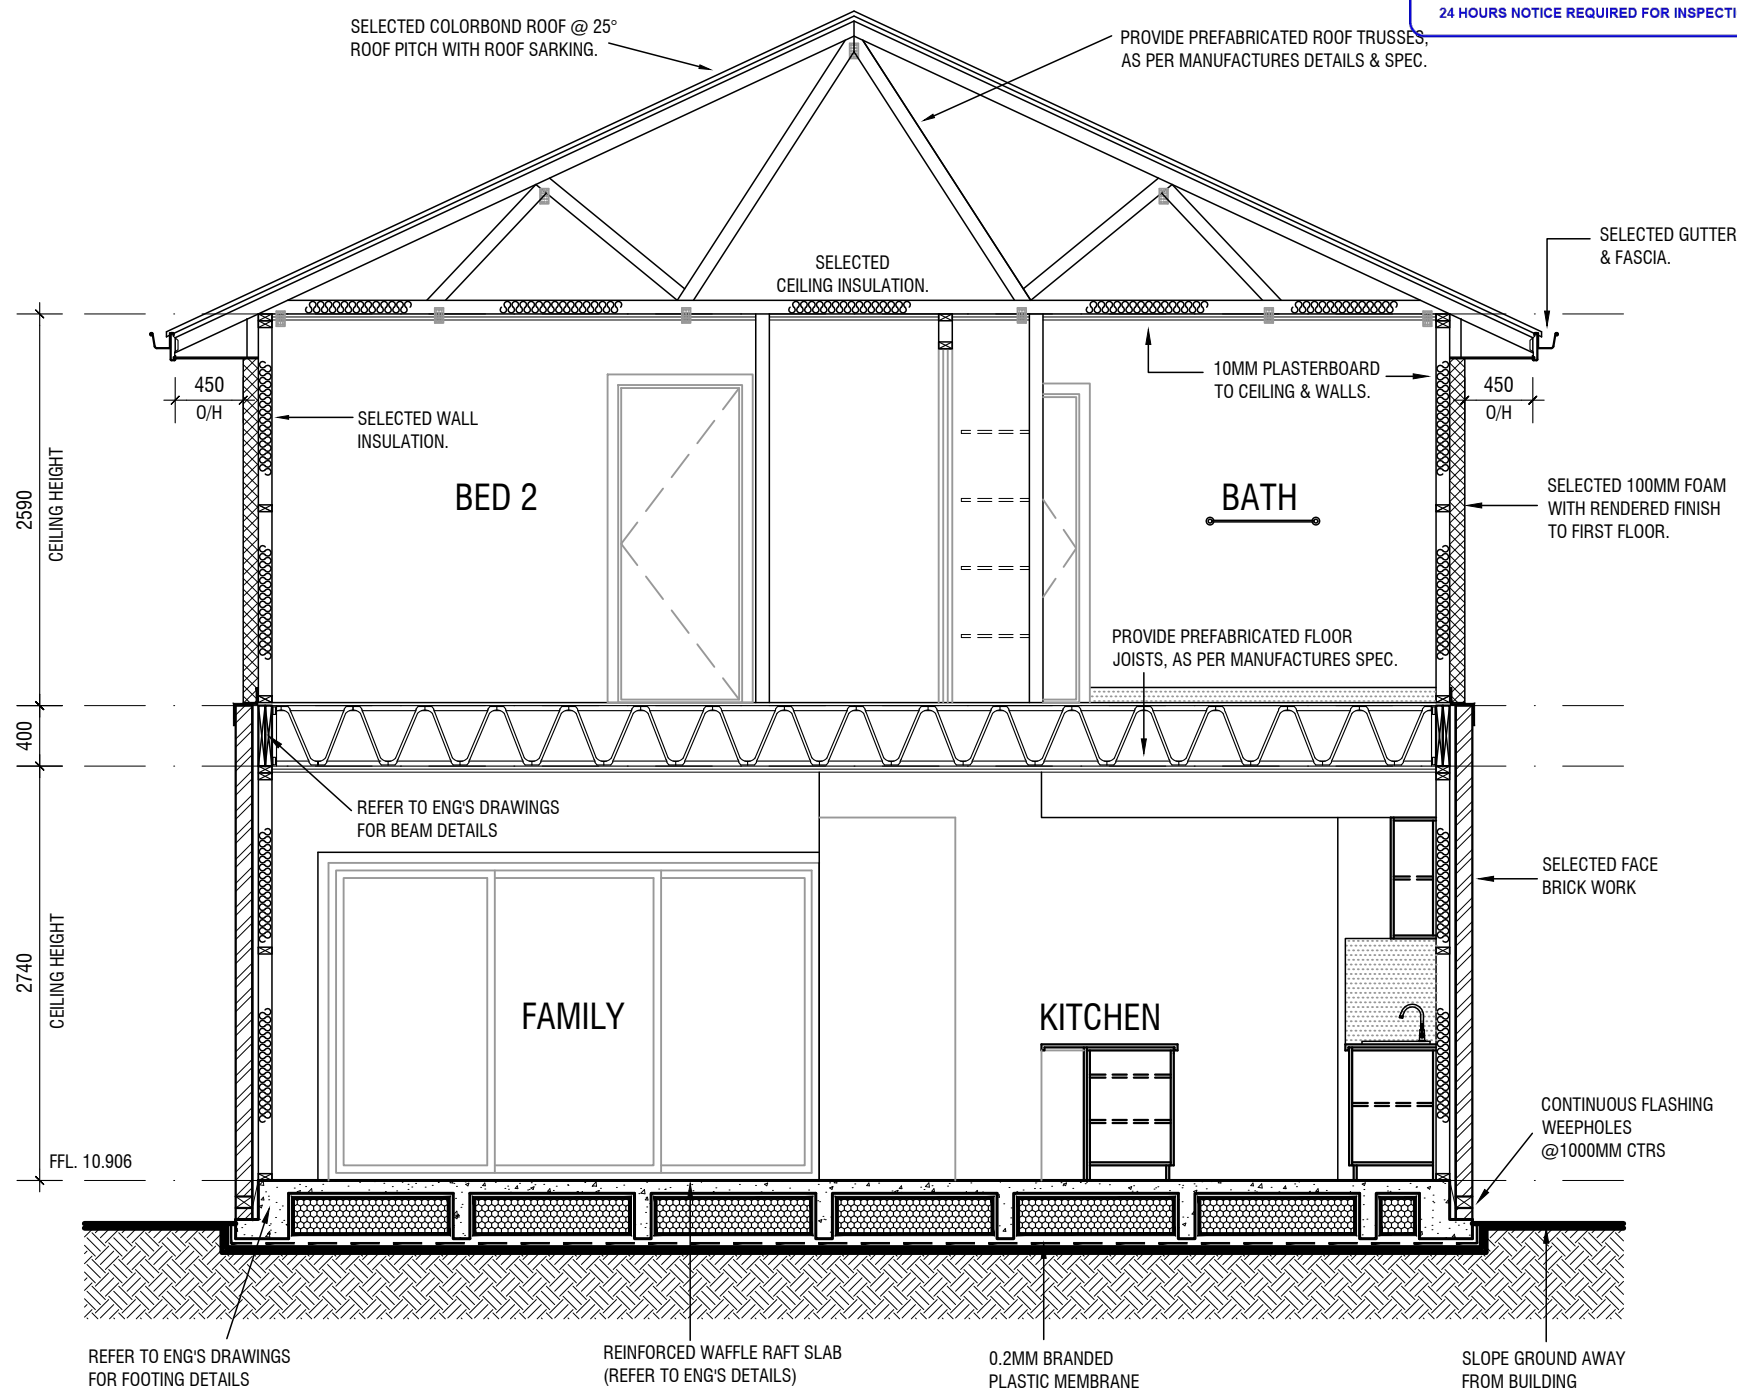

SECTION A-A
SCALE 1:50

REVISION	DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024 E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:
SECTION A-A

ISSUE DATE:	16.01.2024
SCALE:	1:50 @ A3
DRAWN:	E.C.
CHECKED:	E.C.



PROJECT NO: 042224

SHEET NO:
12

SOIL CLASSIFICATION

- This site is classified as "CLASS P" in accordance with A.S. 2870-2011
- Refer to soil report prepared by:
Geo technical consultant: H&I Consulting Engineers
Report date: 05/06/2024 Refer no: 25565-24
Refer to soil report for minimum footing founding depths.

STRUCTURAL DRAWINGS

These drawings should be read in conjunction with structural drawings prepared by others.

DPC NOTES

- The height of a DPC, or flashing serving as a DPC must not be less than-
- 150mm above the adjacent ground level; or
 - 75mm above the finished surface level of adjacent paved, concreted landscaped areas that slope away from the wall.

ENERGY REPORT

Refer to energy rating report for insulation & s isolation details & any other energy efficiency requirements.
As per energy rating report, builder and or contractor to check all report requirements prior to construction.

WATERPROOFING / WET AREAS

Waterproofing of wet areas, being bathrooms, showers, shower rooms, laundries, sanitary compartments and the like shall be provided in accordance with AS 3740-2021. Waterproofing of wet areas in residential buildings. Provide impervious finish to walls ("hardies" 6mm thick villaboard or fully compressed fibre cement, waterproof render, ceramic tile or similar) to a height of not less than 1800mm above the lowest point of the shower, around a shower & 300mm above the rim of the bath, vanity basin, trough or sink refer to manufacturers instructions and specifications.
Provide impervious finish to floors to laundry, bathroom, ensuite, powder rooms, wc & kitchen.
Wet areas are to be impervious to water i.e. wall surfaces and substrates: of shower enclosures, or if unenclosed, within 1.5m horizontally from the fixture and to a height of 1.8m above the floor; and behind any bath, basin, sink etc if within 75mm of a wall to a height of 150mm above the fixture.

3.8.7.2 PLIABLE BUILDING MEMBRANE

- (a) Where a pliable building membrane is installed in an external wall it must:
- (i) comply with AS/NZS 4200.1
 - (ii) be installed in accordance with AS4200.2
 - (iii) be a vapour permeable membrane for climate zones 6, 7 and 8 (iv) be located on the exterior side of the primary insulation layer of wall assemblies that form the external envelope of a building.

Volume 2, Condensation Management Clause 3.8.7.2 ,Part (b)

- (b) Except for single skin masonry or single skin concrete, where a pliable building membrane is not installed in an external wall, the primary water control layer must be seperated from water sensitive materials by a drained cavity.

BRICKLAYERS

All clay/sand lime/concrete bricks or blocks shall conform to A.S. 3700-1998 SAA masonry in buildings & A.S. 2904-1995 Damp Proof Courses & Flashings. Use galvanised face fixing cavity ties to avoid holes in foil insulation material @ 600mm max. horizontal & 450mm max. vertical centres.
Provide masonry articulation joints as recommended by the soil investigation report & in accordance with technical note CN9 of Cement & Concrete Association of Australia.
provide weep holes @ every fourth perpend.
Provide cavity flashing & weep holes above lower storey openings.
For buildings in marine or other exposure environments shall have masonry units, mortar and all built in components and the like complying with the durability requirements of Table 5.1 of AS3700-2001 Masonry Structures

SECTION NOTES

- Prior to ordering trusses check dimensions on site and confirm roof pitch.
- Bracing in accordance with A.S.1684.4 - 2010
- Wall Frame in accordance with A.S.1684.4 - 2010
- Roof tie down in accordance with A.S. 1684.4 - 2010
- All levels are to A.H.D or U.N.O.
- FFL min 150mm above FGL for slabs.
- Truss roof manufacturer is to supply roof framing plans, posi - strut floor joists plans, computations and compliance certificate to be submitted to the building surveyor for approval prior to construction/installation.
- Timber trusses shall be proprietary trusses designed and manufactured using pressed metal connector plates ("gang-nail" or similar). Trusses shall be designed by the manufacturer for the conditions specified, and in accordance with the specifications and any specific loading requirements noted on the structural and architectural drawings.
- The builder shall be responsible for the manufacture, supply an erection of timber trusses, and for all necessary temporary works to ensure that the trusses are correctly located, supported and plumbed, prior to the final connections being made.
- Trusses shall not be cut or altered in any way, and areto be supported at the points nominated on the structural drawings.
- The separating walls between dwellings to have a minimum Rw + Ctr of 50 for sound insulation purposes.

CARPENTER

Refer to engineer's drawings & computations when applicable for all structural timber sizes, grades & allowable spans. Timber framing specification & major roof beam plan in accordance with a.s. 1684.4-2010 national timber framing manual & supplementary tables. Refer to manufactures computation and details if required, before commencing works.

ROOF & WALL FLASHING

Installation of roof tiles to be in accordance with AS2049-2002 & AS2050-2002.
Sheet roof cladding to be designed & installed in accordance with A.S 1562.1-1992.
All tray deck roof sheeting to project a minimum of 50mm into box gutters. Turn up valley corrugations under flashings and cappings at the high end of each roof. Turn down valley corrugations at the low end of each rood only where gutters occur.
All tray deck roof sheeting to be fixed using non corrosive fasteners complying with A.S. 3566
All jointing and sealing of roof sheeting to be carried out in accordance with manufacturers specifications.
Builder to provide continuous flashing at all first floor wall/ground roof junctions.
Provide adequate flashings to all roof wall junctions and to all sills, jambs & heads to windows & doors as required.


CONCRETE SLAB

All concrete footing & slab works shall comply with AS 2870-2011 "Residential Slabs & Footings" Part 1 construction in the absence of engineer's drawings or specification.
Slab designs must be read in conjunction with soil report. Remove topsoil & all organic matter & prepare the sub-base to receive the concrete floor slab. Install sand bed & membrane. Finish slab surface at the correct level & with an appropriate finish the intended floor finish or covering. Footings are not to encroach on neighbouring property.
Slab on Ground – finished slab heights.
Height of slab on ground above external finished surfaces must be not less than:

- (i) 100 mm above the finished ground level.
- (ii) 50mm above impermeable (paved or concreted areas) that slopes away from the building; or
- (iii) 150 mm in any other case

STAIRS & BALUSTRADES

- Levels & number of steps shown are approximate only. All staircases to have: 2030mm minimum head height.
- Landing to be provided where external door still exceeds 570mm or 3 risers above finished surface of the ground with a min. of 750mm wide landing.
- Hand rails to be 865mm minimum above stair nosing and landings.
- Step sizes (other than for spiral stairs) to be:
1. Risers (r) 190mm maximum and 115mm minimum.
2. Going (g) 355mm maximum and 240mm minimum (residential) or 250mm minimum (commercial/industrial)
3. 2r + 1g = 700mm maximum and 550mm minimum.
4. With less than 125mm gap between open treads.
- Risers and treads to be constant in size throughout flight.
- All treads and landings and the like to have non-slip finish or suitable non-skid strip near edge of nosing.
- Provide balustrades where change in level exceeds 1000mm above the surface beneath landings, ramps and/or treads. balustrades (other than tensioned wire balustrades) to be:
1000mm min. above finished surface level of balconies, landings or the like, & 865mm min. above finished surface level of stair nosing or ramp, and vertical with a 125mm maximum gap between, and
Any horizontal element within the balustrade between 150mm and 760mm above the finished floor surface must not facilitate climbing where changes in level exceed 4000mm above the surface beneath landings, ramps and/or treads.
- Proposed non-slip paint / stain on the Staircase Trends Compliance with Part 3.9.1.4* of the BCA/NCC; specifically ensuring the Tread Surface meets the requirements of Dry: P3 or R10 & Wet: P4 or R11.
- Wire balustrade construction to comply with BCA 2016 Volume 1 & 2 D2.16 for other classes of buildings.
1. Stainless steel wires must be 3mm Ø and 1x19 lay.
2. Supports must be provided @ 900 ctrs, droppers or posts.
3. Wire spacing shall be no more than 80mm max.
4. Wires must be tensioned to 670 newtons and shall have max 6mm deflection when a 2kg mass is suspended mid span between supports.
5. Solid top rail of 40mm Ø must be provided.
6. Tensioners must be provided @ each wire and @ each change of direction greater than 30°.
7. Pulley blocks must be provided @ each change of direction.

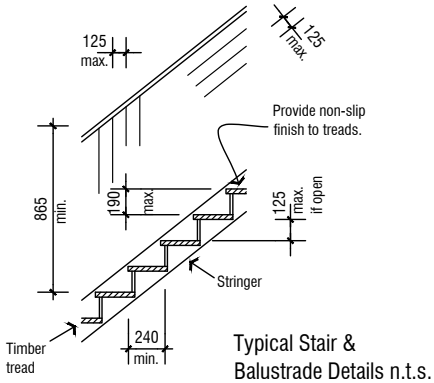

Northpoint Building Surveyors
Timber Framing Specialist
APPROVED DOCUMENT
First Floor Framing must comply with the
Building Act 1993 & Building Regulations
2018
24 HOUR NOTICE REQUIRED FOR ALL WORKS

Timber Framing Specialist
First Floor Framing must comply with the
Building Act 1993 & Building Regulations
2018
24 HOUR NOTICE REQUIRED FOR ALL WORKS

COMMON STUDS	90 X 45 MGP10	@600 CTRS MAX
WINDOW STUDS	2/90 X 45 MGP 10	
BOTTOM PLATE	90 X 45 MGP10	
NOGGINGS	70 X 35 MERCH PINE	@1350 CTRS MAX
FLOOR JOISTS	TO ENG DETAIL	@450 CTRS MAX
Ground floor framing:		
ROOF BATTENS	38 X 50 F8 HW	@330 CTRS MAX (TILED ROOF)
TOP PLATE	2/90 X 45 MGP10	
COMMON STUDS	90 X 45 MGP10	@450 CTRS MAX
WINDOW STUDS	2/90 X 45 MGP 10	
BOTTOM PLATE	90 X 35 MGP10 PINE	
NOGGINGS	70 X 35 Merch PINE	@1350 CTRS MAX
LINTELS:	TO ENGINEER'S DETAIL	
POST	TO ENGINEER'S DETAIL	
BEAM	TO ENGINEER'S DETAIL	

NOTE: All framing to comply with AS1684.2-2021 (Timber Framing)

NOTE: Refer to engineer's drawings and details location of beams supporting concentrated loads.

EXTERNAL WALLS

Any part of the external wall less than 400mm from the ground or less than 400 mm above decks, carport roofs awnings or similar elements hall be of -

- Non-combustible material; or
- Fibre-cement external cladding - a minimum of 6mm in thickness; or
- Bushfire resisting timber; or
- A timber species as specified in Paragraph E1 and list in Table E1, Appendix E of AS3959.0-2009 or;
- A combination of any of Items (a), (b), (c) or (d) above.

ELECTRICAL LEGEND

SYMBOLS	No.	POWER POINT OULETS
	26	DBL GPO @ 300
	17	DBL GPO @ 1150
	1	Single GPO ceiling mounted
	4	DBL w/proof GPO @ 300mm AFFL
	3	SNGL GPO @ 300
LIGHT FITTINGS		
	66	LED Down Light (12 watts)
	4	Pendant Light (12 watts)
	2	Fluorescent strip (12 watts)
	8	W/proof External Flood Light (12 watt globe)
	4	Up and Down External Light (12 watt globe)
	6	Wall Light @ 1700mm AFFL (12 watt globe)
	3	Stair Light
OTHER OUTLETS & FITTINGS		
	5	Smoke detectors
	7	Exhaust Fan 25/s - Vented out Externally
	1	Exhaust Fan 40/s - Vented out Externally
	3	Television point
	4	Data point
	5	2 - way switch
	1	Ceiling Fan

Note:
All the above items are to be confirmed by owner / sub-contractor before ordering.
Client to confirm with contractor all locations of light switches and power points.

ARTIFICIAL LIGHTING REQUIREMENTS:
The lamp power density or illumination power density of artificial lighting, excluding heaters that emit light, must not exceed:

1. In Class 1 building - 5W/m.
2. Verandah or Balcony attached to Class 1 building - 4W/m.
3. In a Class 10 building - 3w/m.


The number of lights per room may change but, the total number of wattage must not exceed the maximum allowances per each area. Refer to the electrical diagrams for maximum allowances per each area.

STANDARD CONNECTIONS:

- Provide single power point outlets to dishwasher, cook top & rangehood.
- Provide stove in kitchen to be hard wired to the electrical switchboard.
- Provide batten light & switch above man hole for roof access.
- Provide single power points in roof for ducted heated & air conditioner if required.
- Exhaust fans to be wired to light switch as per electrical plan.

GENERAL NOTES:



- Locations of fixtures shown on plans are indicative only and may vary due location of structural members and truss layouts.
- All lighting and switching types are to be confirmed on site between the builder and sub-contractor prior to commencement of any wiring.
- All symbols, fittings, appliances and fixtures are indicative only actual item may be of different size or shape.
- Refer to specifications for accurate details and description.
- Cabinetry may be altered upon specialists advice.
- Window sizes are nominal only exact figure may vary on site.
- Minor adjustments to framing and or location of framing may be made for structural purposes.

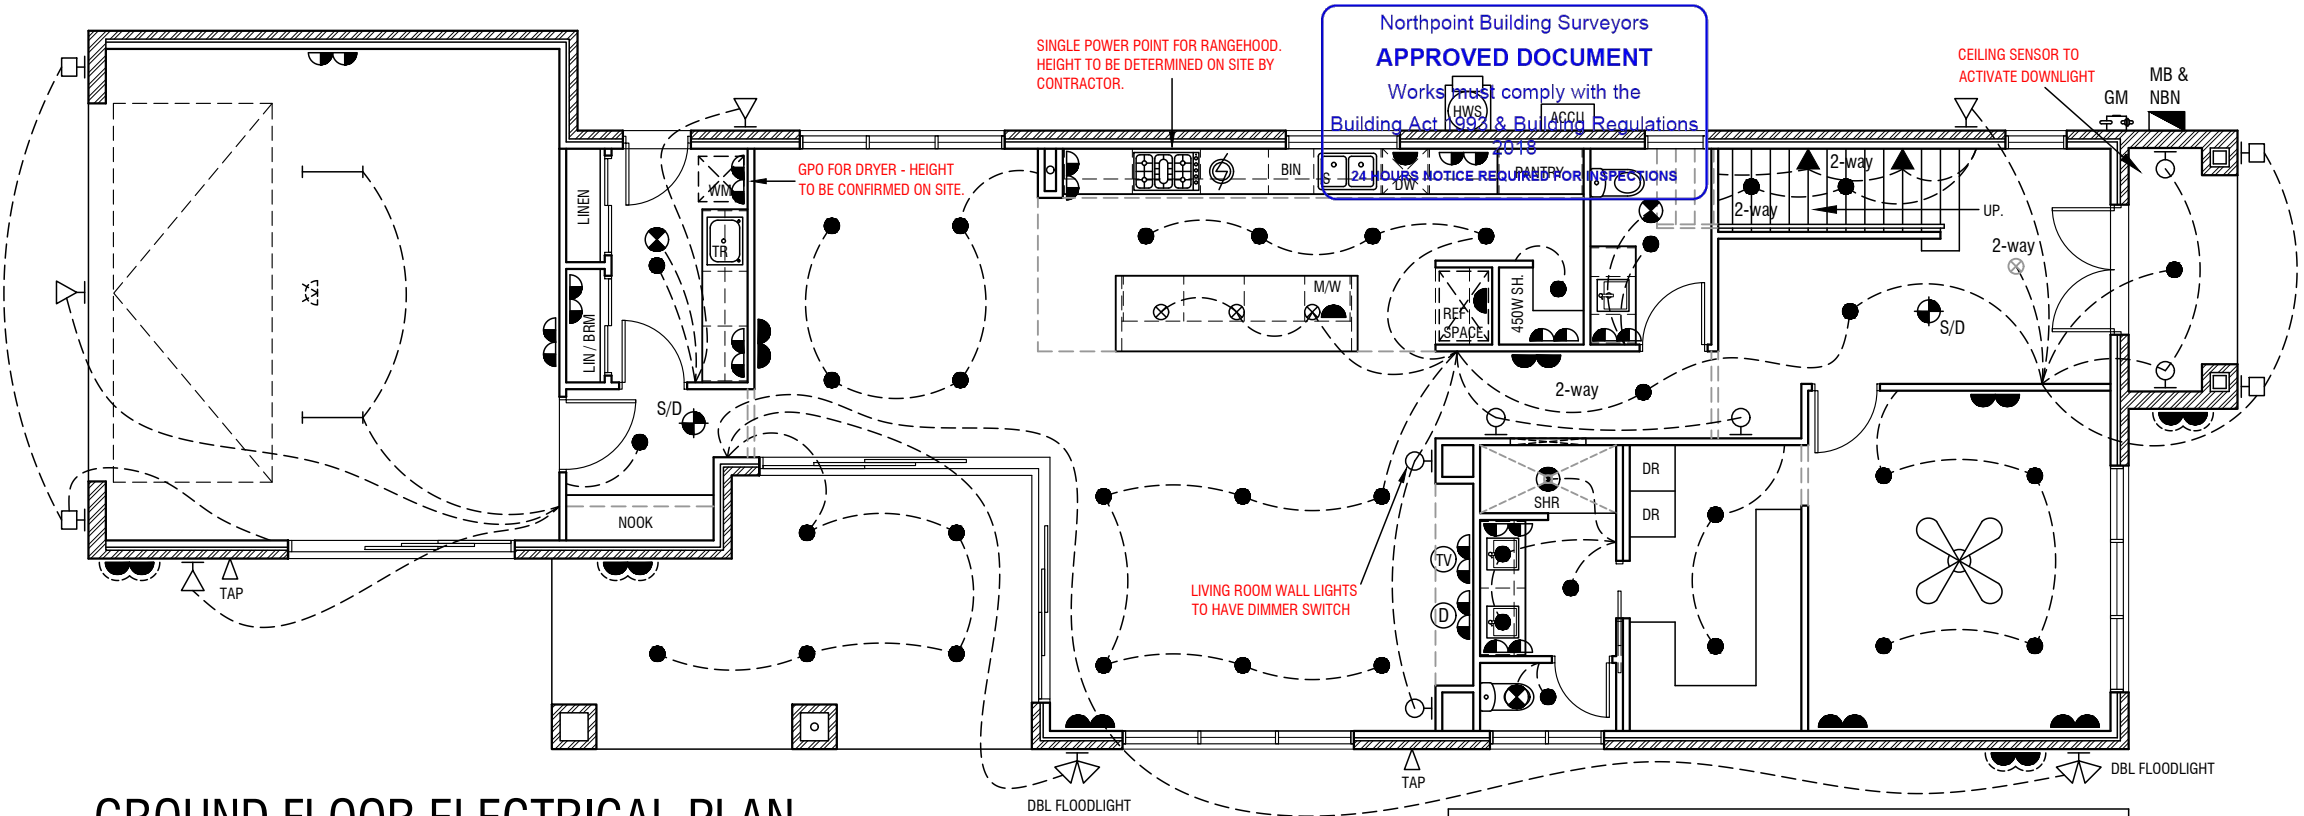

GROUND FLOOR ELECTRICAL PLAN

SCALE 1:100

ARTIFICIAL LIGHTING TABLE			
ZONE	AREA m2	MAX WATT ALLOWED	PROPOSED WATT
GROUND FLOOR AREA	136.28	681.40	384
FIRST FLOOR AREA	157.27	786.35	384
PORCH	4.47	17.88	12
ALFRESCO	19.67	78.68	60
GARAGE	39.00	117.00	24
TOTAL	356.69	1681.31	864

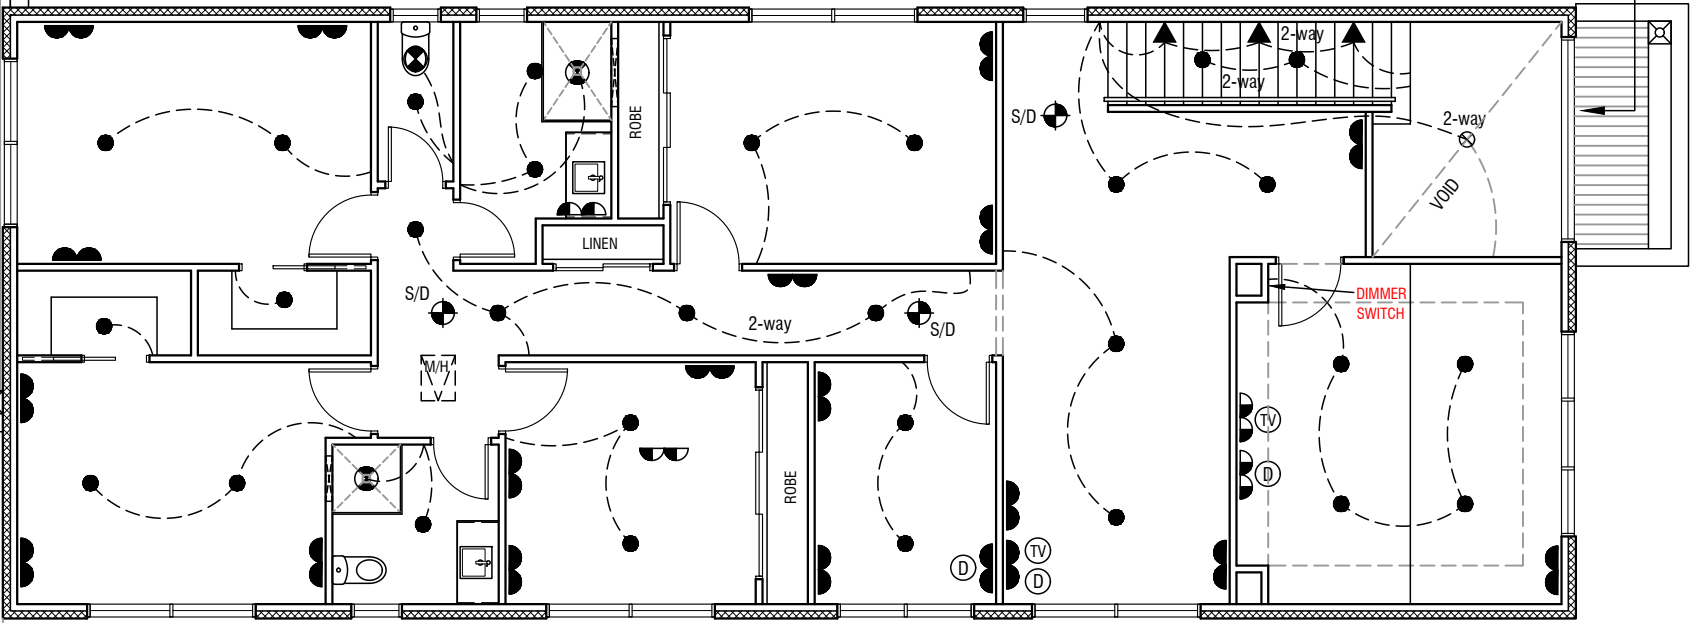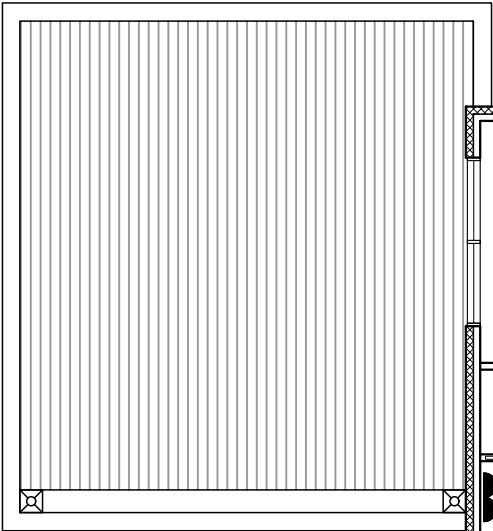


FIRST FLOOR ELECTRICAL PLAN

SCALE 1:100


REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT: NEW DWELLING	CLIENT:
ADDRESS: LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS.	DRAWING NAME: ELECTRICAL PLAN

ISSUE DATE: 16.01.2024
SCALE: 1:100 @ A3
DRAWN: E.C.
CHECKED: E.C.




PROJECT NO: 042224
SHEET NO: 14

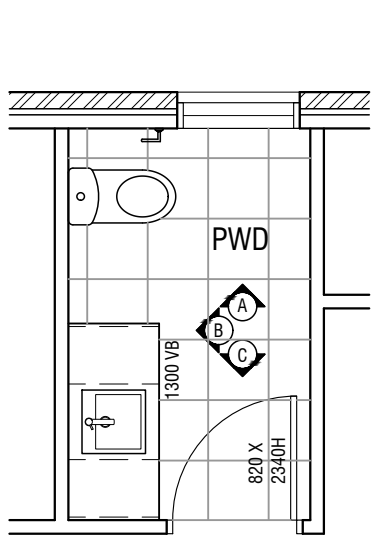


POWDER ROOM PLAN


SCALE 1:50

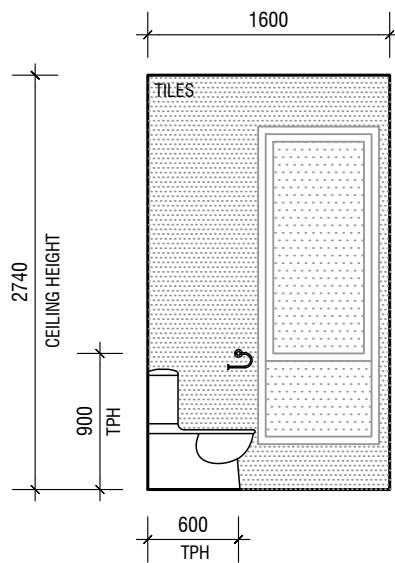

ELEVATION A

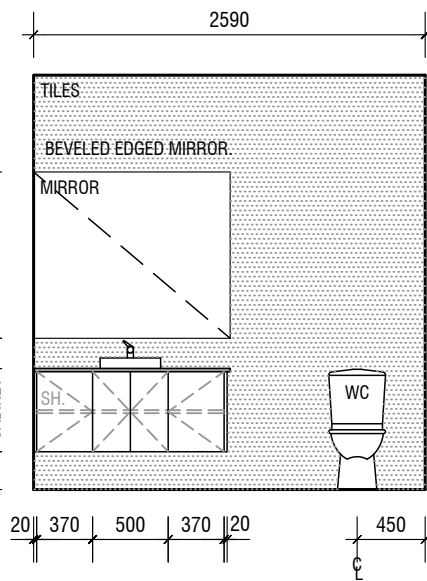


ELEVATION B

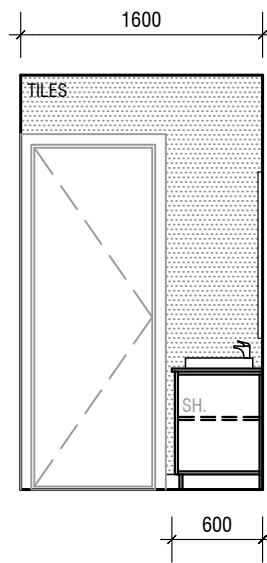

ELEVATION C


Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

GENERAL NOTES:
- Locations of fixtures shown on plans are indicative only and may vary due to location of structural members and truss layouts.
- All symbols, fittings, appliances and fixtures are indicative only actual item may be of different size or shape.
- Refer to specifications for accurate details and description.
- Cabinetry may be altered upon specialists advice.
- Window sizes are nominal only exact figure may vary on site.
- Minor adjustments to framing and or location of framing may be made for structural purposes.

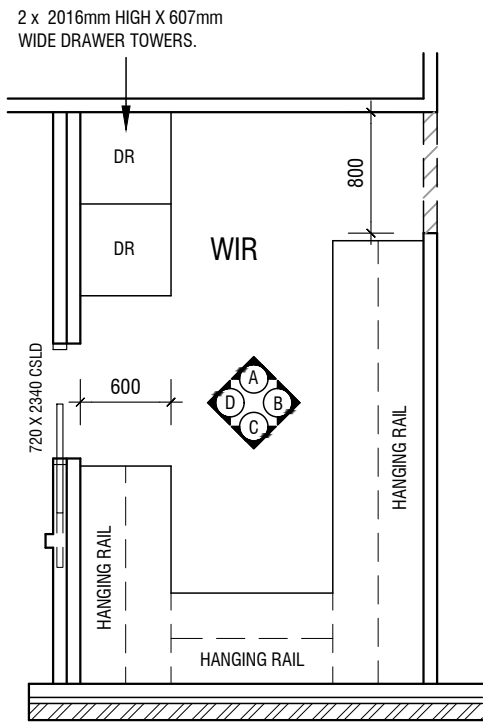


BED 1 - WALK IN ROBE PLAN


SCALE 1:50

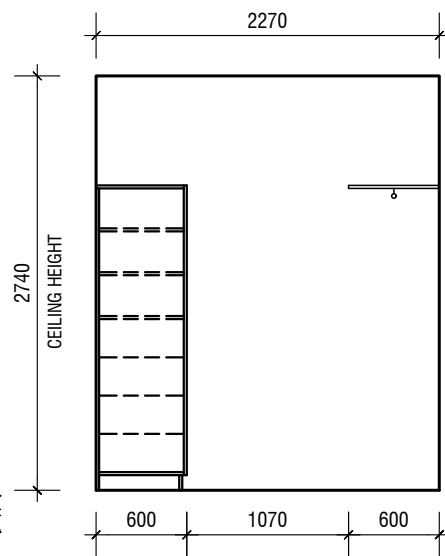


ELEVATION A

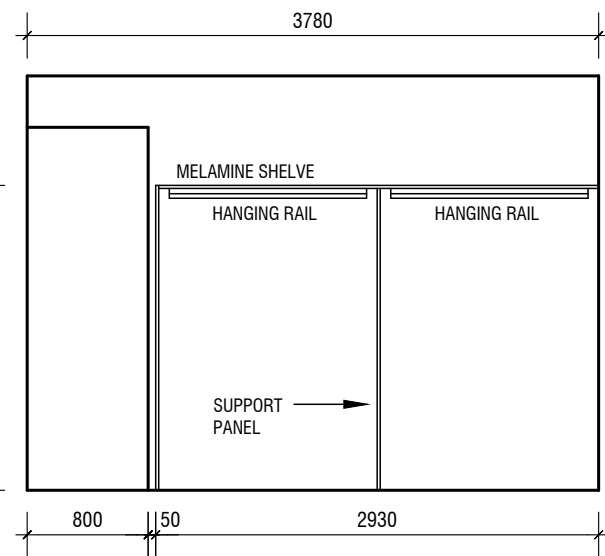

ELEVATION B

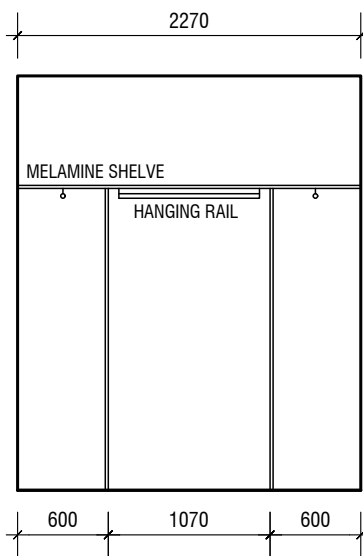

ELEVATION C

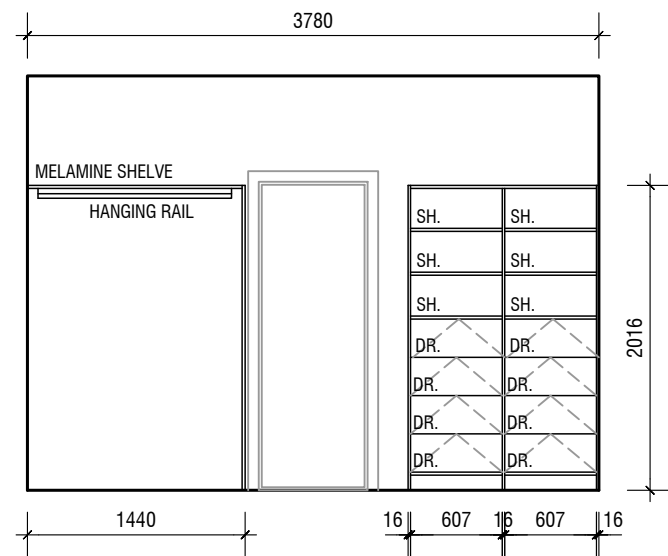

ELEVATION D

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT:
NEW DWELLING

CLIENT:

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.


DRAWING NAME:
INTERNAL DETAILS

ISSUE DATE: 16.01.2024

SCALE: 1:50 @ A3






DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:
15

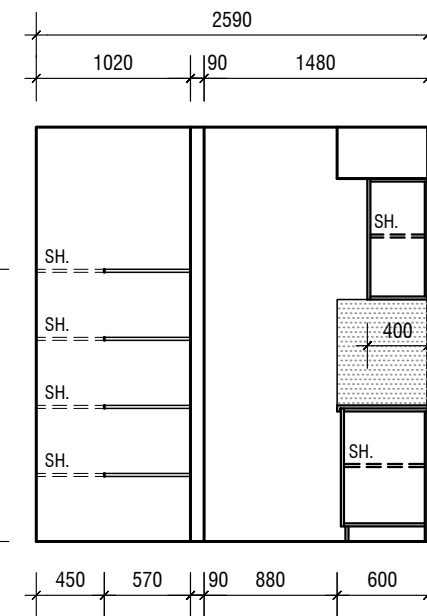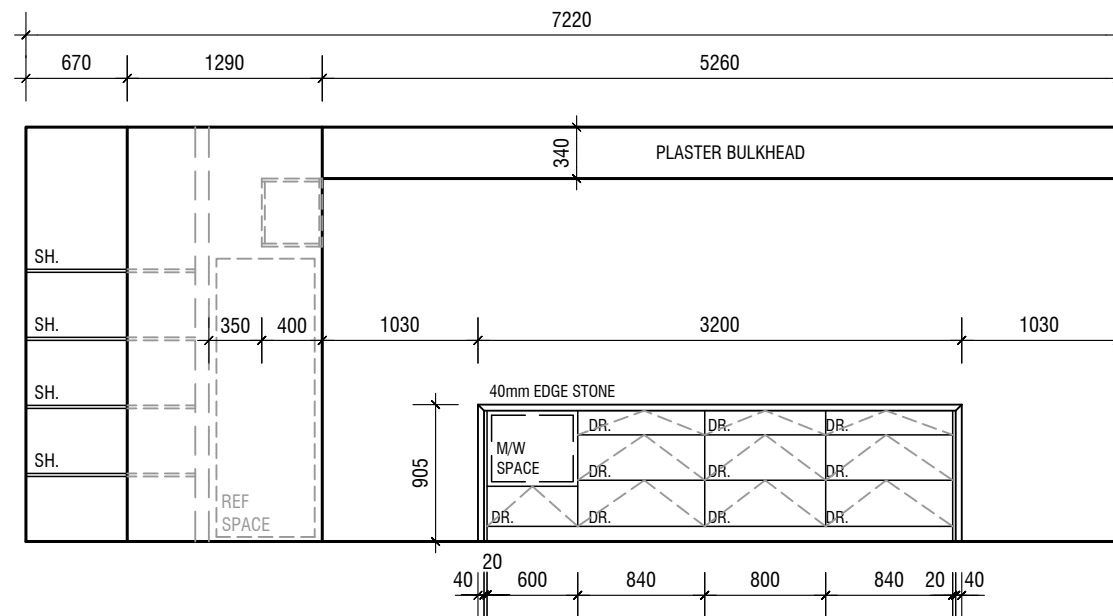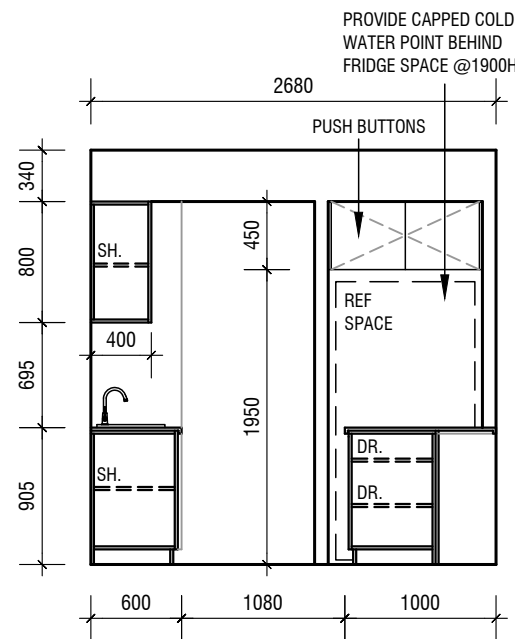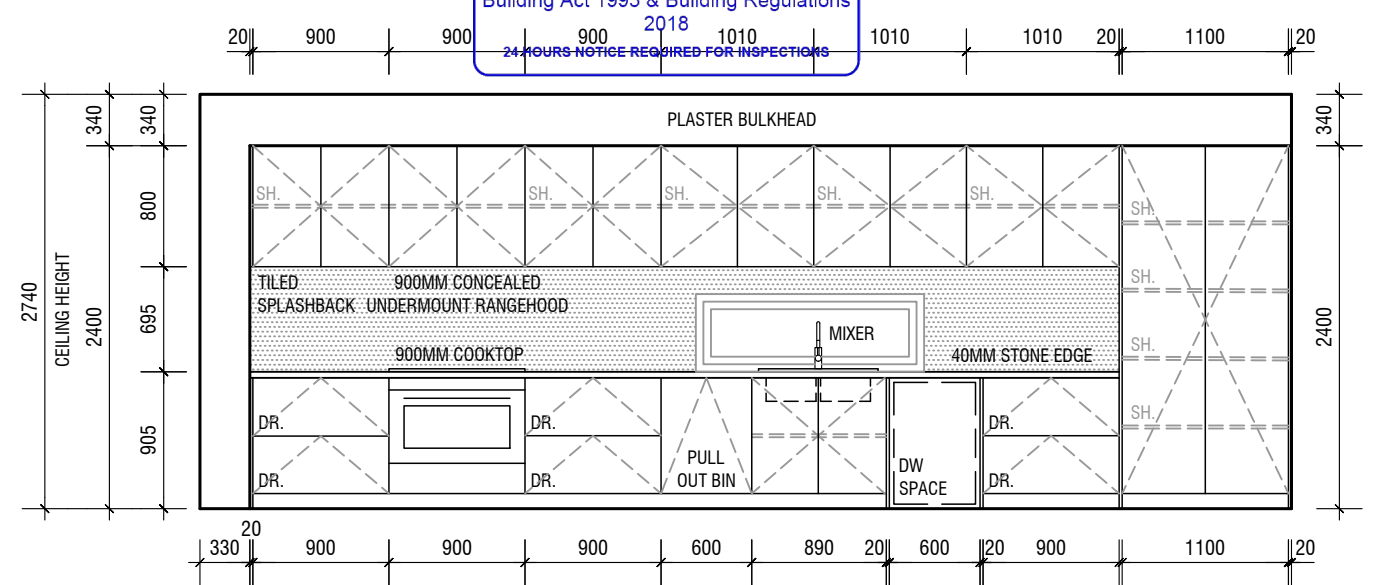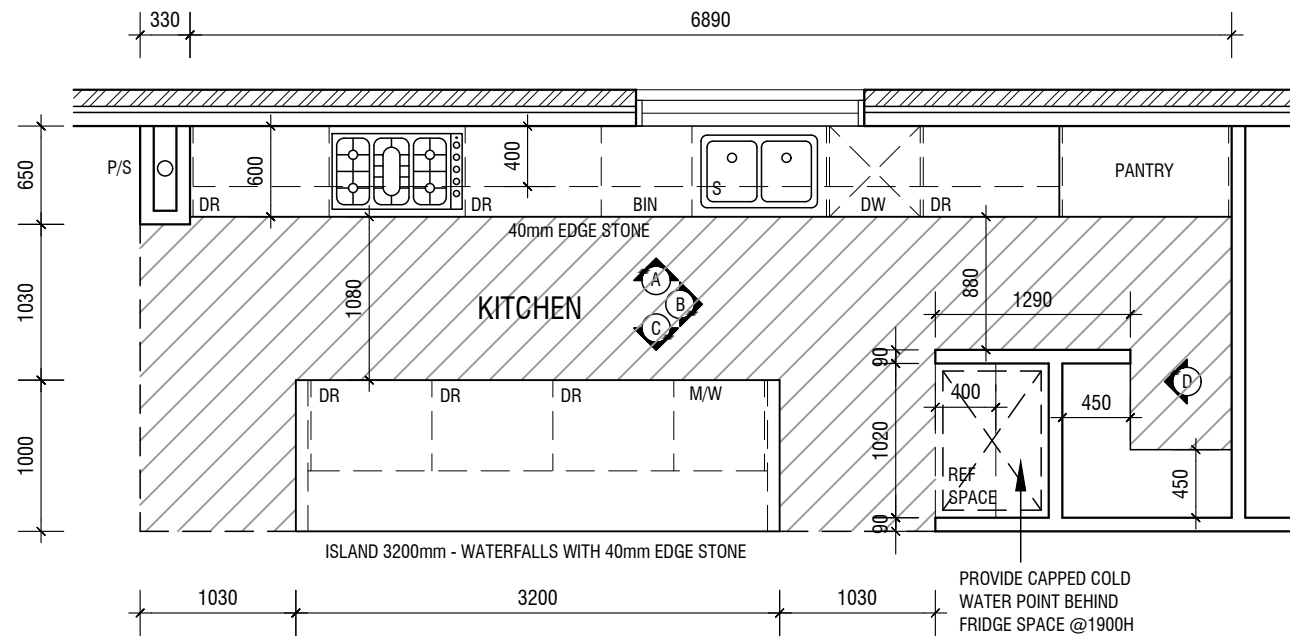

GENERAL NOTES:

- Locations of fixtures shown on plans are indicative only and may vary due to location of structural members and truss layouts.
- All symbols, fittings, appliances and fixtures are indicative only actual item may be of different size or shape.
- Refer to specifications for accurate details and description.
- Cabinetry may be altered upon specialists advice.
- Window sizes are nominal only exact figure may vary on site.
- Minor adjustments to framing and or location of framing may be made for structural purposes.

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT: NEW DWELLING

CLIENT:

ADDRESS: LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS.


DRAWING NAME: INTERNAL DETAILS

ISSUE DATE: 16.01.2024

SCALE: 1:50 @ A3


DRAWN: E.C.

CHECKED: E.C.




PROJECT NO: 042224

SHEET NO: 16

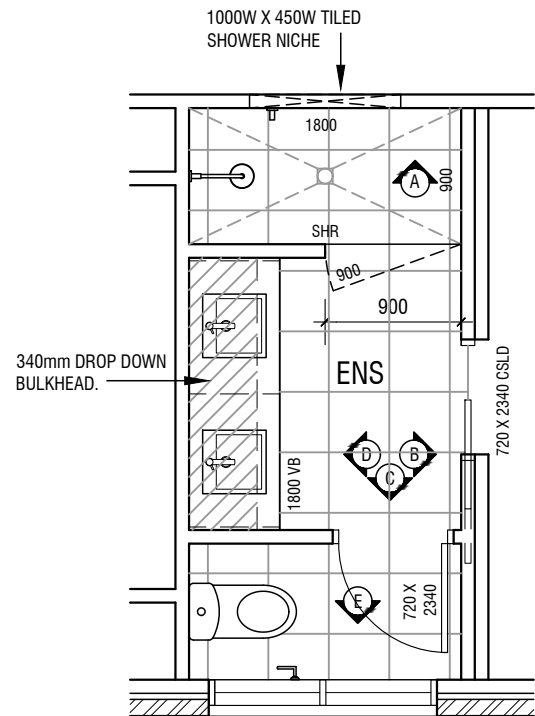


ENSUITE PLAN

SCALE 1:50

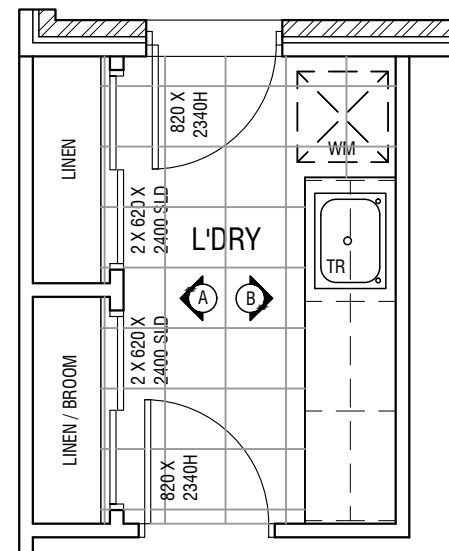


LAUNDRY PLAN


SCALE 1:50

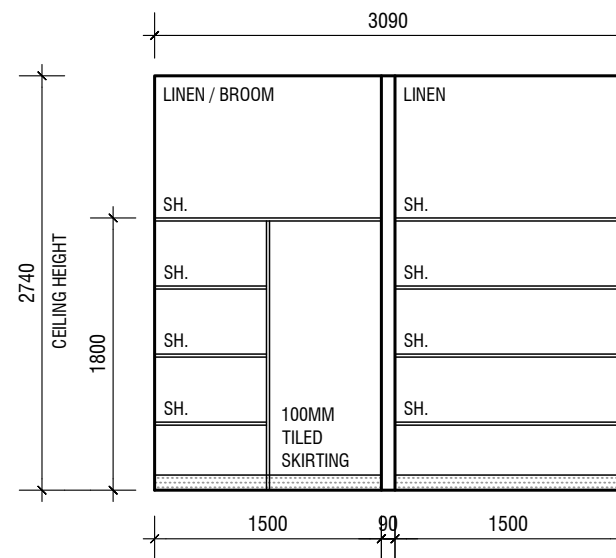


ELEVATION A

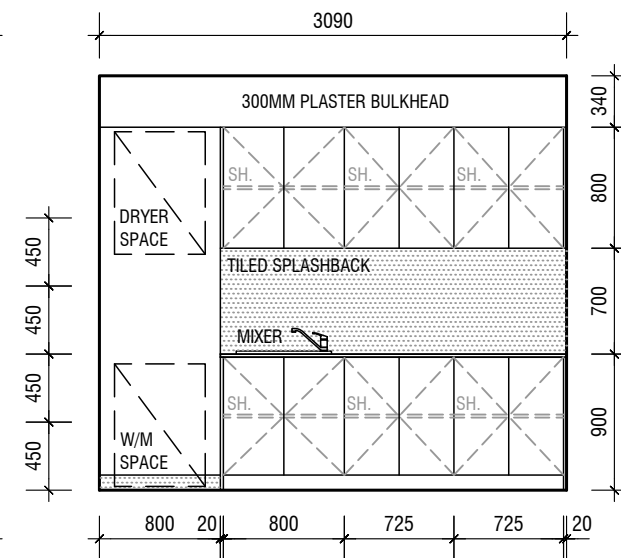


ELEVATION B

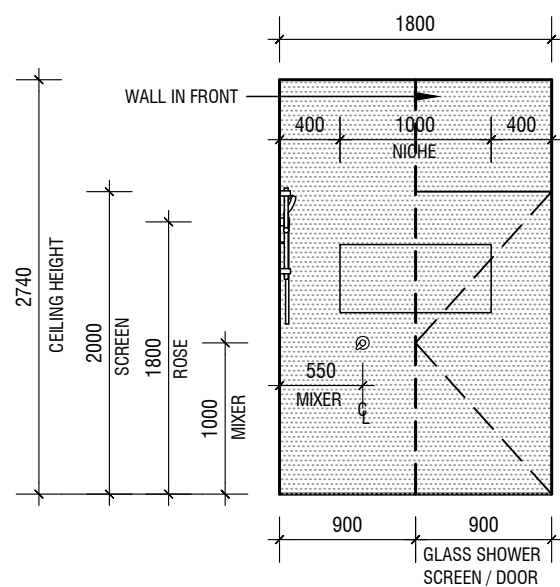


ELEVATION A

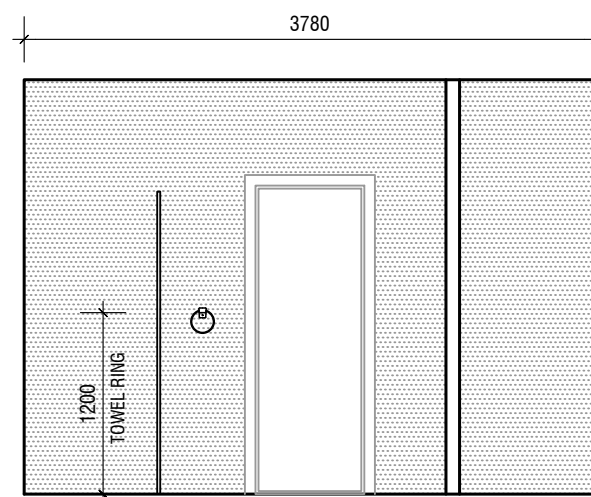


ELEVATION B

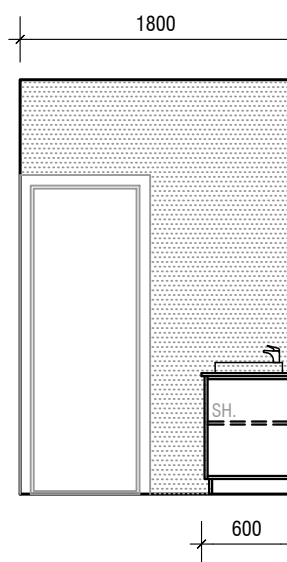

ELEVATION C

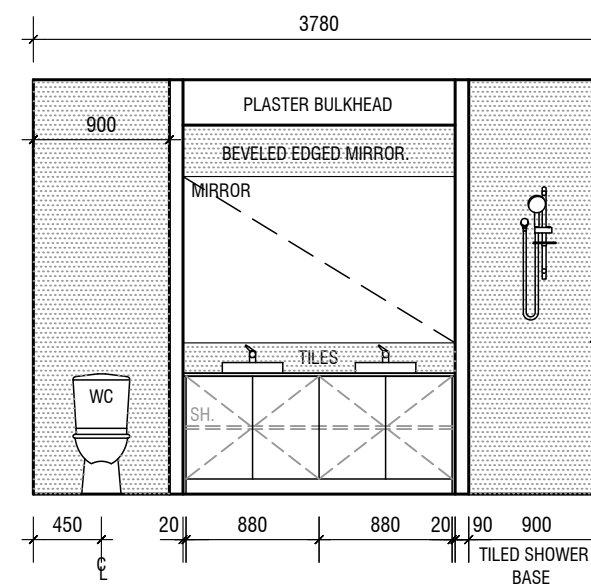

ELEVATION D

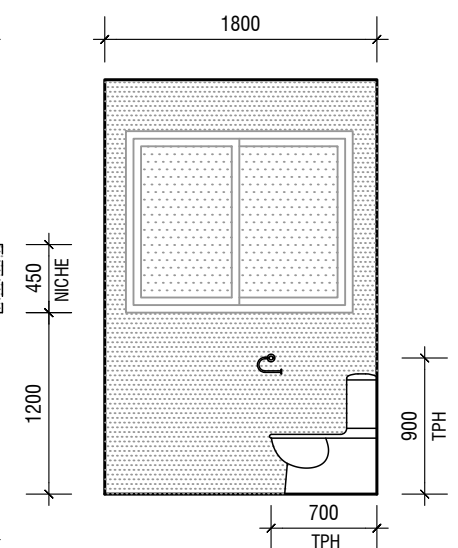

ELEVATION E

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

GENERAL NOTES:
- Locations of fixtures shown on plans are indicative only and may vary due to location of structural members and truss layouts.
- All symbols, fittings, appliances and fixtures are indicative only actual item may be of different size or shape.
- Refer to specifications for accurate details and description.
- Cabinetry may be altered upon specialists advice.
- Window sizes are nominal only exact figure may vary on site.
- Minor adjustments to framing and or location of framing may be made for structural purposes.

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:
INTERNAL DETAILS

ISSUE DATE: 16.01.2024
SCALE: 1:50 @ A3
DRAWN: E.C.
CHECKED: E.C.




PROJECT NO: 042224

SHEET NO:


17

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

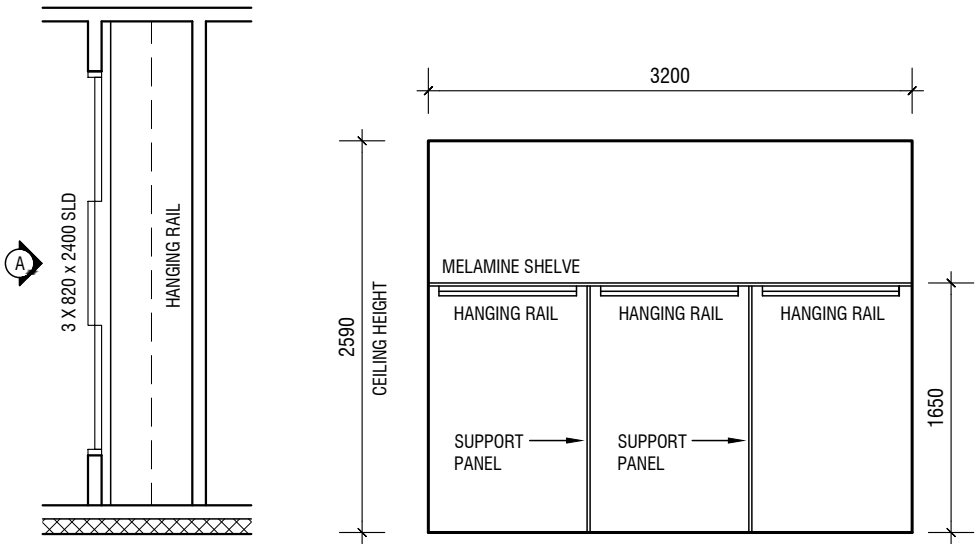


BED 2 ROBE PLAN
ELEVATION A

SCALE 1:50

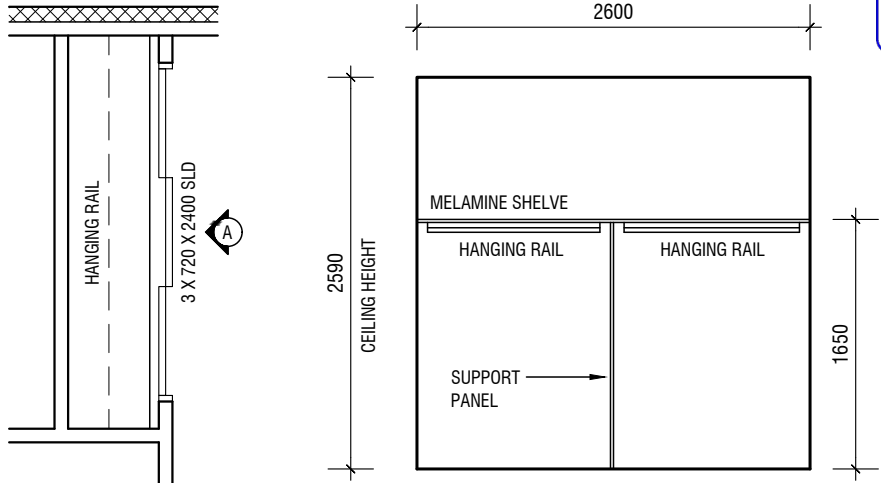


BED 5 ROBE PLAN
ELEVATION A

SCALE 1:50

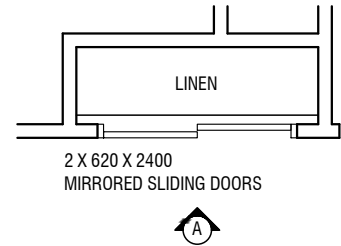


LINEN PLAN
ELEVATION A

SCALE 1:50

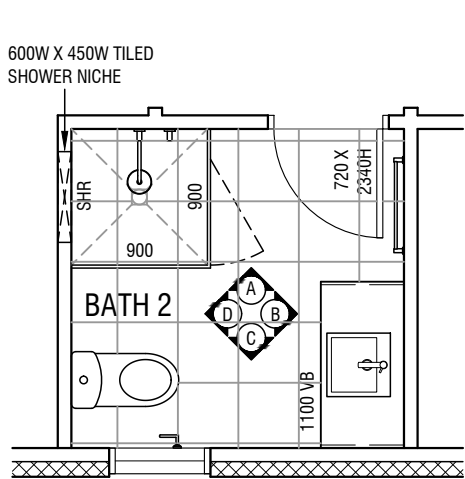


BATH PLAN 2


SCALE 1:50

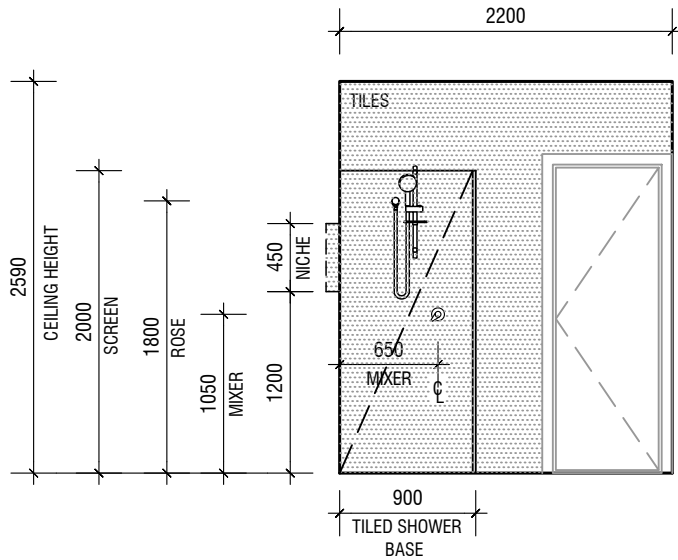


ELEVATION A

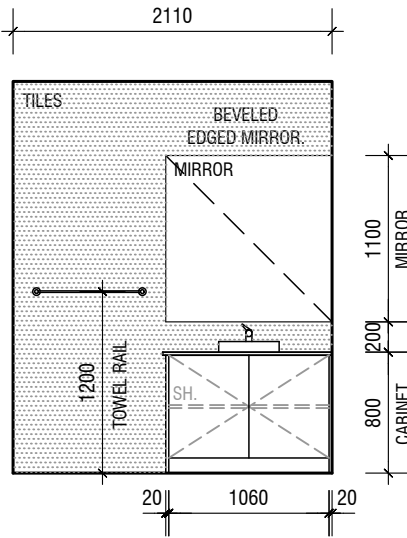

ELEVATION B

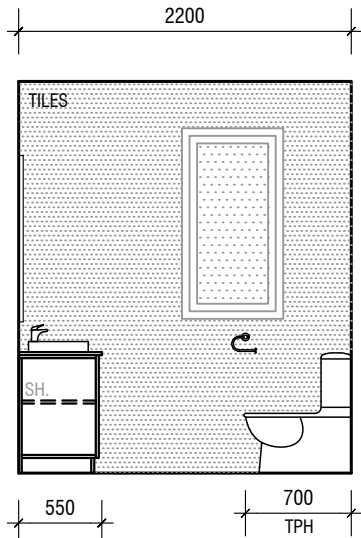

ELEVATION C

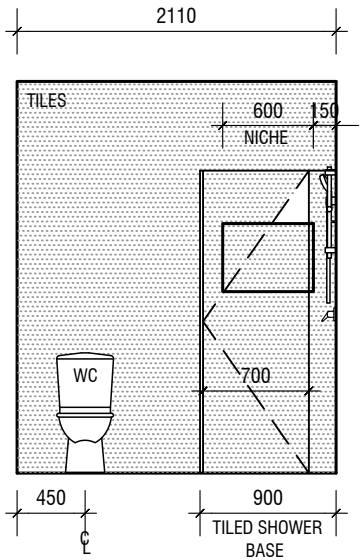

ELEVATION D

- GENERAL NOTES:**
- Locations of fixtures shown on plans are indicative only and may vary due to location of structural members and truss layouts.
 - All symbols, fittings, appliances and fixtures are indicative only actual item may be of different size or shape.
 - Refer to specifications for accurate details and description.
 - Cabinetry may be altered upon specialists advice.
 - Window sizes are nominal only exact figure may vary on site.
 - Minor adjustments to framing and or location of framing may be made for structural purposes.

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
INTERNAL DETAILS

ISSUE DATE: 16.01.2024

SCALE: 1:50 @ A3


DRAWN: E.C.

CHECKED: E.C.




PROJECT NO: 042224

SHEET NO:
18

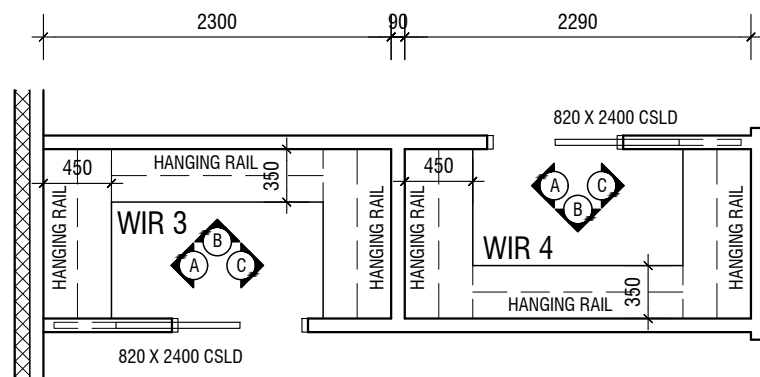

BED 3 & 4 - WALK IN ROBE PLAN

SCALE 1:50

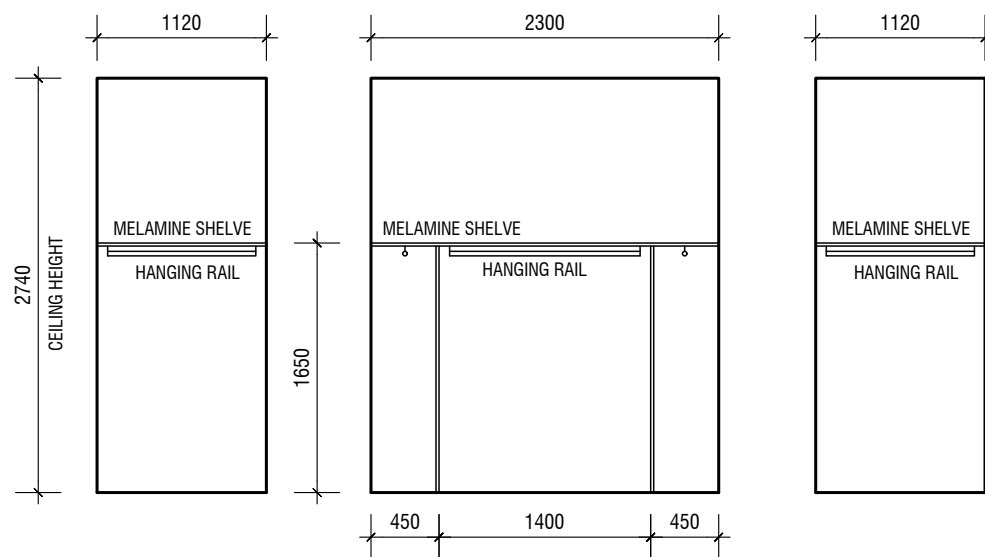


ELEVATION A

ELEVATION B

ELEVATION C


WC PLAN

SCALE 1:50

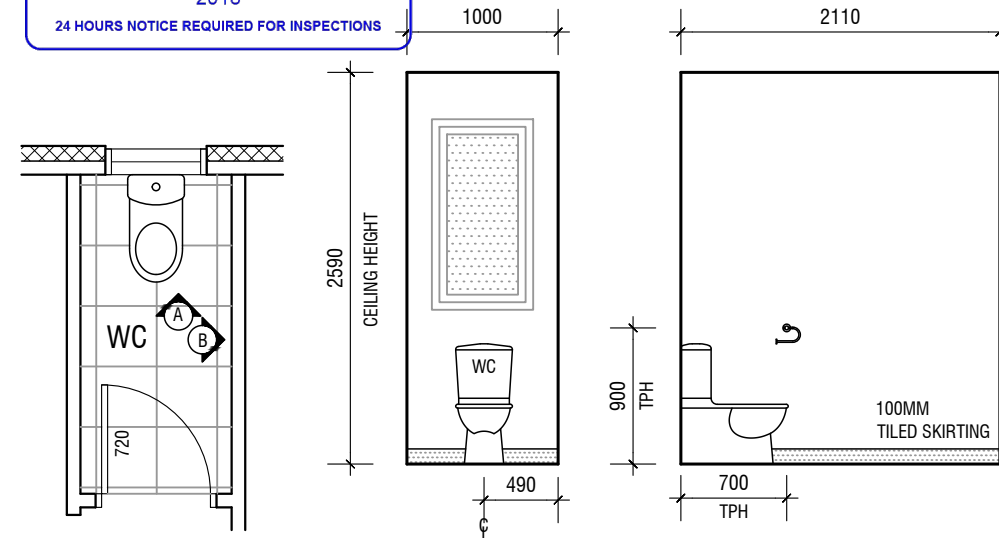


ELEVATION A

ELEVATION B

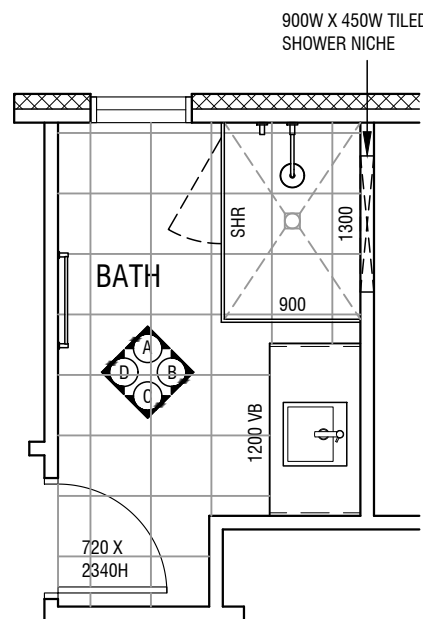


BATH PLAN


SCALE 1:50

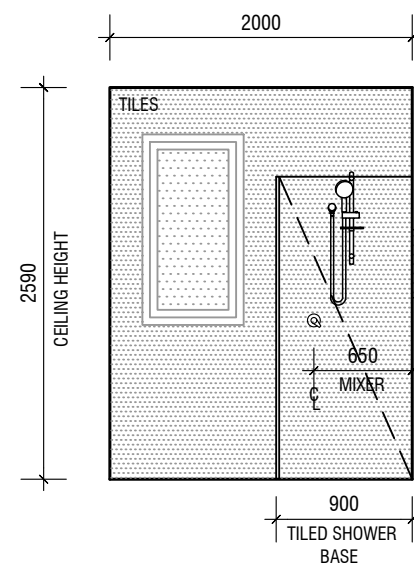


ELEVATION A

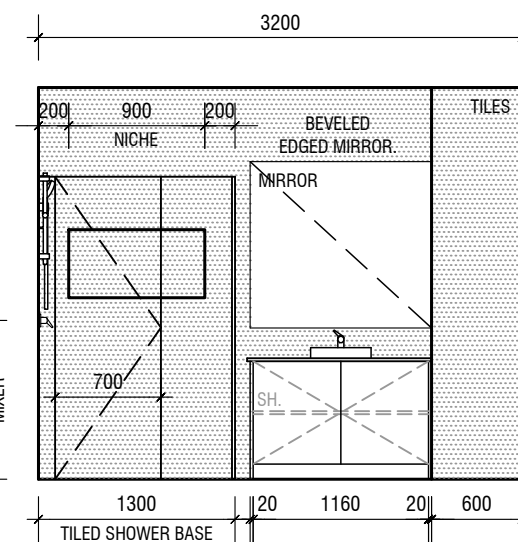

ELEVATION B

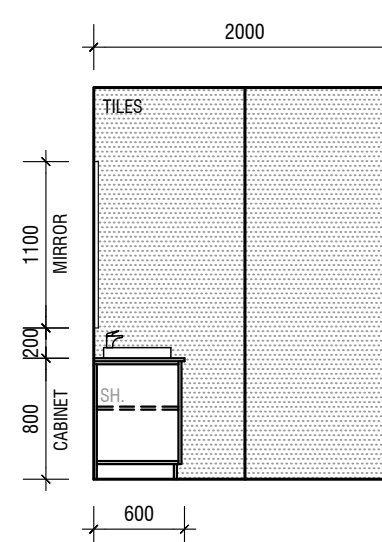

ELEVATION C

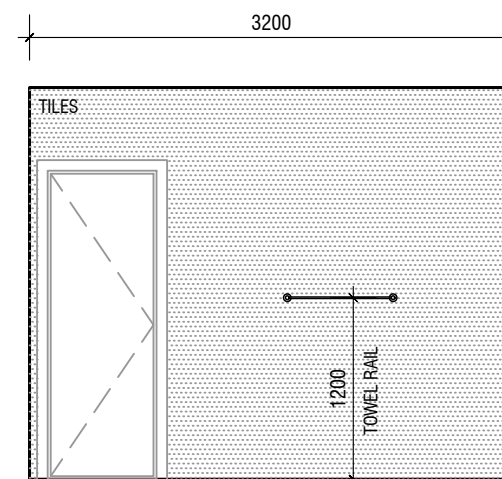

ELEVATION D

- GENERAL NOTES:**
- Locations of fixtures shown on plans are indicative only and may vary due to location of structural members and truss layouts.
 - All symbols, fittings, appliances and fixtures are indicative only actual item may be of different size or shape.
 - Refer to specifications for accurate details and description.
 - Cabinetry may be altered upon specialists advice.
 - Window sizes are nominal only exact figure may vary on site.
 - Minor adjustments to framing and or location of framing may be made for structural purposes.

REVISION	DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024
		E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
INTERNAL DETAILS

ISSUE DATE: 16.01.2024

SCALE: 1:50 @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:
19

BUILDING THERMAL PROPERTY DETAILS		
Floor Type:	MIN. INSULATION REQ.	
Slab Edge:	None	
Waffle Pod:(385mm)	None	
Cantilevering Floors:	R2.5 Bulk Insulation	
Remaining Floor Areas:	None	
Wall Type:	MIN. INSULATION REQ.	Air Gap:
Ext. Walls:	R2.7 Bulk Insulation	Non-Refl (E=0.9/0.9)
Int. Walls:(Garage)	R2.5 Bulk Insulation	None
Int. Walls:(Ldry, Pwd, WC & 2x Bath)	R2.5 Bulk Insulation	None
Ceiling:	MIN. INSULATION REQ.	Roof:
Ceiling under Pitched Roof:	R6.0 Bulk Insulation	Refl Air
Ceiling Perimeter:(Pitched Areas)	R3.0 Bulk Insulation	Refl Air
Ceiling under Flat Roof:	R2.5 Bulk Insulation	R1.3 Blanket + Refl Air
Ceiling under Box Gutter:	R2.5 Bulk Insulation	Refl Air
Window Operability & I.D	Max U-Value, SHGC, WERS Code & Window Details	
Awning	4.10 & 0.47 ALM-005-03; Alum, DG	
Fixed & Sliding Doors	4.10 & 0.52 ALM-006-03; Alum, DG	
LEGEND, ADDITIONAL DETAILS & CLAUSES		
“Ext.” = “External” & “Int.” = “Internal” “Non-Refl” = “Non-Reflective”, “Refl” = “Reflective” & “REQ.” = “Required” - Downlights are sealed & IC4-Rated - Exhaust fans - sealed - Air infiltration seals to external residence and garage internal doors - SHGC is allowed to be +/- 5% of nominated value - Additional details – refer to NatHERS Certificate		

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the Building Act 1993 & Building Regulations 2018

24 HOURS NOTICE REQUIRED FOR INSPECTIONS

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
ENERGY RATING REQUIREMENTS

ISSUE DATE: 16.01.2024

SCALE: N/A @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:
20

SMOKE ALARMS

- 1. Install smoke detectors in locations shown & comply with A.S. 3786 - 2014 self contained smoke alarms directly wired.
- 2. All smoke detectors are to be hardwired.
- 3. An approved smoke detector must be within 1.5m of any bedroom door.

Smoke alarms to be connected to the consumer mains power where consumer power is supplied to the building and be interconnected where there is more than one alarm.

MECHANICAL VENTILATION

All ensuites, bathrooms, wc, p'dr or laundries without an openable window shall comply with the following:
Clean air use 250mm dia. exhaust fan to manufacturers specifications.

- 1. An exhaust fan fitted and vented to external air via a duct or alternative piping system.
- 2. Mechanical light and ventilation ducted to give 25 Litres/sec.
- 3. Light and fan to be connected so that they are both functioning simultaneously.

Mechanical exhausts are required in the sanitary facility rooms (25l/s for bathroom or sanitary compartments and 40l/s for kitchen and laundry) discharging directly to the outside via a duct or alternative piping system or into the roof space that is ventilated in accordance with NCC 2019 Volume 2.

ARTICULATION NOTE

Refer to structural drawings for location of movement joint / articulation joints.
In absence of structural details adopt 5.0m max. centers and in accordance with "Technical Note 61 - Articulated Walling" from the Cement and Concrete Association of Australia. (Latest issue)

WC COMPARTMENTS

Sanitary compartments where the distance between the front of the pan and the door is less than 1200mm, the door is required to have lift off hinges or swing outwards or be a sliding door.

ROOF PLUMBER


Roof plumber is responsible for design, construction and certification of roof drainage.

WINDOWS & DOORS


Window and door sizes nominated are nominal only.
All windows and doors are to be confirmed on site with builder/contractor prior to ordering.
Actual size may vary according to the selected manufacturer and site conditions.
External windows and doors to be flashed all round.
All window and door sizes are height x width.
Window head height to be 2100mm high or to the nearest brick course. (U.N.O.)
All internal doors to be 2100mm high (U.N.O.)
All windows and doors need to comply with the energy rating report for this project.
All full glazed doors, sidelights, including any glazing capable of being mistaken for a doorway or opening, shall be clearly marked for their full width a solid non transparent contrasting line.
The contrasting line shall be not less than 75mm wide and shall extend across the full width of the glazing panel.
The lower edge of the strip shall be located 900mm from the finished floor level. Any contrasting line on the glazing shall provide a minimum of 30% luminance contrast when viewed against the floor surface or surface within 2m of the glazing on the opposite side.

BUILDING MEMBRANE


Where a pliable building membrane is installed in an external wall, it must comply with AS/NZS 4200.1&2 and be located on the exterior side of the primary insulation layer of wall assemblies that form the external envelope of a building.

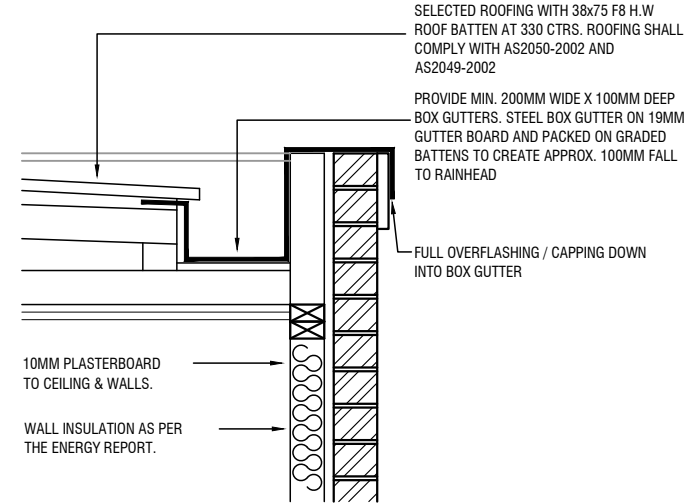


BOX GUTTER DETAIL - TYPICAL

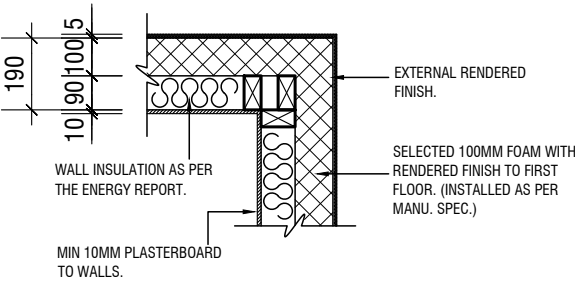

FIRST FLOOR WALL DETAIL

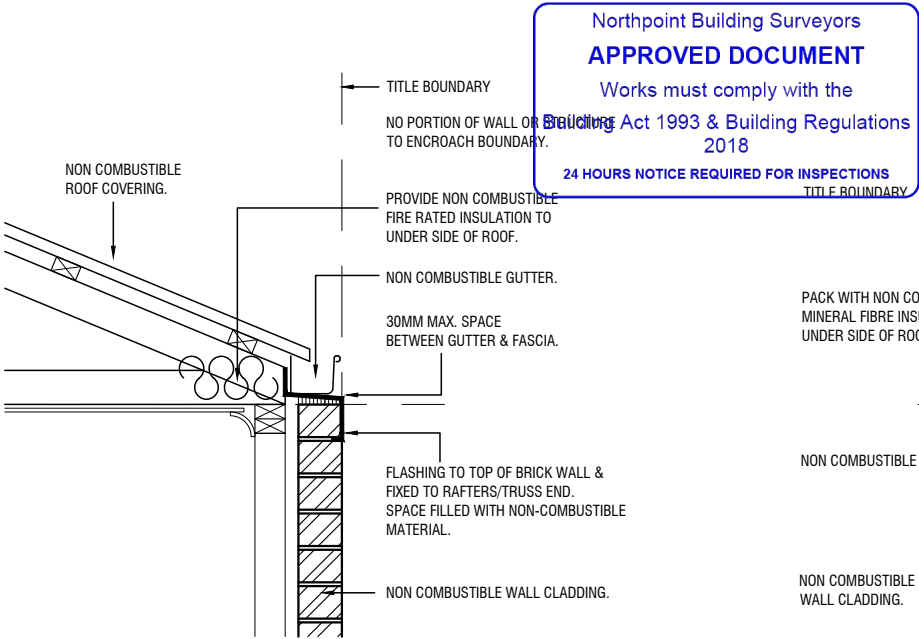


GUTTER ON WALL DETAIL - TYPICAL

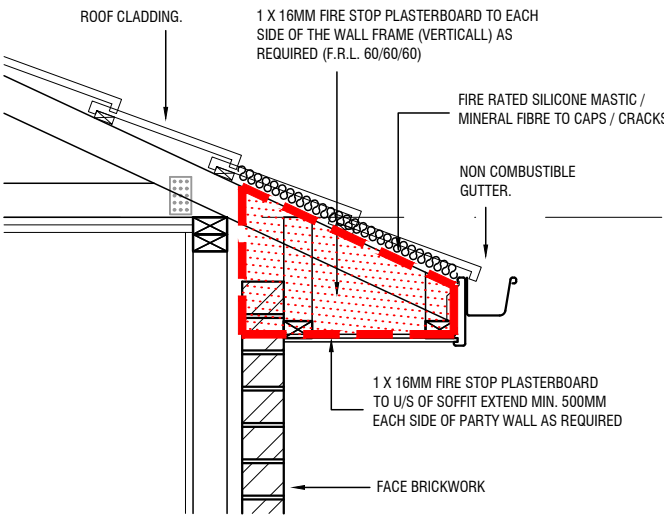


EAVE / SOFFIT SEPERATION DETAIL - TYPICAL 60/60/60

- NOTES:
- EXTERNAL / PARTY WALL (F.R.L. 60/60/60)
 - REFER TO PART H3 FIRE SAFETY FROM THE NCC 2022 VOLUME 2
 - TIMBER FRAMING AS REQUIRED
 - 1 X 16MM FIRE STOP PLASTERBOARD TO EACH SIDE OF THE WALL FRAME (VERTICALL) AS REQUIRED
 - 1 X 16MM FIRE STOP PLASTERBOARD TO U/S OF SOFFIT EXTEND MIN. 500MM EACH SIDE OF PARTY WALL AS REQUIRED
 - FIRE RATED SILICONE MASTIC / MINERAL FIBRE TO CAPS / CRACKS
 - TO FRONT AND REAR OF DWELLING AS REQUIRED TYPICAL.

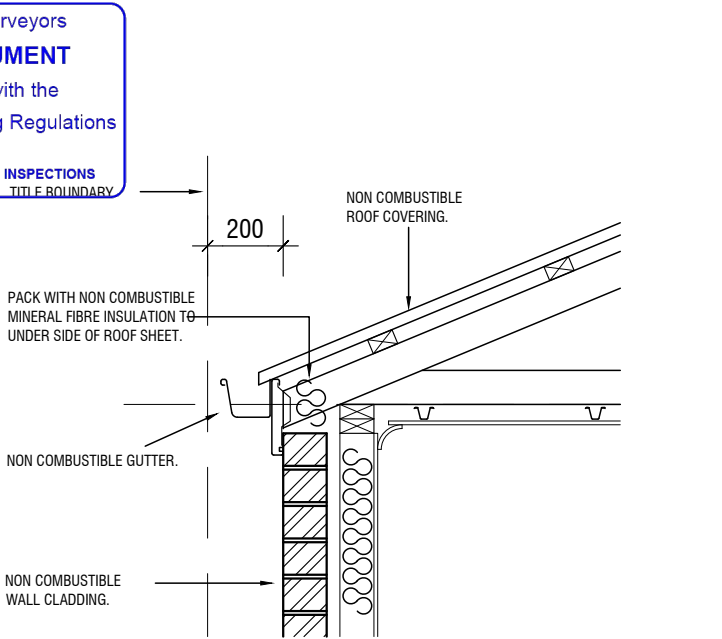

NO EAVE OVERHANG DETAIL - TYPICAL

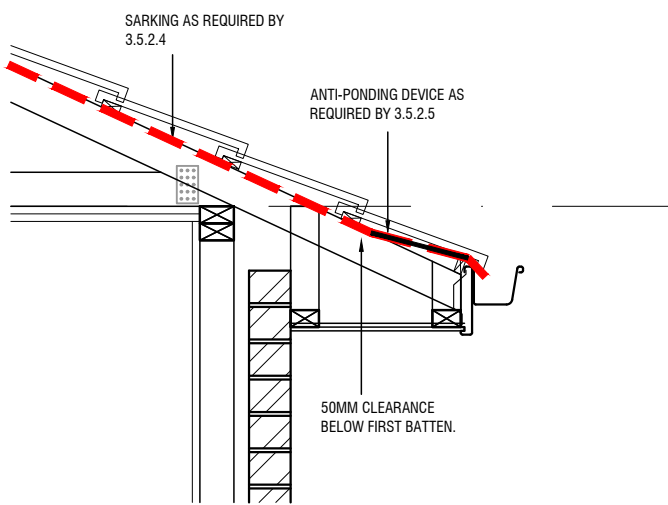

ANTI - PONDING DEVICE BOARD DETAIL - TYPICAL

- NOTES:
- (A)AN ANTI-PONDING DEVICE/BOARD MUST BE PROVIDED—
 - (I)ON SARKED ROOFS WITH A PITCH LESS THAN 200; AND
 - (II)ON ALL ROOF PITCHES WHERE THERE IS NO EAVES OVERHANG, REGARDLESS OF WHETHER SARKING IS REQUIRED.
 - (B)AN ANTI-PONDING DEVICE/BOARD REQUIRED BY (A) MUST BE WATER RESISTANT AND FIXED ALONG THE EAVES LINE FROM THE TOP OF THE FASCIA BACK UP THE RAFTER WITH A CLEARANCE OF APPROXIMATELY 50 MM BELOW THE FIRST BATTEN

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
NOTES

ISSUE DATE: 16.01.2024

SCALE: N/A @ A3

DRAWN: E.C.


CHECKED: E.C.



PROJECT NO: 042224


SHEET NO:

21

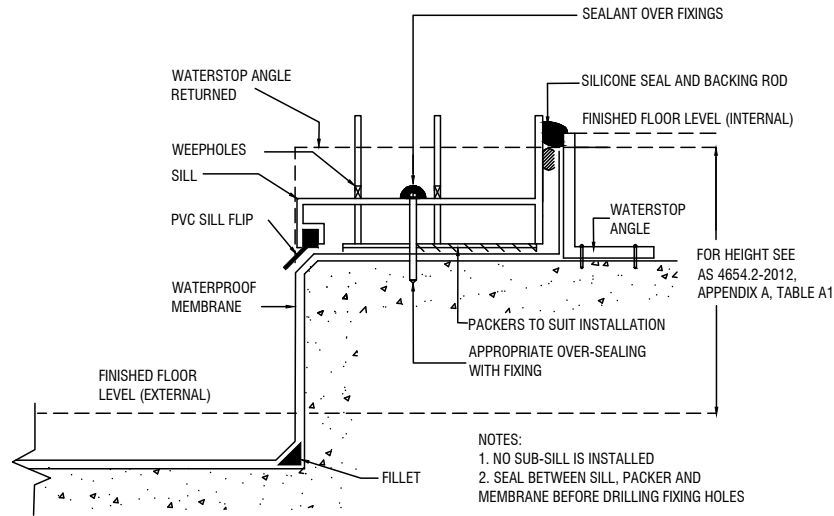


BALKONY WATERPROOFING DETAIL - TYPICAL


- THE BALKONY DETAIL TO ACHIEVE COMPLIANCE WITH CLAUSE 3.8.1.3 (EXTERNAL WATERPROOFING) OF THE BCA:
- THE WATERPROOF MEMBRANE NEEDS TO EXTEND THE WIDTH OF THE SILL AND FINISH SHORT OF THE WATERSTOP ANGLE INSTALLED ON THE INTERNAL SIDE OF THE DOOR OPENING;
 - A WATERSTOP ANGLE TO BE SHOWN ON THE INTERNAL SIDE OF THE DOOR OPENING.
 - FINISHED FLOOR LEVEL TO BE GRADED TO ENSURE STORM WATER DRAINS TO THE DRAINAGE OUTLET;
 - DESIGN AND CONSTRUCTION OF EXTERNAL WATERPROOF MEMBRANE TO AS 4654.1 & 2-2012.
 - PROVIDE CONSTRUCTION DETAIL FOR BALKONY CONSTRUCTION – REFER TO THE DIAGRAM BELOW FOR THE REQUIRED DETAIL.

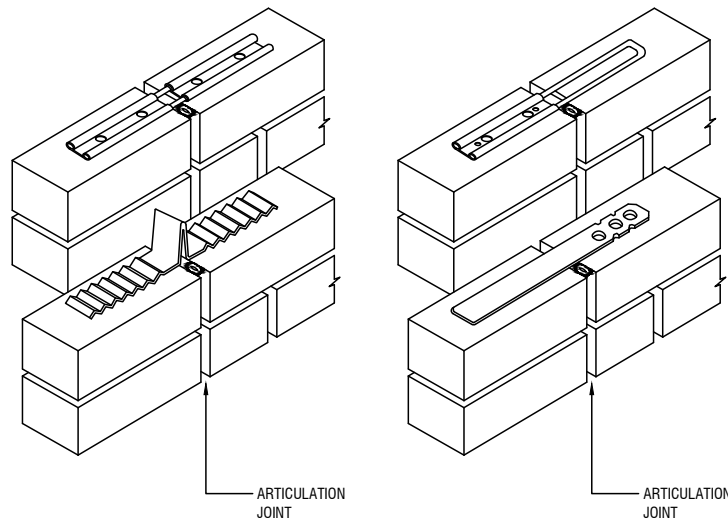


MASONRY EXPANSION (SLIDING/EXTENDABLE) TIES

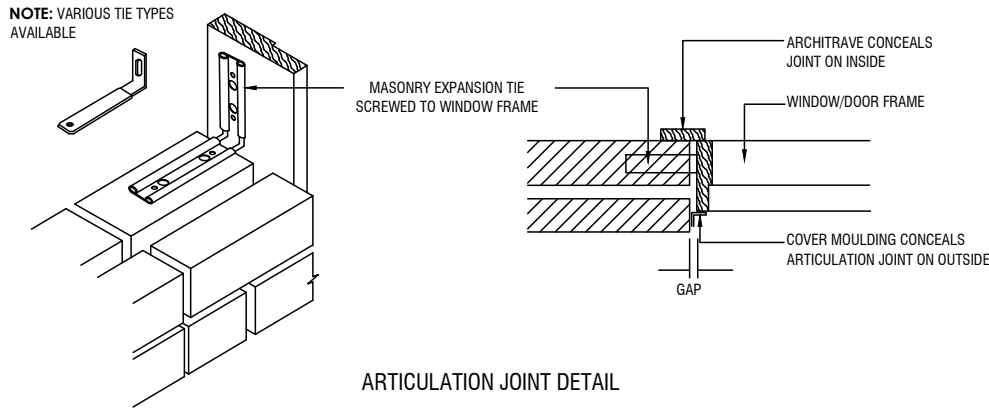

ARTICULATION JOINT DETAIL

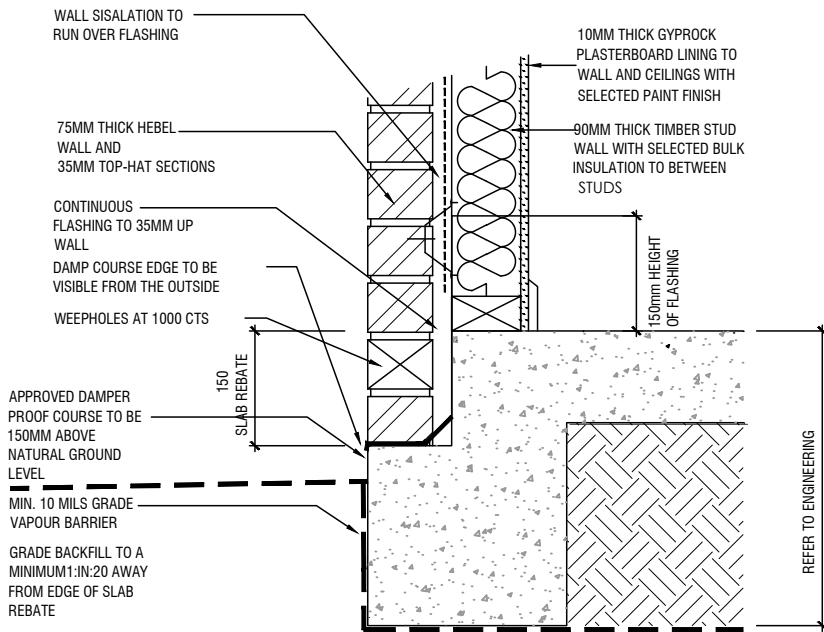

TYPICAL SLAB REBATE DETAIL

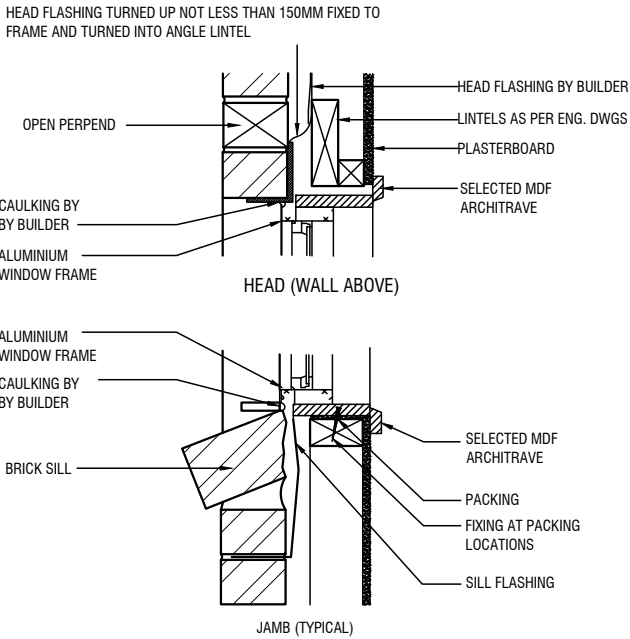


WINDOW HEAD & SILL FLASHING DETAIL
HEAD FLASHING AND SILL FLASHING DETAIL TO THE TOP AND BOTTOM OF ALL WINDOW OPENINGS.

REVISION	DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024 E.C.

PROJECT: NEW DWELLING
CLIENT:
ADDRESS: LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS.
DRAWING NAME: DETAILS

ISSUE DATE: 16.01.2024
SCALE: N/A @ A3
DRAWN: E.C.
CHECKED: E.C.



PROJECT NO: 042224
SHEET NO: 22

FIGURE 10.2.2:
EXTENT OF TREATMENT FOR SHOWER AREAS — CONCRETE COMPRESSED FIBRE-CEMENT AND
FIBRE-CEMENT SHEET FLOORS

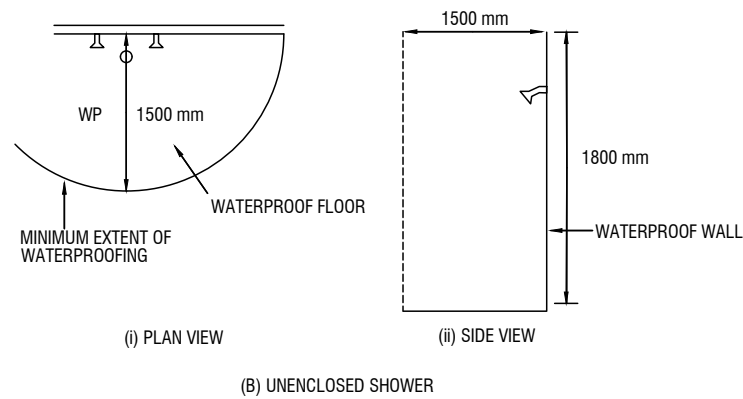
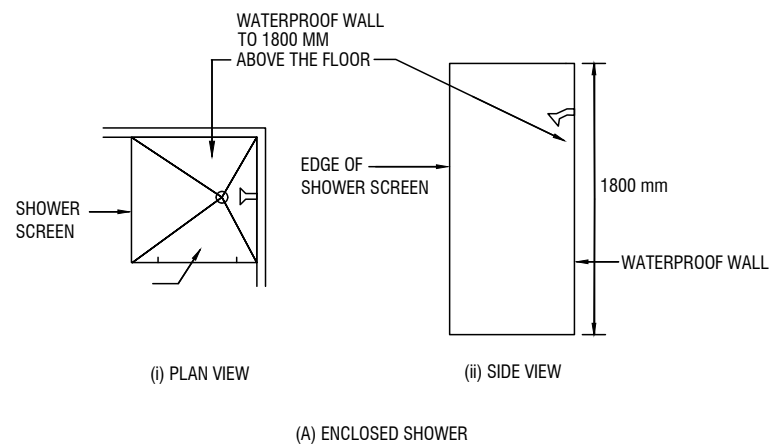


FIGURE 10.2.16:
TYPICAL HOB CONSTRUCTION — INTERNAL MEMBRANE

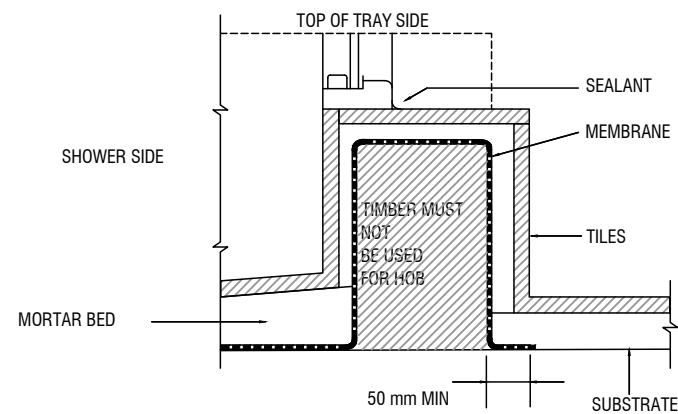


FIGURE 10.2.4A:
AREAS ADJACENT TO BATHS AND SPAS WITHOUT SHOWERS FOR CONCRETE, COMPRESSED
FIBRE-CE-MENTAND FIBRE-CEMENT SHEET FLOORING.





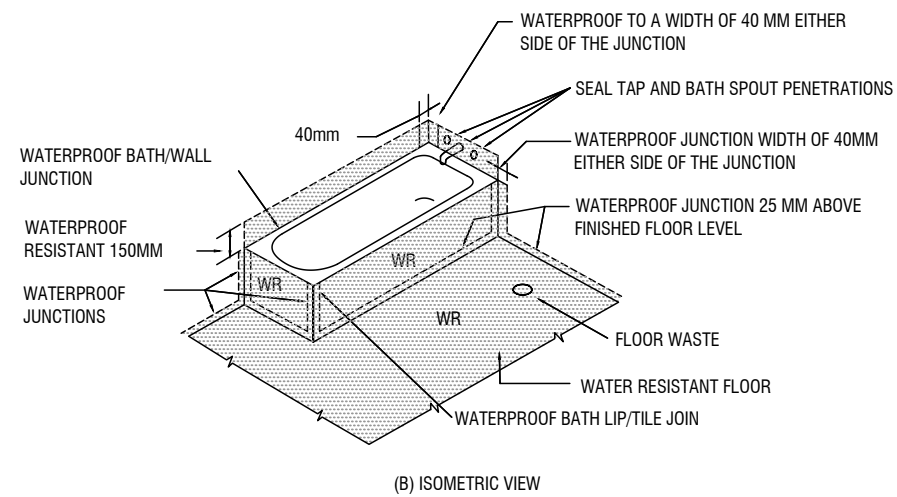


FIGURE 10.2.18:
TYPICAL TERMINATION OF MEMBRANE AT EXTENT OF SHOWER AREA

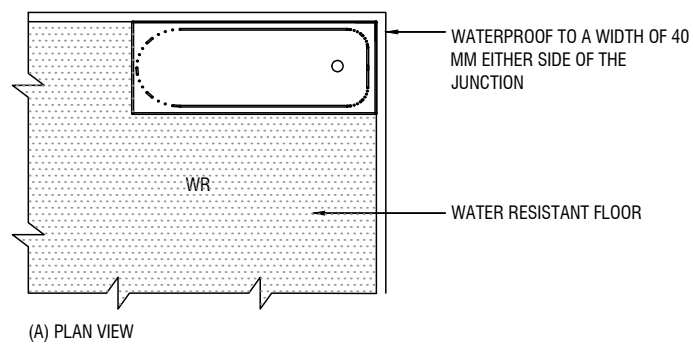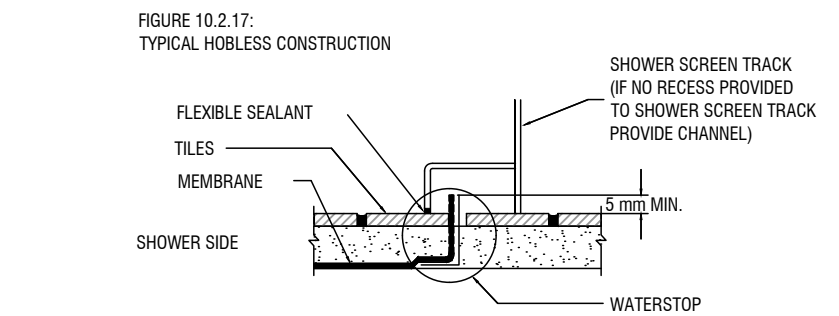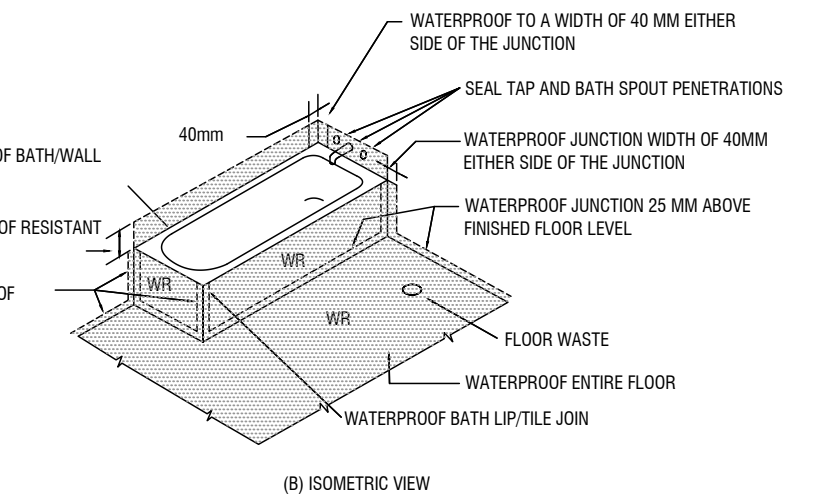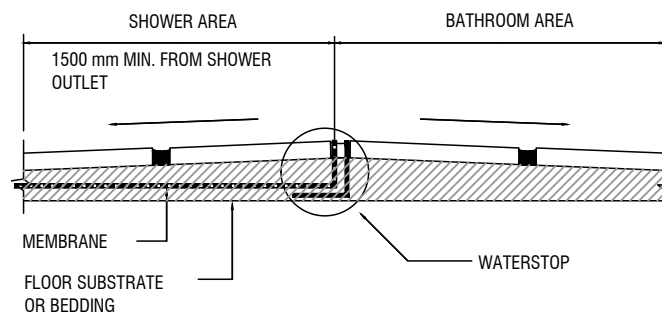

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
DETAILS

ISSUE DATE: 16.01.2024

SCALE: N/A @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:
23

FIGURE 10.2.19B:
TYPICAL PREFORMED SHOWER BASE/FLOOR JUNCTION ON TIMBER FLOORS, INCLUDING
PARTICLEBOARD,PLYWOOD AND OTHER TIMBER MATERIALS

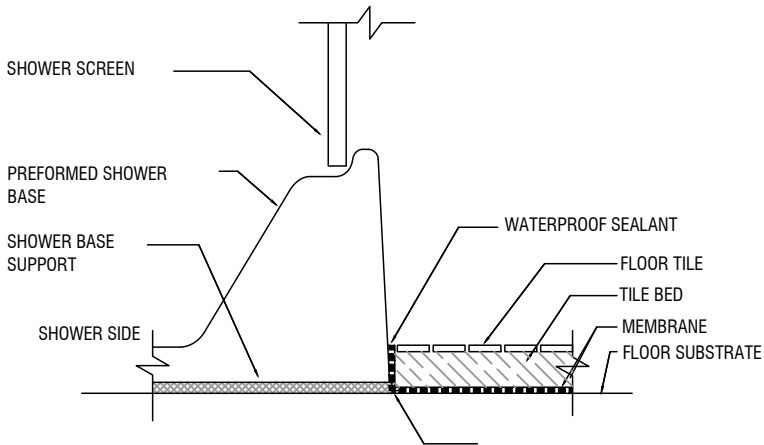


FIGURE 10.2.29:
TYPICAL MEMBRANE TERMINATION AT DRAINAGE OUTLET

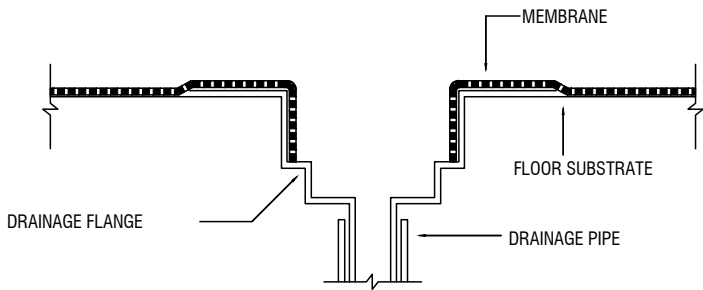


FIGURE 10.2.19A:
TYPICAL PREFORMED SHOWER BASE WALL/FLOOR JUNCTION

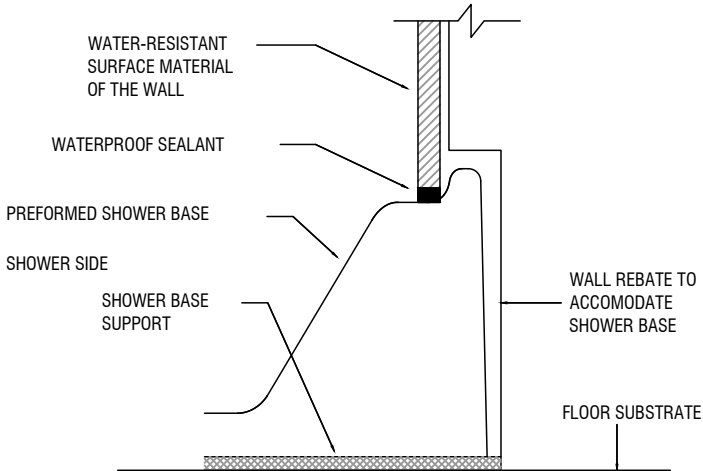


FIGURE 10.2.24:
TYPICAL BATHROOM DOOR DETAILS FOR WHOLE BATHROOM WATERPROOFING




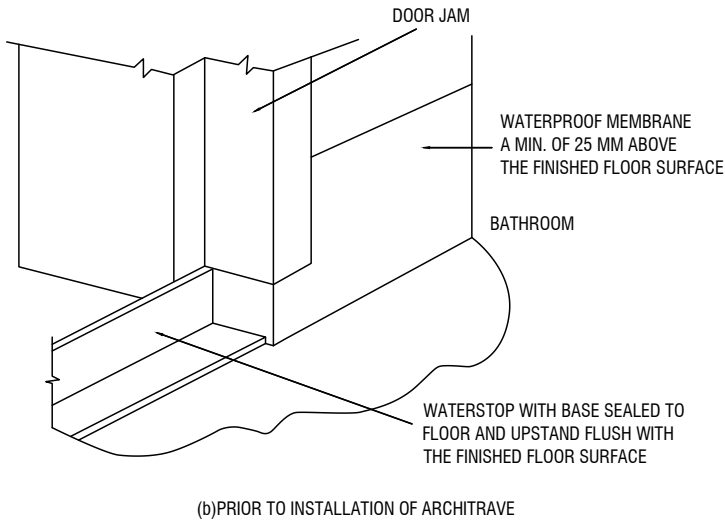


FIGURE 10.2.5:
BATH AND VESSEL ABUTTING WALL — AREAS TO BE PROTECTED

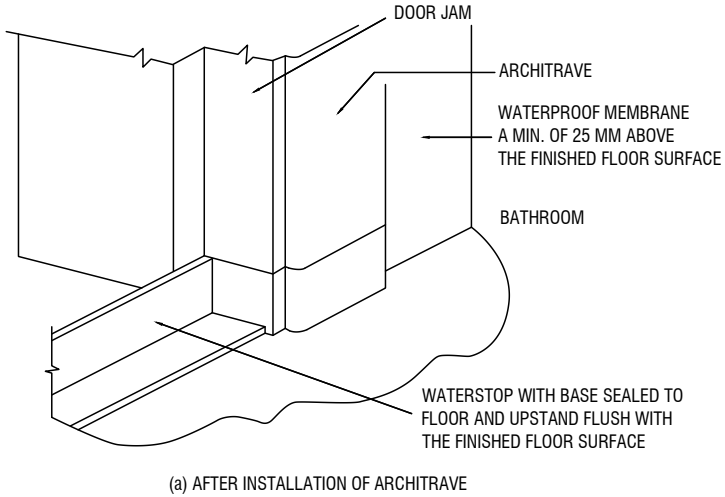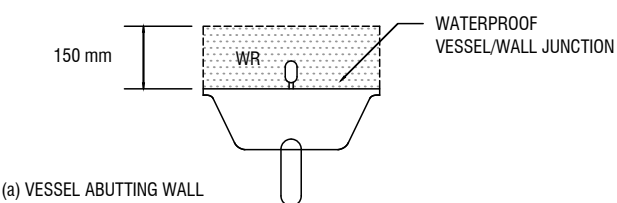

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

FIGURE 10.2.27:
EXPLANATORY: TYPICAL BOND BREAKER DETAILS

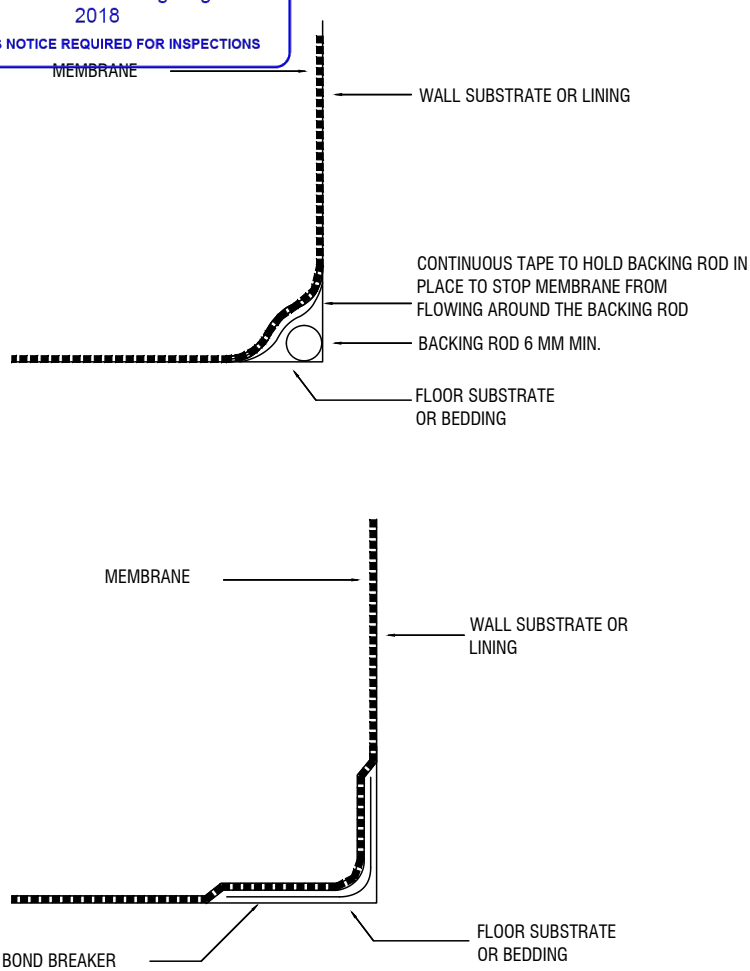

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
DETAILS

ISSUE DATE: 16.01.2024

SCALE: N/A @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:
24

FIGURE 10.2.15A:
TYPICAL ENCLOSED STEPPED DOWN SHOWER CONSTRUCTION (MEMBRANE BELOW TILE BED)


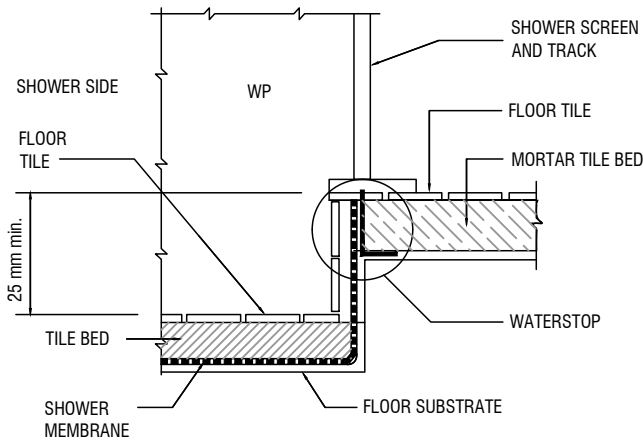


FIGURE 10.2.15B:
TYPICAL ENCLOSED STEPPED DOWN SHOWER CONSTRUCTION (MEMBRANE ABOVE TILE BED)

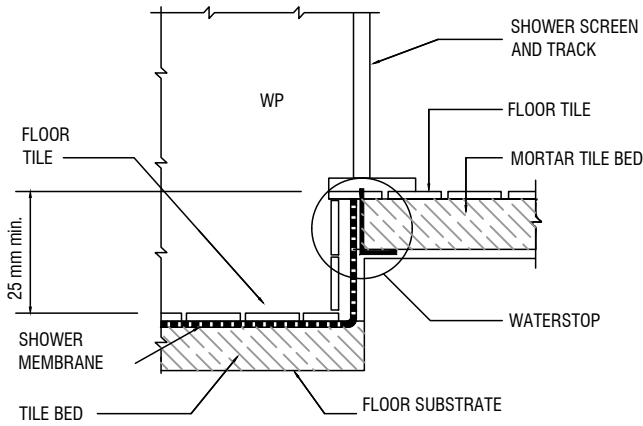

NOTE:
- FALLS IN WET AREAS (MIN 1:80 IN THE SHOWER AREA & 1:100 OUTSIDE THE SHOWER AREA).
- PROPOSED SHOWER GRATE TO HAVE A PUDDLE FLANGE RECESSED INTO THE SUBSTRATE
- PROPOSED WALL LING TO BE WATER RESISTANT PLASTERBOARD OR OTHER MATERIAL AS PER NCC GUIDELINES.
- A MINIMUM 25MM STEP DOWN FROM THE HIGHEST FINISHED FLOOR LEVEL OF THE SHOWER AREA TO THE LEVEL OUTSIDE THE SHOWER

FIGURE 10.2.15C:
TYPICAL UNENCLOSED STEPPED DOWN SHOWER CONSTRUCTION (MEMBRANE BELOW TILE BED)





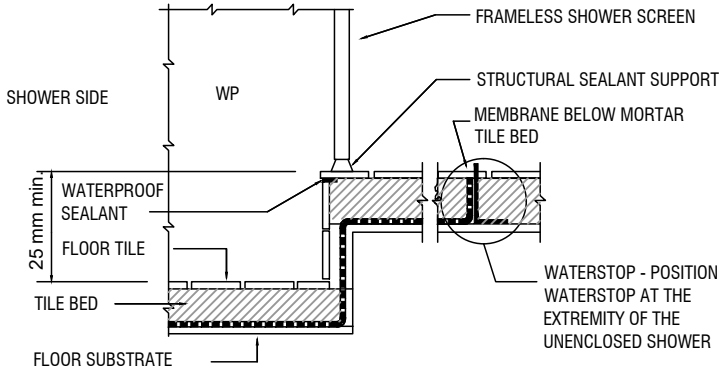


FIGURE 10.2.15D:
TYPICAL UNENCLOSED STEPPED DOWN SHOWER CONSTRUCTION (MEMBRANE ABOVE TILE BED)

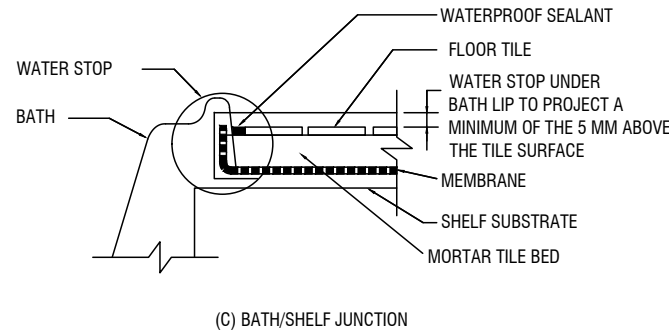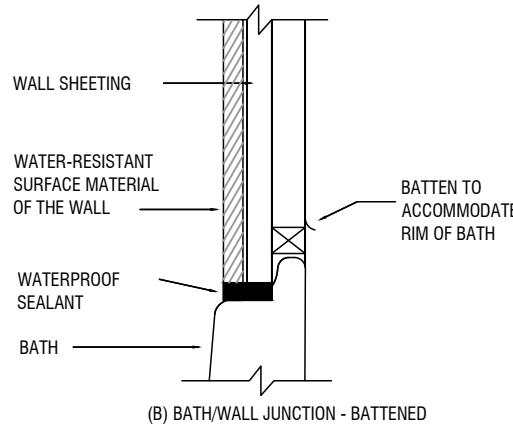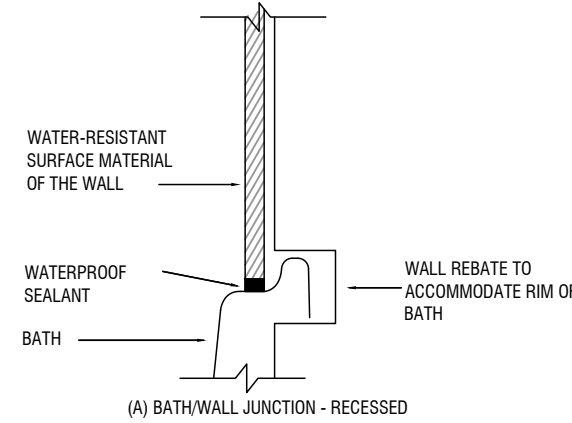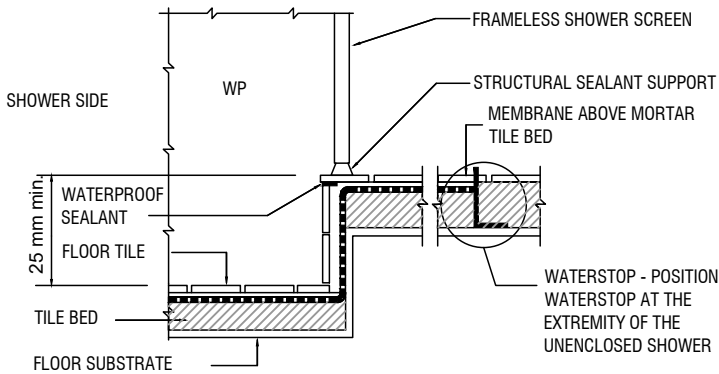

REVISION	DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024 E.C.

PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:


DRAWING NAME:
DETAILS

ISSUE DATE: 16.01.2024

SCALE: N/A @ A3

DRAWN: E.C.

CHECKED: E.C.



PROJECT NO: 042224

SHEET NO:

25


LEGEND

Existing Fence Line - - - - -

Proposed Shadow - - - - -

22 September Shadow Cast

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

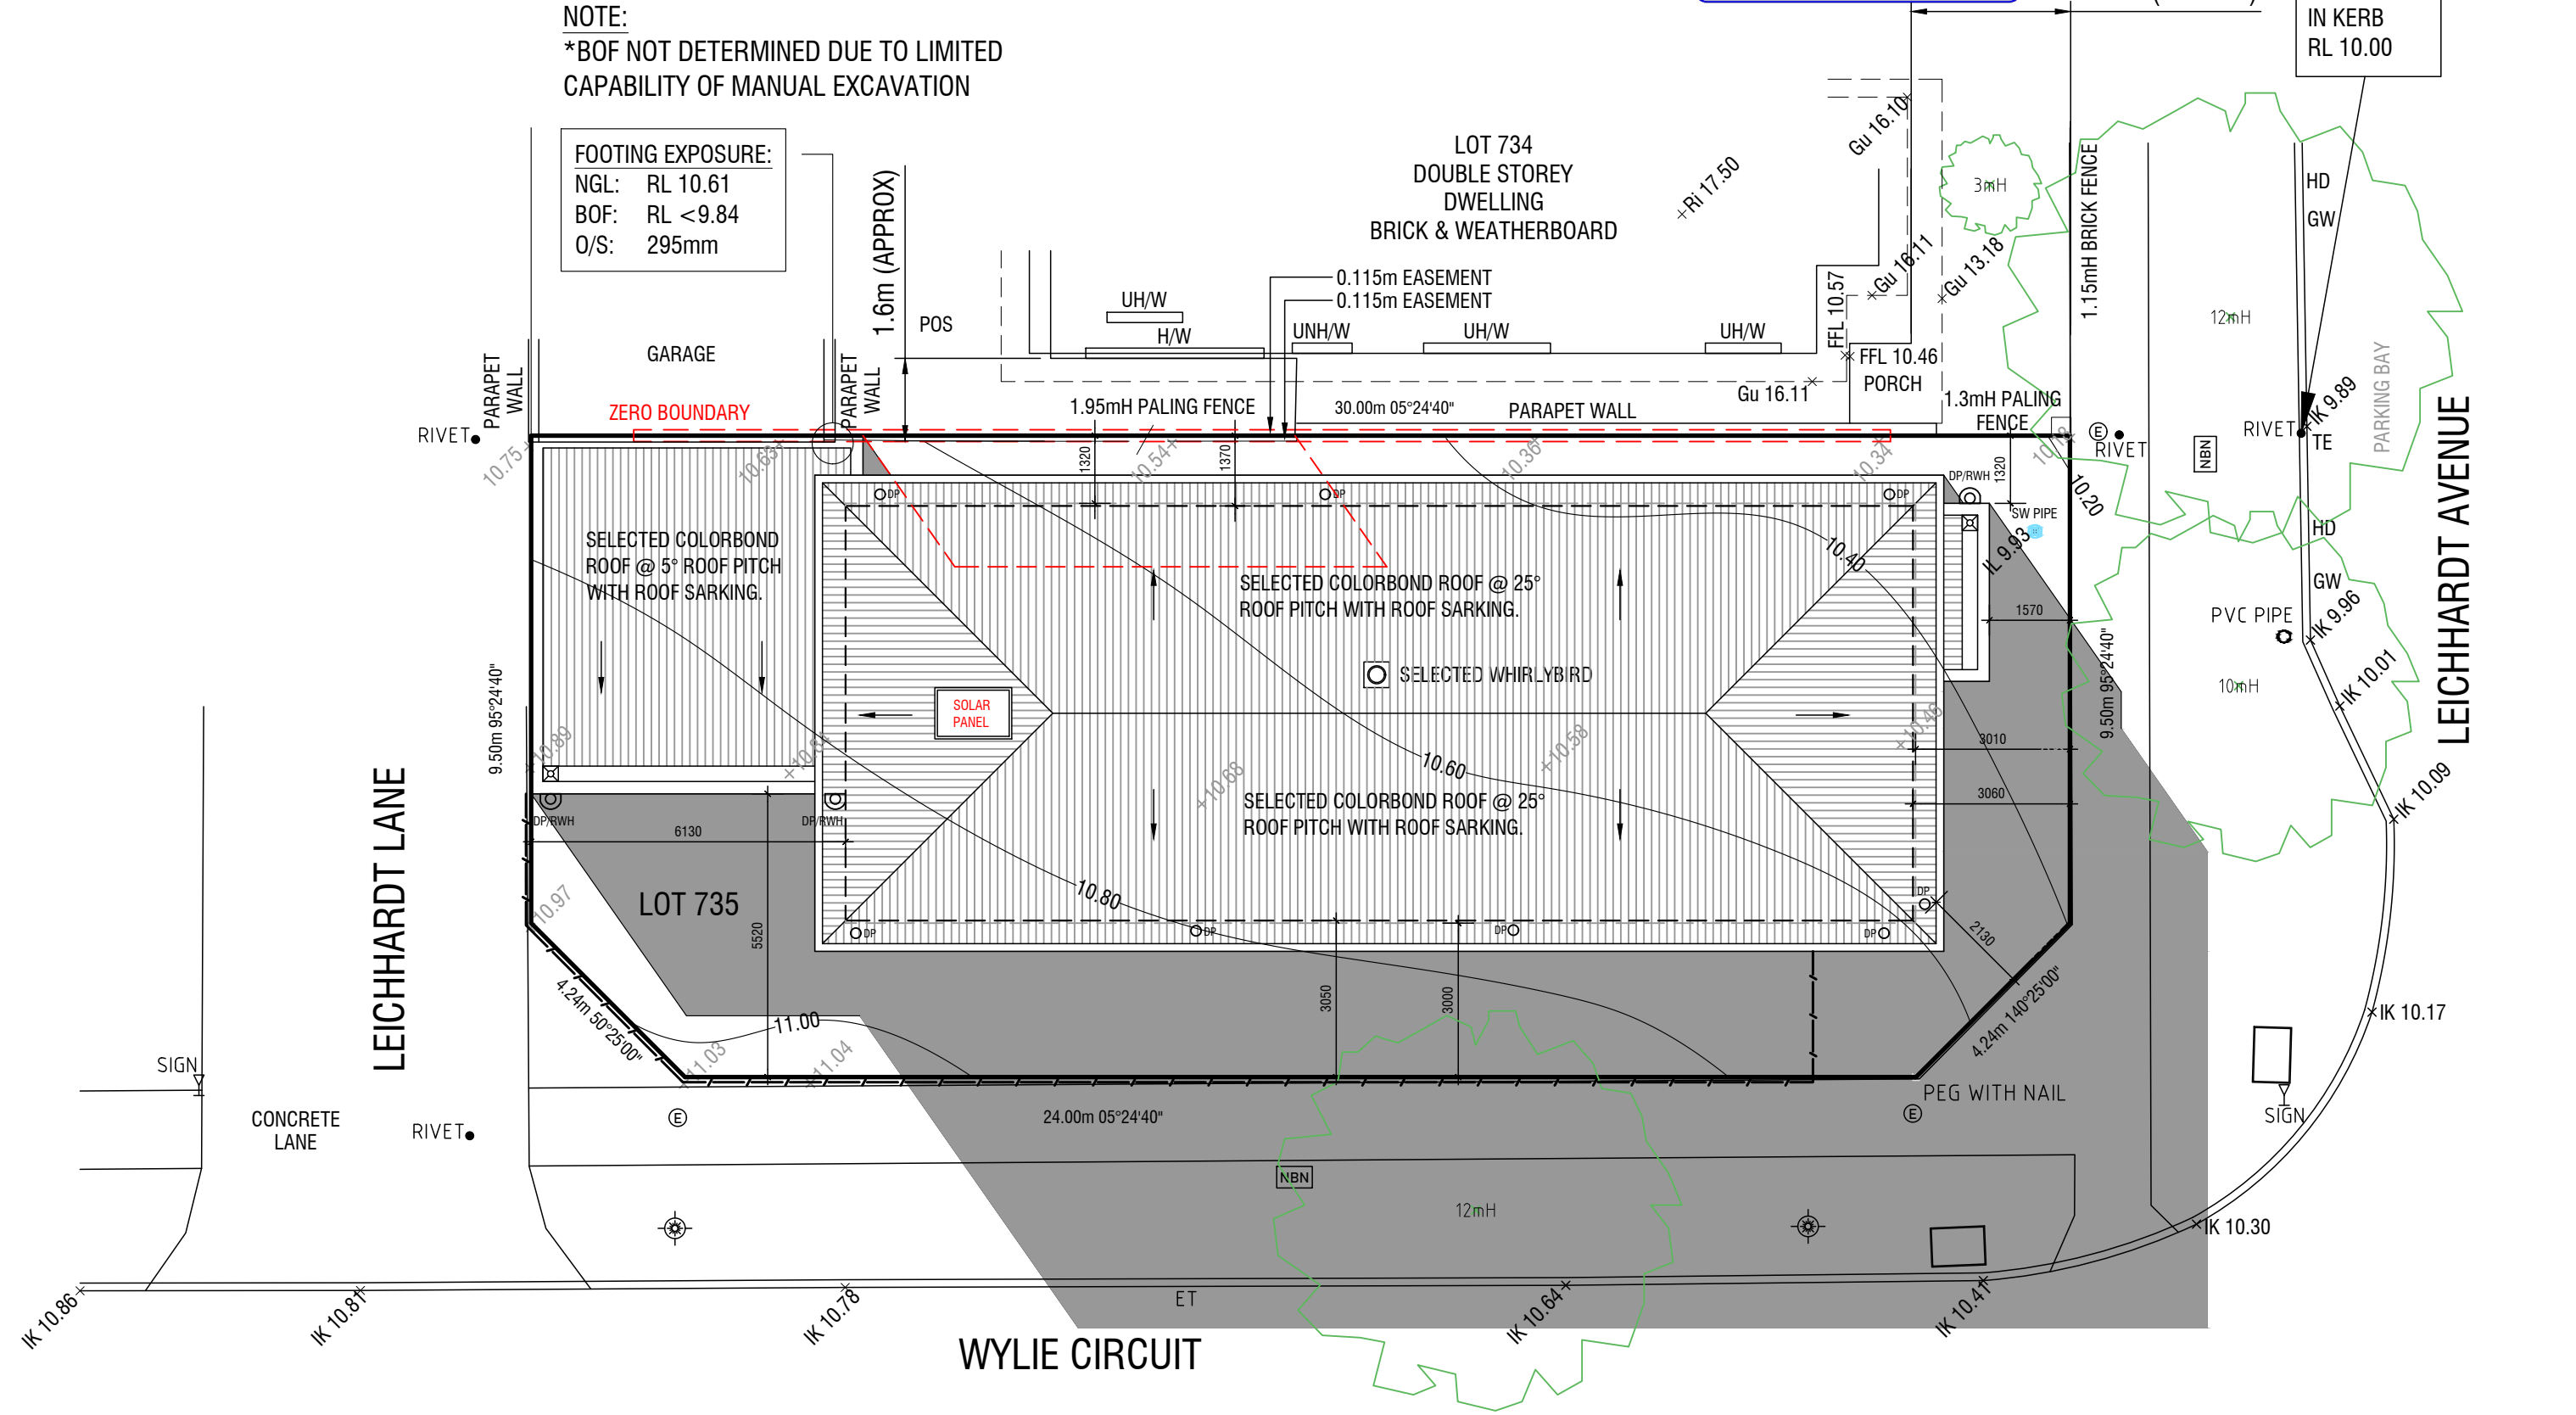

LEGEND

Existing Fence Line - - - - -

Proposed Shadow ██████████


22 September Shadow Cast

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the
Building Act 1993 & Building Regulations
2018

24 HOURS NOTICE REQUIRED FOR INSPECTIONS

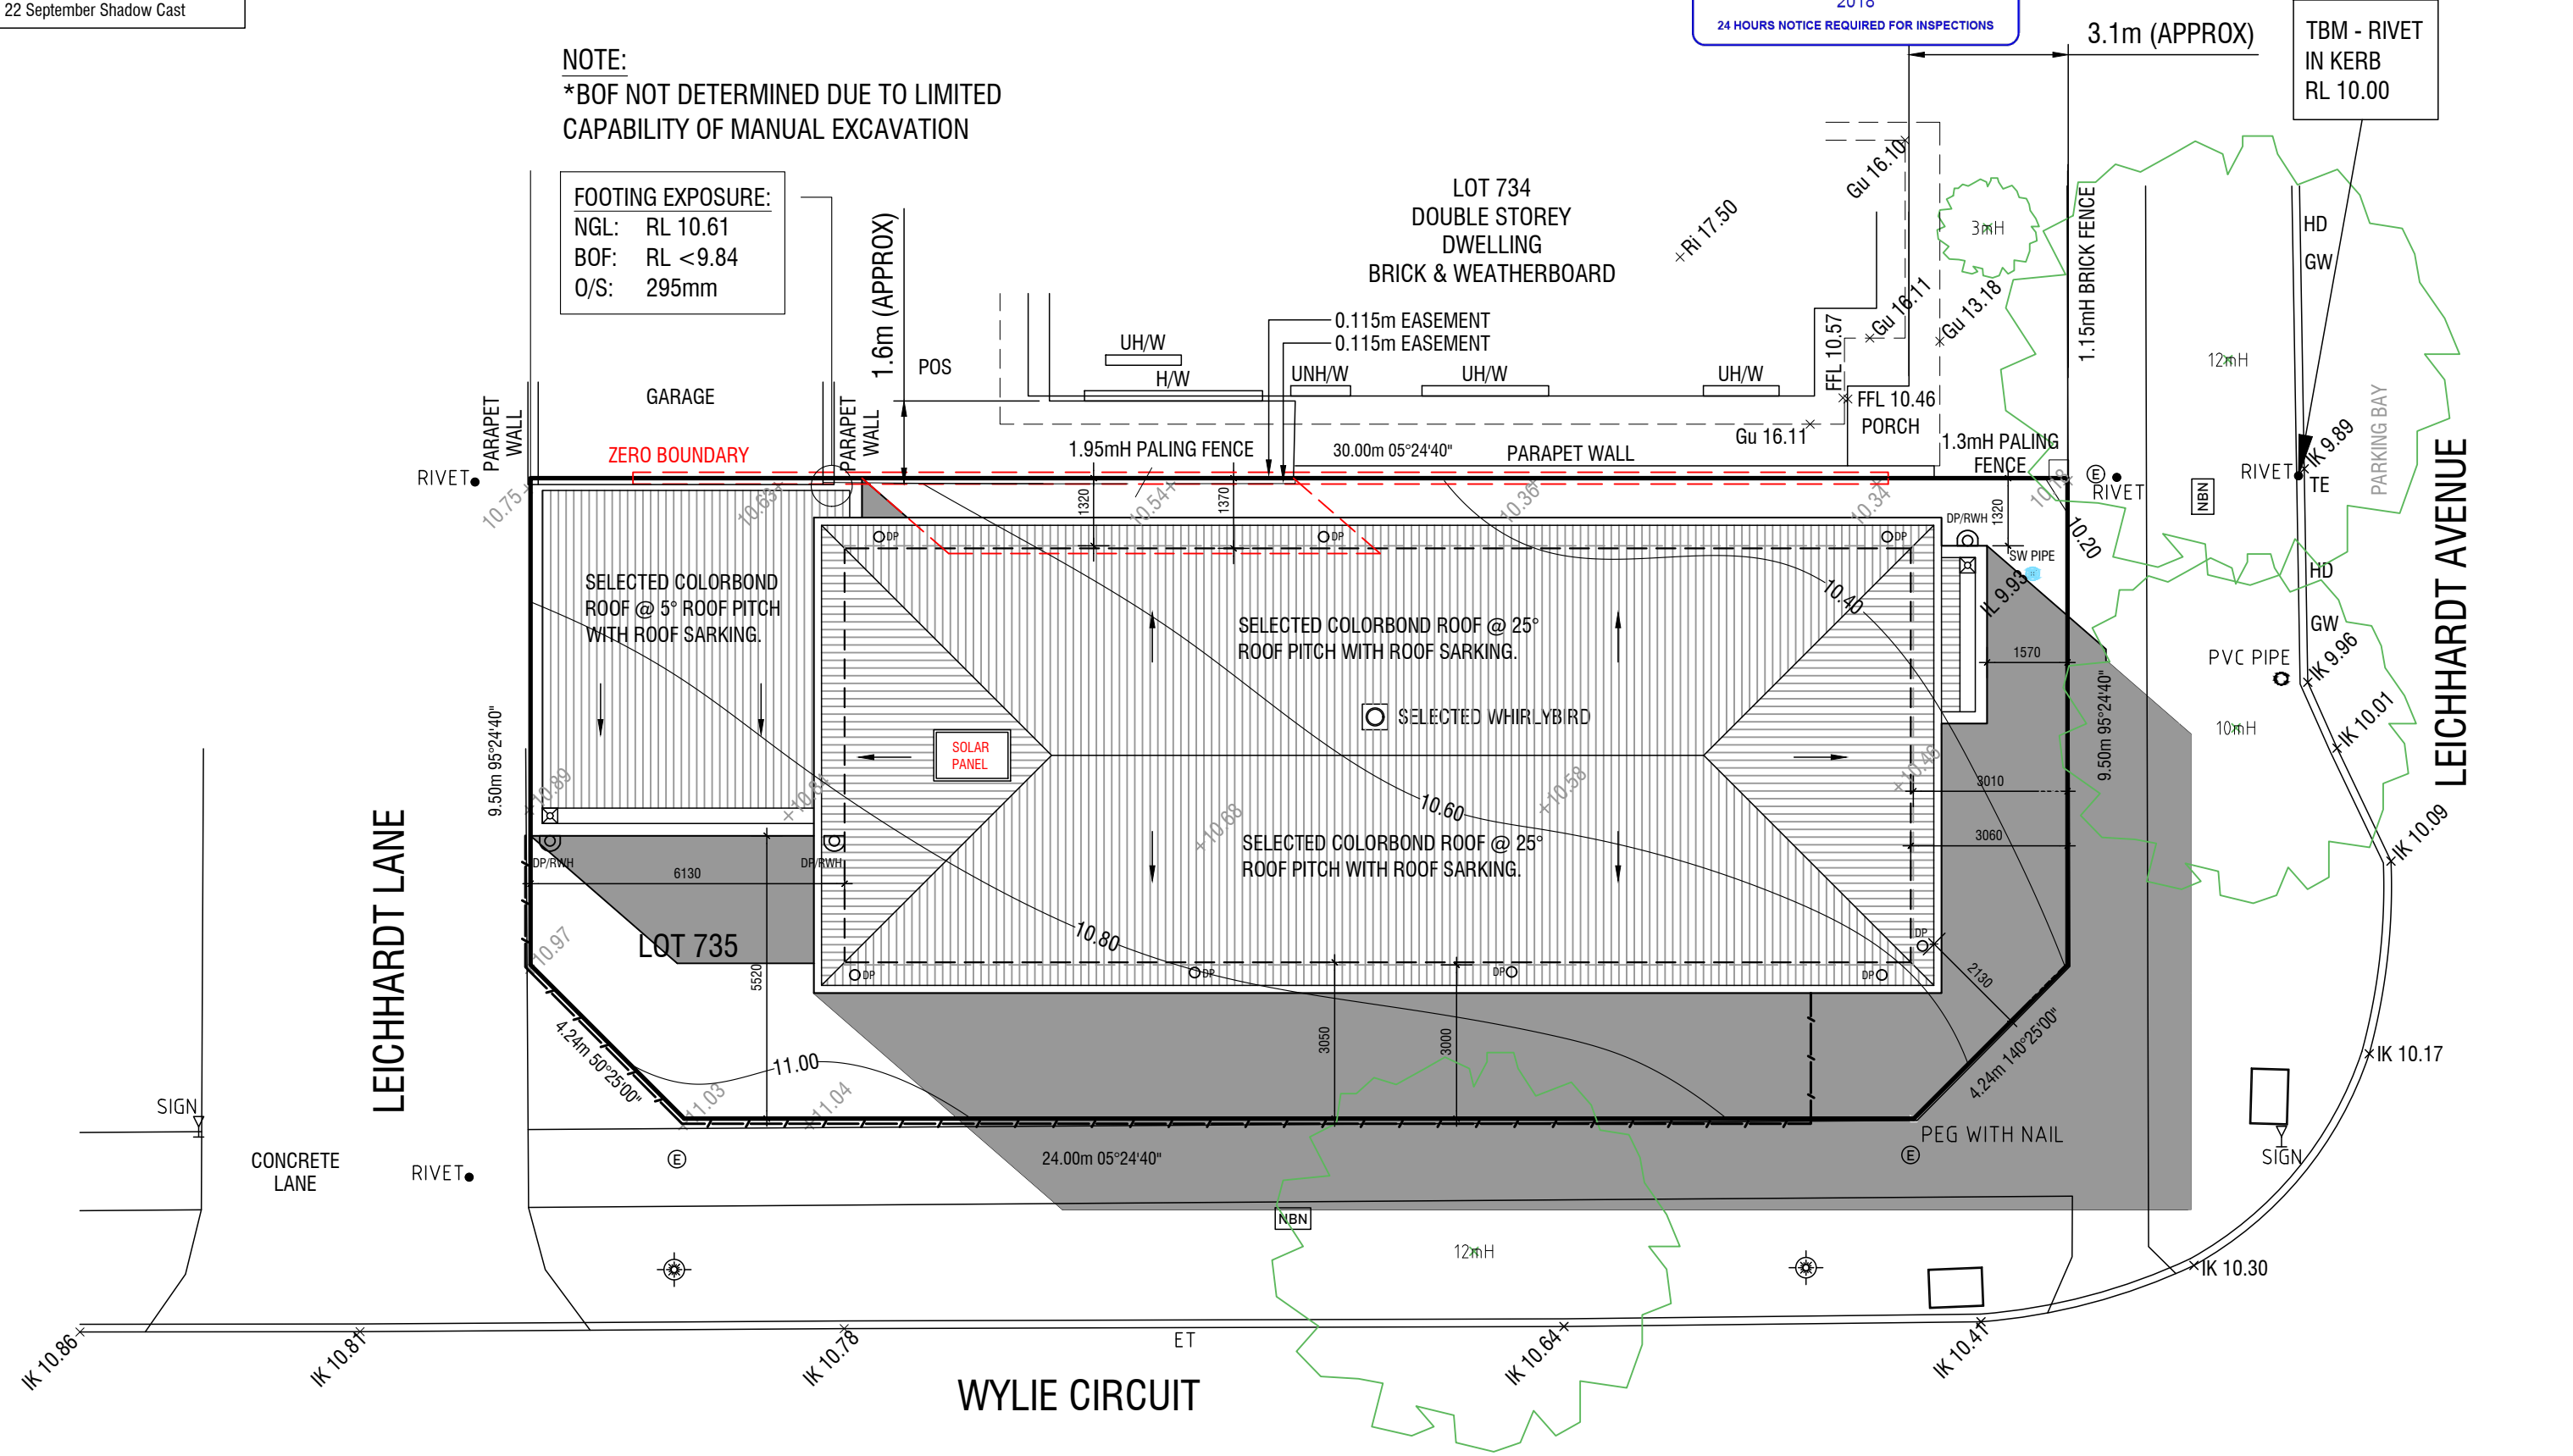

LEGEND

Existing Fence Line - - - - -


Proposed Shadow

22 September Shadow Cast

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

NOTE:
*BOF NOT DETERMINED DUE TO LIMITED
CAPABILITY OF MANUAL EXCAVATION

FOOTING EXPOSURE:
NGL: RL 10.61
BOF: RL <9.84
O/S: 295mm

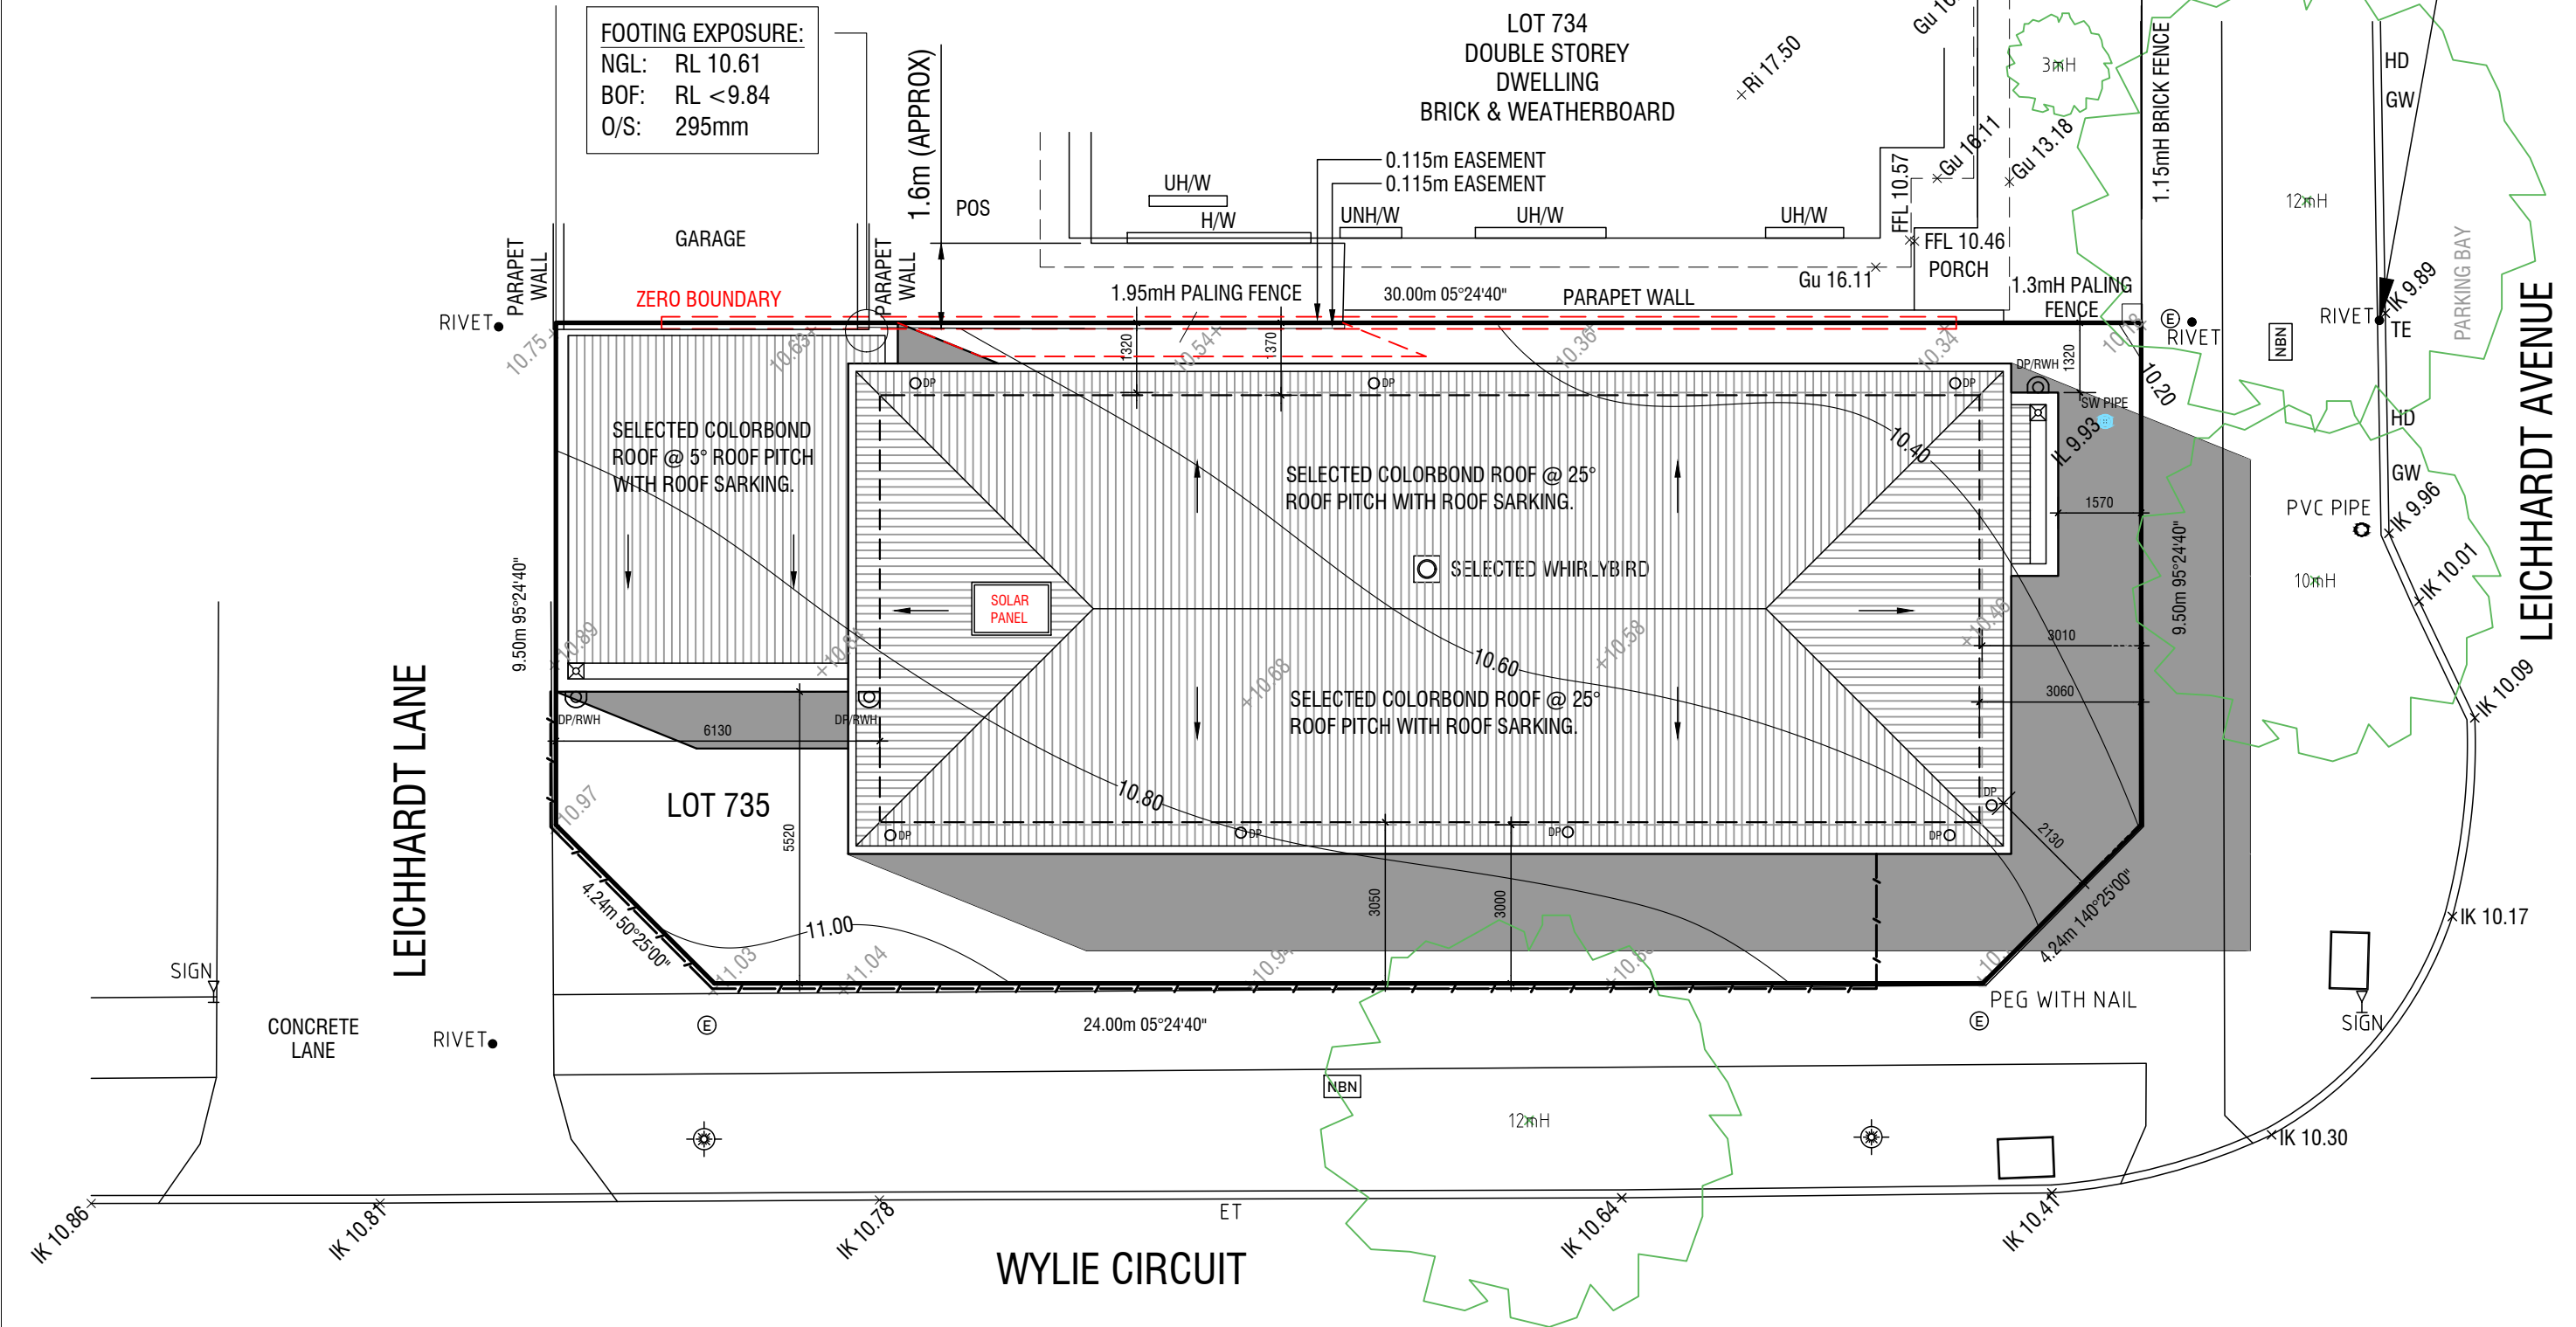

REVISION		DATE:	BY:
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


PROJECT:
NEW DWELLING

ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

CLIENT:

DRAWING NAME:
SHADOW DIAGRAM 11:00AM

ISSUE DATE: 16.01.2024	
SCALE:	1:125 @ A3
DRAWN:	E.C.
CHECKED:	E.C.



PROJECT NO: 042224

SHEET NO:
28

LEGEND

Existing Fence Line - - - - -

Proposed Shadow - - - - -


22 September Shadow Cast

Northpoint Building Surveyors

APPROVED DOCUMENT

Works must comply with the
Building Act 1993 & Building Regulations
2018

24 HOURS NOTICE REQUIRED FOR INSPECTIONS

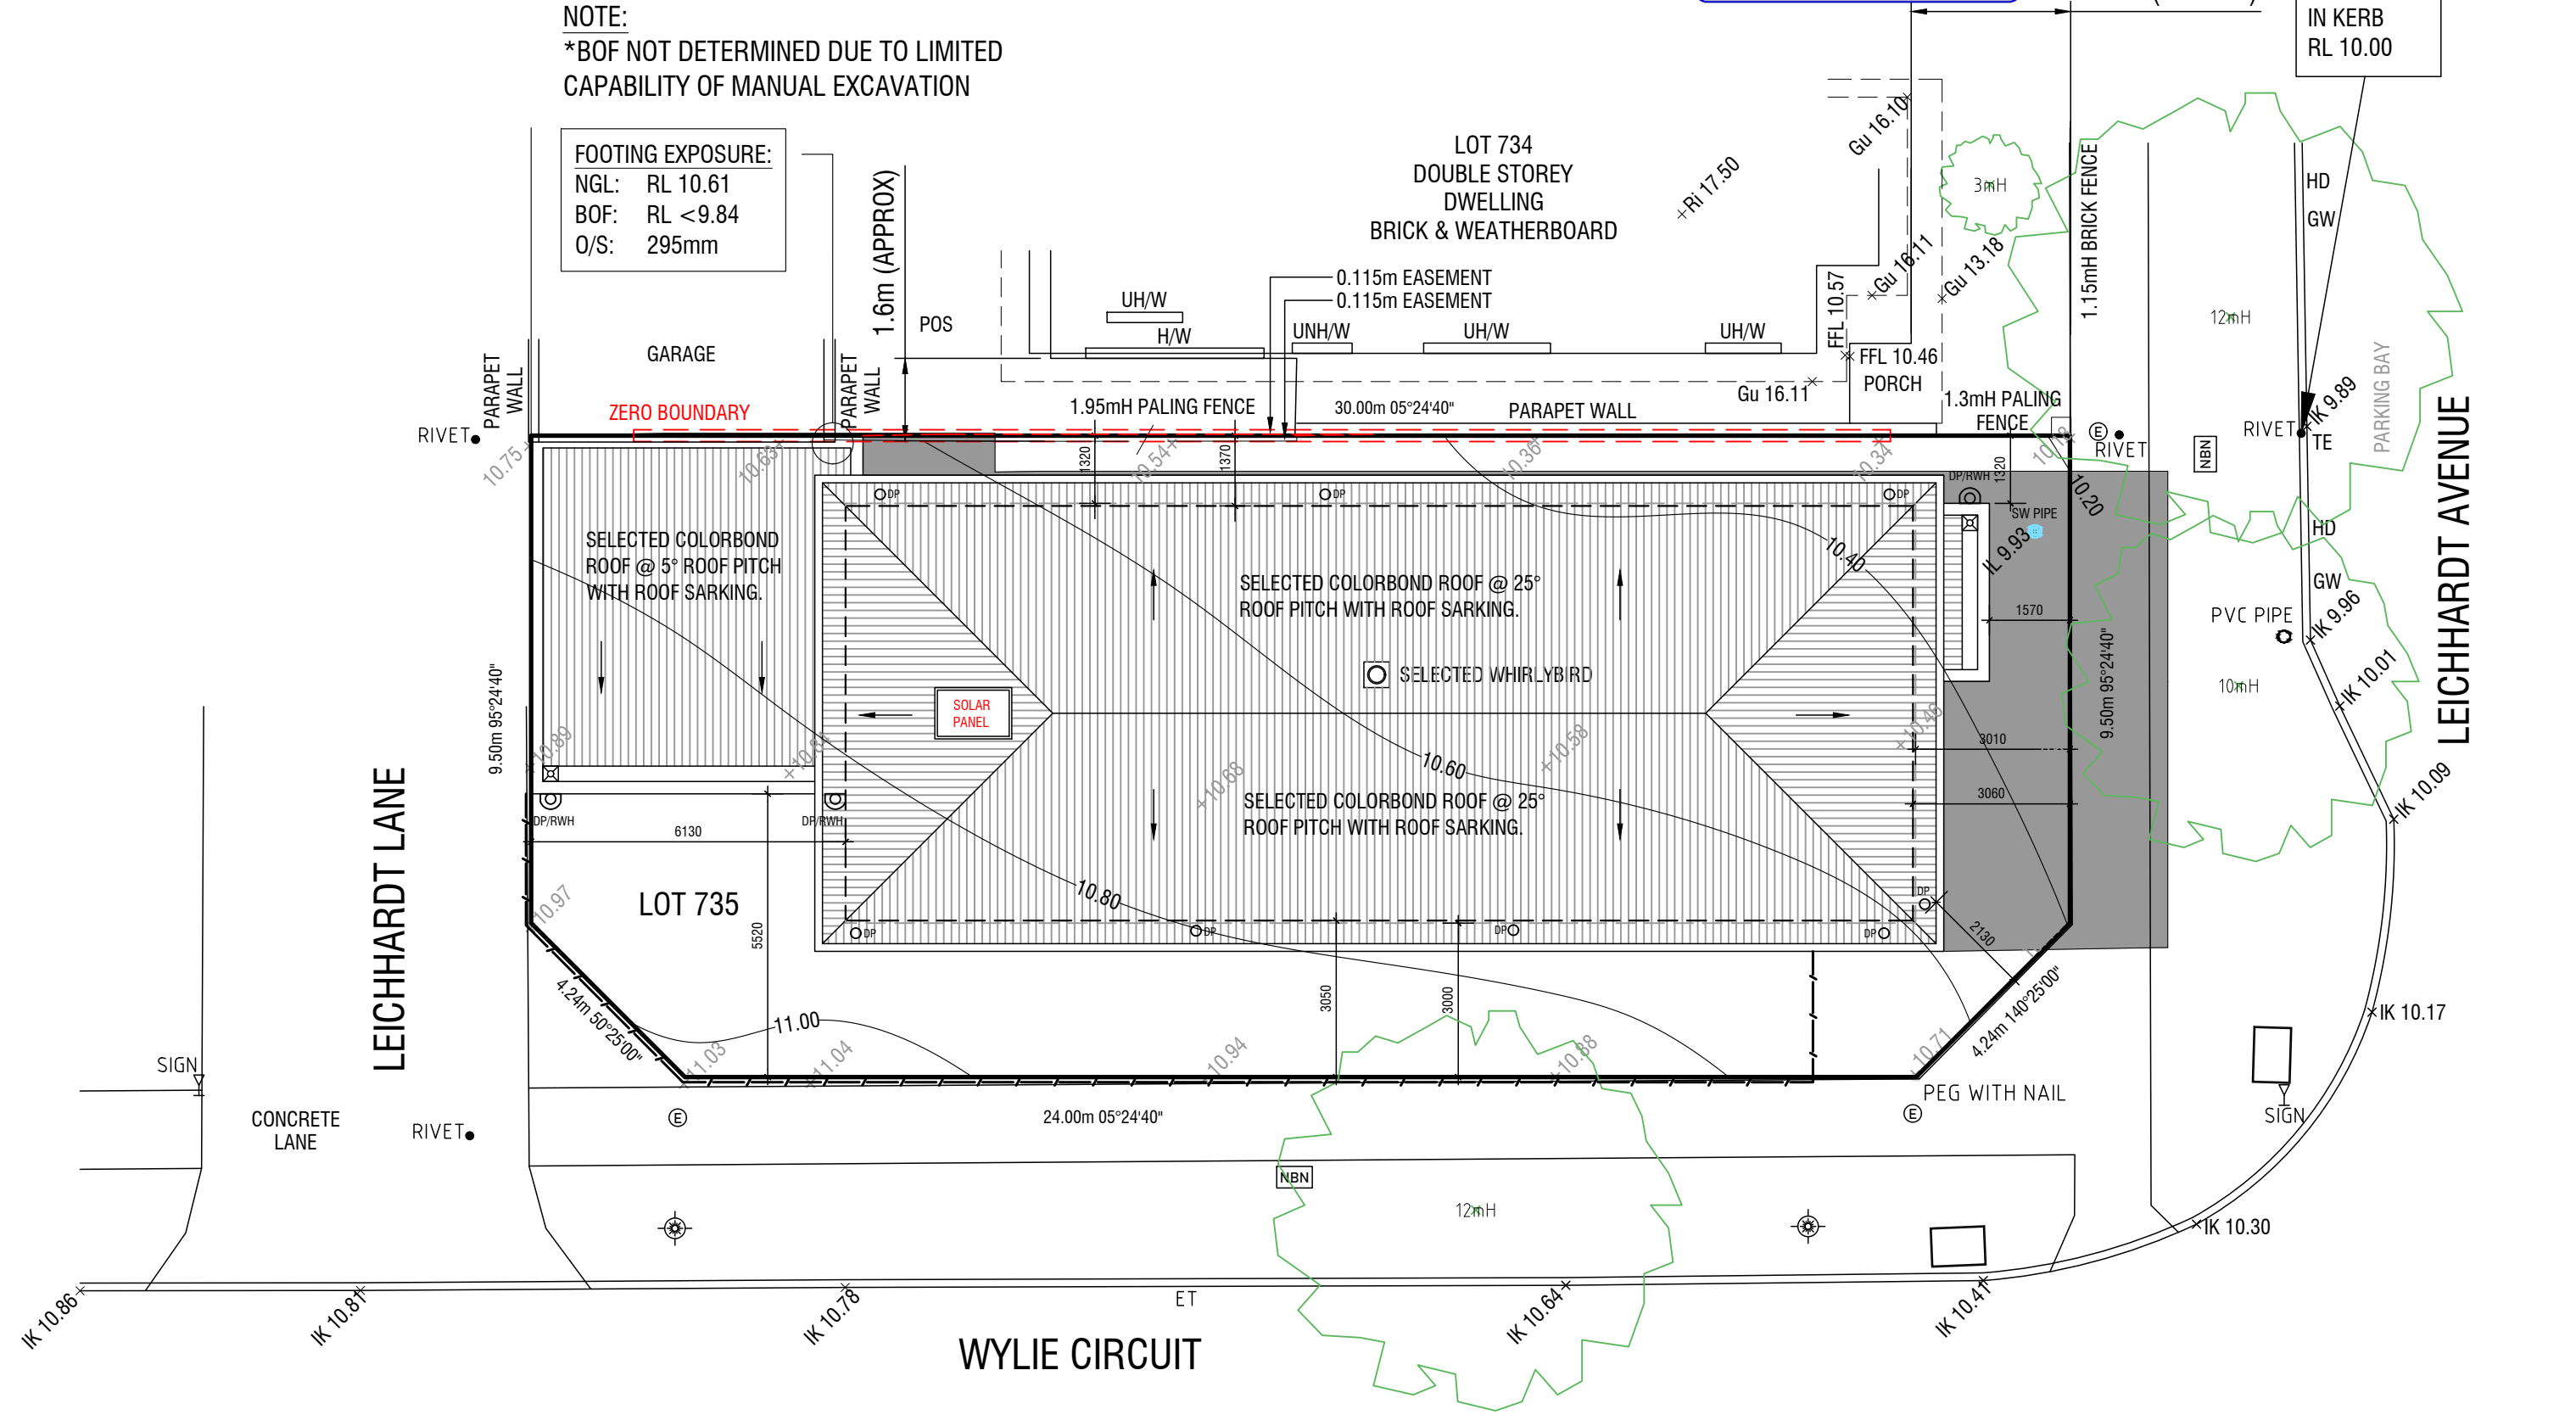

LEGEND

Existing Fence Line - - - - -

Proposed Shadow

22 September Shadow Cast

Existing Fence Line - - - - -

Proposed Shadow 

22 September Shadow Cast

Northpoint Building Surveyors
APPROVED DOCUMENT
Works must comply with the
Building Act 1993 & Building Regulations
2018
24 HOURS NOTICE REQUIRED FOR INSPECTIONS

NOTE:
*BOF NOT DETERMINED DUE TO LIMITED
CAPABILITY OF MANUAL EXCAVATION

FOOTING EXPOSURE:
NGL: RL 10.61
BOF: RL <9.84
O/S: 295mm

LOT 734
DOUBLE STOREY
DWELLING
BRICK & WEATHERBOARD

— 0.115m EASEMENT
— 0.115m EASEMENT

GARAGE

ZERO BOUNDARY

SELECTED COLORBOND
ROOF @ 5° ROOF PITCH
WITH ROOF SARKING.

SELECTED COLORBOND ROOF @ 25°
ROOF PITCH WITH ROOF SARKING.

☐ SELECTED WHIRLYBIRD

SELECTED COLORBOND ROOF @ 25°
ROOF PITCH WITH ROOF SARKING.

LOT 735

LEICHHARDT LANE

CONCRETE
LANE

WYLIE CIRCUIT

3.1m (APPROX)

TBM - RIVET
IN KERB
RL 10.00

LEICHHARDT AVENUE

REVISION

DATE:

BY:

PROJECT:
NEW DWELLING

CLIENT:

ISSUE DATE: 16.01.2024

PROJECT NO: 042224

-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.


ADDRESS:
LOT 735 (NO. 15) LEICHHARDT
AVENUE, BURNSIDE HEIGHTS.

DRAWING NAME:
SHADOW DIAGRAM 1:00PM

SCALE: 1:125 @ A3


DRAWN: E.C.

CHECKED: E.C.



SHEET NO:

30


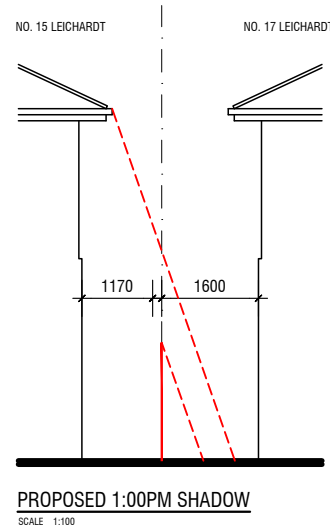



LEGEND

Existing Fence Line - - - - -

Proposed Shadow - - - - -

22 September Shadow Cast

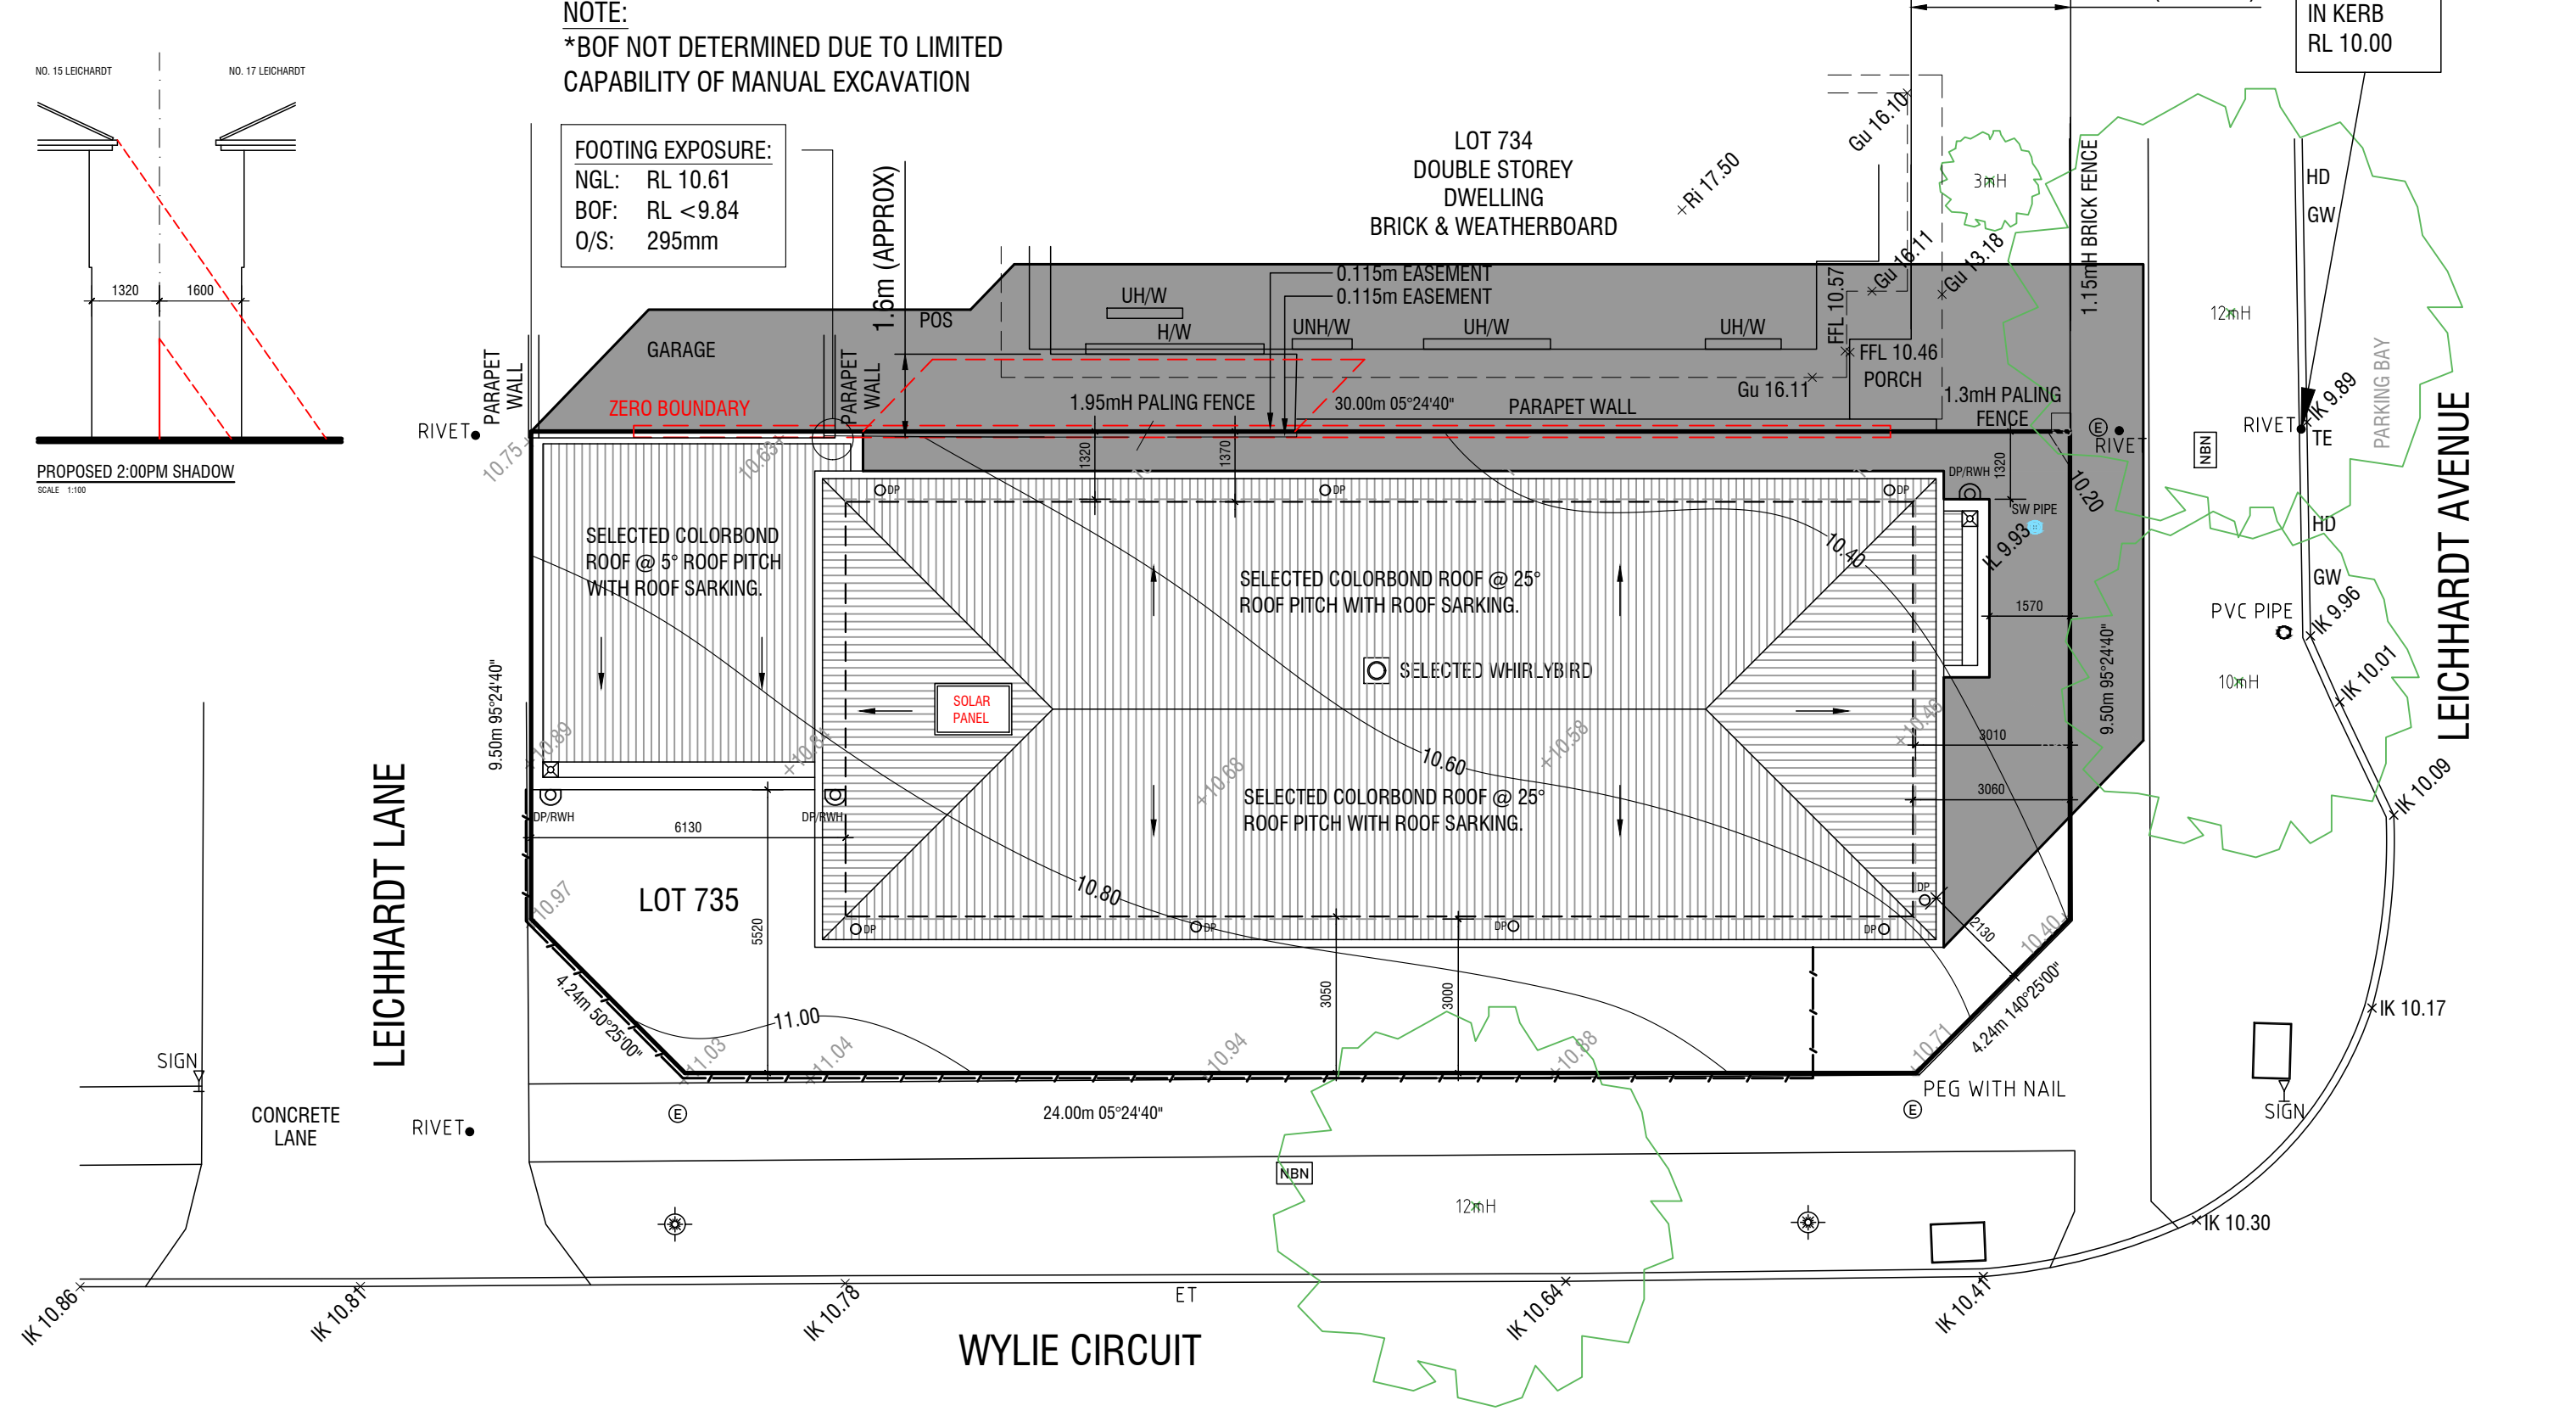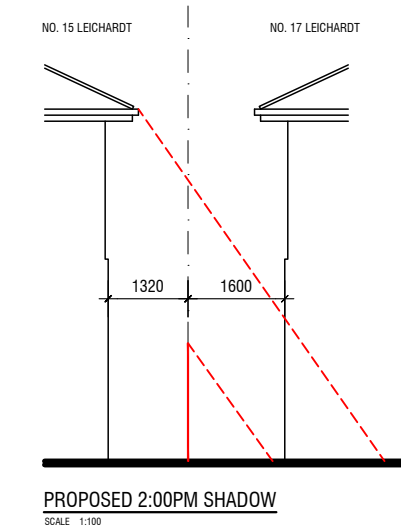

REVISION		DATE:	BY:	PROJECT:	CLIENT:	ISSUE DATE: 16.01.2024		PROJECT NO: 042224
-	DRAWINGS ISSUED FOR CONSTRUCTION.	20.01.2024	E.C.	NEW DWELLING		SCALE: 1:125 @ A3		SHEET NO:
				ADDRESS:	DRAWING NAME:	DRAWN: E.C.		31
				LOT 735 (NO. 15) LEICHHARDT AVENUE, BURNSIDE HEIGHTS.	SHADOW DIAGRAM 2:00PM	CHECKED: E.C.		

