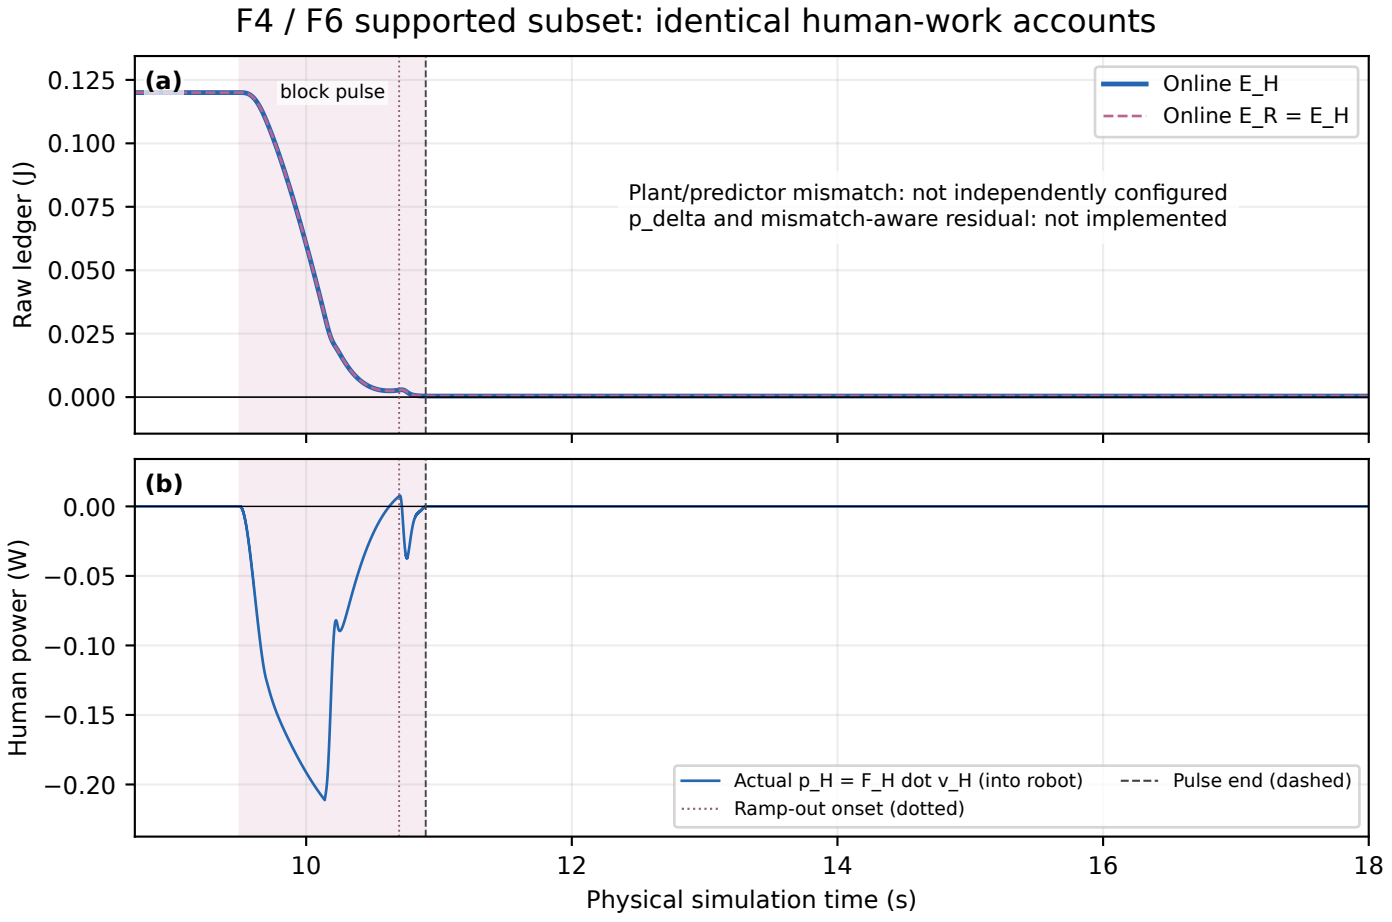

F4 / F6 supported subset: identical human-work accounts
(a)
block pulse
Online E_H
Online E_R = E_H
Plant/predictor mismatch: not independently configured
p_delta and mismatch-aware residual: not implemented
Raw ledger (J)
0.125
0.100
0.075
0.050
0.025
0.000
(b)
Human power (W)
0.00
−0.05
−0.10
−0.15
−0.20
Actual p_H = F_H dot v_H (into robot)
Pulse end (dashed)
Ramp-out onset (dotted)
10
12
14
16
18
Physical simulation time (s)