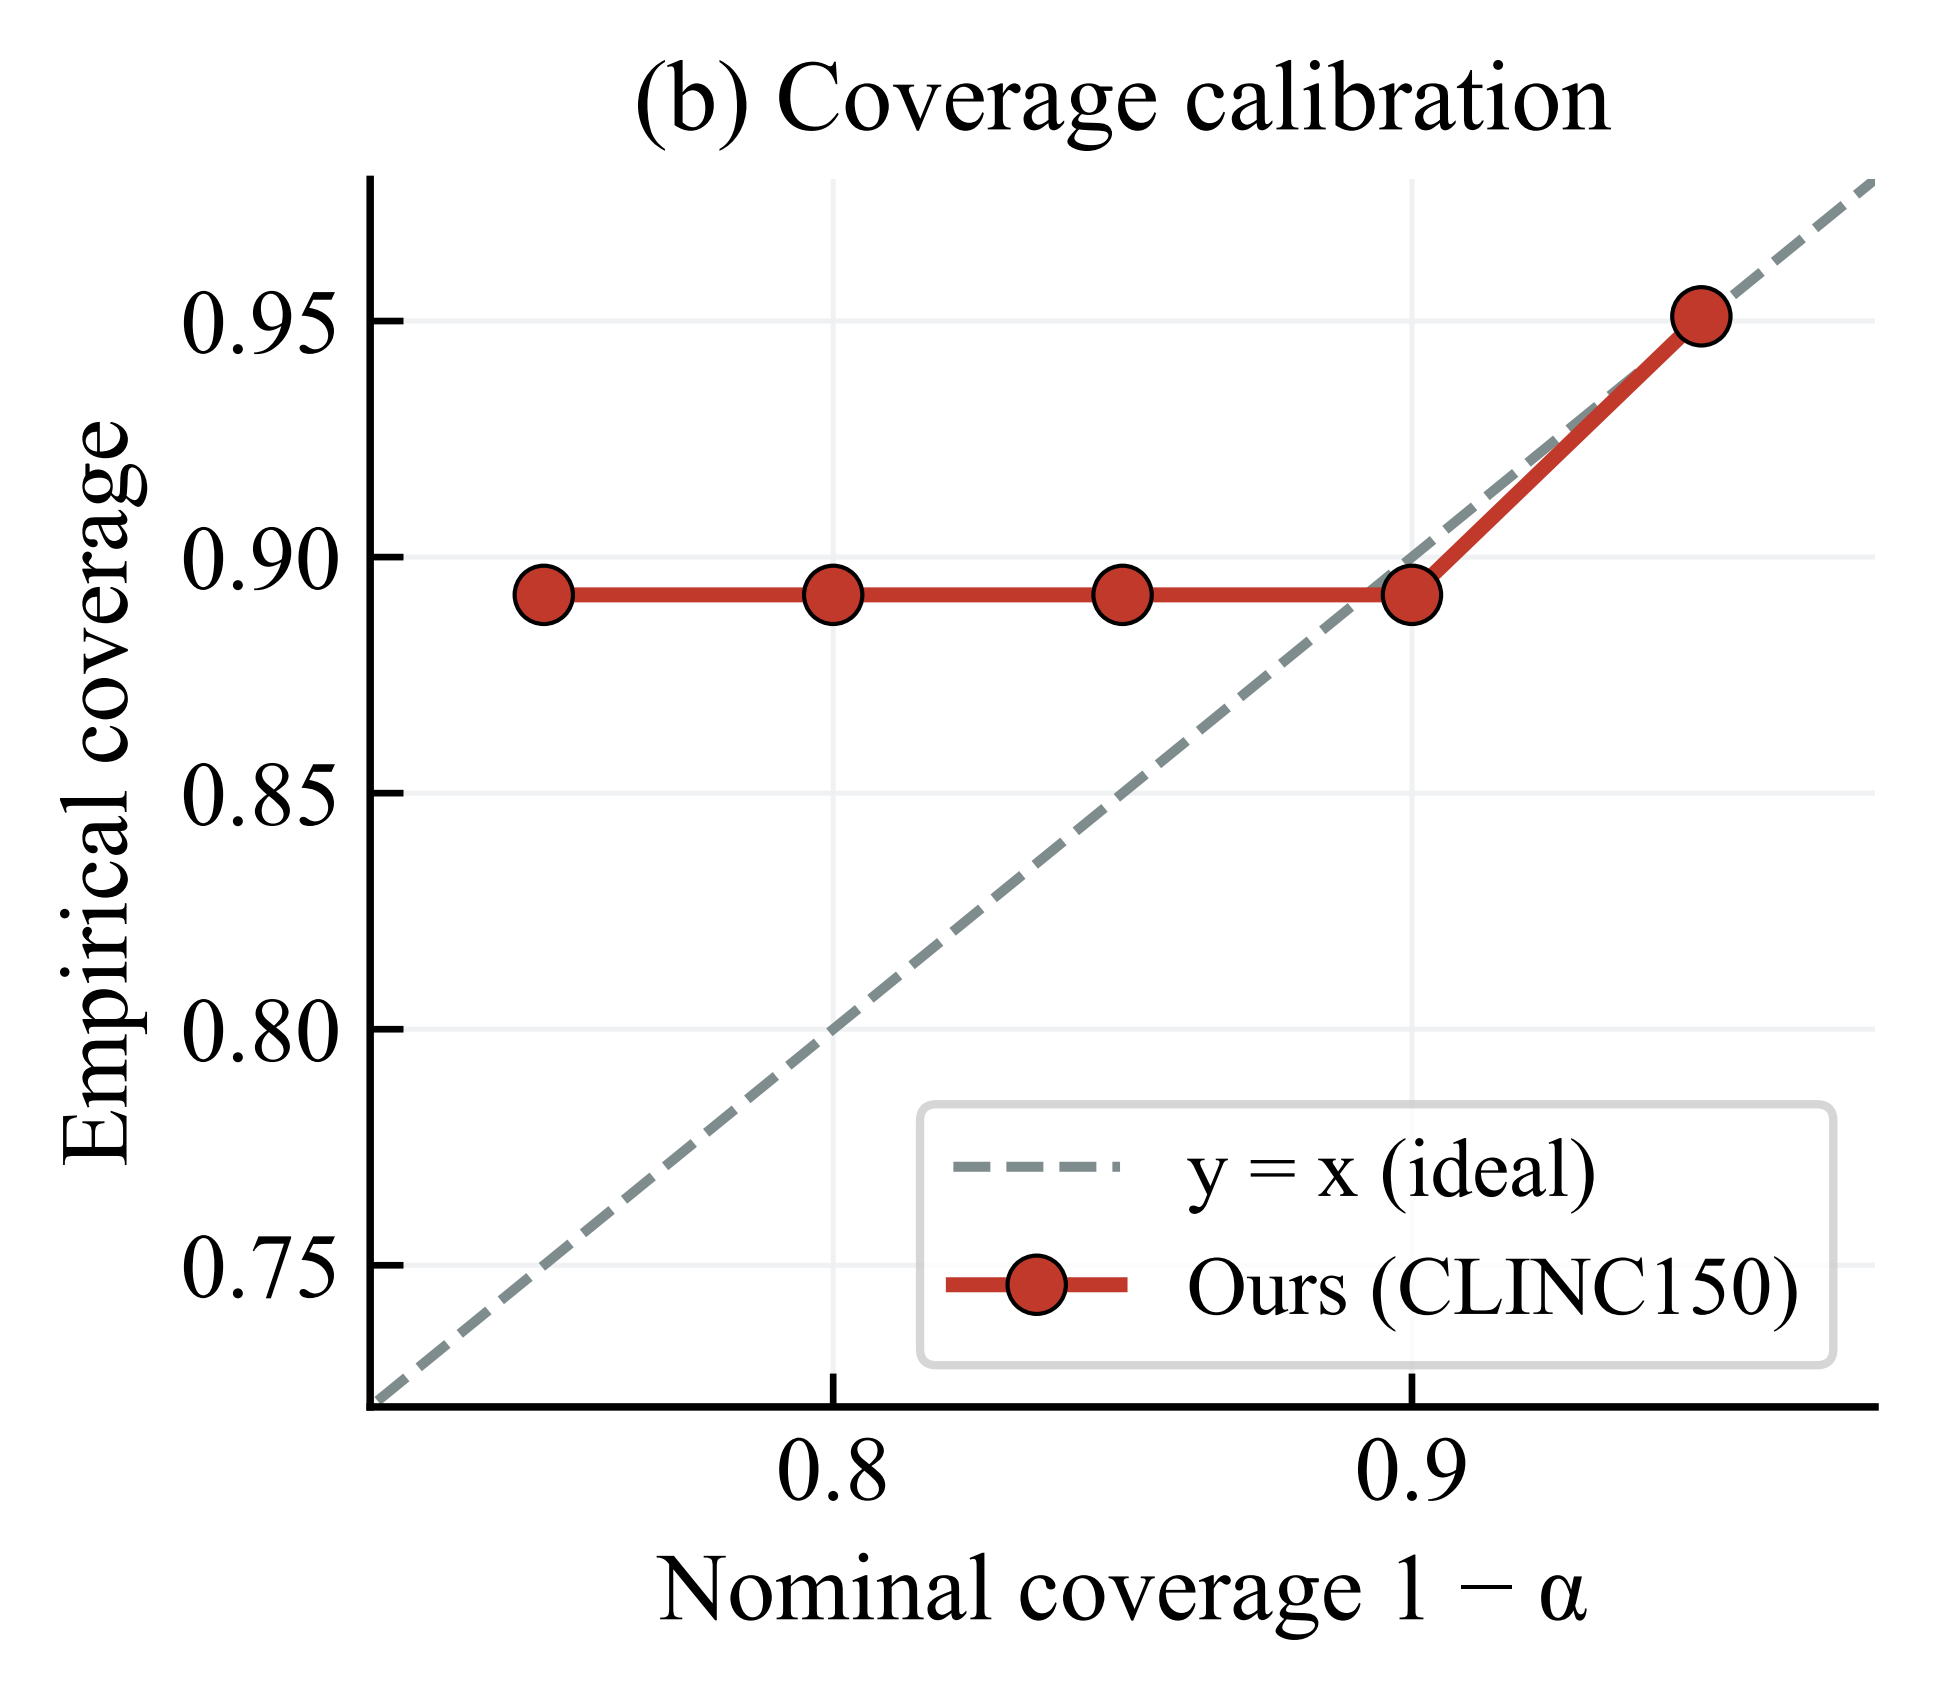
(b) Coverage calibration
Empirical coverage
0.95
0.90
0.85
0.80
0.75
0.8
0.9
Nominal coverage 1 − α
y = x (ideal)
Ours (CLINC150)