


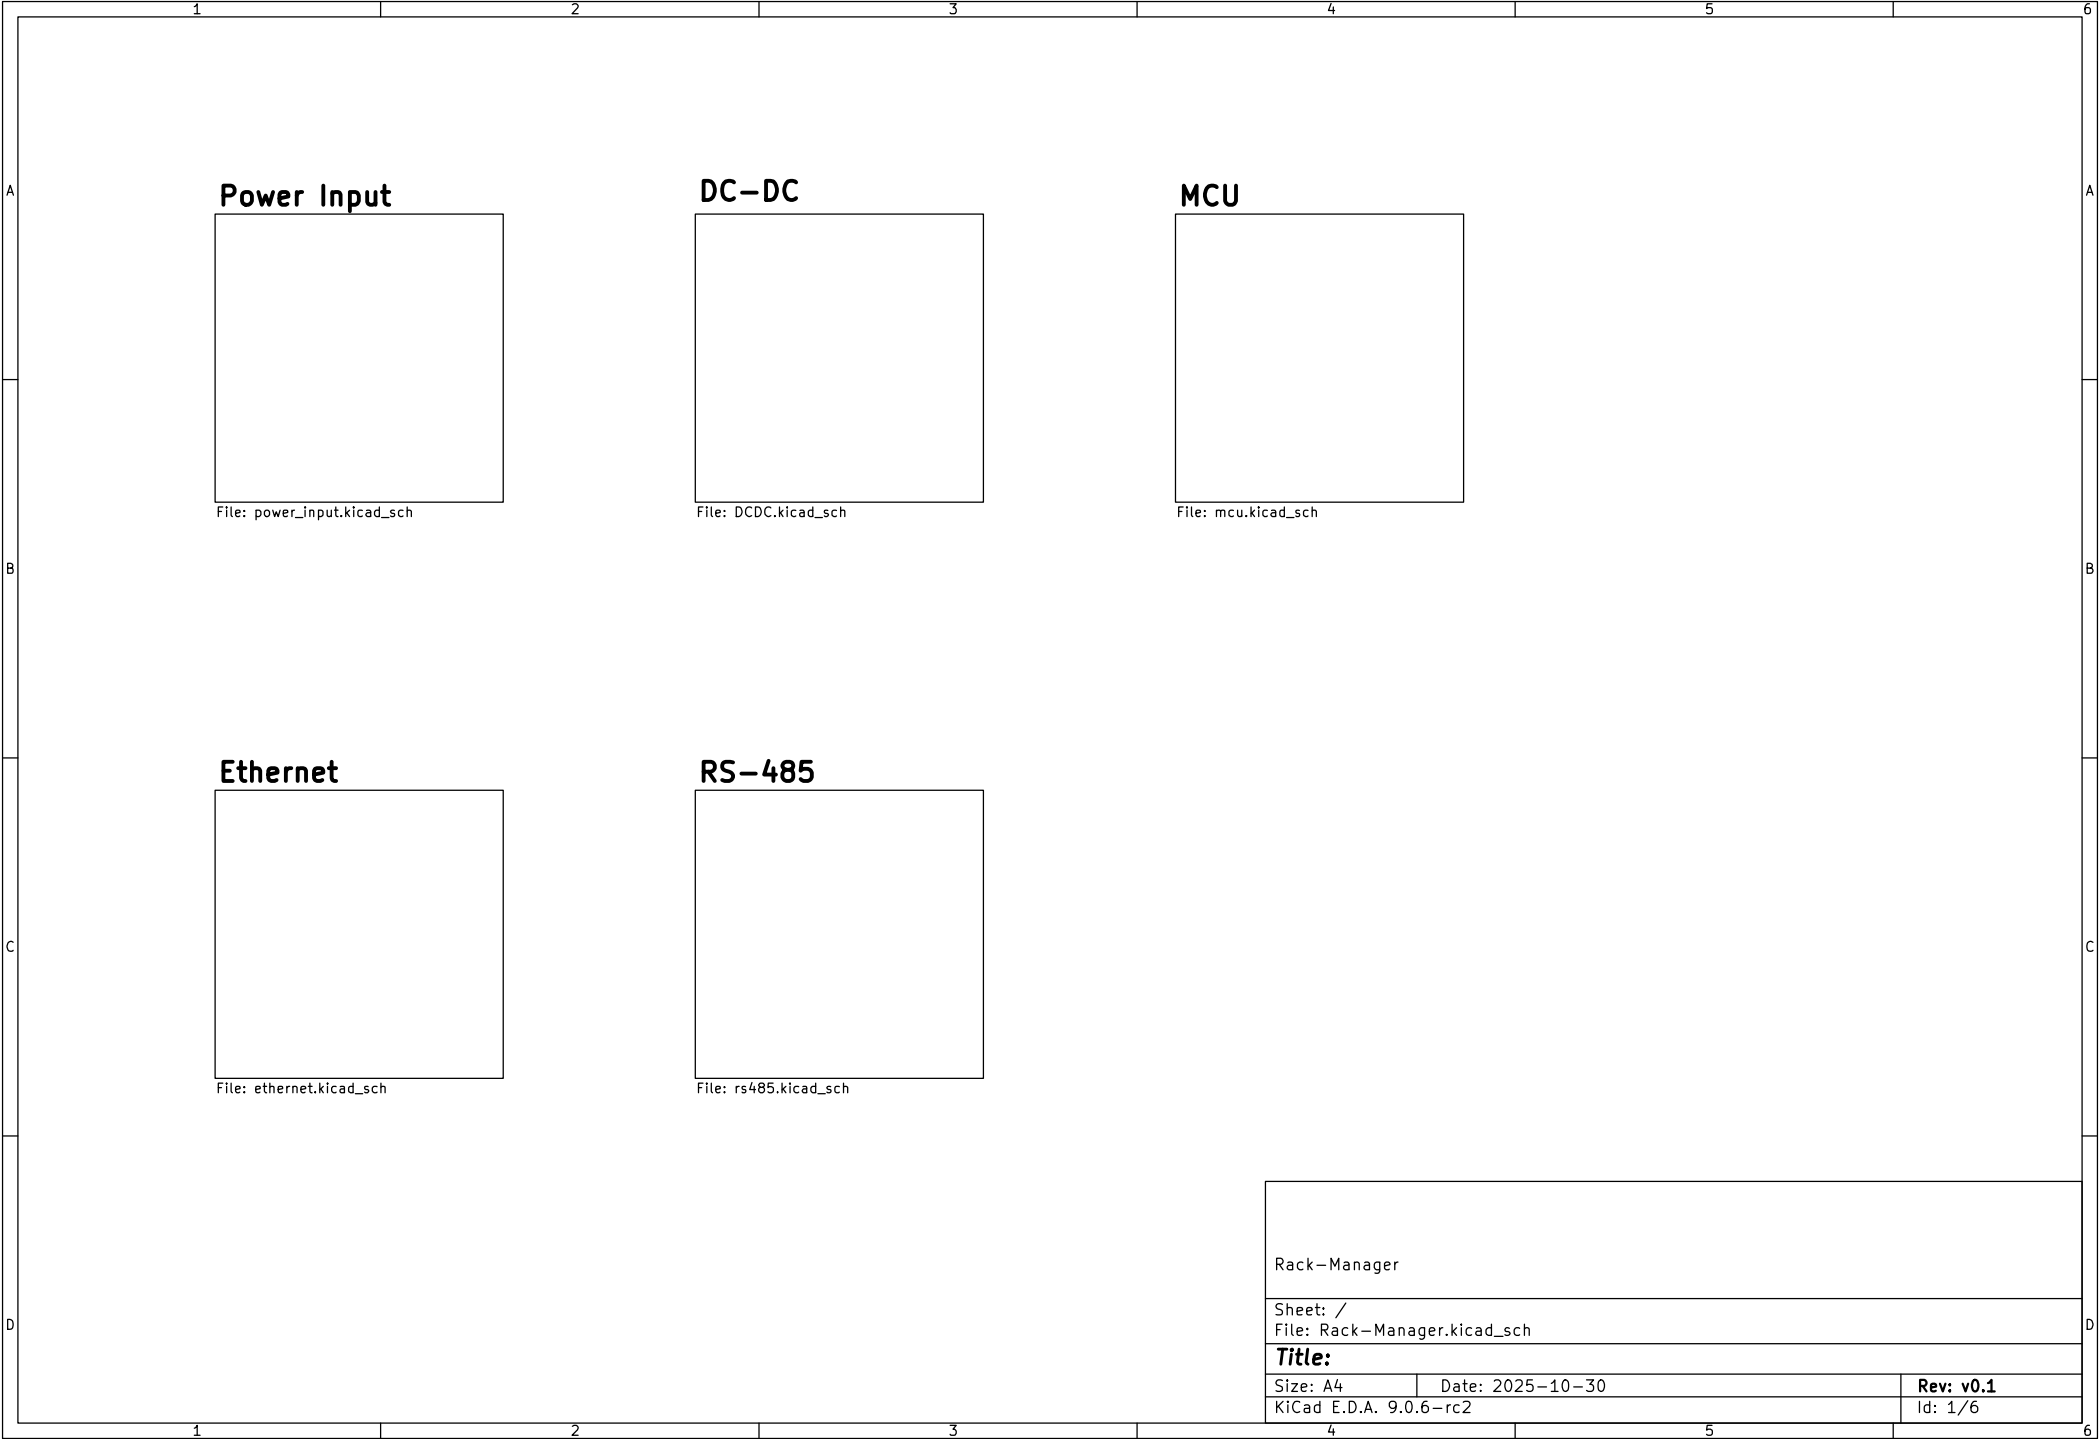
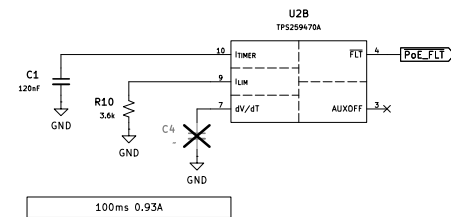
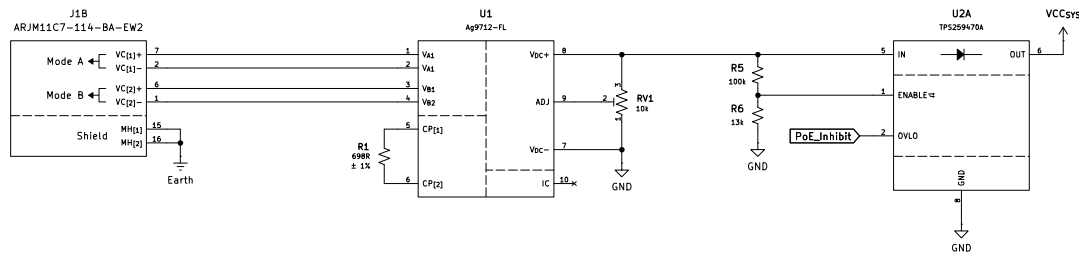
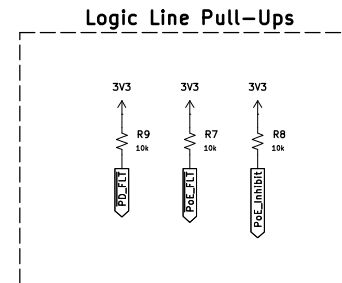


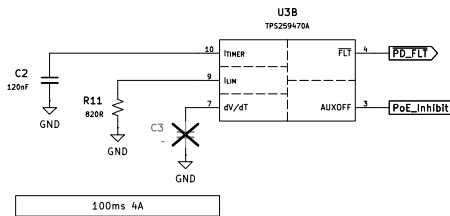

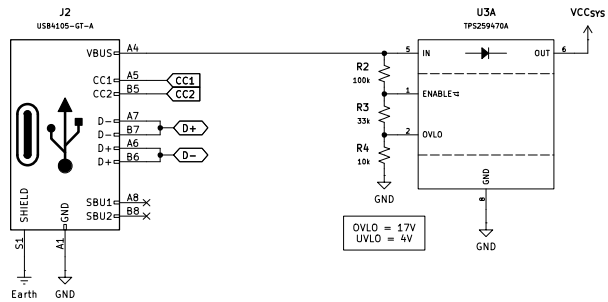

Power Bus Capacitance

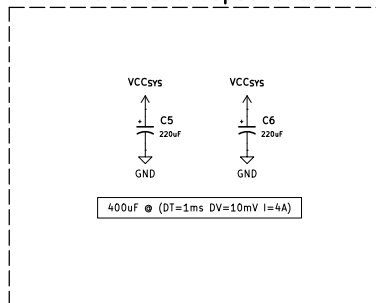

Note

Need to add kV capacitor from Earth to Ground

Note

Split all domains with OR resistors and add testpoints



Rack-Manager

Sheet: /Power Input/
File: power_input.kicad_sch

Title: Power Input Stage

Size: A3 Date: 2025-10-30
KiCad E.D.A. 9.0.6-rc2

Rev: v0.1
Id: 2/6

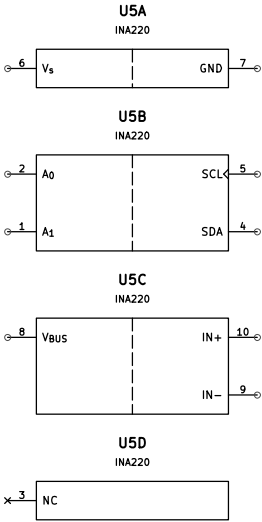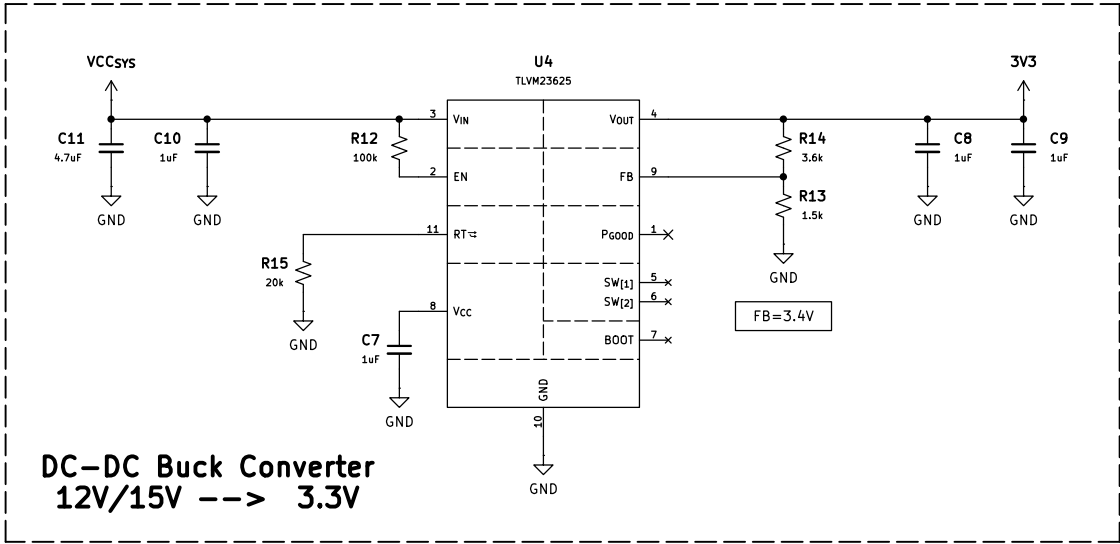

Rack-Manager

Sheet: /DC-DC/
File: DCDC.kicad_sch


Title: DC-DC converter Stage

Size: A4 Date: 2025-10-30


KiCad E.D.A. 9.0.6-rc2

Rev: v0.1


Id: 3/6

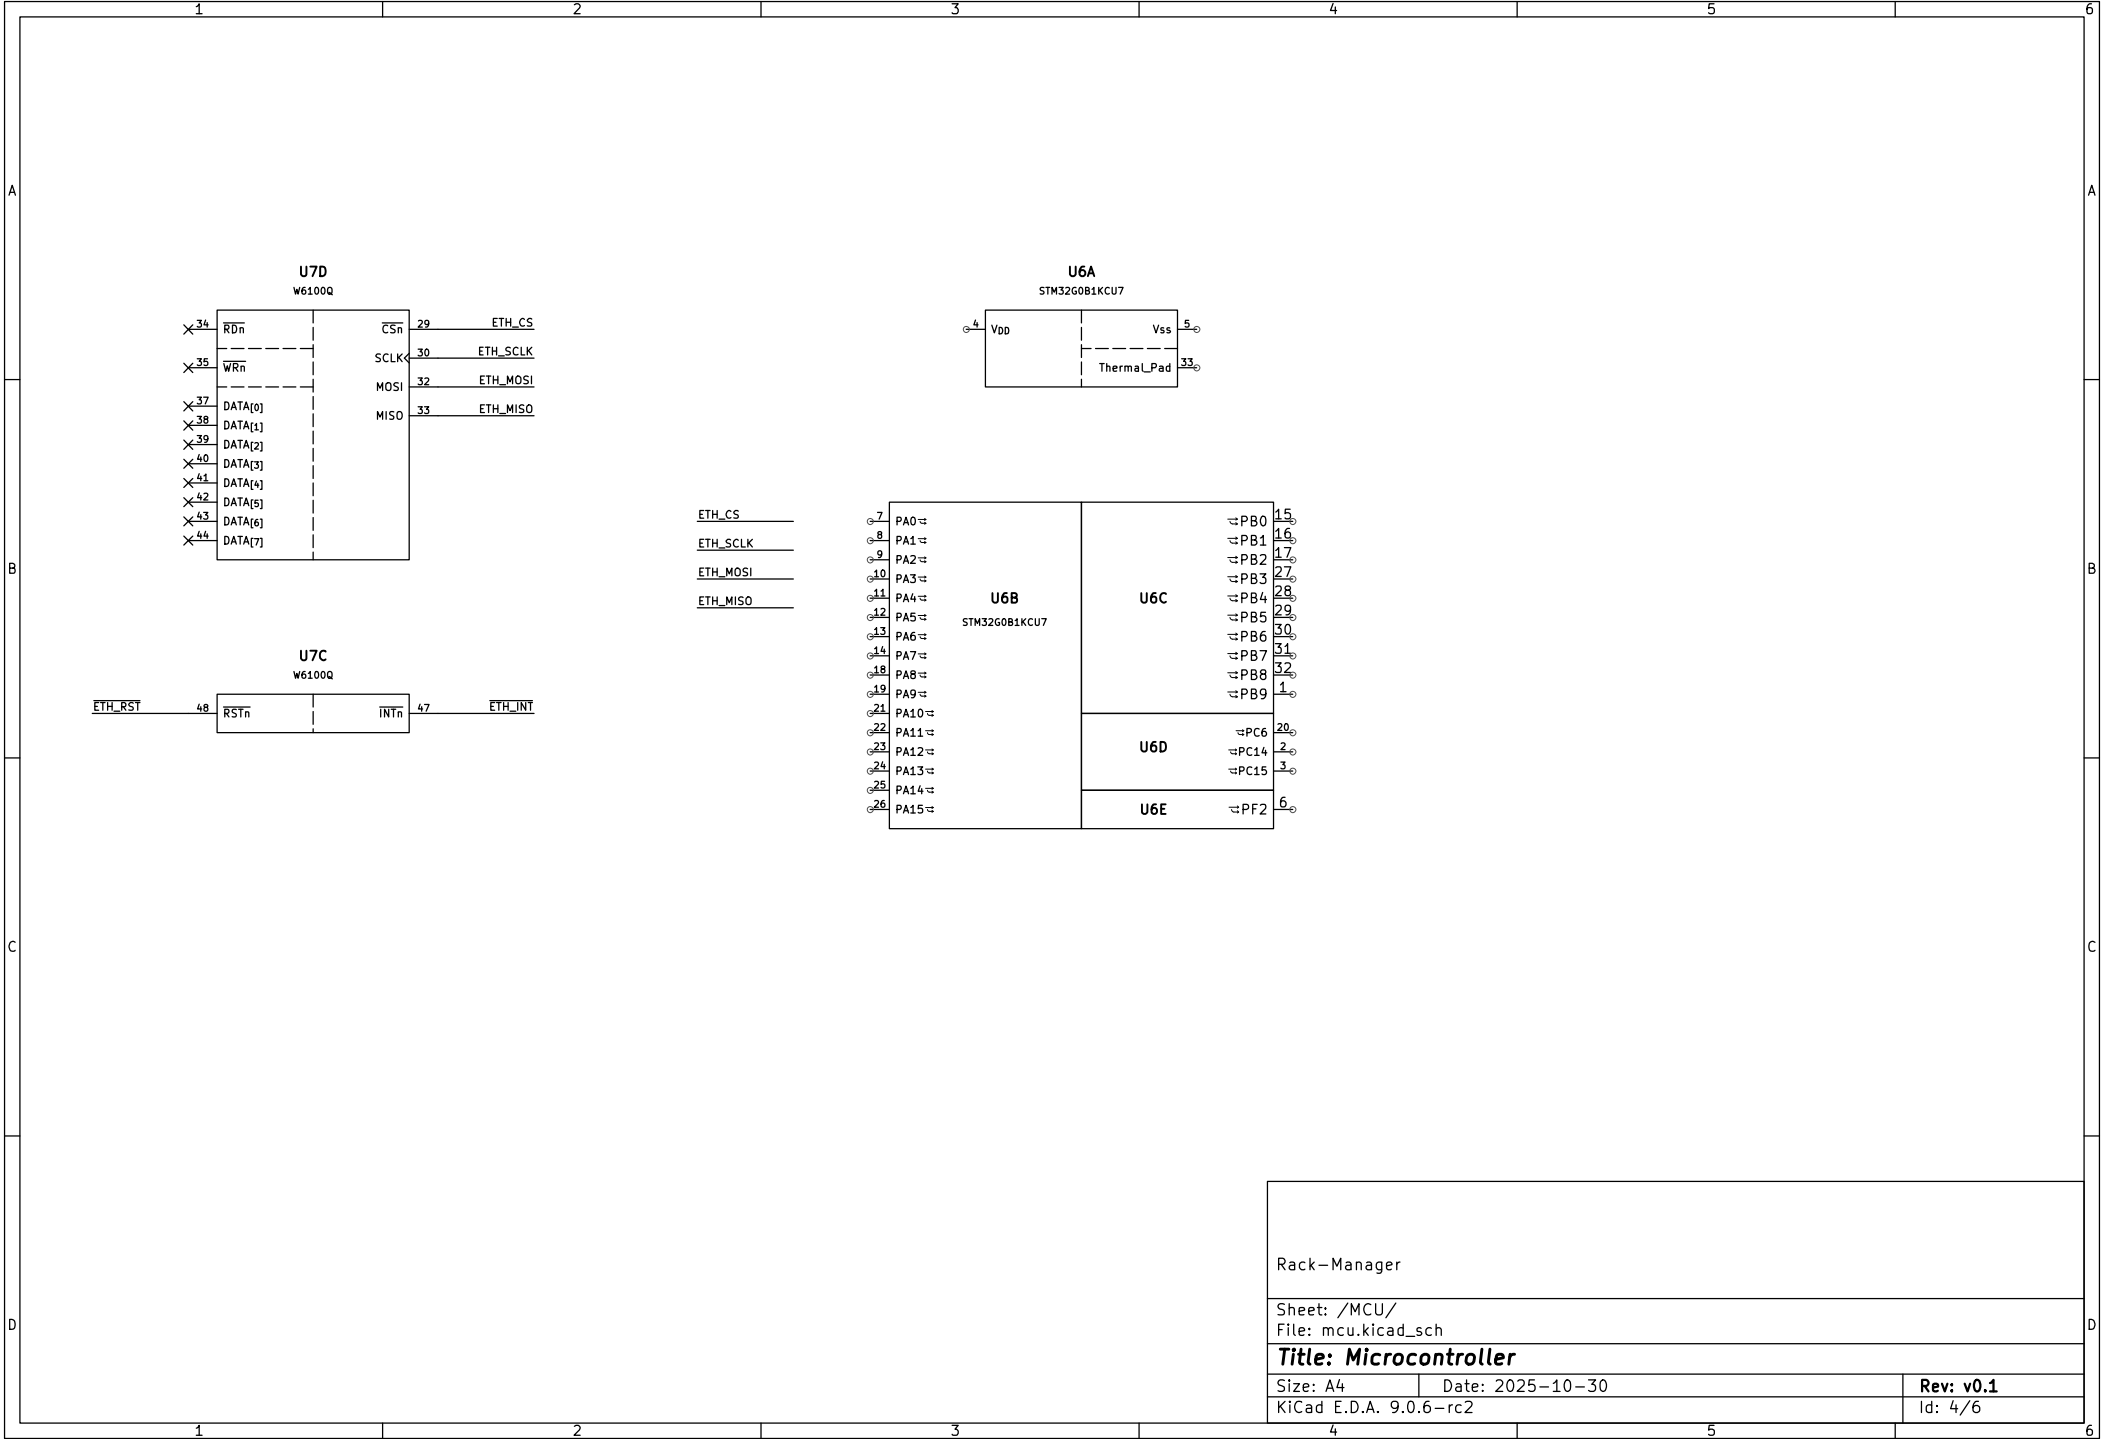

RS-485 BUS 1

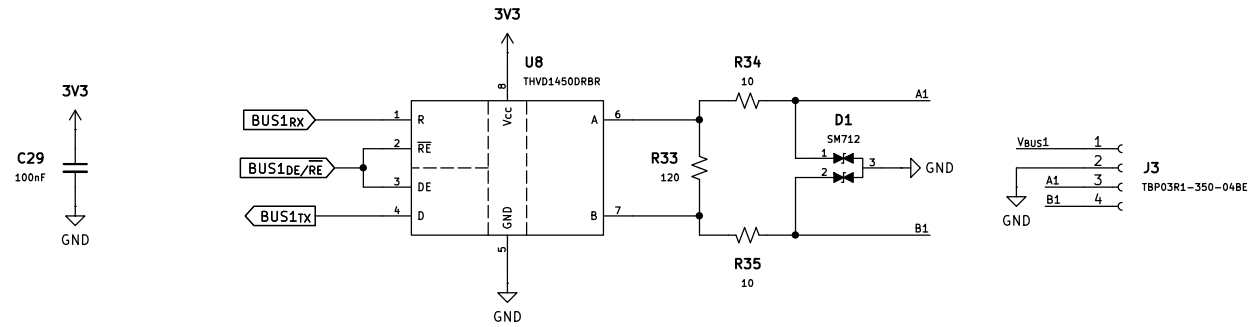

RS-485 BUS 2

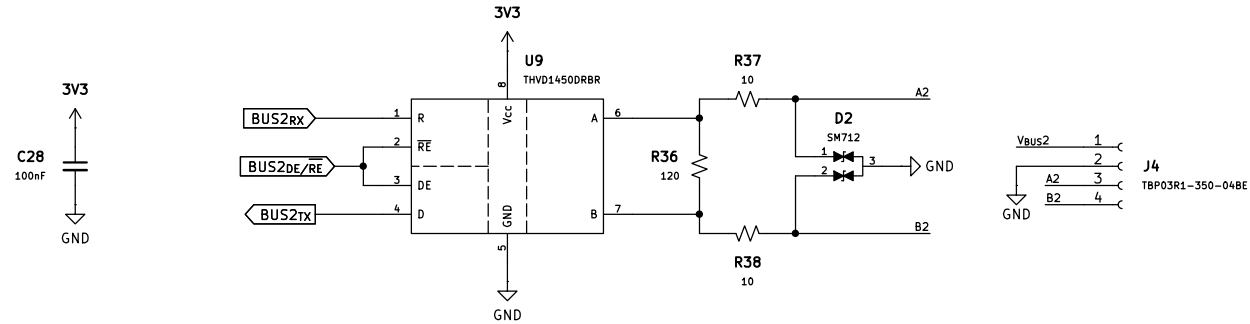

Rack-Manager

Sheet: /RS-485/
File: rs485.kicad_sch

Title: RS-485 Busses

Size: A4 Date: 2025-10-30

KiCad E.D.A. 9.0.6-rc2

Rev: v0.1

Id: 6/6