

LEGEND

RAIN WATER LINE

WATER SUPPLY LINE

SEWER LINE

FIRE HYDRANT

SAND BUCKET

FIRE EXTINGUISHER

HOSE REAL

SAND BUCKET

FIRE EXTINGUISHER

PROPOSED CONSTRUCTION

TREES

LANDSCAPING

RAIN WATER HARVESTING TANK

TOTAL G.F. COV AREA = 2024.50 SQM

R.W.H.225 SQM = 20 CU.M.

R.W.H. FOR REMAINING = (2024.50-2000) = 24.50 SQM.

= 24.50/50*5CU.M. = 2.45 CU.M.

TOTAL R.W.H.REQUIRED = 160+2.45 = 162.45CU.M.

PROVIDED 1 NO. R.W.H. 165 CU.M. (6000x5500x5000)







U.G. WATER TANK FOR FIRE FIGHTING USE

6000X5500X5000 CAP. 1,65,000 LTR.

HOSE REAL

SAND BUCKET

FIRE EXTINGUISHER

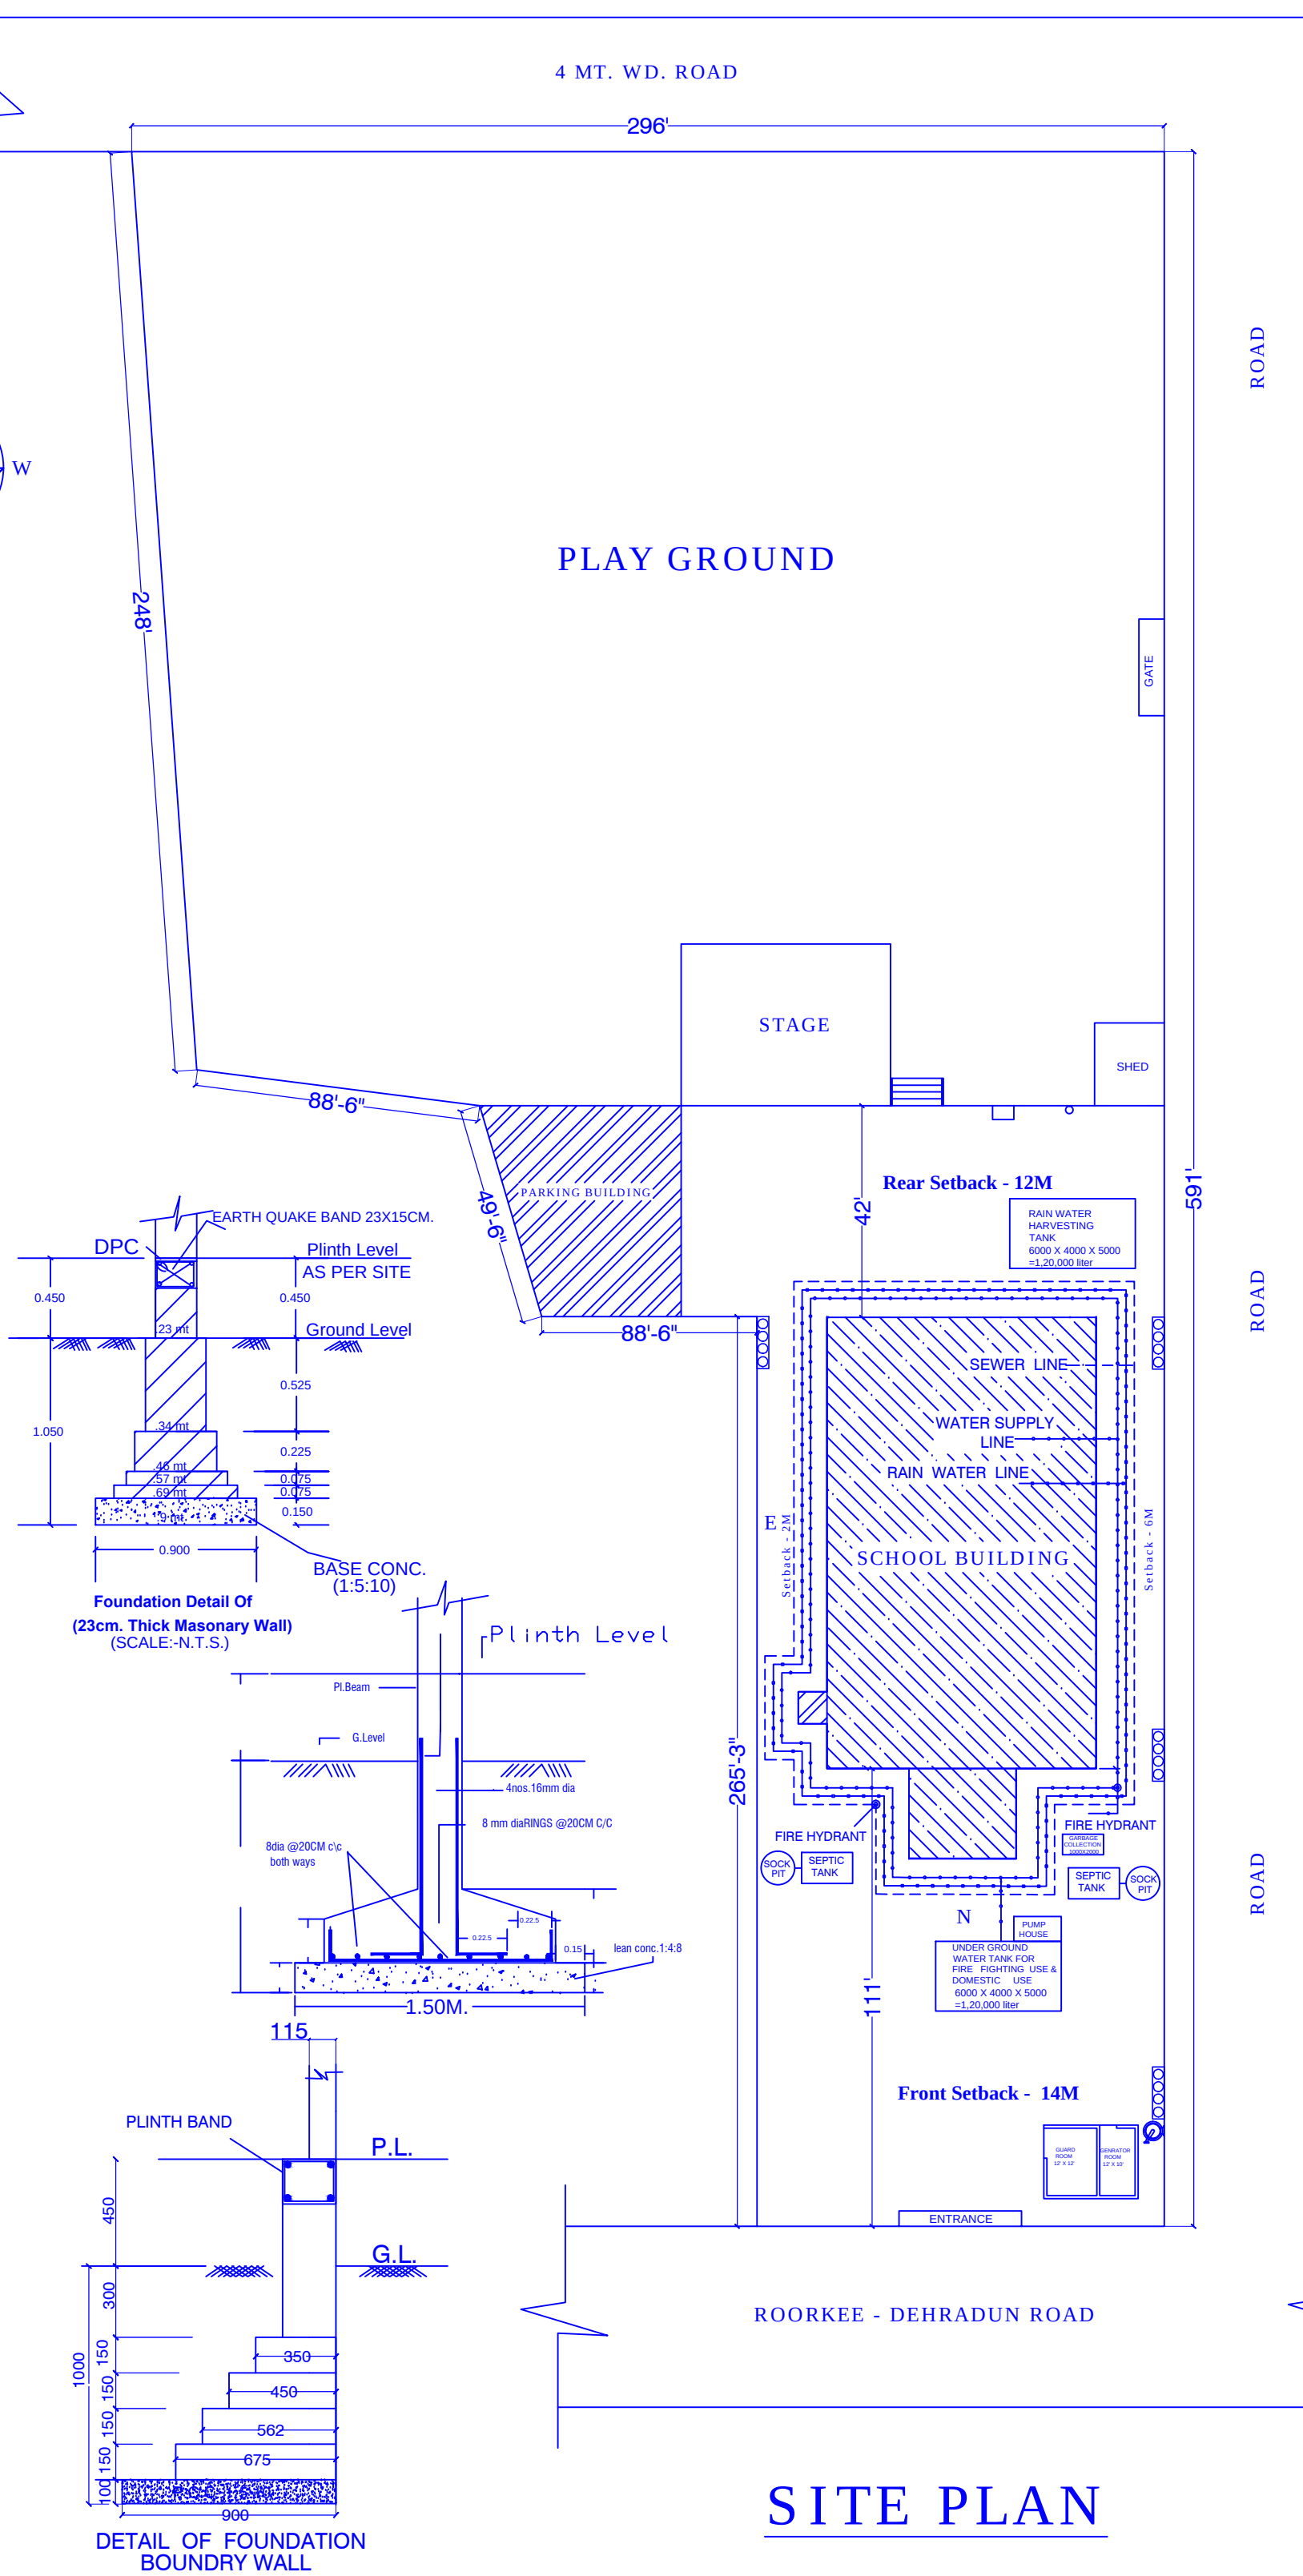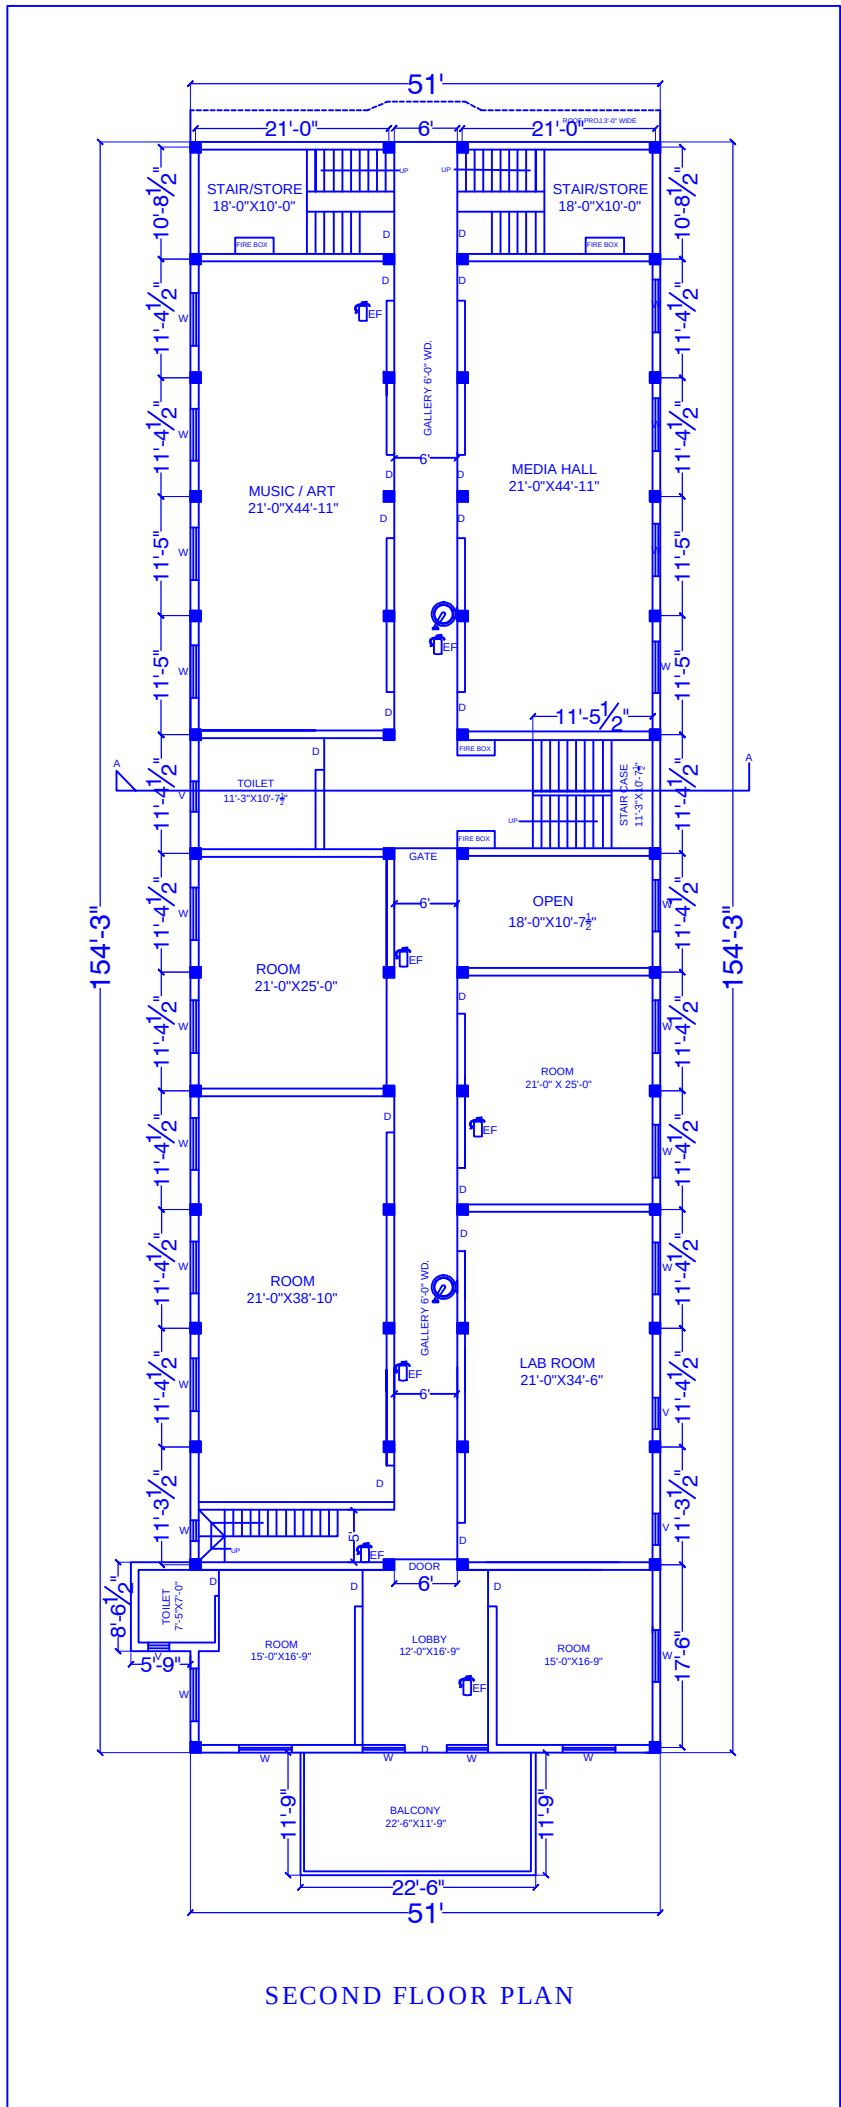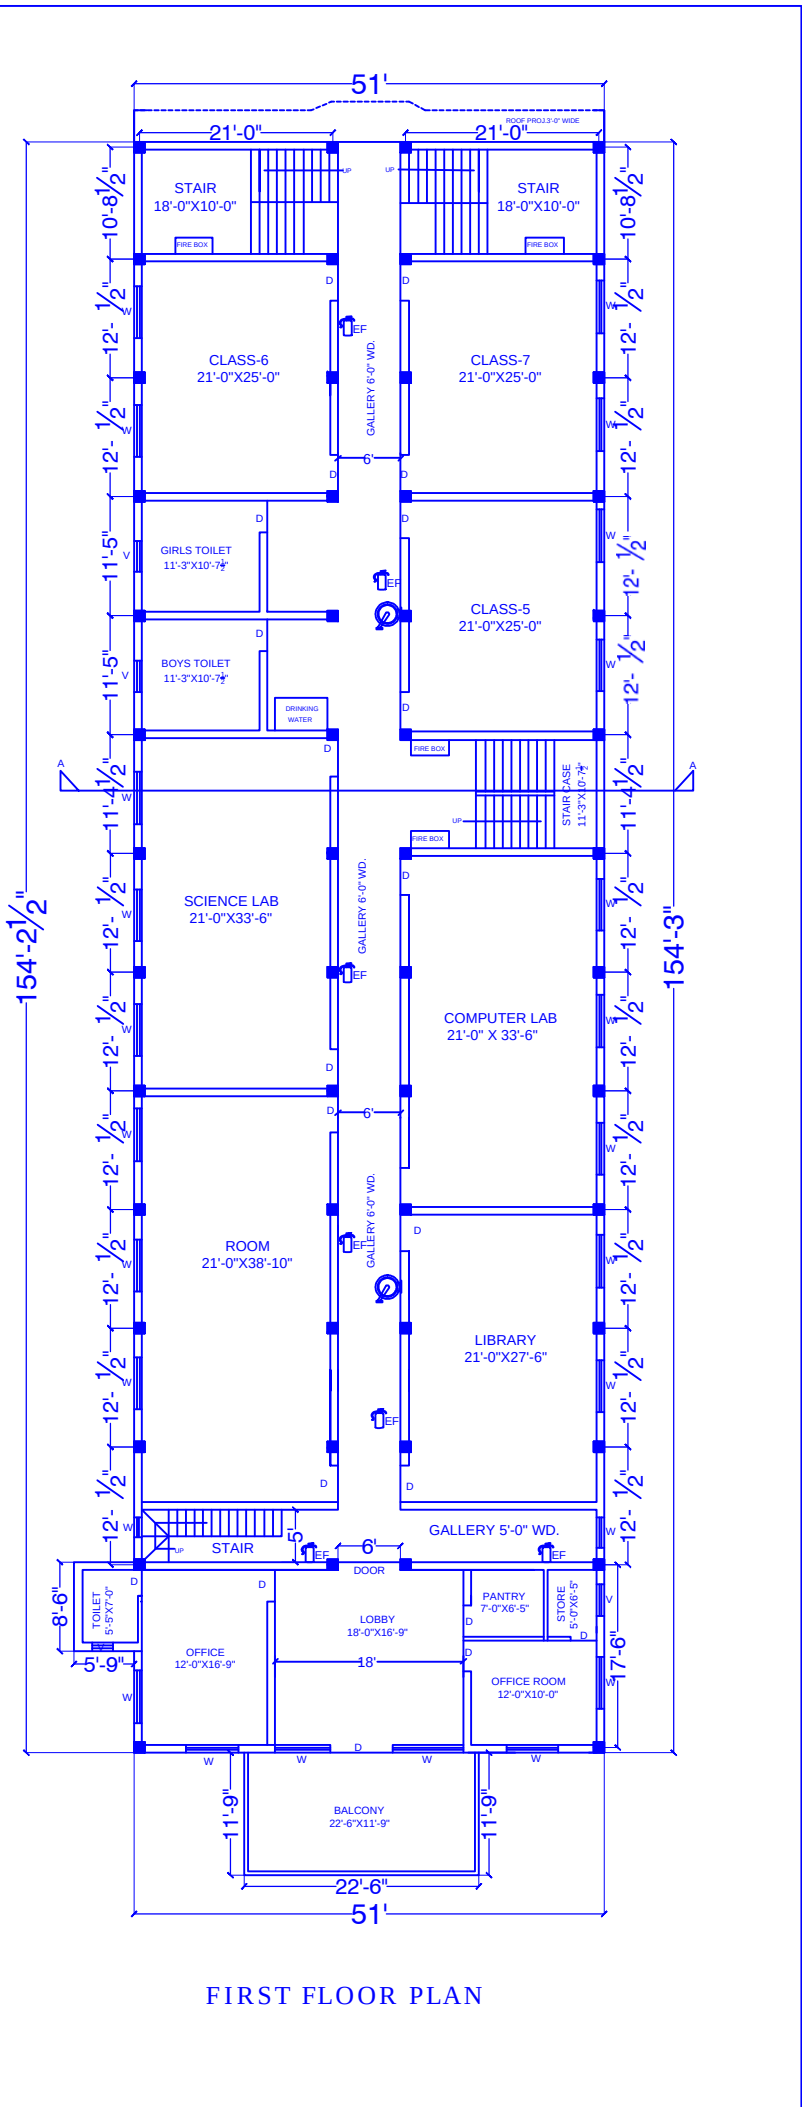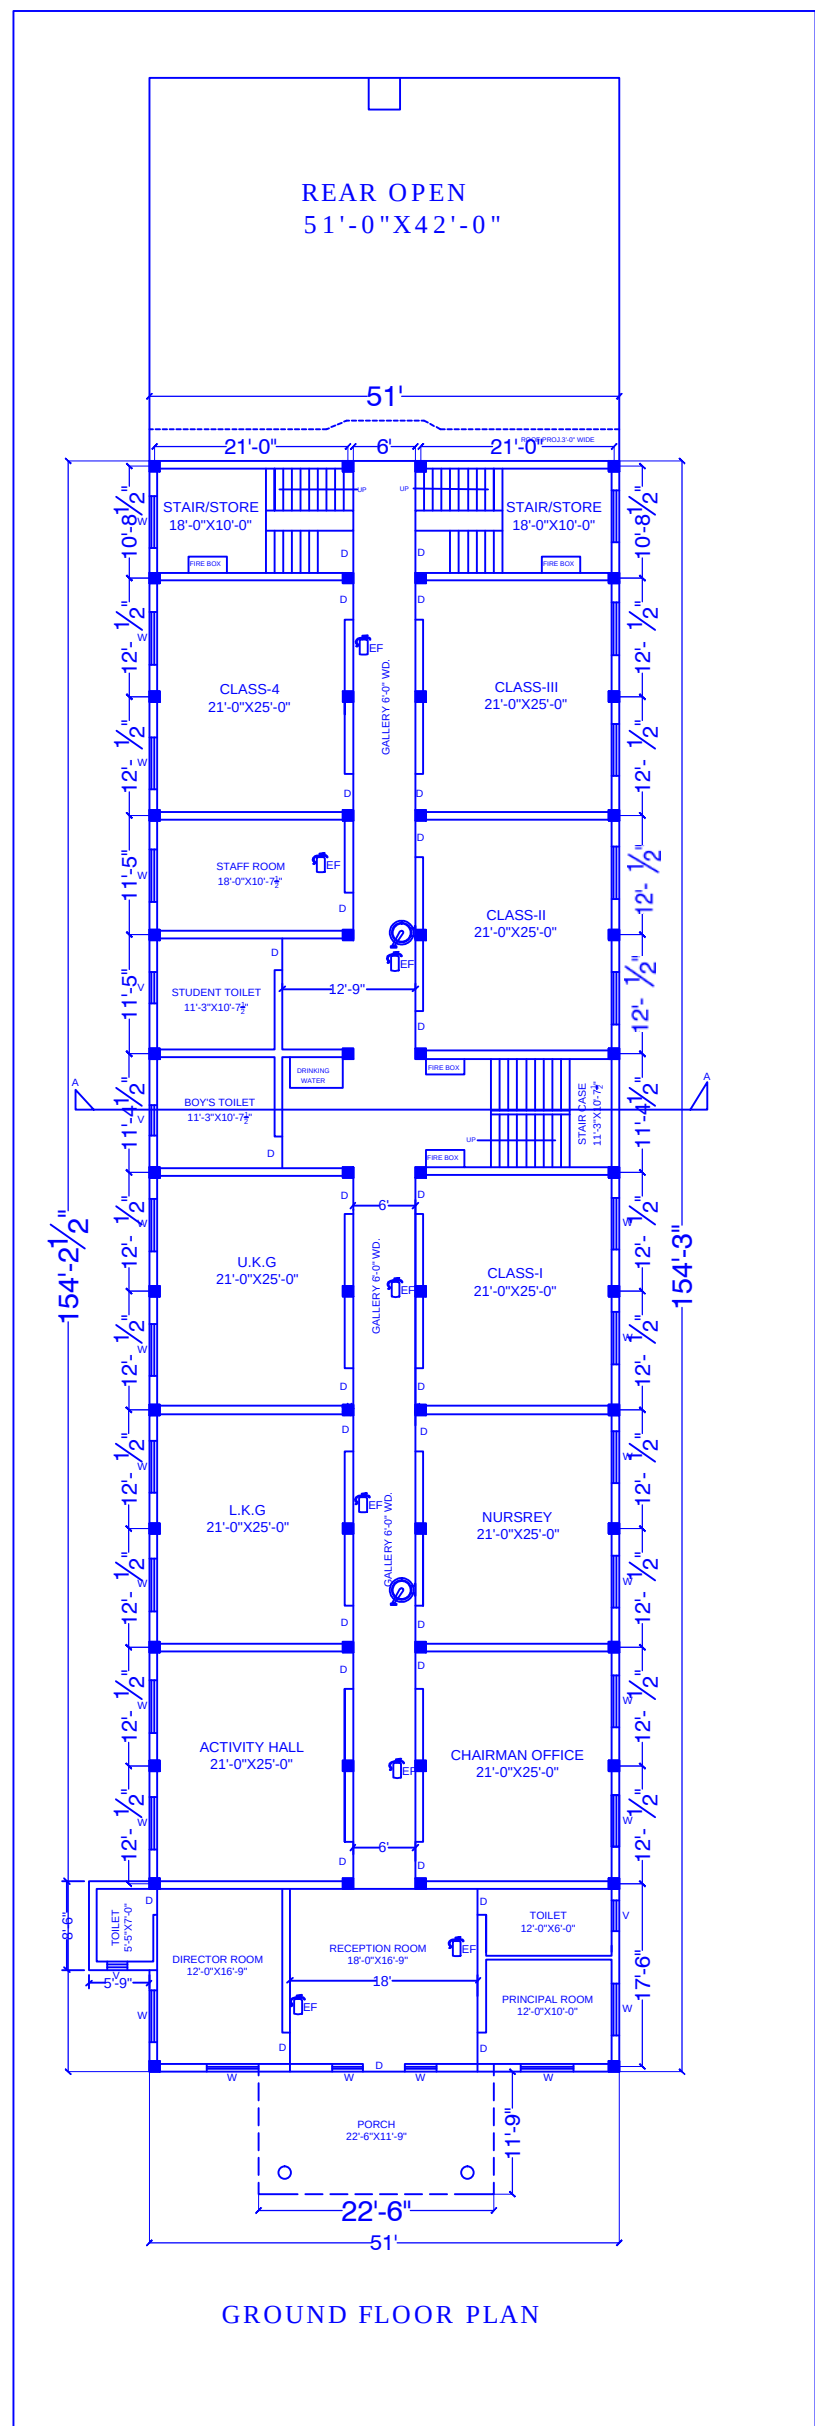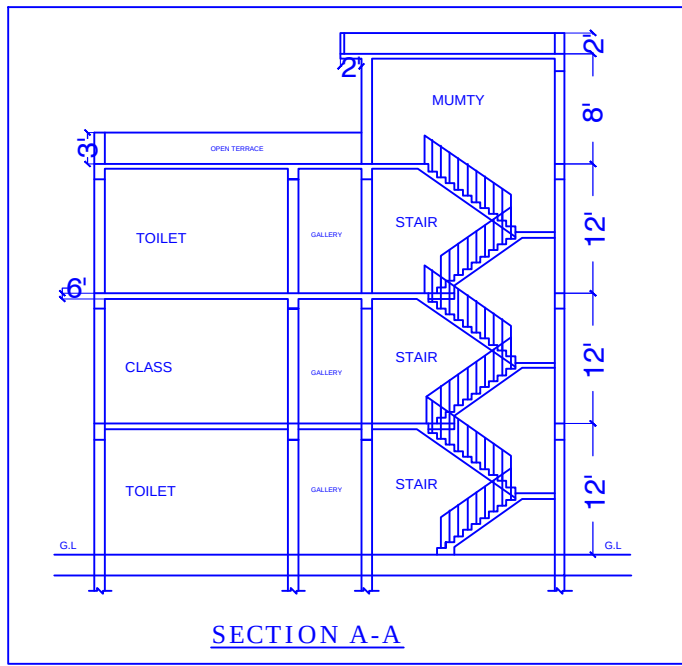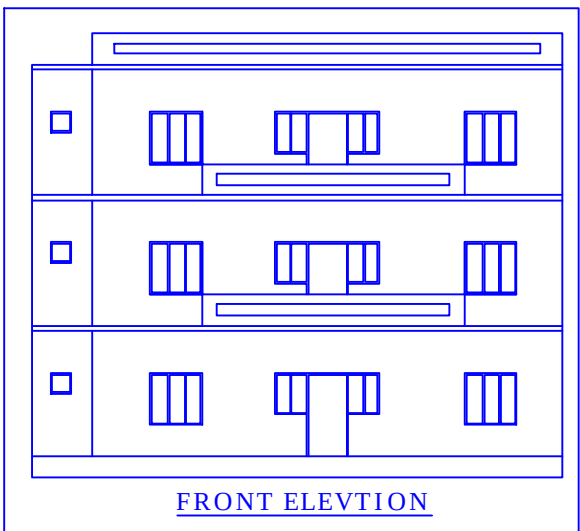


For Office Use

कनिष्ठ अभियन्ता
जिला पंचायत, हरिद्वार

अभियन्ता
जिला पंचायत, हरिद्वार

अपर मुख्य अधिकारी
जिला पंचायत, हरिद्वार

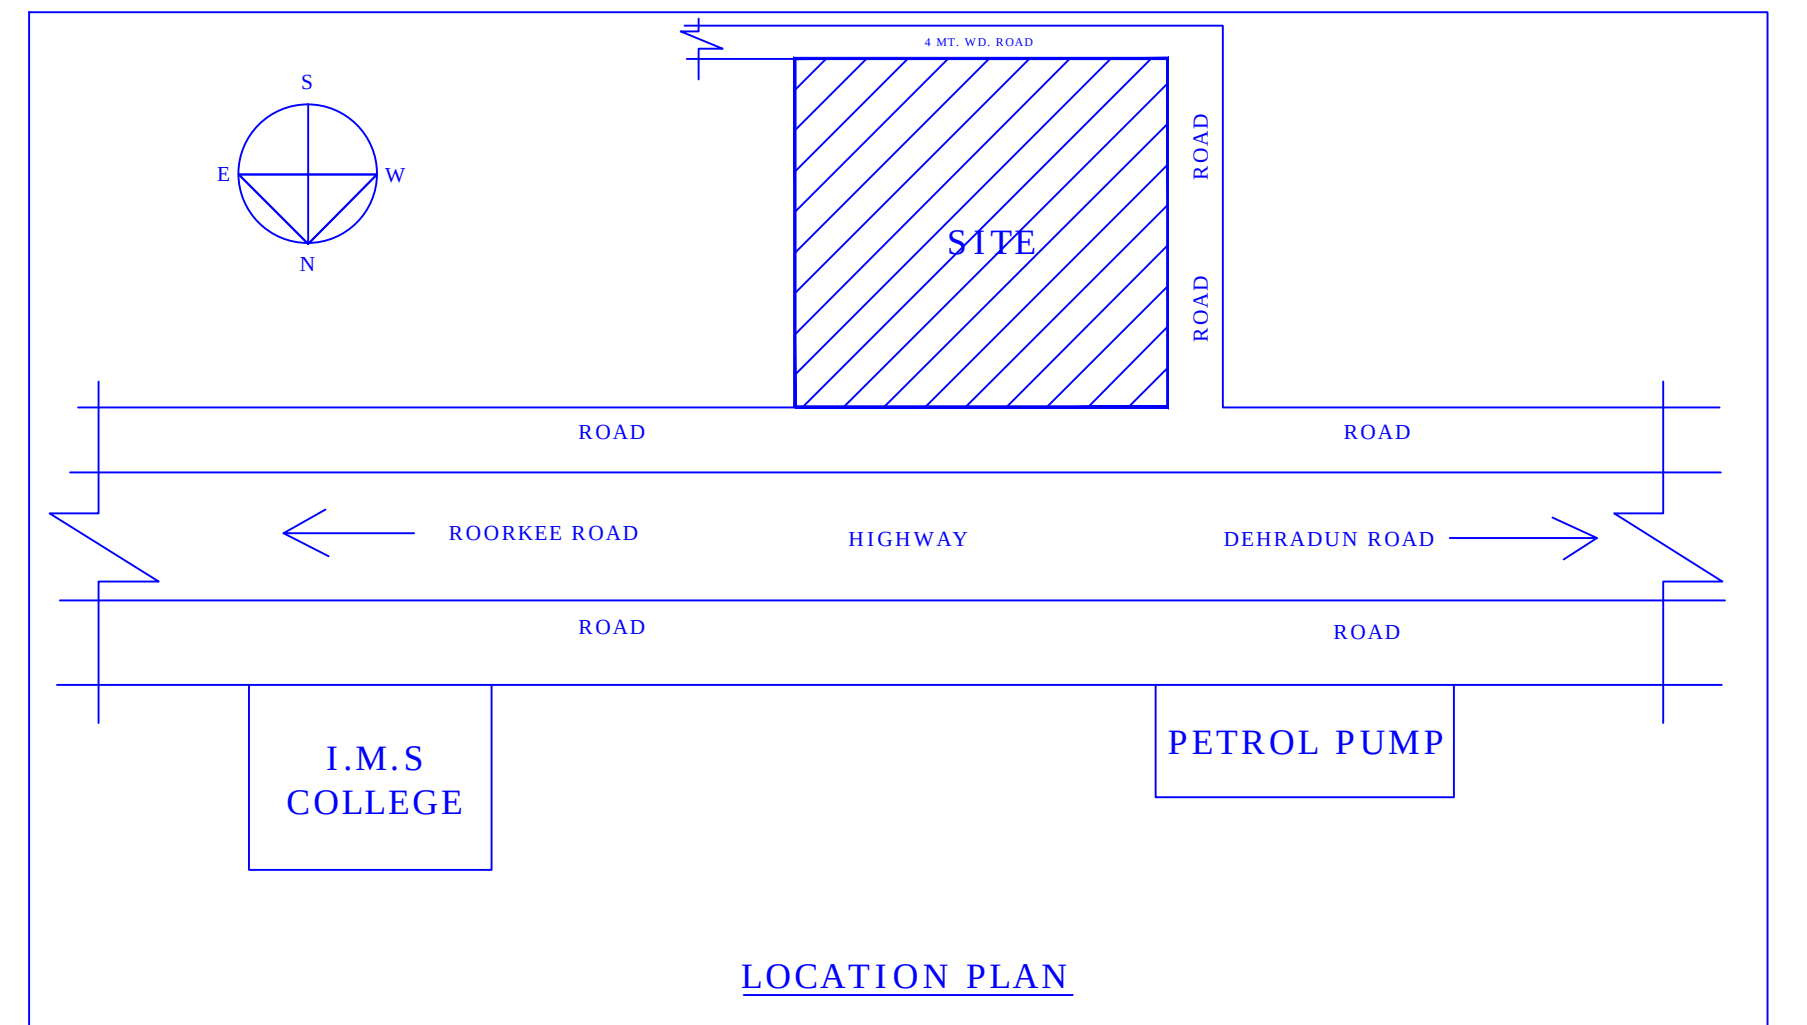

FIELDRUSH PUBLIC SCHOOL

PLOT AREA - 90373.24 SQFT. , (8399.00 SQMT.)

GROUND FLOOR AREA - 7254.49 SQFT. , (674.20 SQMT.)

FIRST FLOOR AREA - 7254.49 SQFT. , (674.20 SQMT.)

SECOND FLOOR AREA - 7059.49 SQFT. , (656.08 SQMT.)

TOTAL COV. AREA - 21568.47 SQFT. , (2004.504 SQMT.)

SCHOOL BUILDING PLAN OF

SH. COL. ASHOK KUMAR YADAV S/O SH. SUBE SINGH YADAV & SMT. VRINDA YADAV W/O COL. ASHOK KUMAR YADAV SITE SITUATED AT VILL. - KAROUNDI MUSTHAKAM, PAR. BHAGWANPUR TEHSIL ROORKEE, DISTT. HARIDWAR (UTTRAKHAND)

ARCHITECT SIGN :-

OWNERS SIGN :-

R. K. SANGAL
B.Arch C.E. 20113590
32-Civil Lines,ROORKEE

Director
FIELD RUSH PUBLIC SCHOOL
ROORKEE (Uttarakhand)

Principal
FIELD RUSH PUBLIC SCHOOL
ROORKEE (HARIDWAR)
UTTARAKHAND