A continuously updating, patient-specific monitoring twin

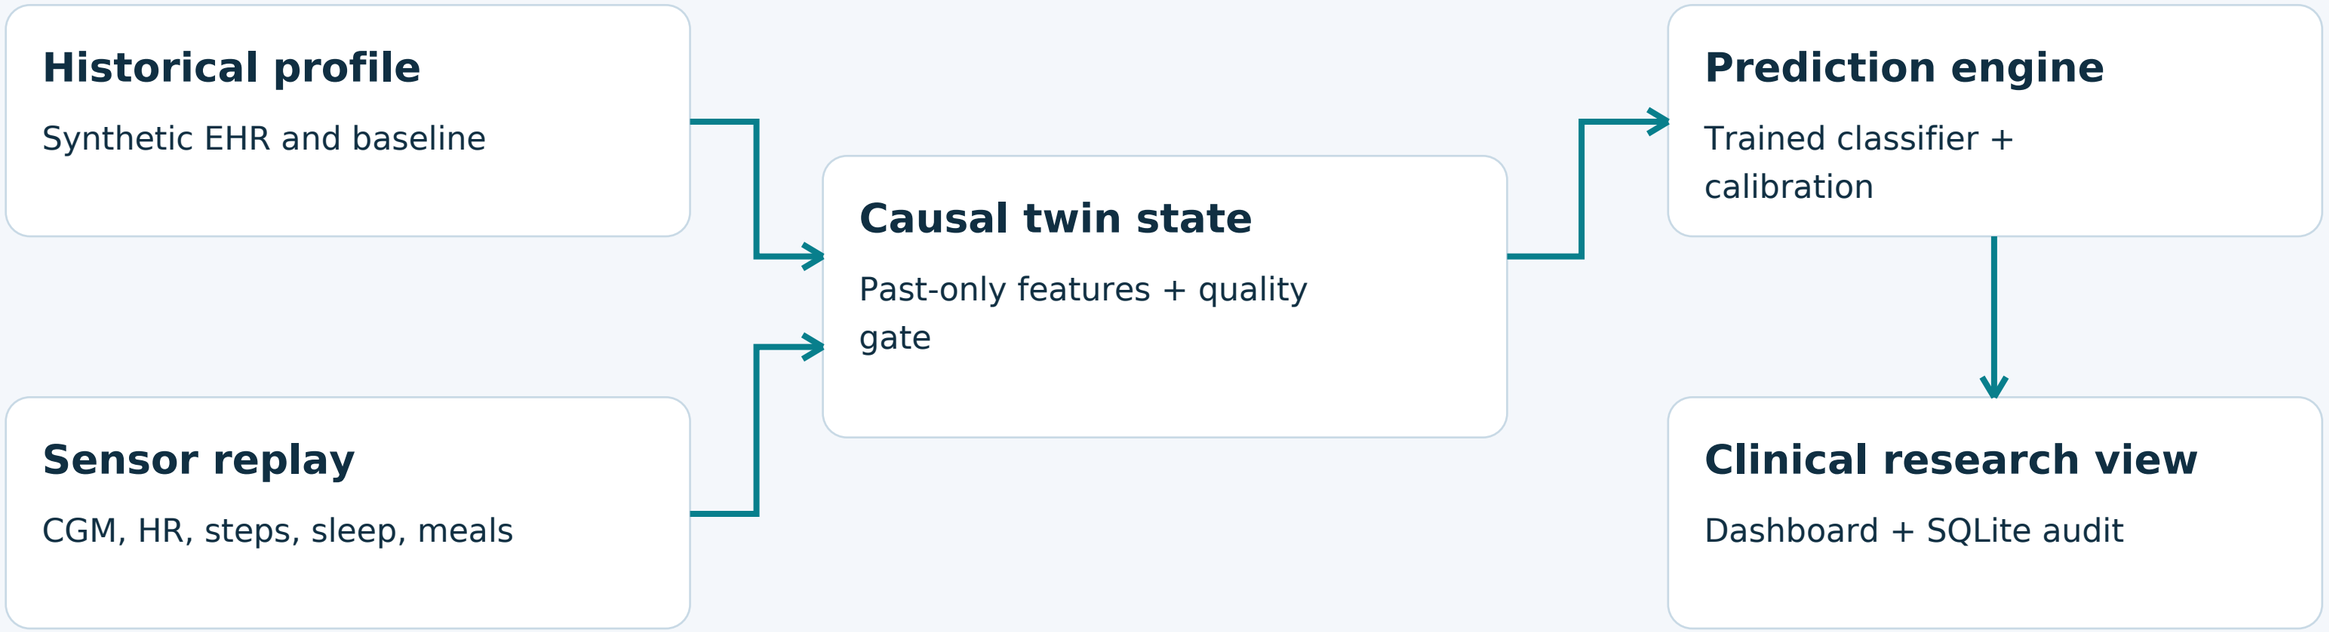

Offline: simulator > labels > patient split > train > validate > calibrate > final test

Future observations are used only for labels and explicit retrospective evaluation.