

# **Water Report**


### Instructions:

Each parameter in the water report represents a different aspect of water quality. Below are the parameters and their corresponding normal ranges:


- pH: pH is a measure of how acidic or basic water is. Range: 6.5 - 8.5
- Temperature: Temperature of the water in Celsius. Range: 0 - 100°C
- TDS: Total Dissolved Solids in parts per million (ppm). Range: 0 - 200
- Turbidity: Turbidity measures the cloudiness of water. Range: 0 - 5 NTU

Red color indicates that the value is out of range, while green indicates that it is within the acceptable range.


pH Measurement

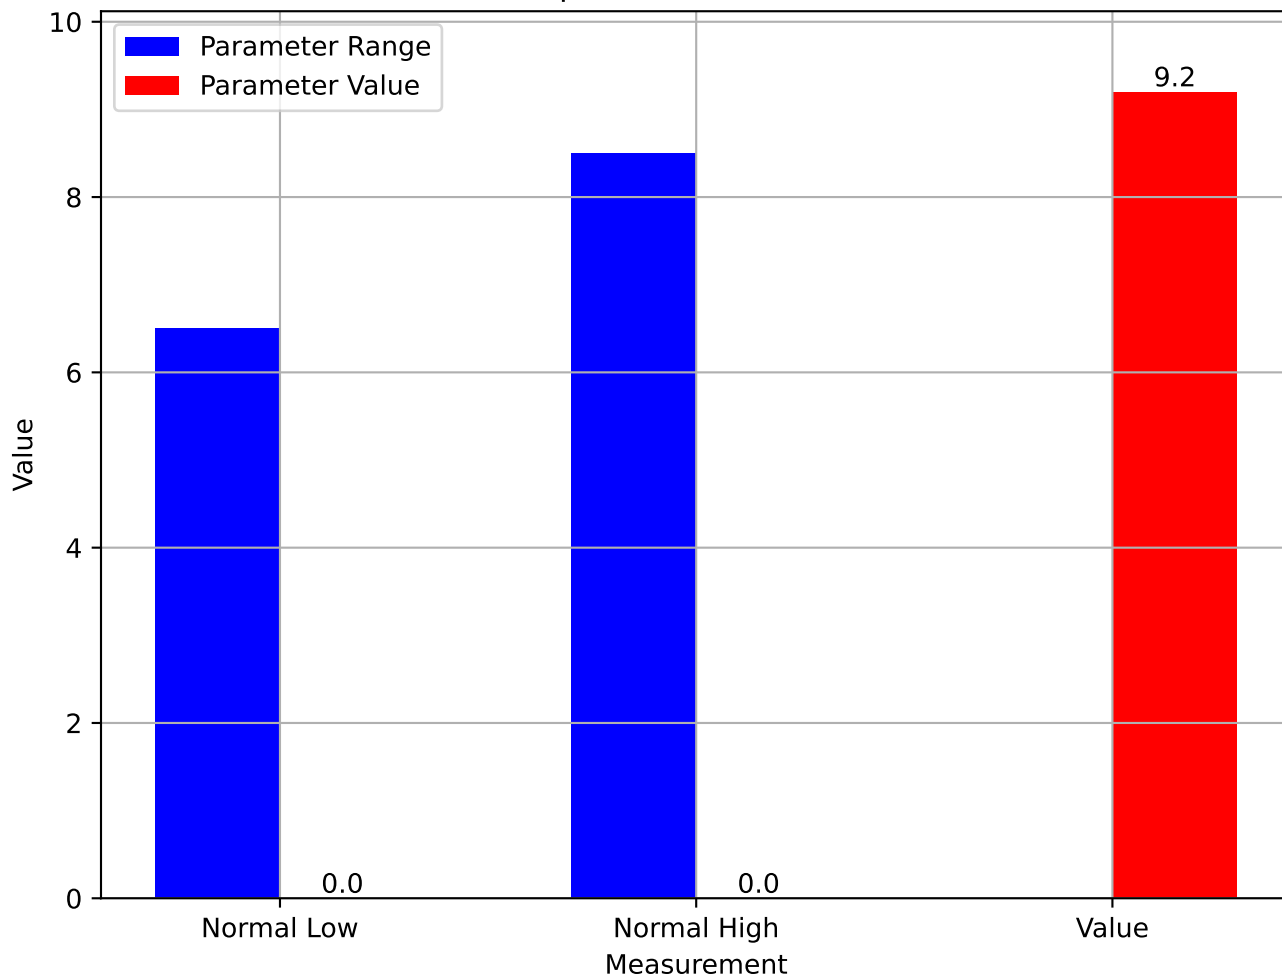


Temp Measurement

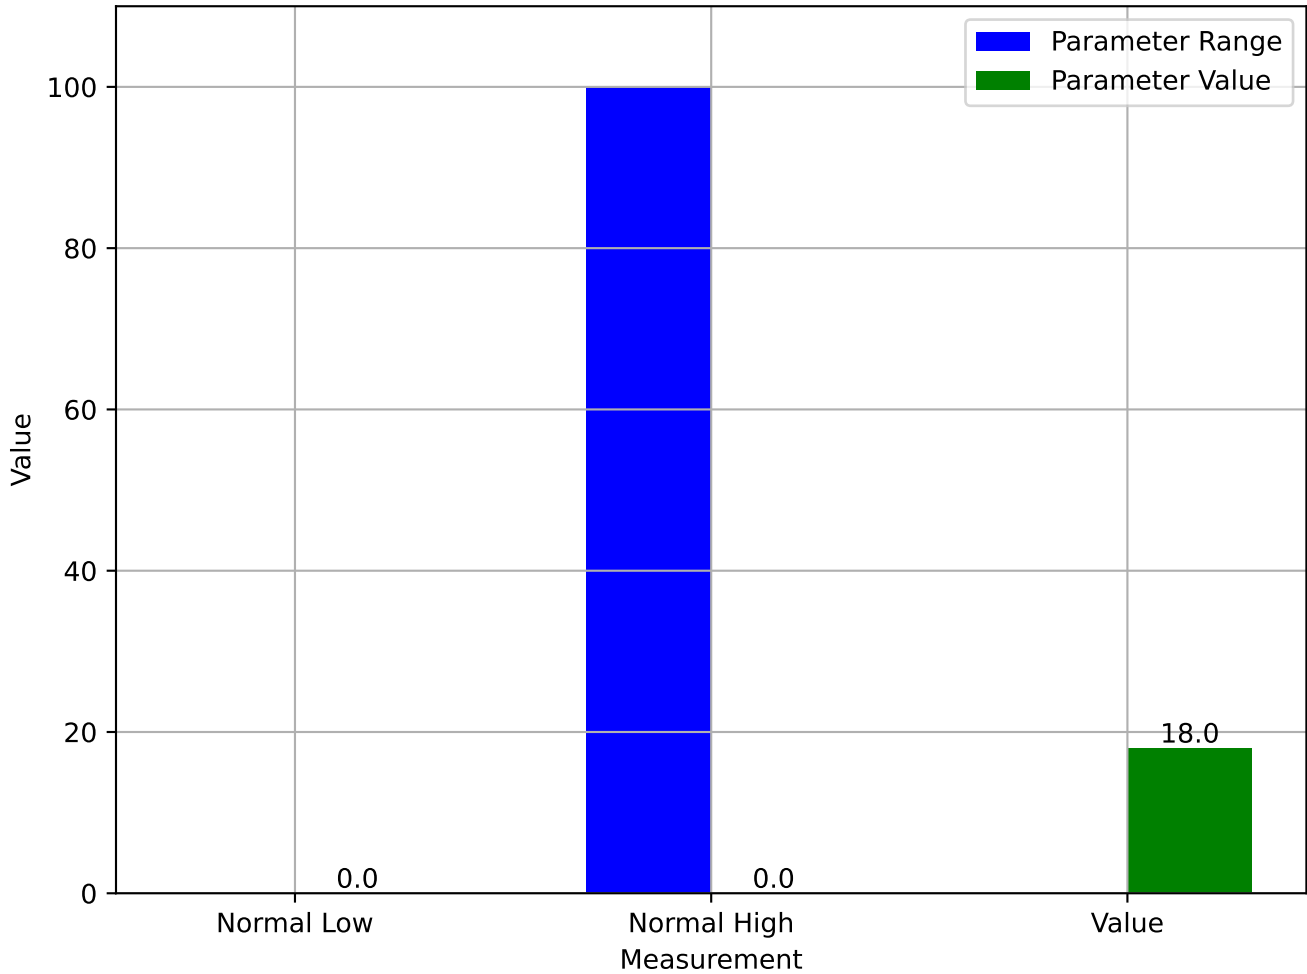

# TDS Measurement

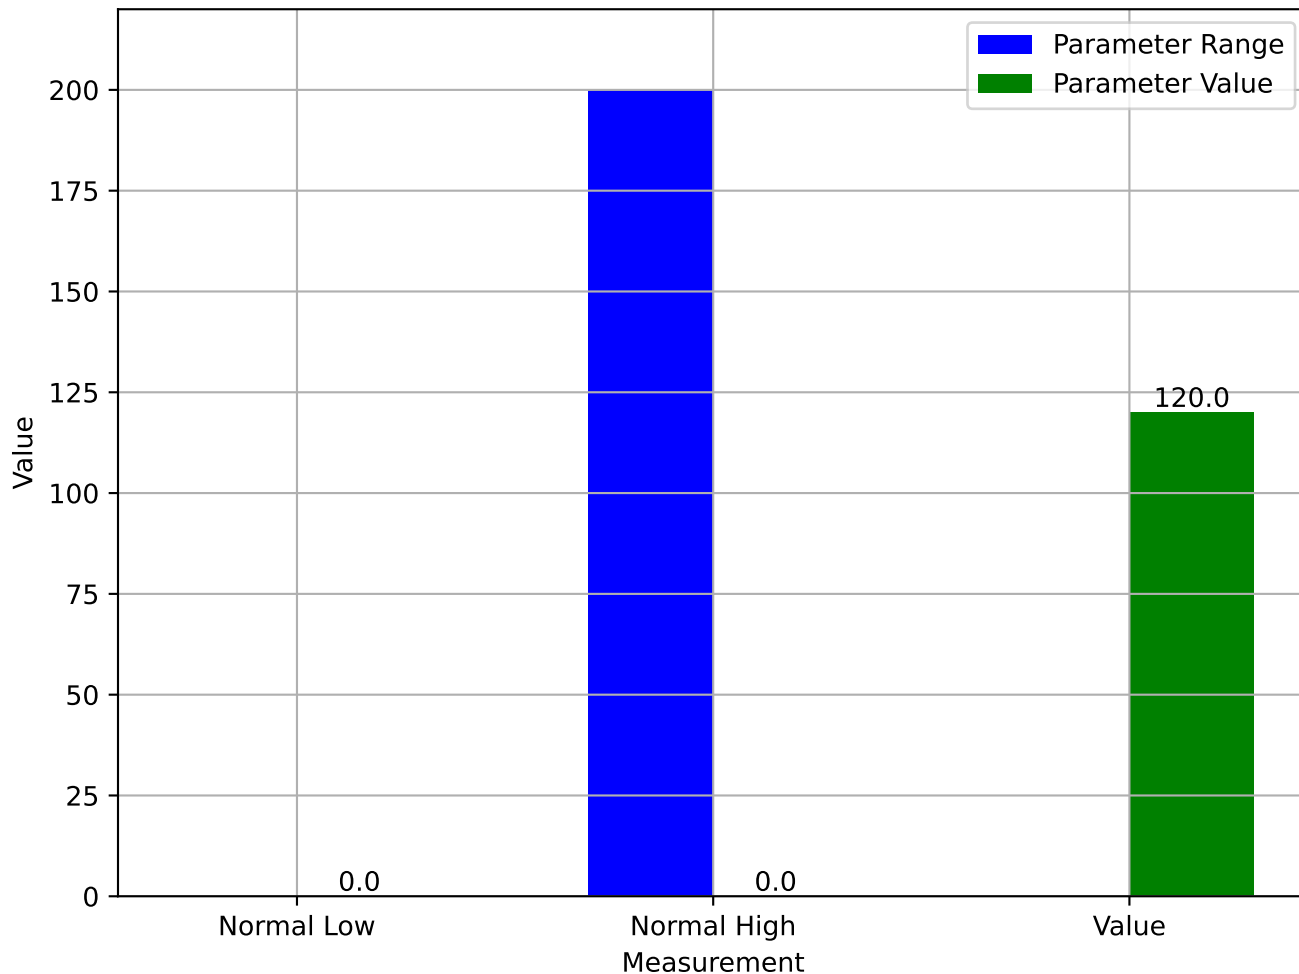

## Turbidity Measurement

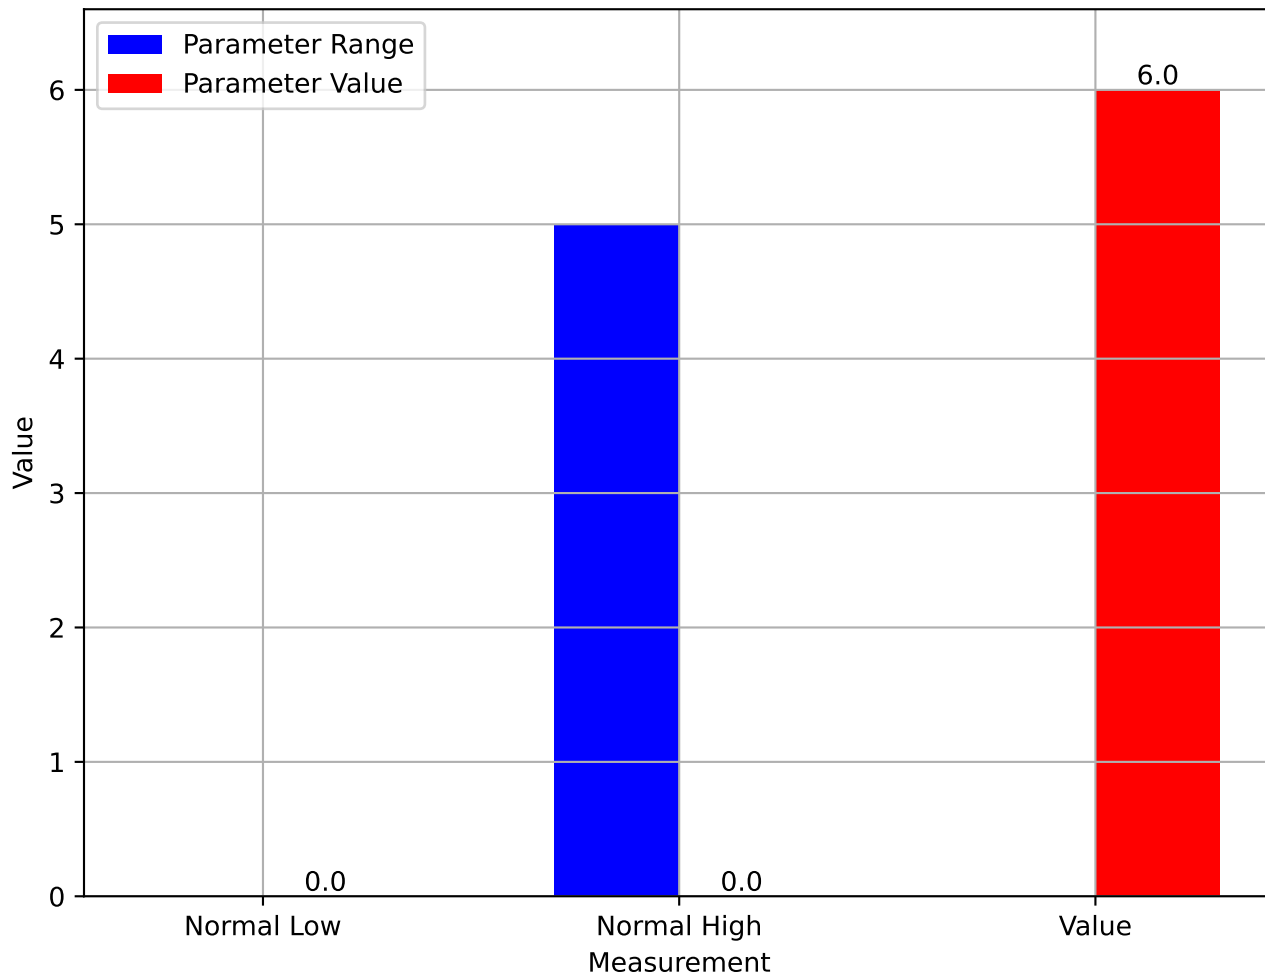

# Summary Table

Parameter	Normal Low	Normal High	Value	Status
pH	6.5	8.5	9.2	Out of Range
Temp	0.0	100.0	18.0	Within Range
TDS	0.0	200.0	120.0	Within Range
Turbidity	0.0	5.0	6.0	Out of Range

**Thank You**