

MOVUS Machine Health Detail Report

MOVUS
Smarter Machines

Report Period: 06 November 2017, 17:06

Details View

St Lucia Campus - Central chiller station (Building No 57A) - Chiller No 4 (V2)



82% Calibrated

Condition




Degradation




AI Output

Legend:

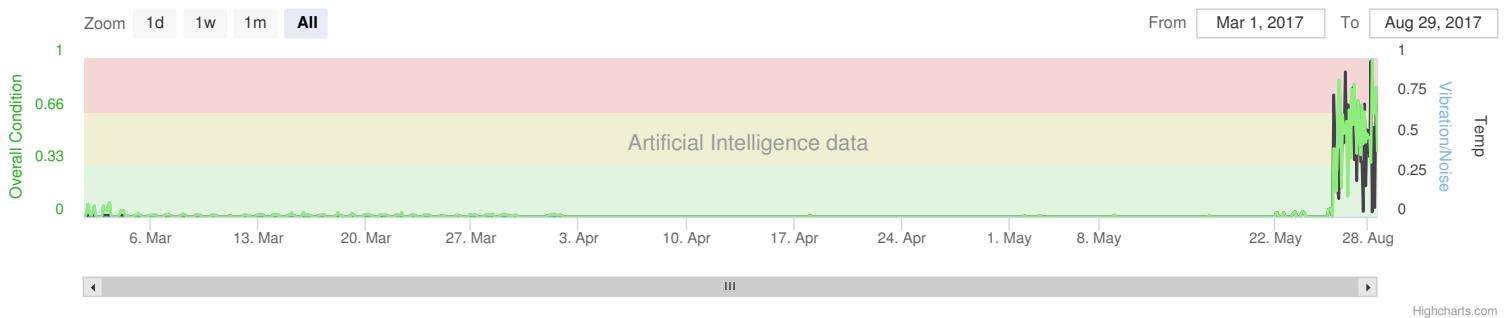

Measured data

Legend: RMS (mm/s) Temp (C)

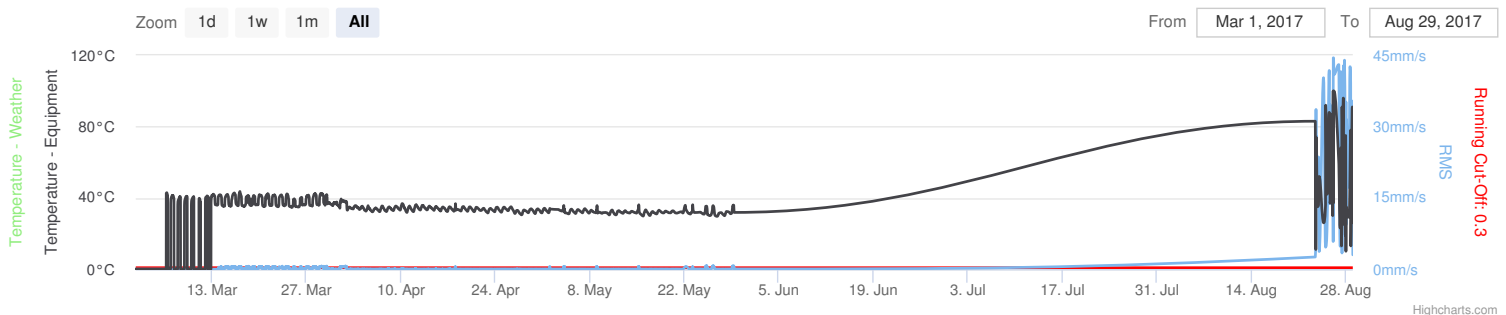


RMS: N/A mm/s, Class III

T°: N/A °C, Baseline T°: 41

Equipment usage (%)

Estimated Power Usage (kWh) Running/not running

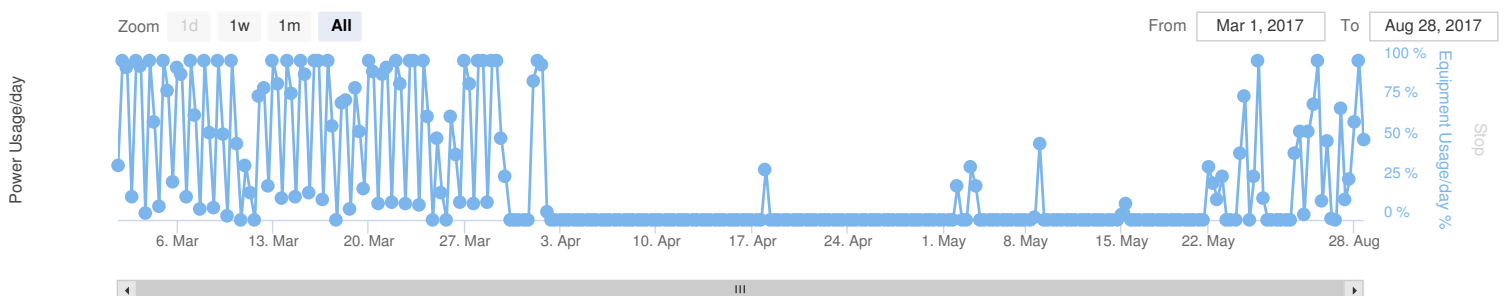

Equipment Utilisation

Last day	Last 7 days	Last 4 weeks	Last 365 days
N/A	N/A	N/A	N/A

Estimated power usage

Last day	Last 7 days	Last 4 weeks	Last 365 days
N/A	N/A	N/A	N/A

St Lucia Campus - AEB Chiller Station (Building 49) - Cooling tower 4 (V2)





Condition




Degradation



AI Output

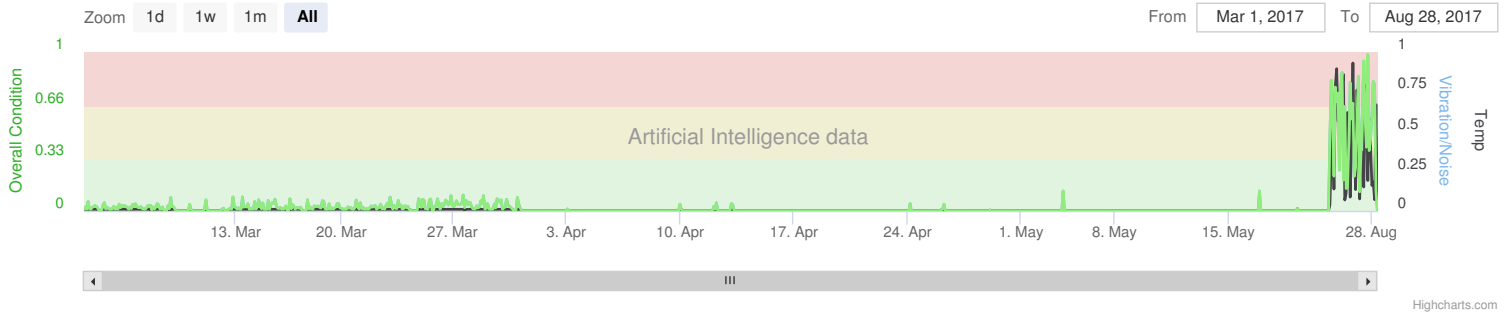



Measured data

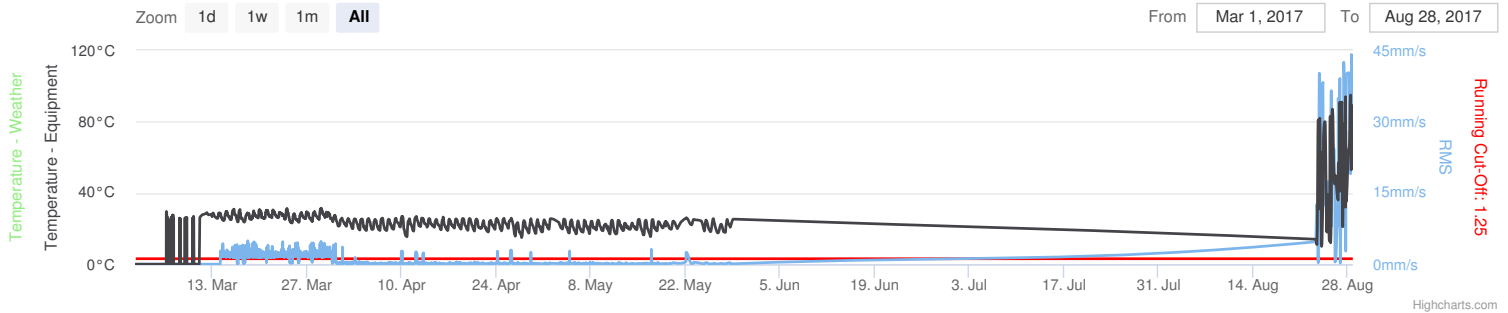

RMS: N/A mm/s, Class I

T°: N/A °C, Baseline T°: 29

Equipment usage (%)

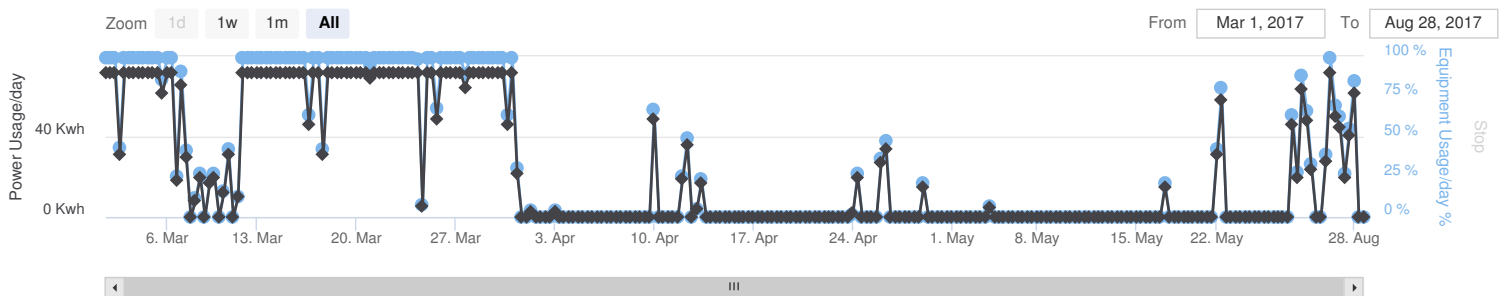

Equipment Utilisation

Last day	Last 7 days	Last 4 weeks	Last 365 days
N/A	N/A	N/A	N/A

Estimated power usage

Last day	Last 7 days	Last 4 weeks	Last 365 days
N/A	N/A	N/A	N/A