

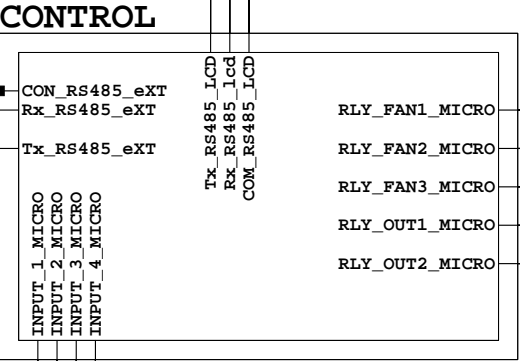
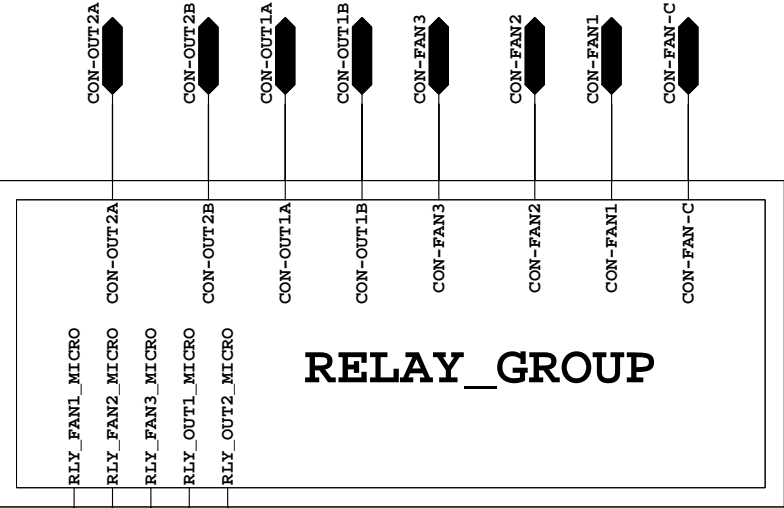
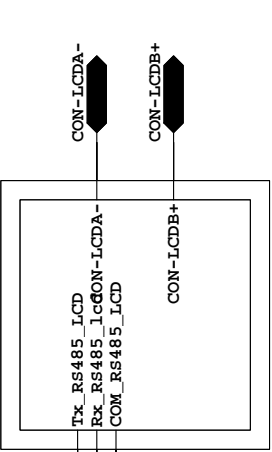
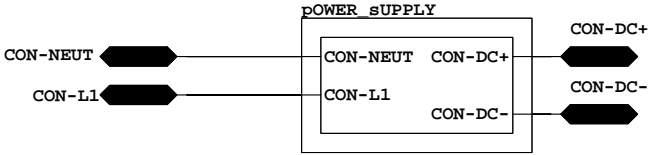



TITLE			
SIZE	DWG NO	REV	
B	SMART-HVAC_BASE_V1_TOP		
DRAWN BY	SHEET	of	REV
	1	1	11/03/2022:19:41

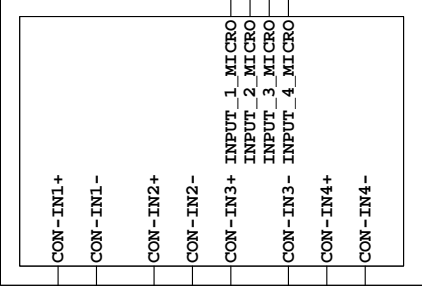


RS-485-EXTERNA

INPUTS

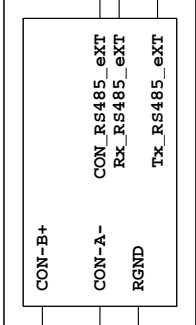





TITLE		
Smart-Control-HVAC		
SIZE	DWG NO	REV
B		
DRAWN BY	SHEET 1 OF 2	
	16/06/2023:19:36	

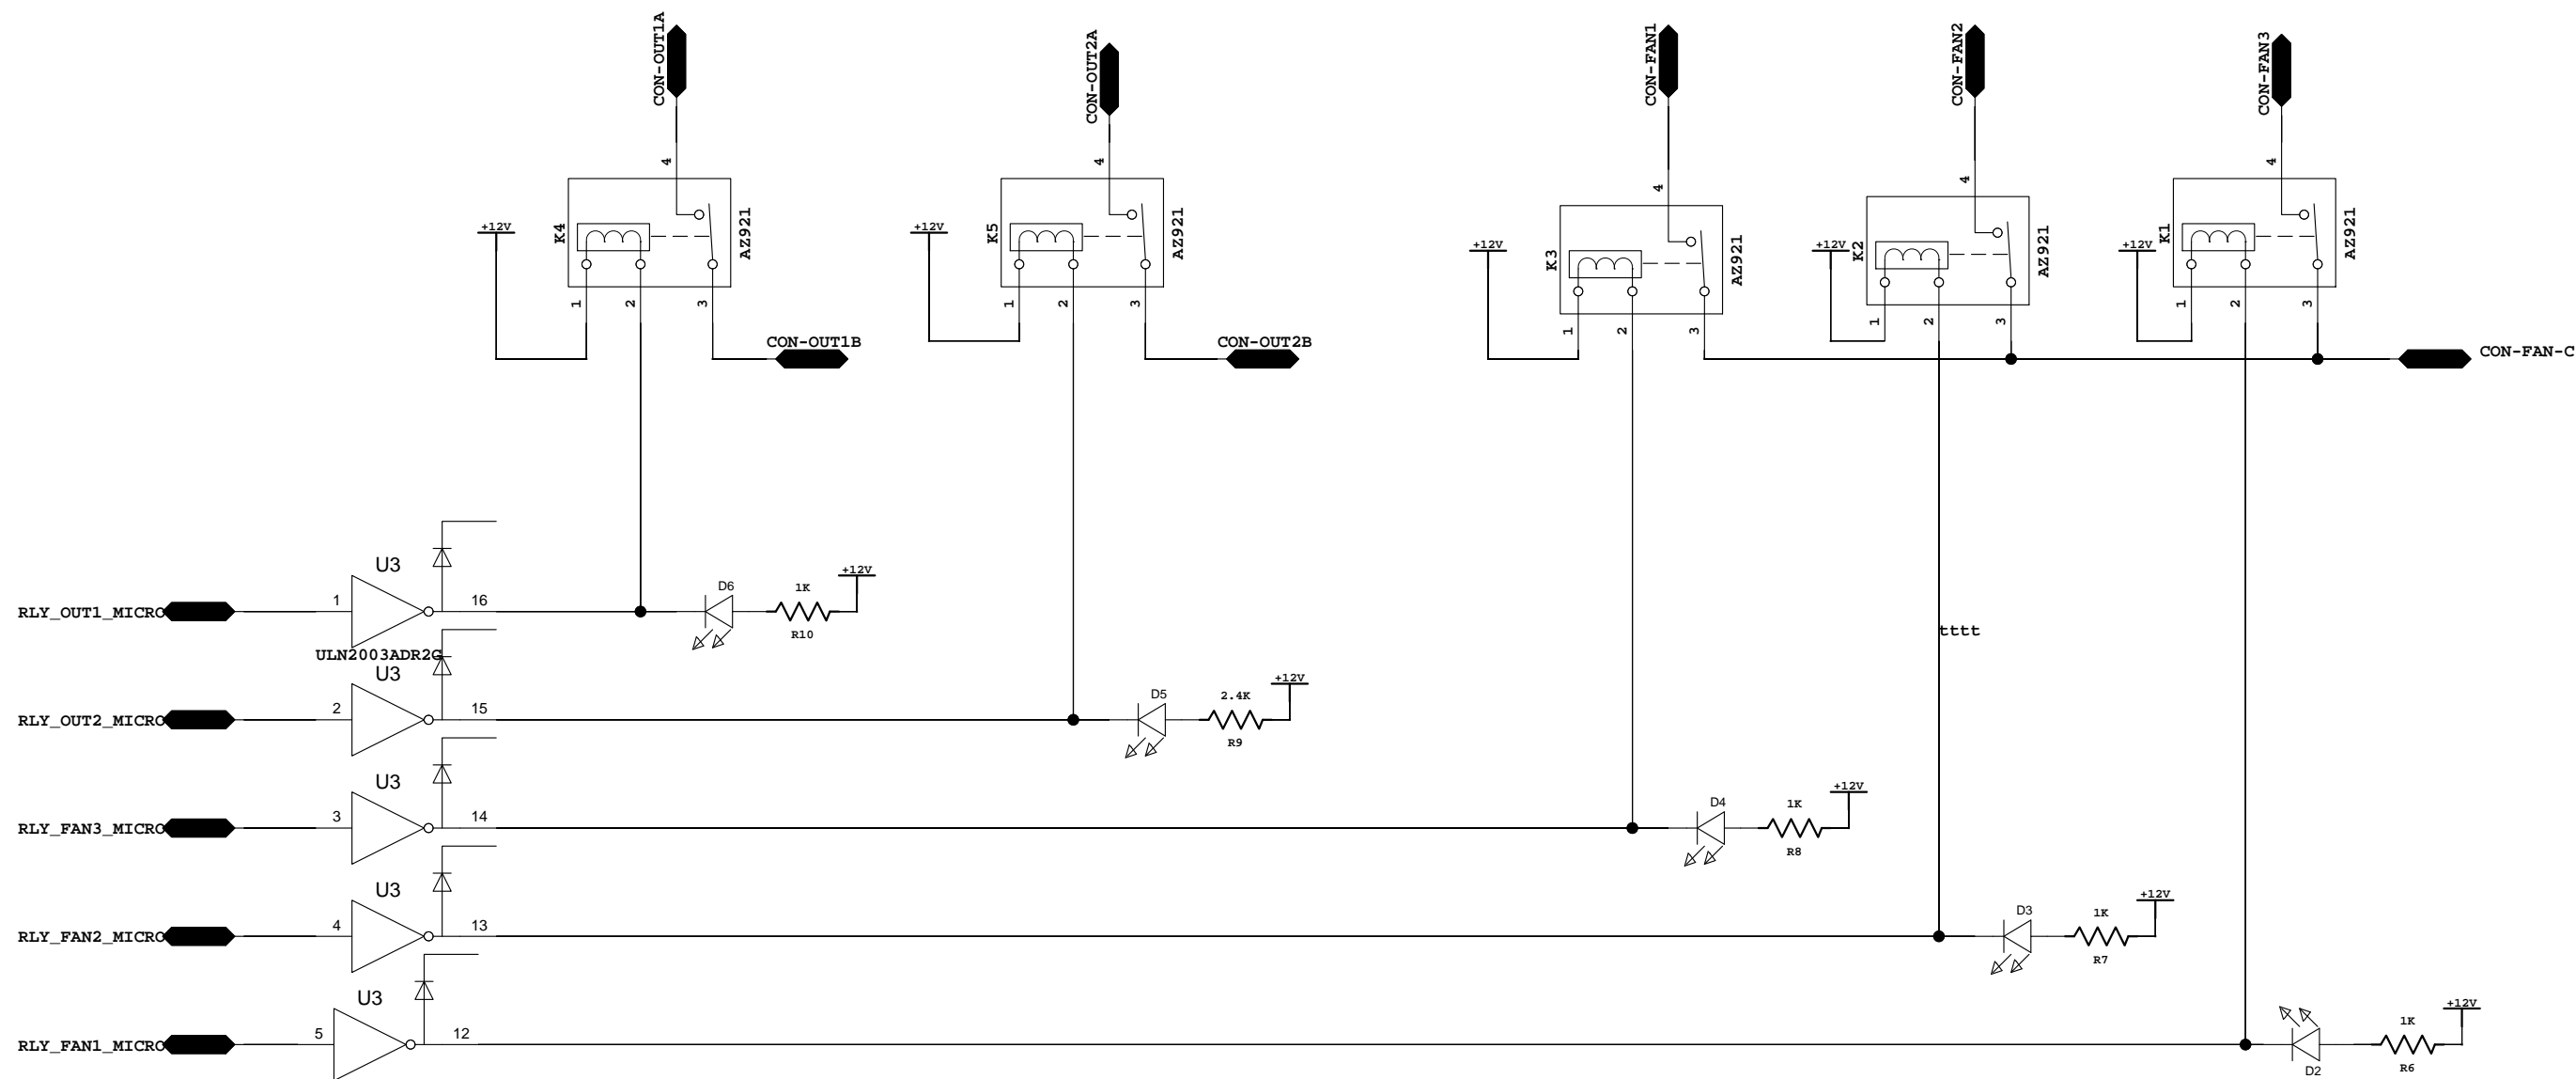

CONRS485_ext

Mentor[®]
A Siemens Business

TITLE			
SIZE	DWG NO	RELAY_GROUP 1	
DRAWN BY	SHEET	of 5	18/02/2022:17:58

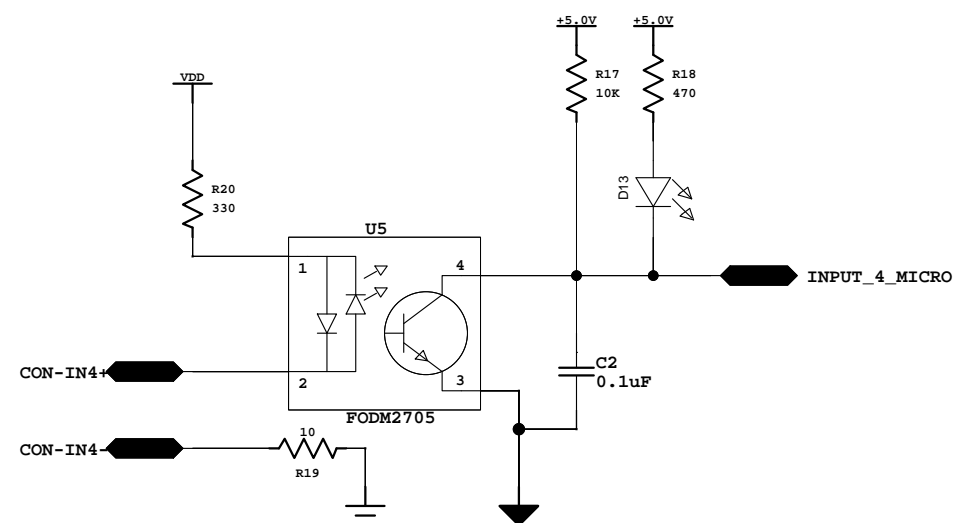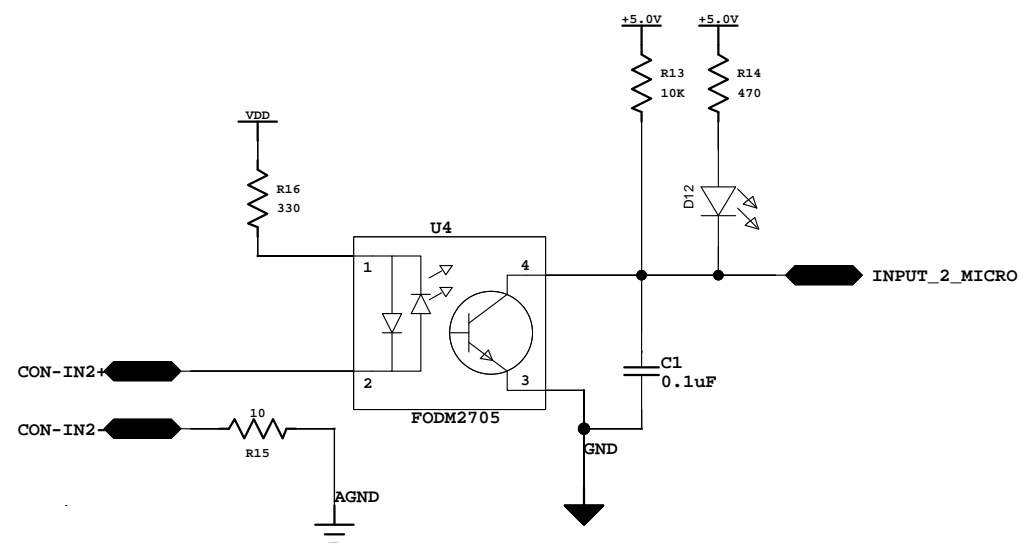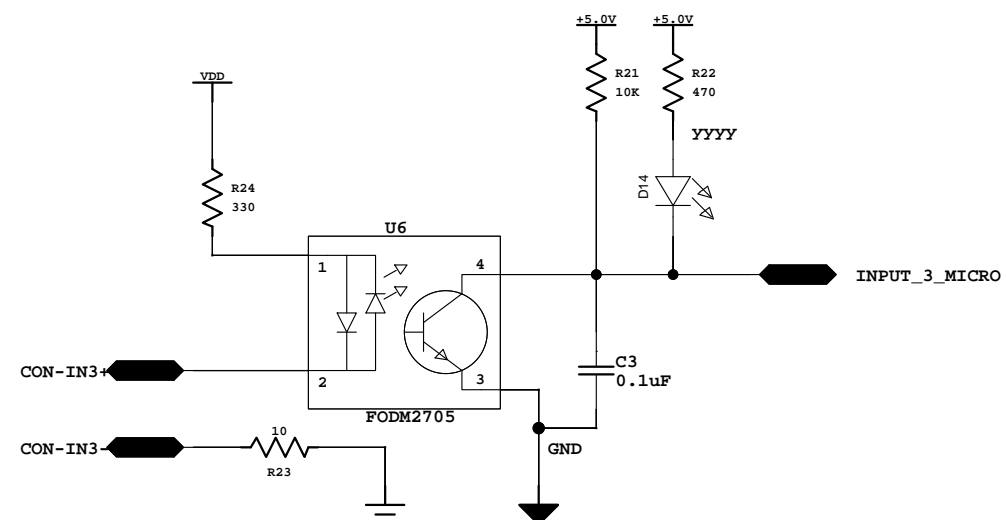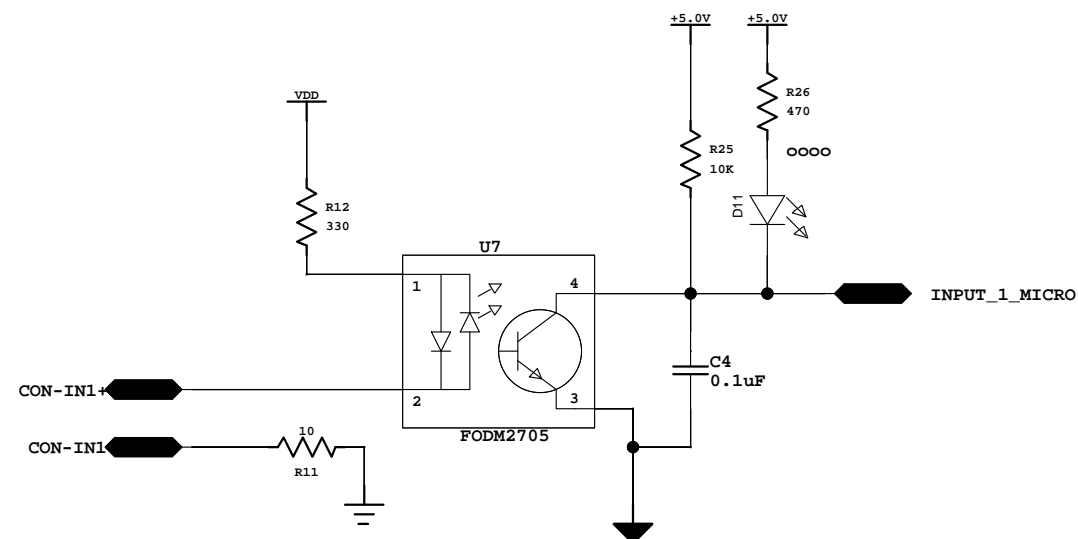

Mentor[®]
A Siemens Business

TITLE

SIZE DWG NO

B


INPUTS 1


DRAWN BY



SHEET

6

29/06/2021:17:27

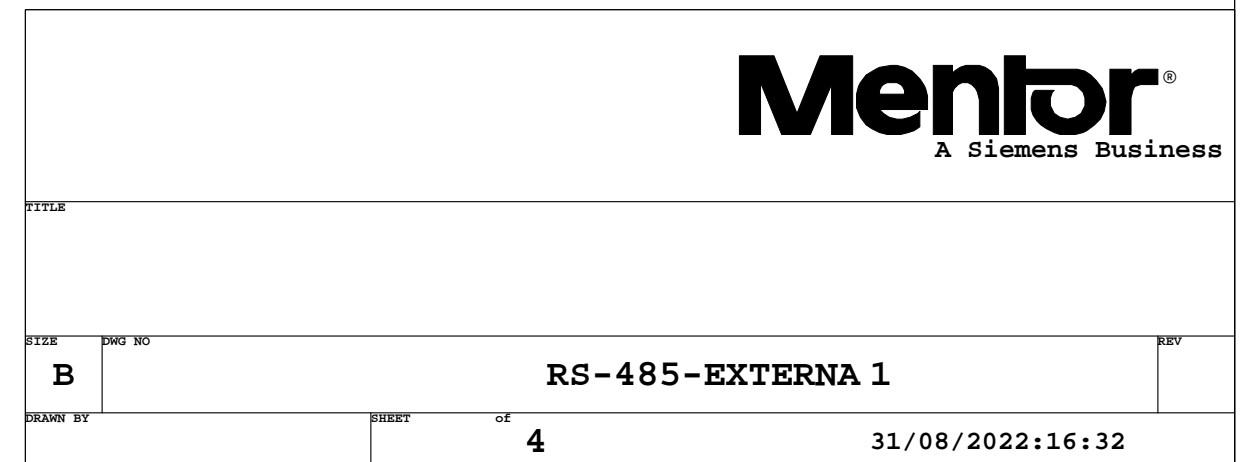


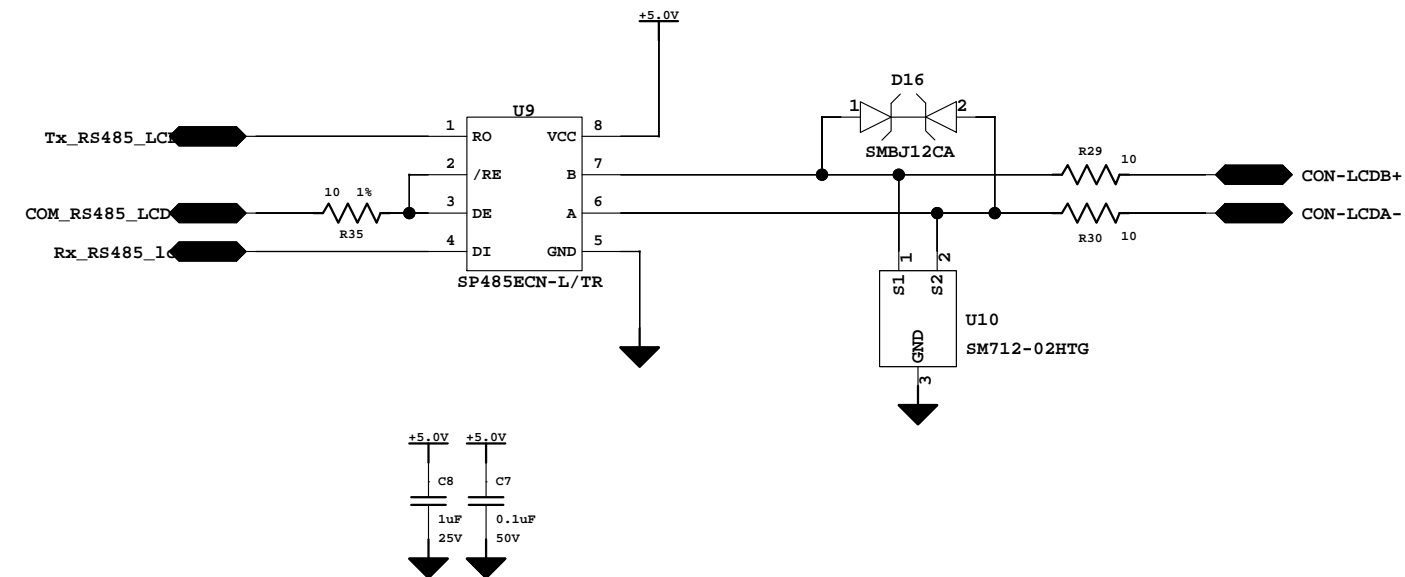

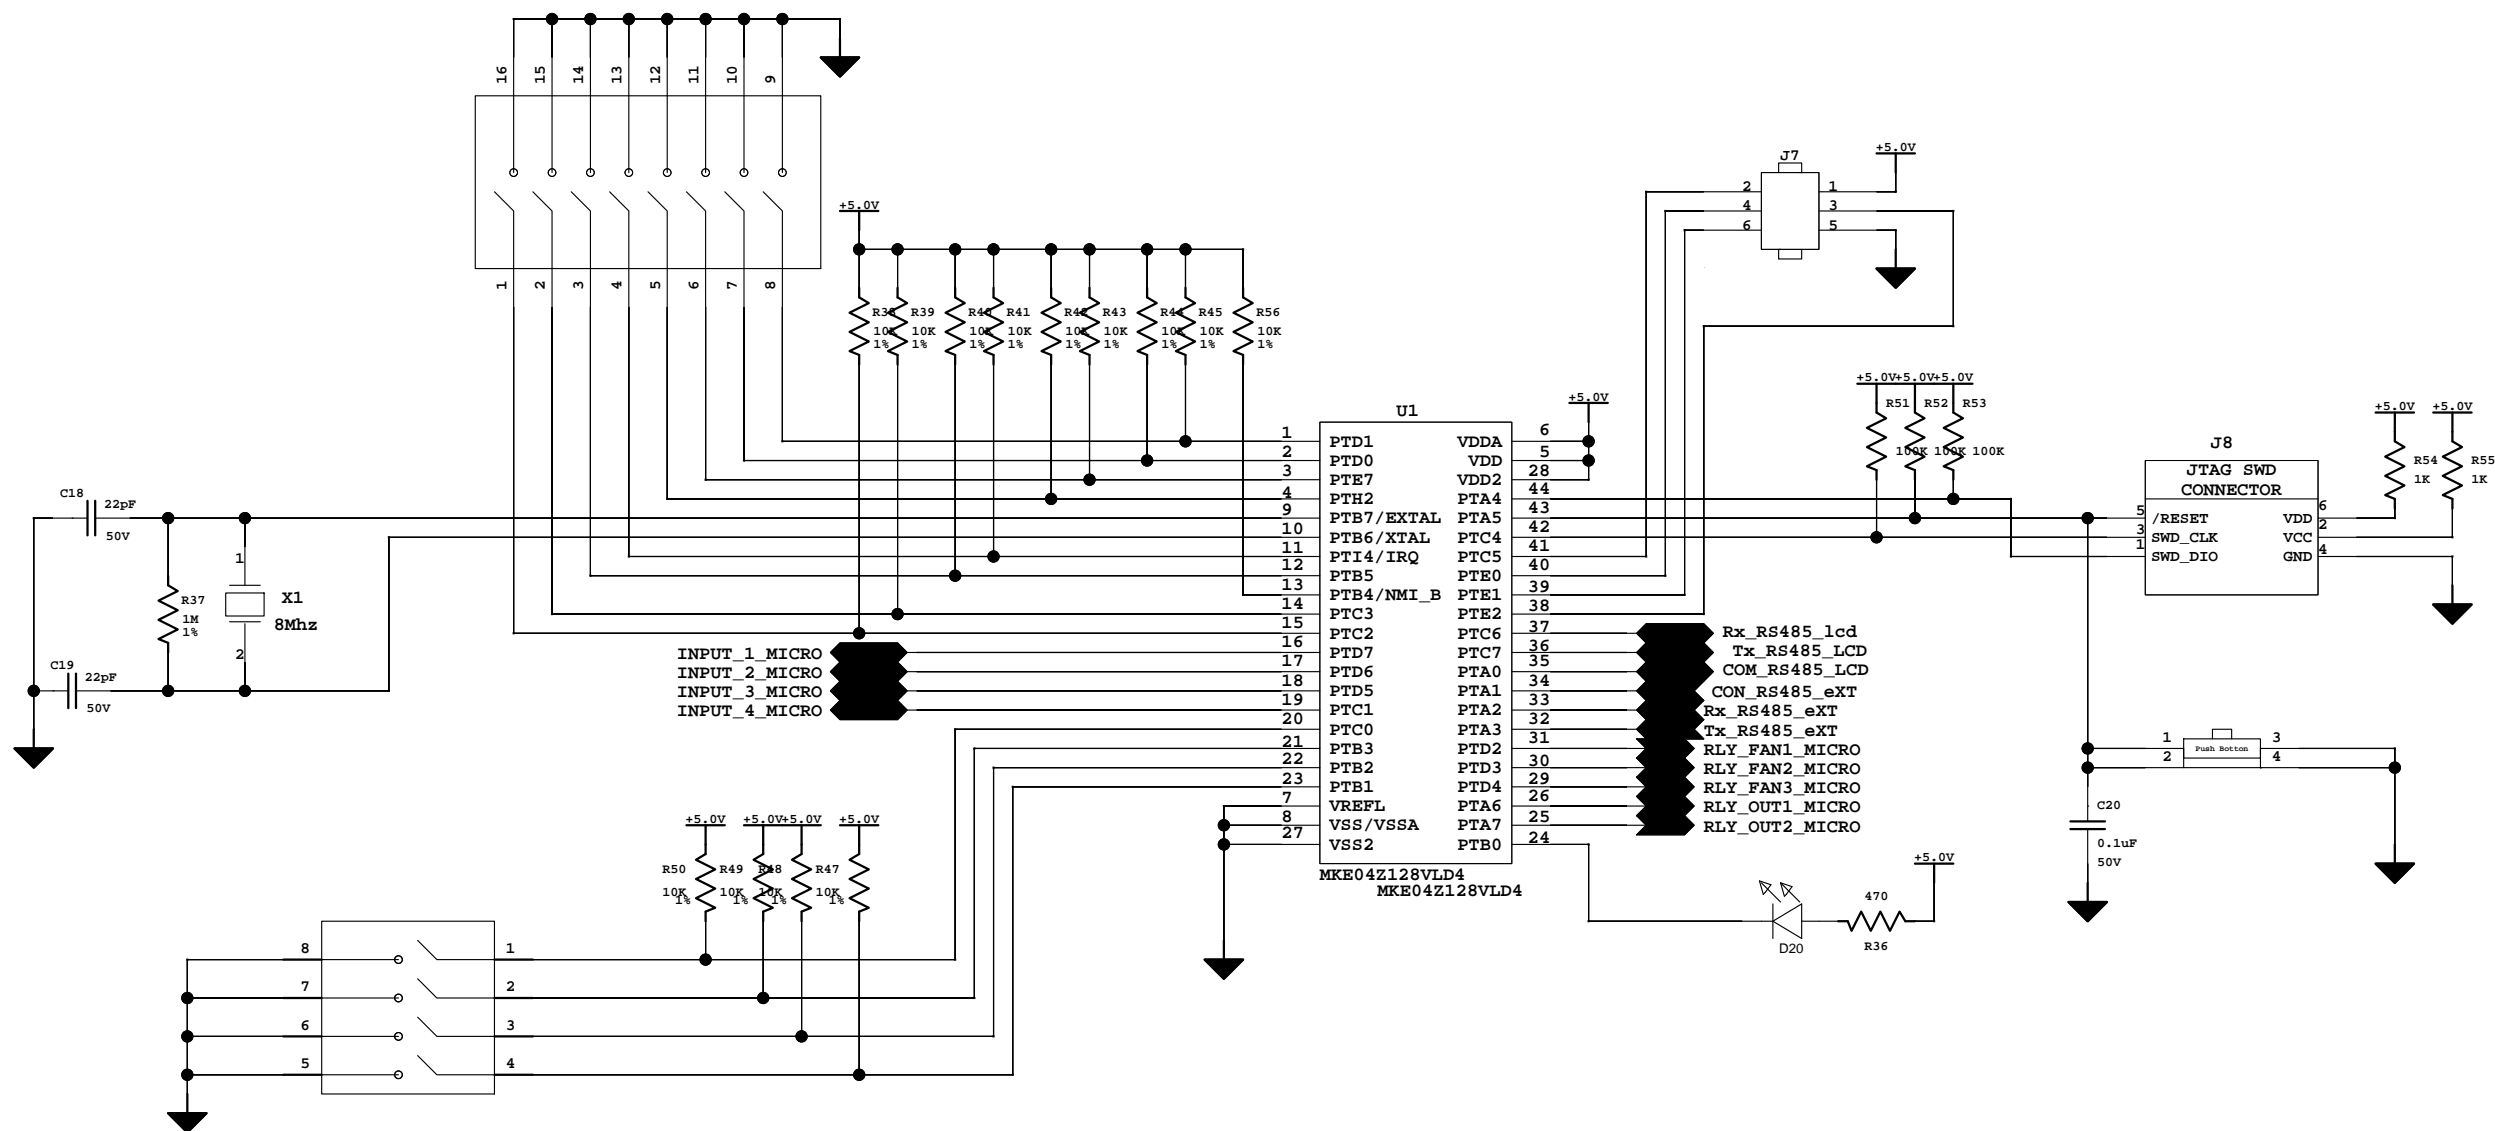

Mentor
A Siemens Business

TITLE			
SIZE	DWG NO	CONTROL 1	
B			
DRAWN BY	SHEET	of	8
		25/03/2022:17:33	

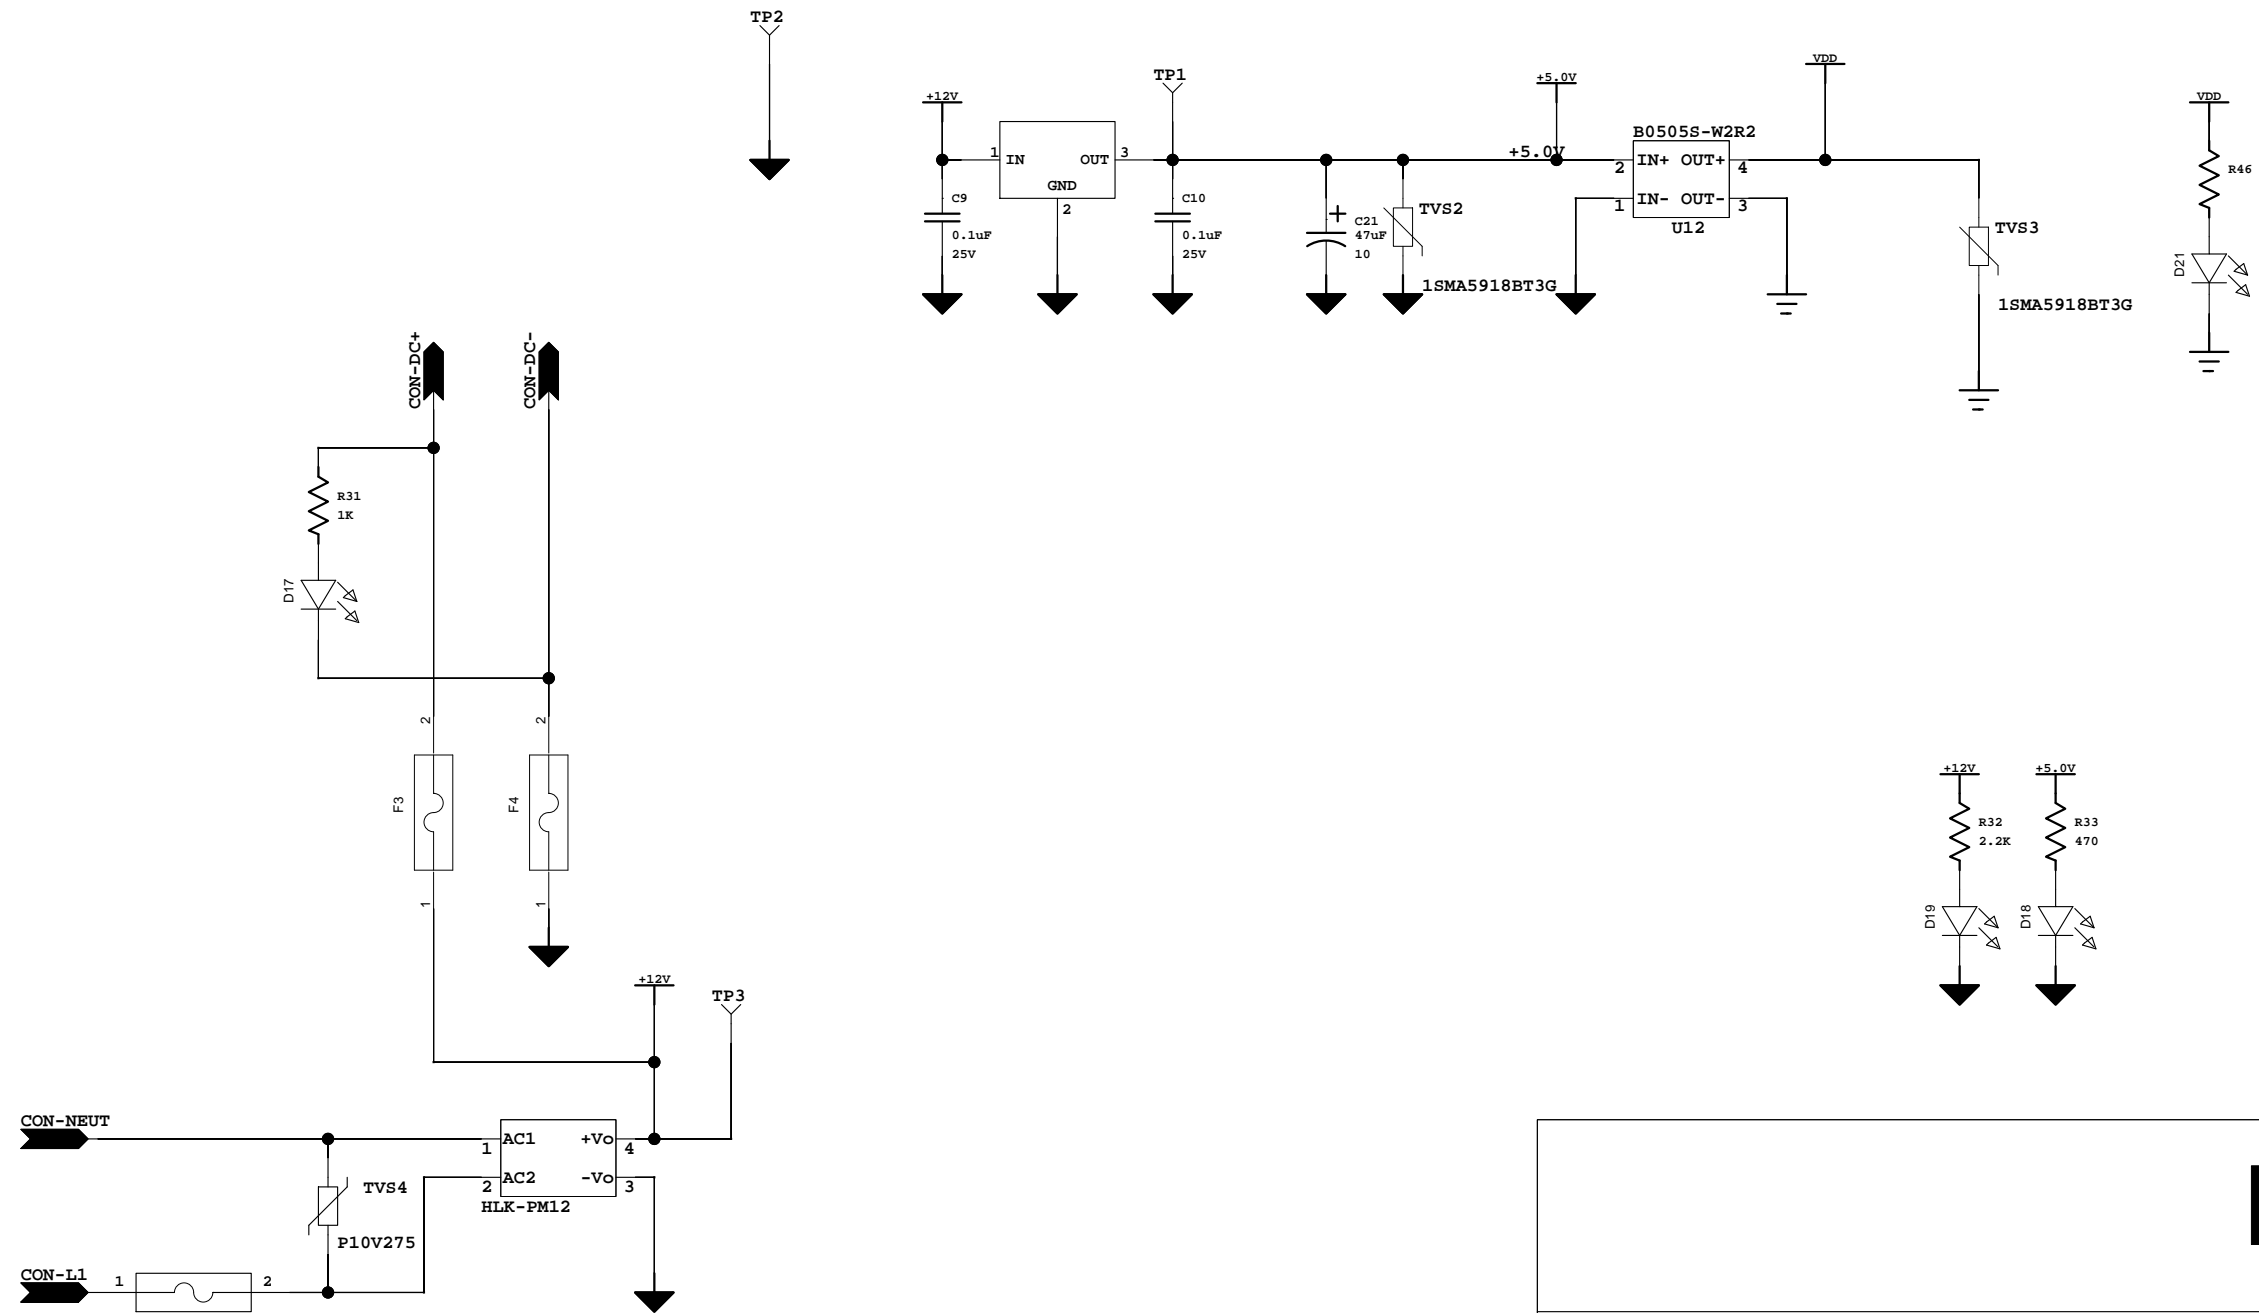

Mentor[®]
A Siemens Business

TITLE			
SIZE	DWG NO	power_supply 1	
DRAWN BY	SHEET	of 7	31/08/2022:16:32