Quarterly maintenance summary. This report lists the work done in the third quarter and the energy use of the main plant. The chart on the next page shows the monthly consumption.

Addendum. A new section on spare parts was added at the request of the facilities manager. It lists the parts that were replaced during the quarter.

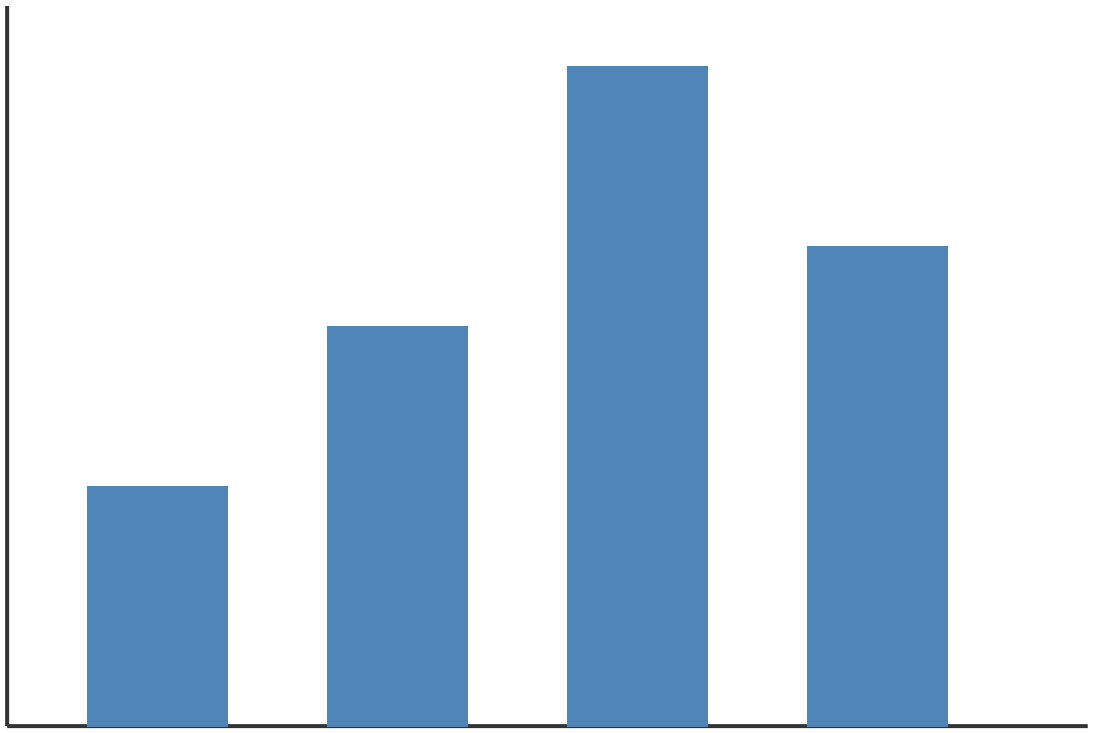

Notes. Consumption rose in the second month because of a chiller fault that was repaired within two days. All other values are within the expected range.