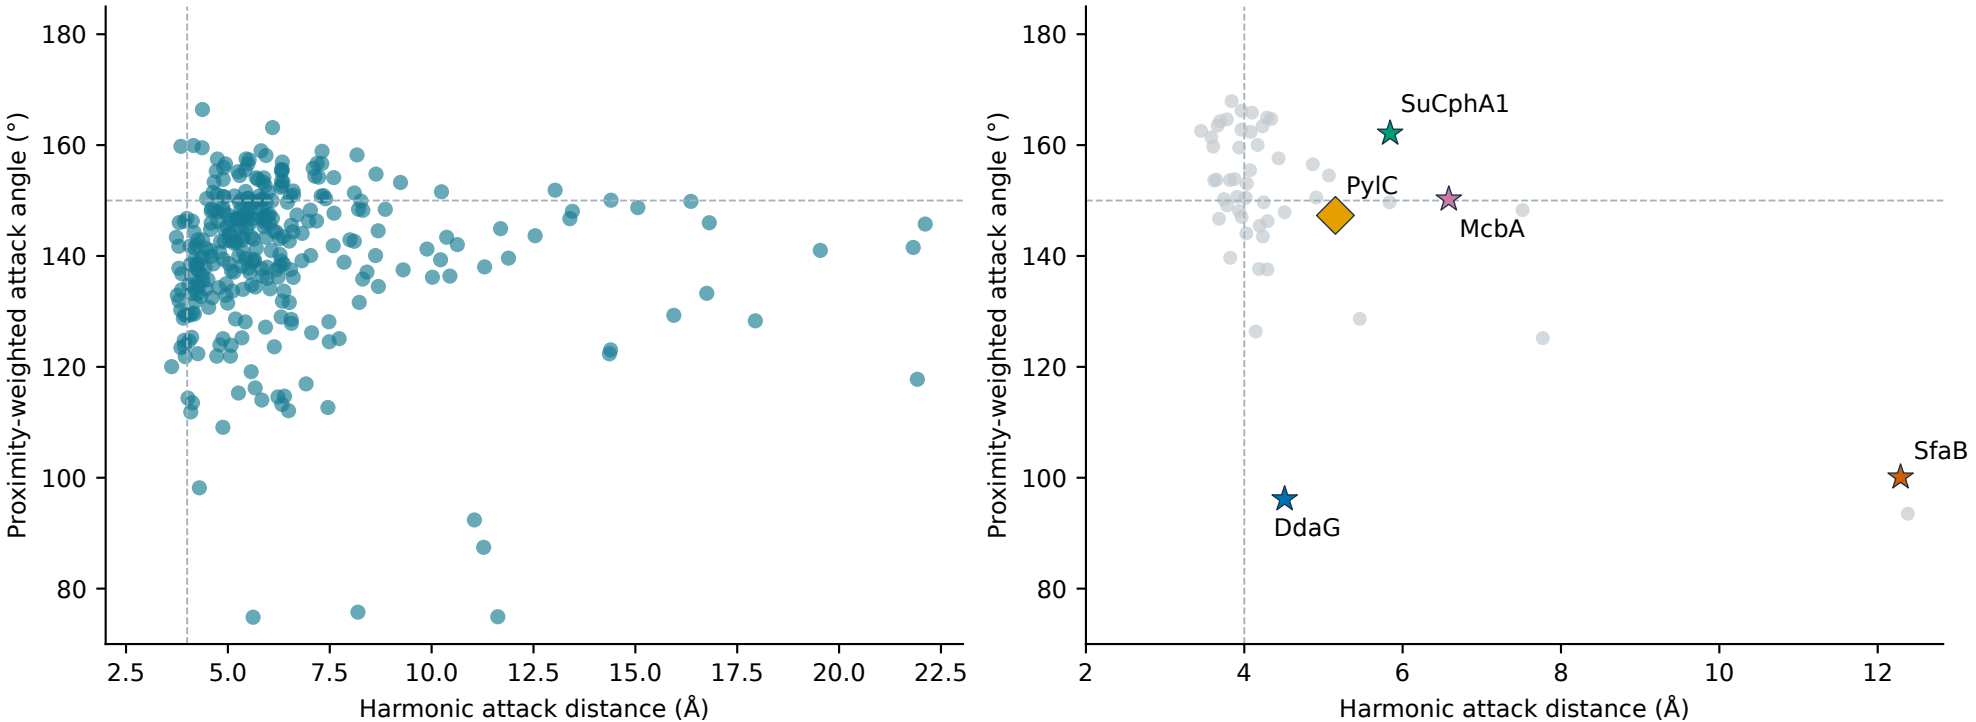

Targets are separate panels. PylC is not an interpretable negative control; historical reference protocols vary.