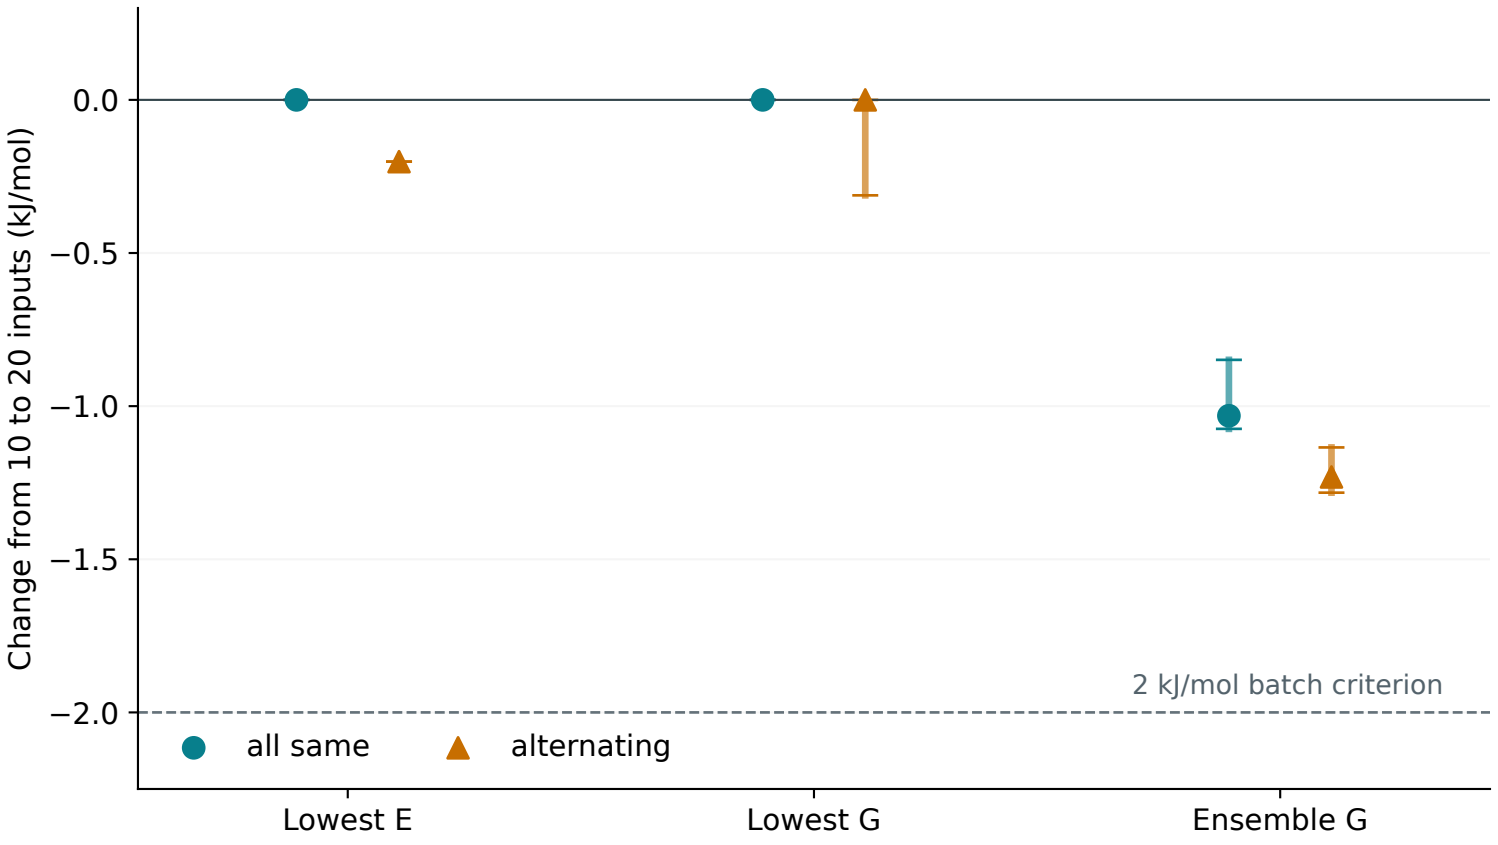
0.0
−0.5
−1.0
−1.5
−2.0
Change from 10 to 20 inputs (kJ/mol)
2 kJ/mol batch criterion
all same
alternating
Lowest E
Lowest G
Ensemble G