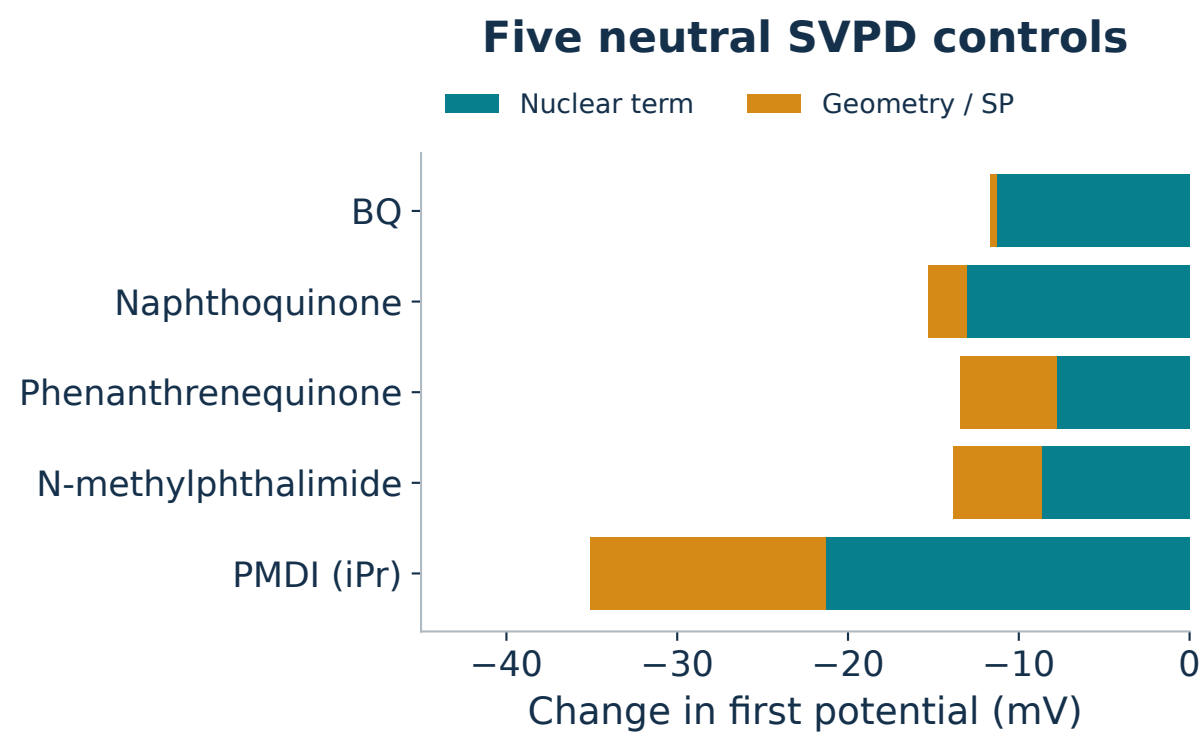
Five neutral SVPD controls
Nuclear term
Geometry / SP
BQ
Naphthoquinone
Phenanthrenequinone
N-methylphthalimide
PMDI (iPr)
−40
−30
−20
−10
0
Change in first potential (mV)

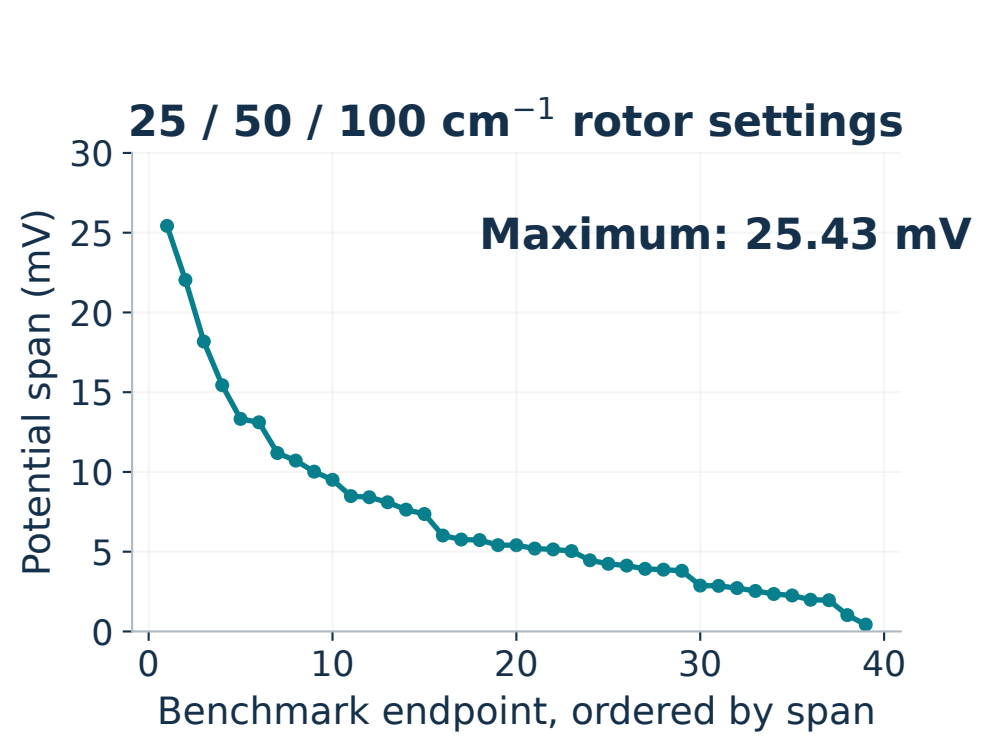
25 / 50 / 100 cm^{-1} rotor settings
Maximum: 25.43 mV
Potential span (mV)
0
5
10
15
20
25
30
0
10
20
30
40
Benchmark endpoint, ordered by span