The value of energy efficiency in Tunisia's power system

What each MWh saved avoids from 2027 to 2030, at the pace Tunisia actually builds

Rayen Romdhani, Energy Engineering, ENIM (Monastir, Tunisia)

PyPSA-Earth capacity-expansion model, 2 nodes, 8,760 hours

Each MWh saved from 2027 to 2030 avoids about 70 EUR

Built year by year at Tunisia's real pace; saving 15% by 2030 (S1-15) against no extra saving (S0), per MWh saved:

70 EUR

of system cost (investment + operation)

1.95 MWh

of gas burnt for power

0.39 t

of CO2

423 MW

of new gas plants not needed (the whole saving)

With little room to build solar, almost every saved MWh comes off a gas plant. In 2030 alone with no build limit, the same saving avoids 60 EUR, 0.91 MWh of gas and 0.18 t of CO2.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

An open model, calibrated to 2024, then run to 2030

1

Base network

PyPSA-Earth builds Tunisia's grid, plants, solar and wind potential and hourly demand from open data

2

2024 calibration

Official ONEM fleet; one efficiency factor fitted so gas burnt matches STEG within 0.4%

3

11 scenarios

Demand cut 10%-20%, cooling-first saving, shiftable load, gas price x0.5 and x1.5

4

Two ways to 2030


Year by year from 2027 at Tunisia's building pace; and 2030 alone with no build limit and at least 35% renewable. 10% reserve in every run

Every input number has a row and a source in the assumptions register. All 11 runs for 2030 and all 46 pathway solves pass the post-solve checks.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

A 10% saving removes the need for new gas plant

2030 on its own, with no limit on building

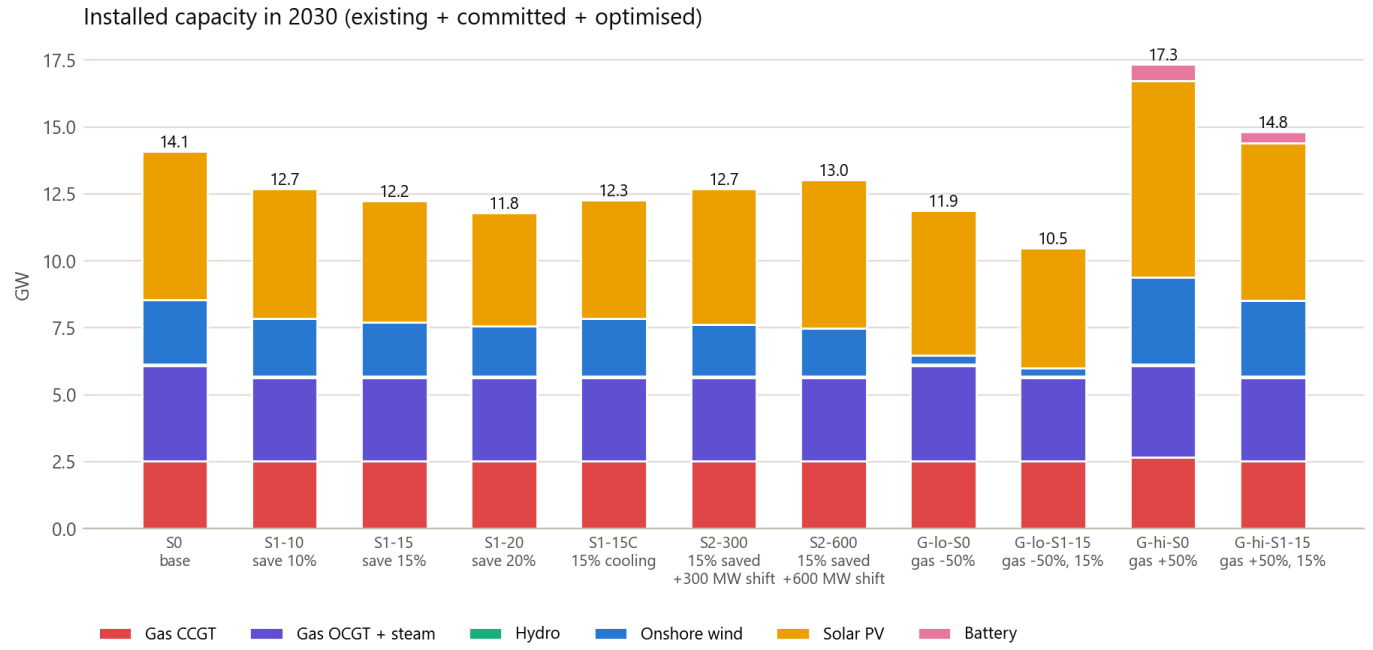

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

423 MW

of new gas turbines in the base case, to keep a 10% reserve above the peak


Every efficiency scenario avoids all of it. Further savings then avoid mostly solar and wind that would otherwise be built.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

Saving during air-conditioning hours is worth more

2030 on its own, with no limit on building

Saving 15% evenly vs from summer cooling first (per MWh saved, vs S0)

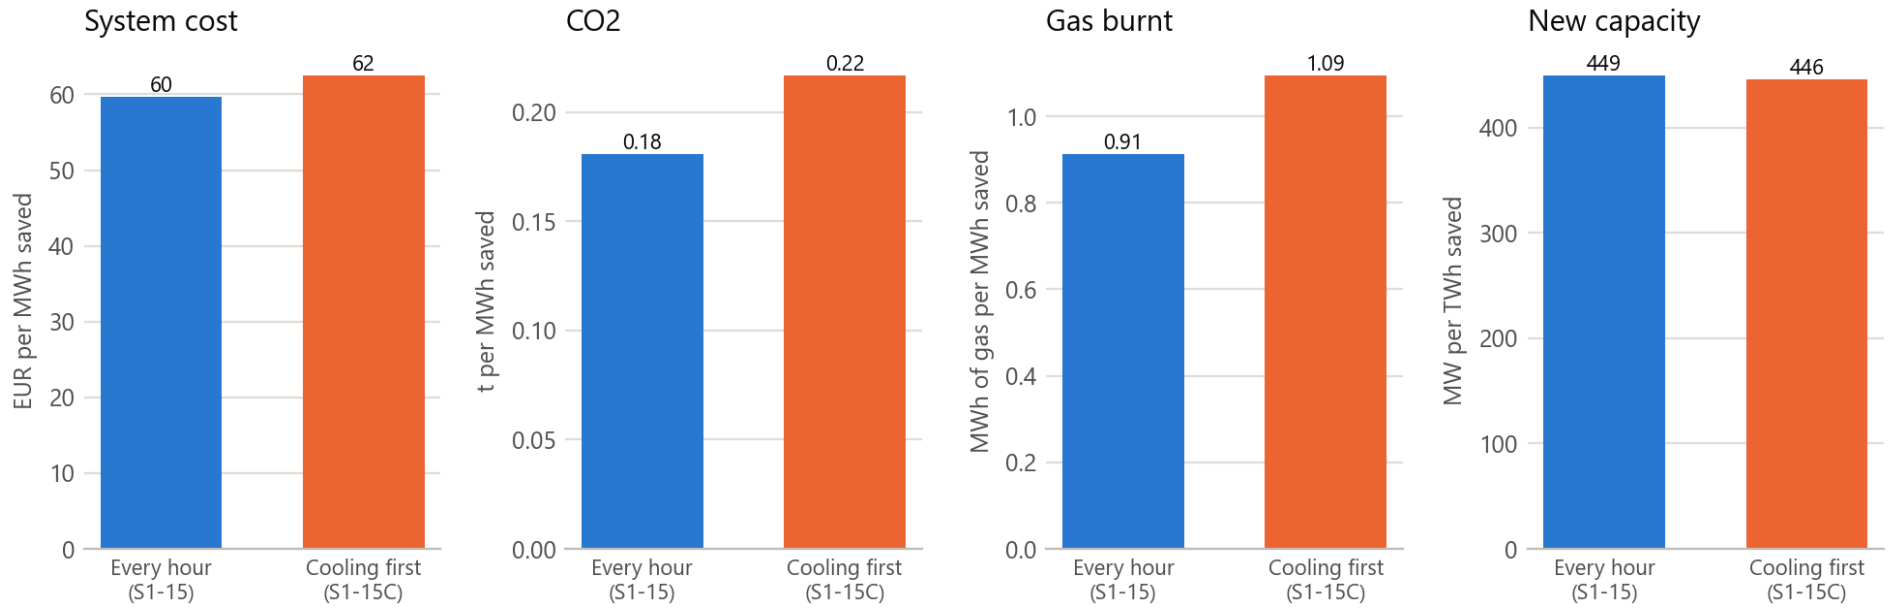


Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

Only 39% of the 15% saving fits on the summer cooling load, yet it avoids 20% more gas and CO2 per MWh than an even cut: those are the hours when gas runs.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

Shifting load by up to 3 hours adds to efficiency

2030 on its own, with no limit on building

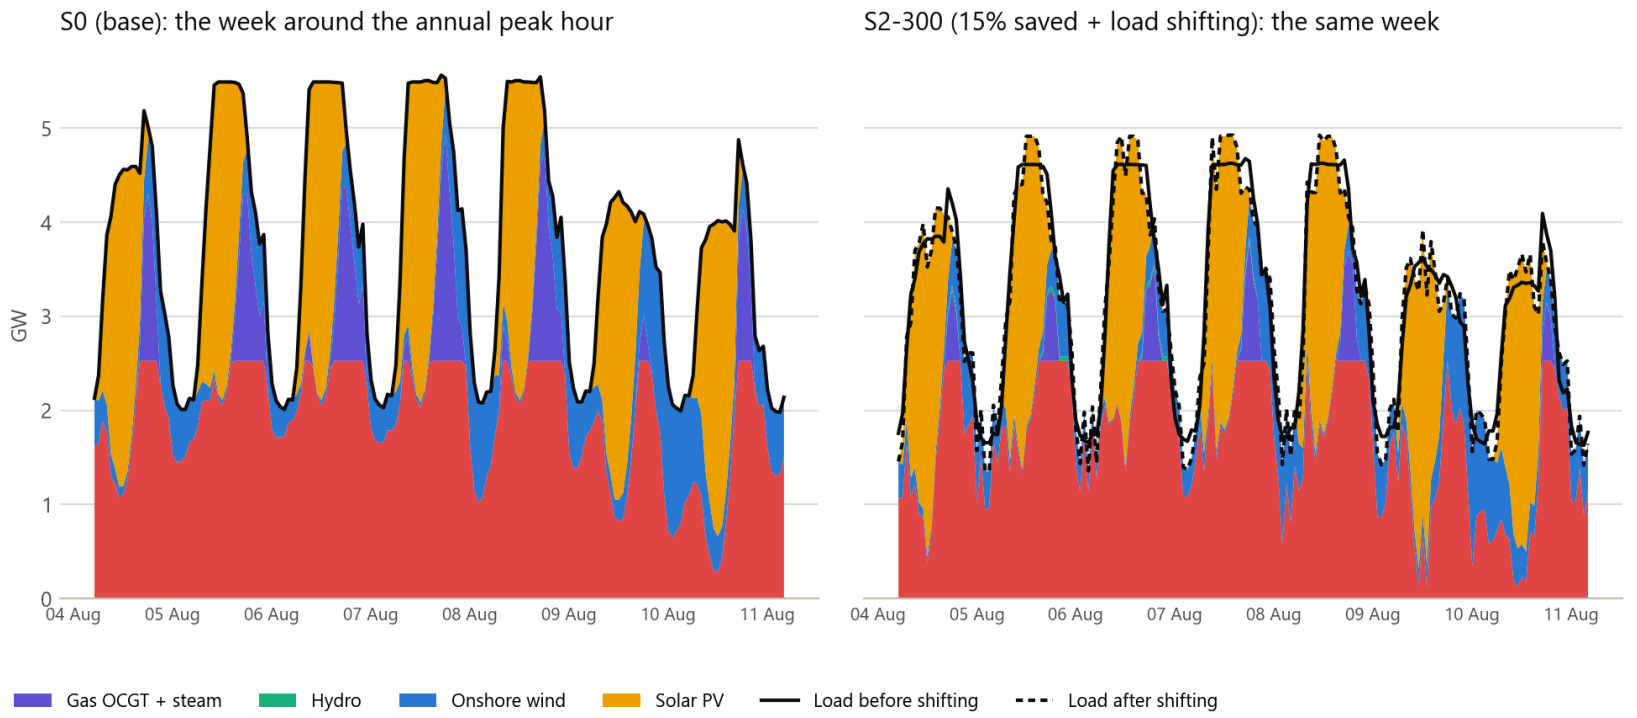

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx; weather year 2013, times in UTC


300 MW of shiftable load saves another 22 M EUR and 0.24 Mt of CO2 per year, by moving morning and evening load into midday solar hours.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

The gas price decides what a saved MWh displaces

2030 on its own, with no limit on building

What each MWh of electricity saved avoids in 2030

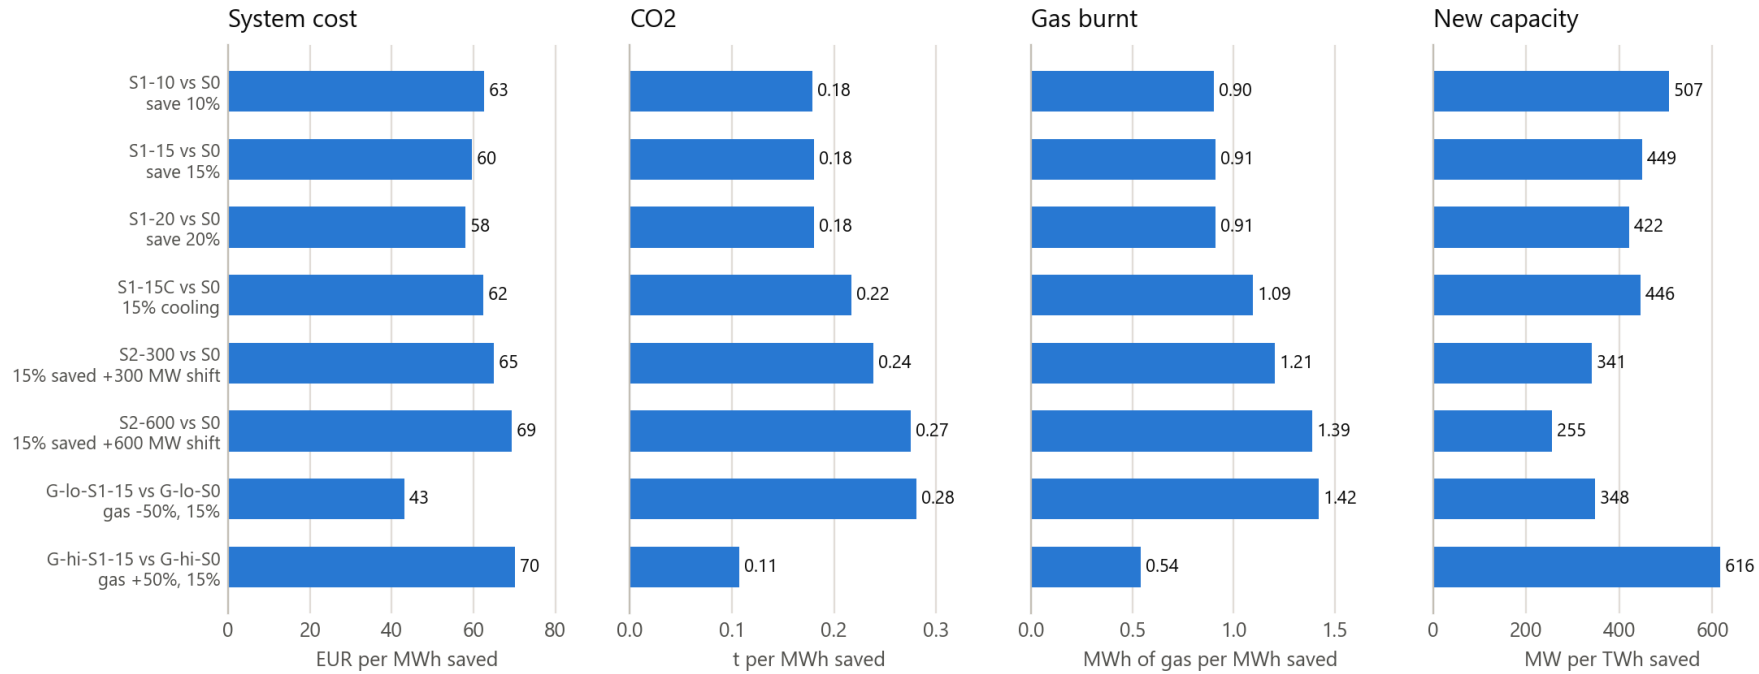


Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx; each scenario is compared with its reference at the same gas price

Cheap gas: each MWh saved avoids 0.28 t of CO2. Expensive gas: the system is already 70% renewable, so it avoids only 0.11 t of CO2 but 70 EUR of cost.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

At Tunisia's real pace, 35% is out of reach

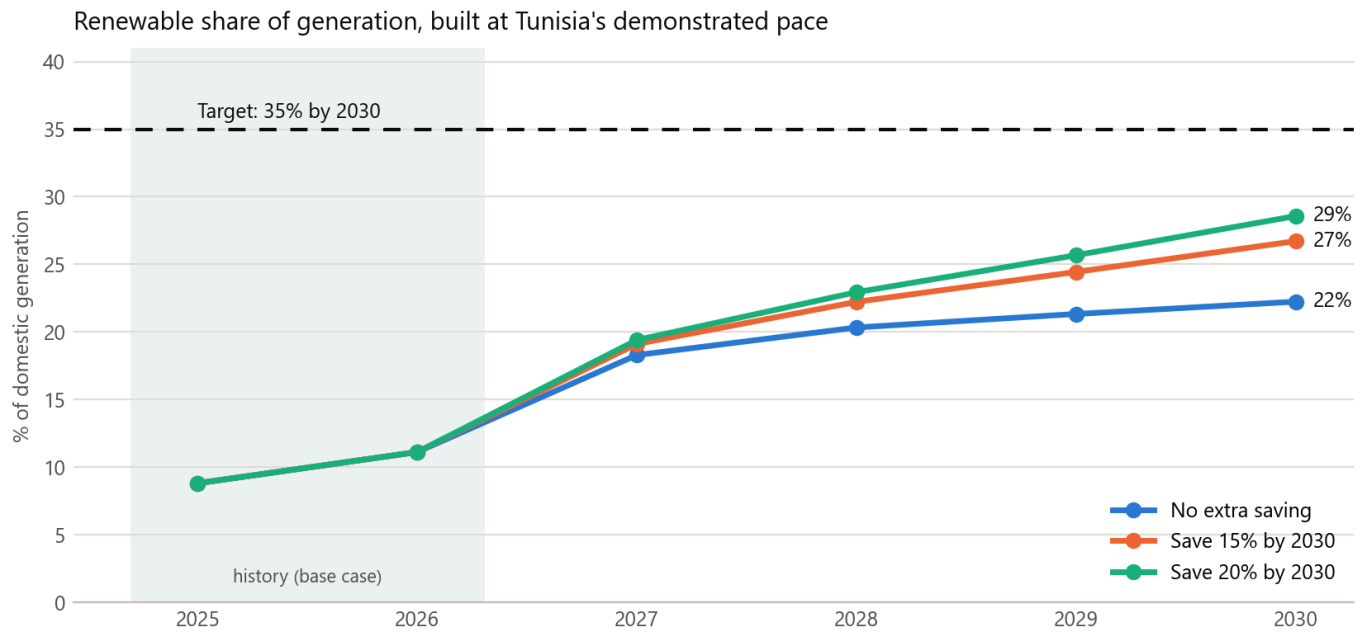

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx; build limits in the register (pathway_*)


22%

renewables in 2030 without extra saving; 27% when saving 15%

Saving 15% adds 4.5 percentage points; the target needs 12.8. The same panels cover a larger part of a smaller demand.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

A stricter air-conditioner standard saves for less than it avoids

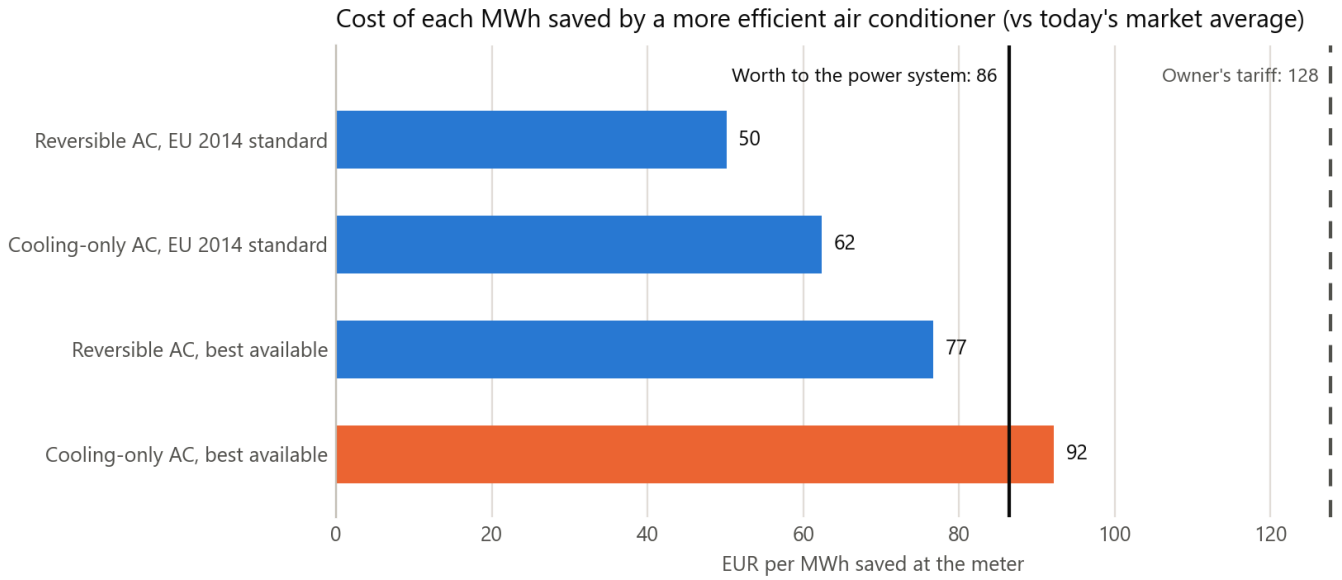

Source: LBNL 2023 (prices and kWh per unit); value: own model, S1-15C 2027-2030 plus 18% grid losses; results/saving_cost.csv

50-62 EUR

per MWh saved at the EU 2014 level, against 86 EUR avoided

It covers 9%-25% of the 15% saving; the other measures are not priced yet.

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx

What the numbers mean, and what comes next

Read with care

Not a forecast: 2030 alone has no build limit; the pathway's limits are judgements

Only air-conditioner standards are priced: the cost of the whole saving is unknown

One weather year; imports flat at their 2024 level

Demand growth from STEG's forecast as quoted by JICA (2022)

Next steps

Add the ELMED link to Italy as a scenario

Test faster build rates as the 2 GW wind tenders progress

Price lighting, building and industry savings in Tunisia

Source: own PyPSA-Earth model of Tunisia 2030; inputs in data/assumptions_register.xlsx