
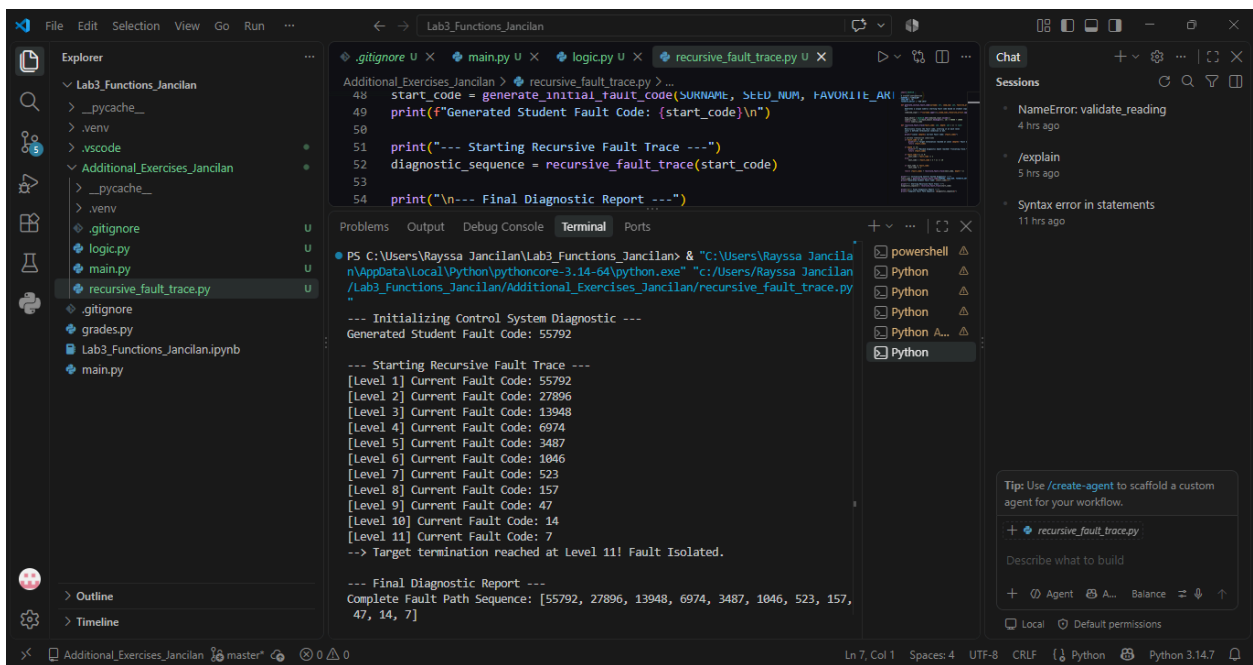


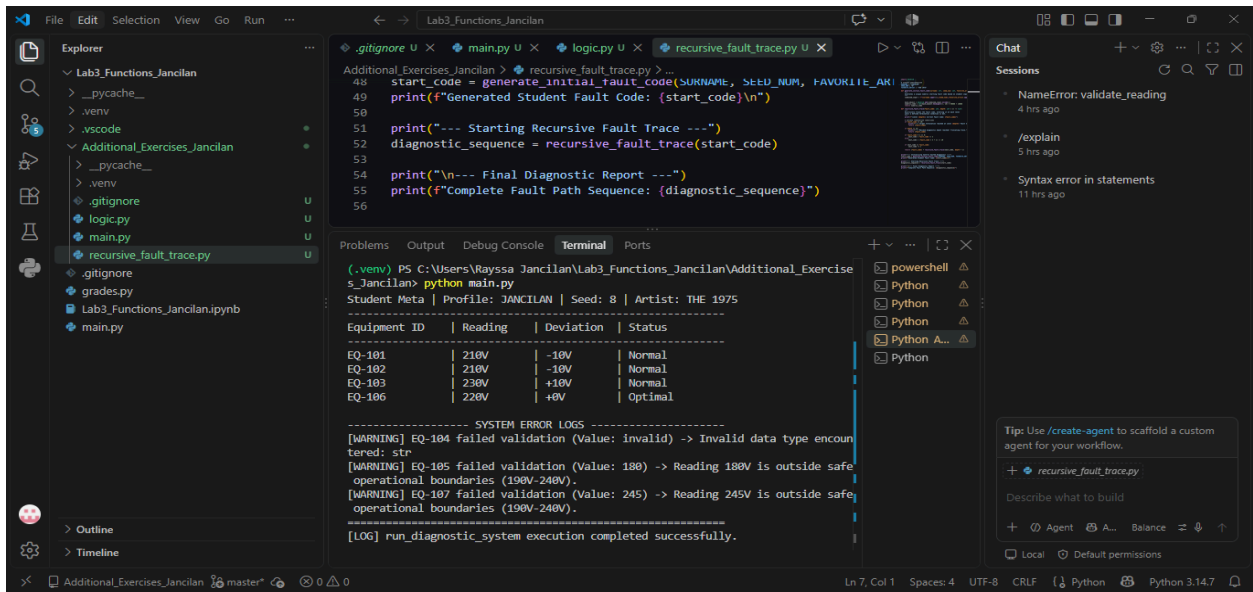

```
Problems Output Debug Console Terminal Ports
PS C:\Users\Rayssa Jancilan\Lab3_Functions_Jancilan> & "C:\Users\Rayssa Jancila
n\AppData\Local\Python\pythoncore-3.14-64\python.exe" "c:/Users/Rayssa Jancilan
/Lab3_Functions_Jancilan/Additional_Exercises_Jancilan/pipeline.py"

[DECORATOR] Starting processing via function: 'run_equipment_pipeline'
[INFO] Initializing telemetry stream with seed modifier: 1055
[DECORATOR] Finished 'run_equipment_pipeline' in 0.021127 seconds.

=====
                FINAL DIAGNOSTIC REPORT
=====
Total Processed Readings : 20
Valid Readings Recorded  : 18
Invalid Readings Deflected: 2
Abnormal Events Flagged   : 4
=====
```

```
Problems Output Debug Console Terminal Ports Jupyter
PS C:\Users\Rayssa Jancilan\Lab3_Functions_Jancilan> & "C:\Users\Rayssa Jancila
n\AppData\Local\Python\pythoncore-3.14-64\python.exe" "c:/Users/Rayssa Jancilan
/Lab3_Functions_Jancilan/Additional_Exercises_Jancilan/pipeline.py"

Detailed Diagnostic Log Preview:
-> Item 1: [INVALID_ERROR: Unexpected string signature encountered: CORRUPTED_
DATA] - Val: CORRUPTED_DATA
-> Item 2: [ABNORMAL] - Val: 195.3
    └─ Level-0 Check: Value 195.3 exceeds standard thresholds.
    └─ Level-1 Check: Value 185.3 exceeds standard thresholds.
    └─ Level-2 Check: Value 175.3 exceeds standard thresholds.
    └─ Result: Critical Alert: Persistent abnormal condition verified at depth
3.
-> Item 3: [NORMAL] - Regulated Val: 78.75
-> Item 4: [NORMAL] - Regulated Val: 77.70
-> Item 5: [NORMAL] - Regulated Val: 77.70
-> Item 6: [INVALID_ERROR: Unexpected string signature encountered: CORRUPTED_
DATA] - Val: CORRUPTED_DATA
-> Item 7: [ABNORMAL] - Val: 175.35
    └─ Level-0 Check: Value 175.35 exceeds standard thresholds.
    └─ Level-1 Check: Value 165.35 exceeds standard thresholds.
    └─ Level-2 Check: Value 155.35 exceeds standard thresholds.
    └─ Result: Critical Alert: Persistent abnormal condition verified at depth
3.
-> Item 8: [NORMAL] - Regulated Val: 91.35
-> Item 9: [NORMAL] - Regulated Val: 39.90
-> Item 10: [NORMAL] - Regulated Val: 45.15
PS C:\Users\Rayssa Jancilan\Lab3_Functions_Jancilan>
```