
W12A Landfill, London, Ontario: site sizing

What the gas W12A flares could power, how much land it would take, and what it could earn each year.

3.6 MW	4	9 ac	332k
POWER FROM THE GAS	COMPUTE MODULES	LAND NEEDED	MMBTU BOUGHT / YR

GAS SALE, PER YEAR	LAND LEASE, PER YEAR	TOTAL TO THE OWNER, PER YEAR
up to $996k	$9k to $19k	$9k to $1.02M

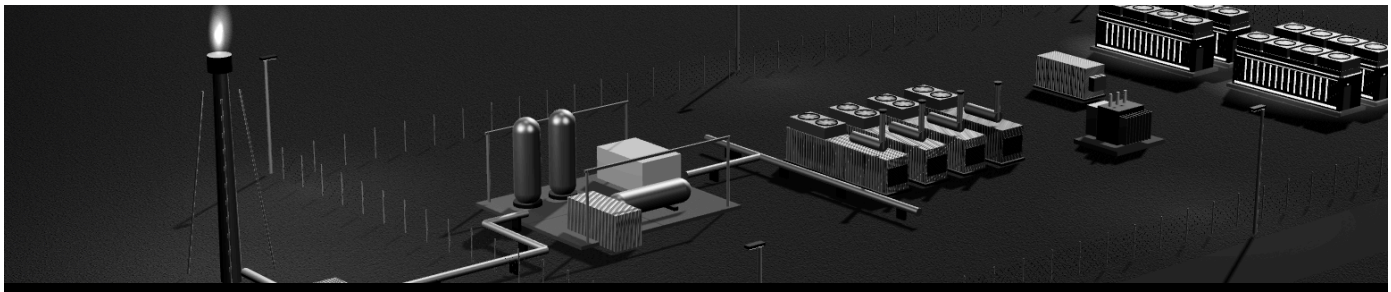

YOUR SITE IN OUR LIVE 3D MODEL — ACCRETIONCOMPUTE.COM/SITE-MODEL?SRC=LFG&FLOW=1460&CH4=45

THE MATH

Landfill gas collected (2024)	about 1,460 scfm
Methane content (2025 report)	45%
Energy in the gas	39.9 MMBtu per hour
Power at a heat rate of 11,000 Btu/kWh	about 3.6 MW
Compute (power less cooling and losses, /1.2)	about 3.0 MW
Compute modules (about 1 MW each)	4
Gas engines (running plus one spare)	4 at 1.6 MW
Land: 5 acres plus 1.2 acres per MW	about 9 acres
Gas bought per year (95% run time)	332k MMBtu
Gas payment, up to $3.00/MMBtu	up to $996k
Land lease at $1,000 to $2,000 per acre per year	$9k to $19k

Landfill gas: about 1,012 Btu per cubic foot of methane. Figures in US dollars; the price band is the one shown on our Site model page.

WHAT IT WOULD LOOK LIKE

- Gas engines on a small parcel near the gas, a battery to smooth the load, and factory-built compute modules leased to an AI company.
- No grid connection and no export: all of the power is used on site.
- We build and run the site. The owner puts in no capital.
- Multi-year gas and land agreements, matched to the tenant's lease, at a fixed price.

WORTH CHECKING

- Latest flow after the approved expansion
- Space for a small fenced parcel near the flare
- Gas quality (siloxanes, H2S) for engines
- Any provincial or City approvals for on-site generation

Source: Ontario Ministry of the Environment landfill gas dataset 2010-2025 (100% of collected gas flared, 2020-2025). The 2025 row shows about 1,940 scfm; at that flow the figures above rise by about a third. This is an estimate from public data, not an offer: no cost and no obligation. The real price and terms are set in the gas and land agreements after a site review.