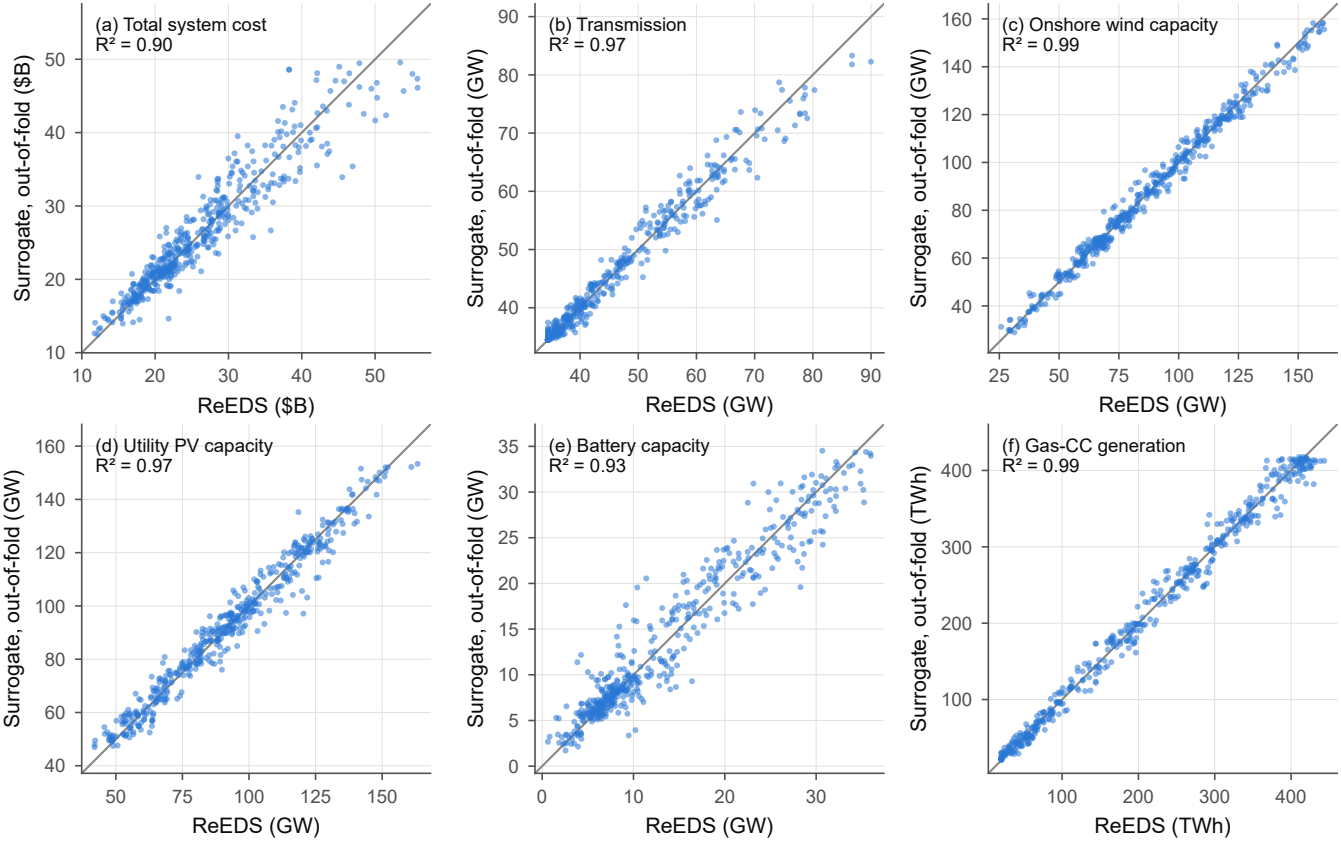

(a) Total system cost
R² = 0.90
Surrogate, out-of-fold ($B)
ReEDS ($B)
(b) Transmission
R² = 0.97
Surrogate, out-of-fold (GW)
ReEDS (GW)
(c) Onshore wind capacity
R² = 0.99
Surrogate, out-of-fold (GW)
ReEDS (GW)
(d) Utility PV capacity
R² = 0.97
Surrogate, out-of-fold (GW)
ReEDS (GW)
(e) Battery capacity
R² = 0.93
Surrogate, out-of-fold (GW)
ReEDS (GW)
(f) Gas-CC generation
R² = 0.99
Surrogate, out-of-fold (TWh)
ReEDS (TWh)