

I. CASE STUDY DEMONSTRATION

A. Simulation Data: IEEE 123 Bus Test System

We're using a Balanced Three-Phase version of the IEEE 123 Bus Test System, which has 85 Load Nodes. Additionally, 20% (17) and 30% (26) of these load nodes also contain reactive power controllable Solar photovoltaics (PVs) and Batteries respectively. Their ratings are as per Table I. To demonstrate the effectiveness of the proposed algorithm, the Test System has been divided into four areas on similar lines as [?]. The full test system along with the area-wise division is shown in Figure 1.

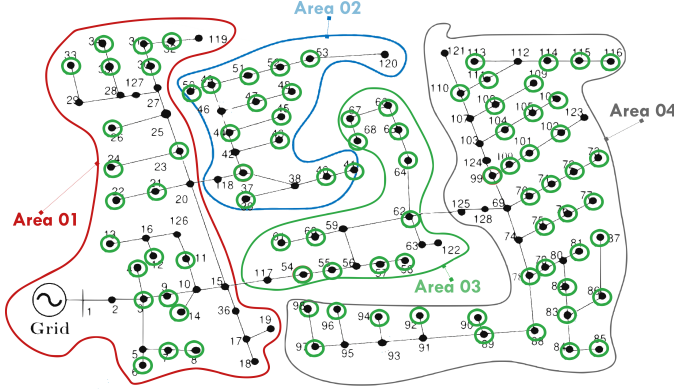


Fig. 1: IEEE 123 Node System Divided Into Four Areas

Change figure to display battery buses and PV buses

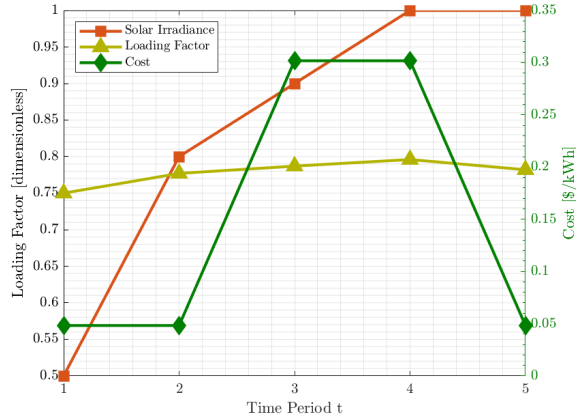


Fig. 2: Forecasts for Demand Power, Irradiance and Cost of Substation Power over a 5 Hour Horizon

TABLE I: Parameter Values

Parameter	Value
V_{min}, V_{max}	0.95, 1.05
P_{DR_j}	$0.33p_{LR_j}$
S_{DR_j}	$1.2p_{DR_j}$
P_{BR_j}	$0.33p_{LR_j}$
B_{R_j}	$T_{fullCharge} \times P_{BR_j}$
$T_{fullCharge}$	4 h
Δt	1 h
η_C, η_D	0.95, 0.95
soc_{min}, soc_{max}	0.30, 0.95
α	0.001