


Validation against FEMA DC FIS 2010 — Potomac at Little Falls

USGS gauge 01646500 · LP3 (Bulletin 17C) with EMA censoring · LP3 error bars: 90 % CI

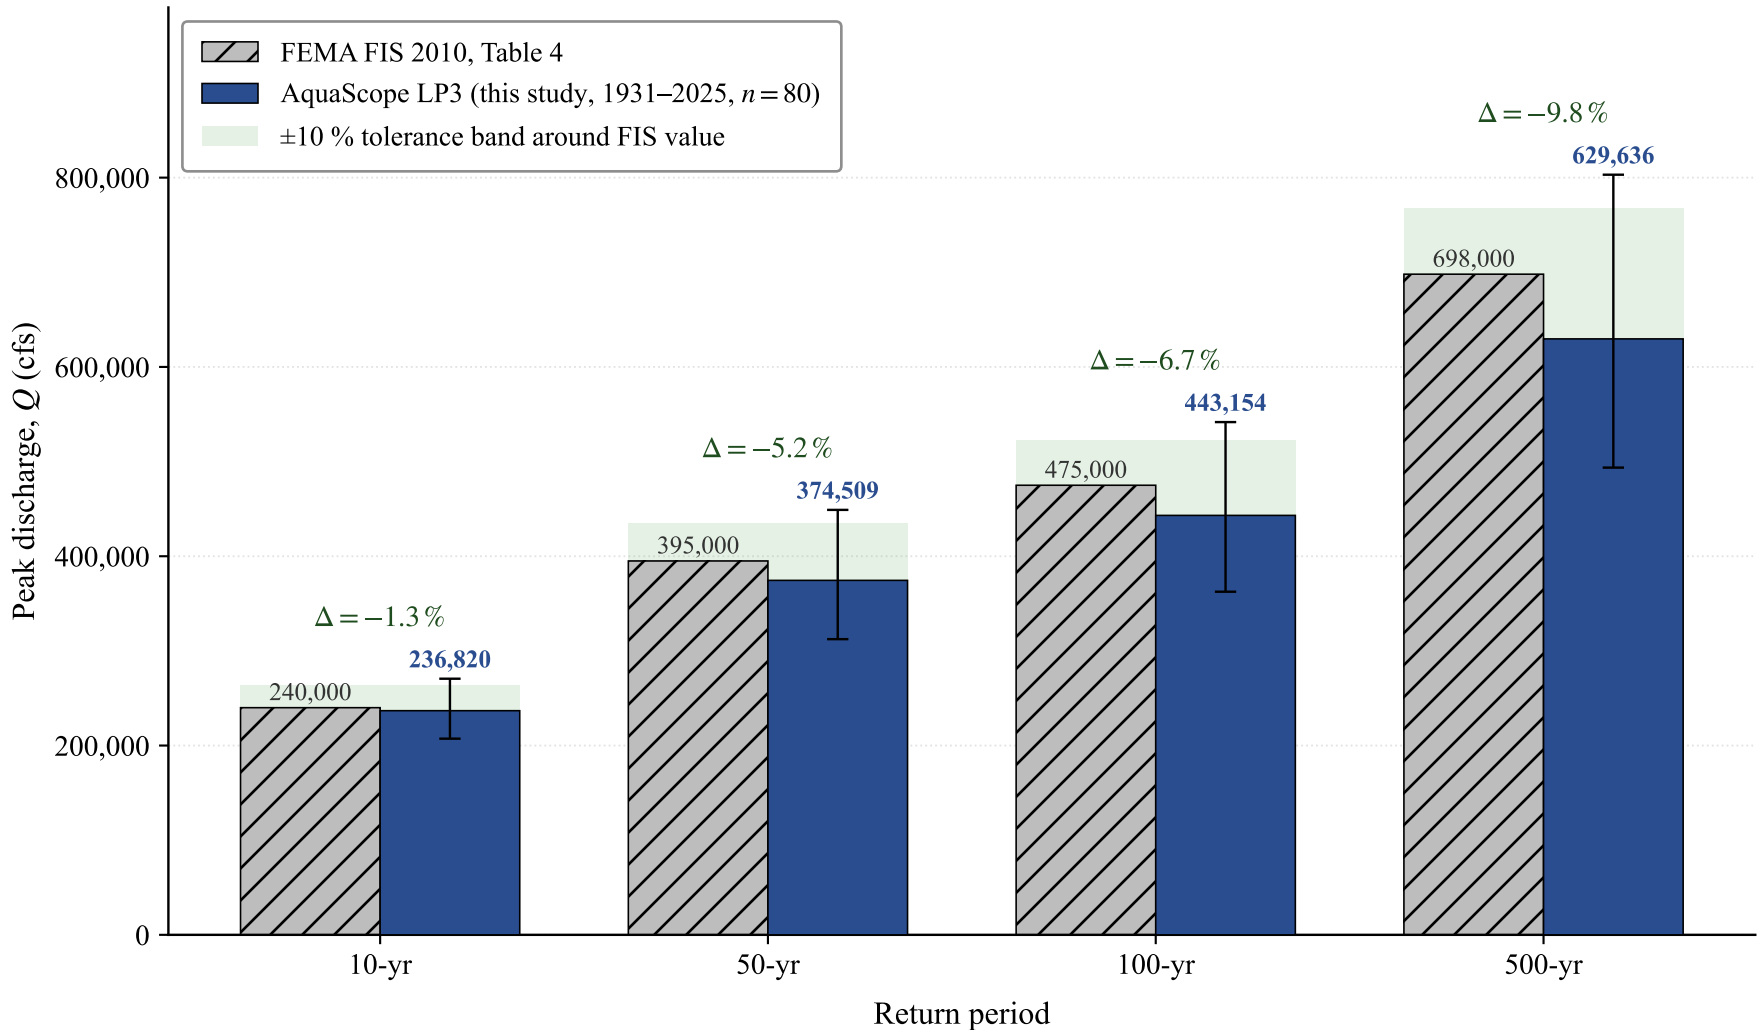

Reference: FEMA Flood Insurance Study, District of Columbia, FIS 110001V000A (2010-09-27), Table 4. All four published return periods agree within $\pm 10\%$.