



**BIDS AND AWARDS COMMITTEE**

April 28, 2025

**NOTICE OF AWARD**  
SUPPLY AND DELIVERY OF SMOKE DETECTOR OF IDS BUILDING  
BAC RESO NO. 2025-121 dated April 10, 2025

**MR. ROBERT EMMANUEL B. AMIJILAR**  
Sales Engineer  
**THE SENTINEL AUTOMATION AND SECURITY SOLUTIONS INC.**  
1089 KAREN AVENUE HEN. T. DE LEON 1442  
CITY OF VALENZUELA NCR, THIRD DISTRICT PHILIPPINES  
Phone No.: 09985512617/09985512618  
Email: [sales.sentinel@outlook.ph](mailto:sales.sentinel@outlook.ph)/[engineering@thesentinelautomation.com](mailto:engineering@thesentinelautomation.com)/  
[sales@thesentinelautomation.com](mailto:sales@thesentinelautomation.com)

Dear **Mr. Amijilar**:

Please be notified that the result of the Negotiated Procurement through *Small Value Procurement* for the **SUPPLY AND DELIVERY OF SMOKE DETECTOR OF IDS BUILDING** under PR No. 25-03-448, is hereby awarded to you as the lowest quotation with a contract amount equivalent to **TWO HUNDRED FORTY-EIGHT THOUSAND EIGHT HUNDRED EIGHTY-EIGHT PESOS AND 89/100 ONLY (Php 248,888.89)**;

Item No.	QTY	UNIT	ITEM / DESCRIPTION	UNIT COST	TOTAL AMOUNT
1.	1	Lot	Complete Supply and Delivery of Labor, Tools, Materials, Equipment, Consumables, Technical Expertise, Supervision for the Additional Smoke Detector, Manual Pull Station, Sounder w/ Strobe Light and Mechanical Bell at Molecular Laboratory Valenzuela Medical Center - IDS BUILDING	248,888.89	248,888.89
			<b>Smoke Detector:</b> Specifications: Voltage Range: 12-30V DC Standby Current: 35µA Alarm Current @24V DC 470Ω: 30mA Ambient Temperature: -10°C~+55°C Material: Fire Proof Plastic Dimensions: 102mmØ x 49mmØ Weight: range to 150-157 grams Color: White		
			<b>Manual Pull Station:</b> Specifications: Model: MS402AP Dimensions: 4.55" H x 3.3" W x 2.1" D Nominal Operating Voltage: 15-32 VDC		

"PHIC Accredited Healthcare Provider"  
"Valenzuela Medical Center...Where your health matters most"



Address: Padrigal St., Karuhatan, Valenzuela City, 1441  
Telephone Nos: 8294-6711 to 17  
Director's Office Direct Line: 8291-4259  
Email Address: [valgen\\_hosp@yahoo.com](mailto:valgen_hosp@yahoo.com)  
Website: <https://vmc.doh.gov.ph/>



Republic of the Philippines  
Department of Health  
Metro Manila Center for Health Development  
**VALENZUELA MEDICAL CENTER**



BACOG PILIPINAS

			Maximum Alarm Current @24V: 5.4mA Average Operating Current @24V: 600µA		
			<b>Fire Alarm Bell:</b> Specifications: Model: AH-0218 Dimensions: ø4" (152mm) x 56mm (H) Voltage: 24V DC Current: 25mA Sound Output: 93dB@1M Movement: Motor, Pinion and Striker Movement Features: DC Motor, acetal gear wheel, steel striker Gong: Steel, secured with philip screw Base Plate: Molded black polycarbonate Material: Steel Plate Weight: About 700-850g		
			<b>Strobe Light with Sounder:</b> Specifications: Model: SYS/HS Operating Temperature: 0-49 degrees celcius Humidity: 10-93% RH, No dew condensation Operating Voltage: 16-33 VDC (normally at 24V) Sound intensity: ≥82dBA. - It is possible to set the display light to high or low, the volume setting for 3 levels of continious and temporary - Automatically synchronize alarm flash light for 30 minutes - Flash mode after 1 seconds		
			<b>General Requirements:</b> 1. Mobilization of Manpower & Tools/Equipment to site.2. Coordinate with Engineering and Facilities Management Section (EFMS) for work schedule.3. Use appropriate wire/cable, conduit, hangers, and support for all roughing ins.4. Installation of Additional Smoke Detectors, Manual Pull Station and Mechanical Bell5. The new devices shall be compatible with the existing Fire Detection and Alarm System.6. Programming, Testing and Commissioning of all newly installed devices. Coordinate with EFMS for name of rooms/area for the addressing of devices.7. The winning contractor must submit the as-built plans for the additional Fire Detection and Alarm Systems upon project completion8. Conduct housekeeping in the area of work.		
			<b>SCOPE OF WORKS:</b> MOLECULAR LABORATORY - IDS BUILDING 1. Installation of Additional Conventional Smoke Detector, Manual Call Point, Sounder w/ Strobe Light and Mechanical Bell. 2. Roughing-in and wiring for additional devices to Fire Alarm Control Panel (FACP) located in the Ground Floor, Pharmacy Stockroom 3. Supply of electrical materials, pvc pipes conduits, connectors, connecting boxes, support system, miscellaneous items, etc.		

"PHIC Accredited Healthcare Provider"  
"Valenzuela Medical Center...Where your health matters most"



Address: Padrigal St., Karuhatan, Valenzuela City, 1441  
Telephone Nos: 8294-6711 to 17  
Director's Office Direct Line: 8291-4259  
Email Address: valgen\_hosp@yahoo.com  
Website: <https://vmc.doh.gov.ph/>



Republic of the Philippines  
Department of Health  
Metro Manila Center for Health Development  
**VALENZUELA MEDICAL CENTER**




BAGONG PILIPINAS

			4. Wiring for the additional Smoke Detectors, Manual Call Point, Sounder with Strobe Light and Mechanical Bell.		
			5. Programming, Testing and Commissioning.		
			<b>Delivery Period:</b> 90 Calendar Days upon receive of JO and payment		
			<b>Warranty:</b> six (6) Months on Supplies and Labor		
			<b>Brand:</b> Horing Lih		
			***** nothing follows *****		
				<b>TOTAL:</b>	<b>248,888.89</b>

The Valenzuela Medical Center reserves the right to withdraw / terminate this Notice of Award in view of non-delivery on the time specified, delivery of items of poor quality / substandard and any other violation of the terms and conditions provided in the Notice of Award.

Approved by:

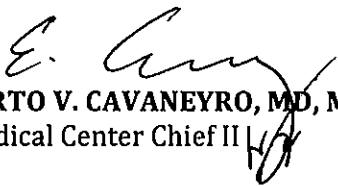

APR 29 2025


**EDILBERTO V. CAVANEYRO, MD, MHA, FPCS, FPSGS**  
OIC - Medical Center Chief II

Conformed:

Authorized Representative  
**THE SENTINEL AUTOMATION AND SECURITY SOLUTIONS INC.**  
Company

Date: \_\_\_\_\_

/ D.P.

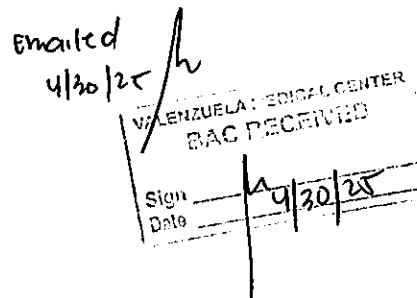

"PHIC Accredited Healthcare Provider"  
"Valenzuela Medical Center...Where your health matters most"



Address: Padrigal St., Karuhatan, Valenzuela City, 1441  
Telephone Nos: 8294-6711 to 17  
Director's Office Direct Line: 8291-4259  
Email Address: valgen\_hosp@yahoo.com  
Website: <https://vmc.doh.gov.ph/>