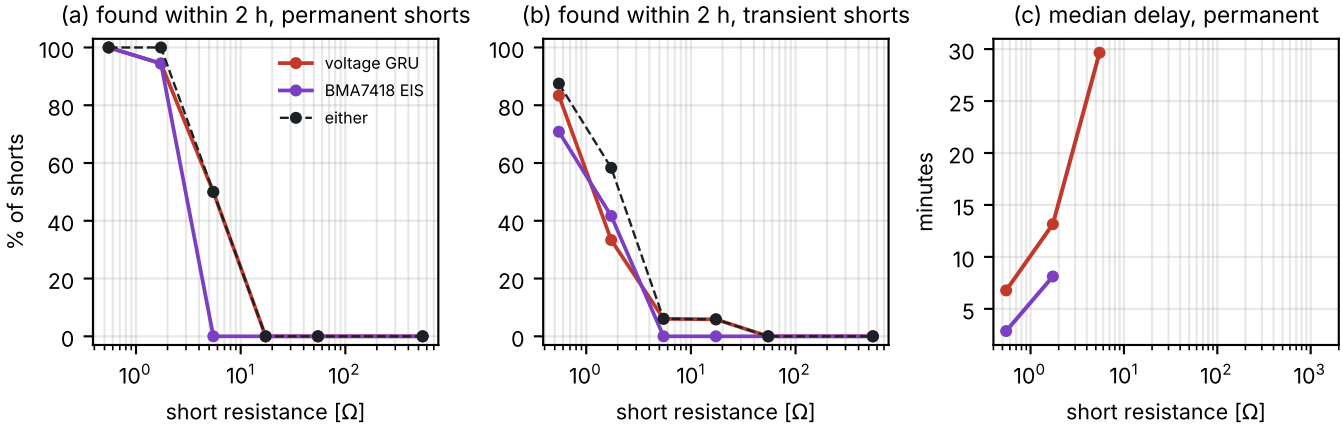
Same 512 test scenarios. False alarms per module-hour: GRU 0.016, EIS 0.006
(a) found within 2 h, permanent shorts
(b) found within 2 h, transient shorts
(c) median delay, permanent
voltage GRU
BMA7418 EIS
either
% of shorts
minutes
short resistance [Ω]
short resistance [Ω]
short resistance [Ω]