Dominion Energy Virginia reliability: what public data shows, and where I’d look first

Independent analysis of public data

Print test · design system v0

Outage minutes rose 17% from 2023 to 2025, and most of the rise came from more frequent interruptions

144.4


SAIDI ex-MED 2025, minutes


1.32

SAIFI ex-MED 2025, interruptions

109.4

CAIDI ex-MED 2025, minutes

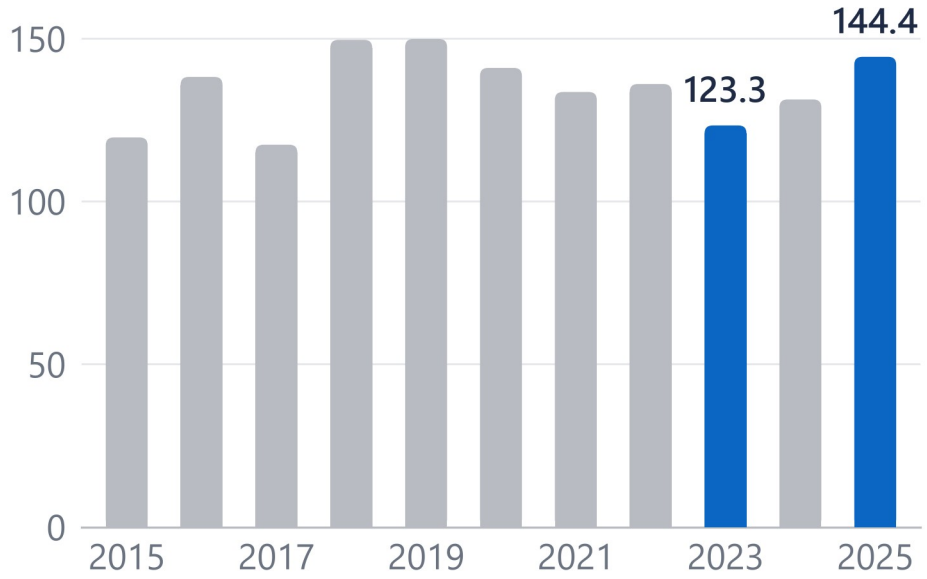

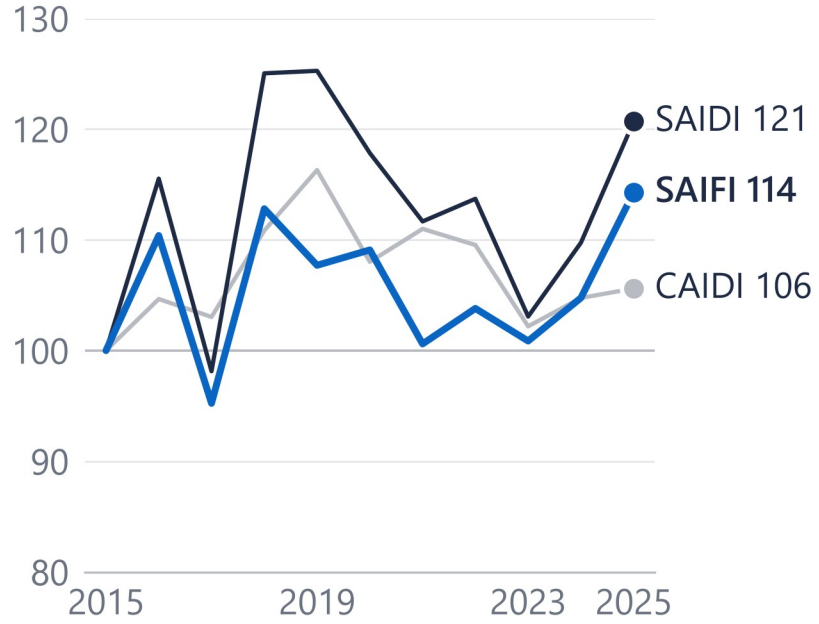

For Dominion: the first place to look is what drives interruption frequency on the worst circuits.

Source: EIA-861 (2025 final) and PUDL 2015–2024, Dominion Energy Virginia, ex-MED. Table data/output/storm_vs_saidi.csv. Body 16 pt, labels 13.5 pt (12 and 10.1 pt printed).