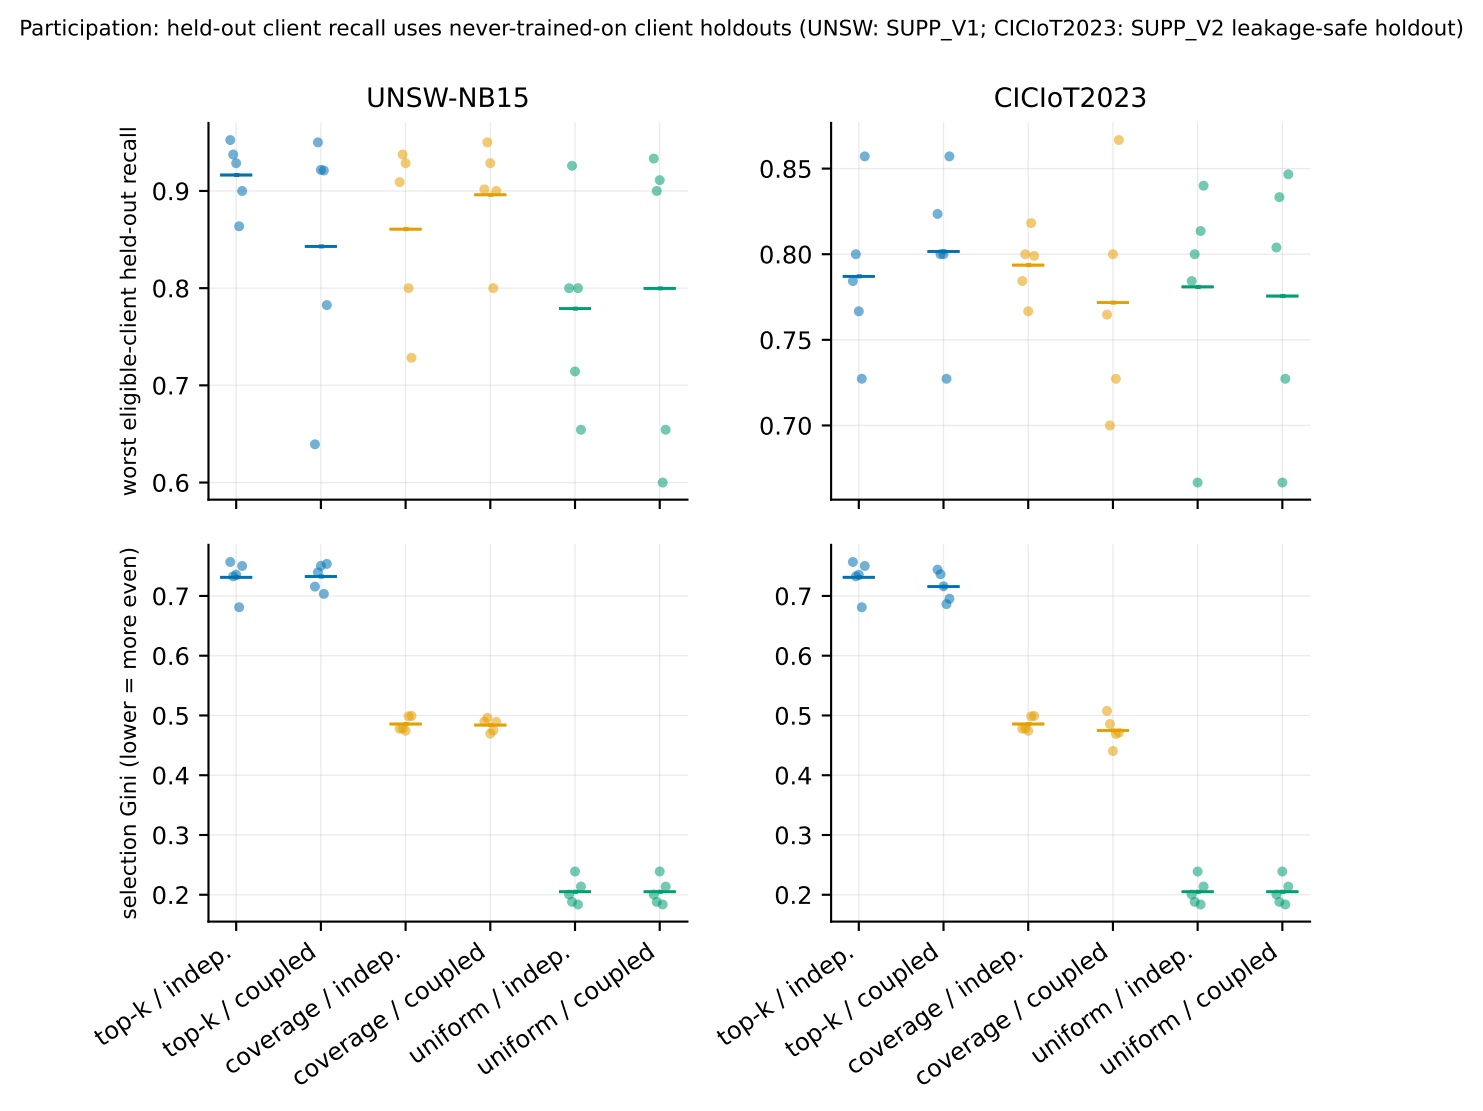
Participation: held-out client recall uses never-trained-on client holdouts (UNSW: SUPP_V1; CICIoT2023: SUPP_V2 leakage-safe holdout)
UNSW-NB15
CICIoT2023
worst eligible-client held-out recall
selection Gini (lower = more even)
0.9
0.8
0.7
0.6
0.85
0.80
0.75
0.70
0.5
0.4
0.3
0.2
top-k / indep.
top-k / coupled
coverage / indep.
coverage / coupled
uniform / indep.
uniform / coupled