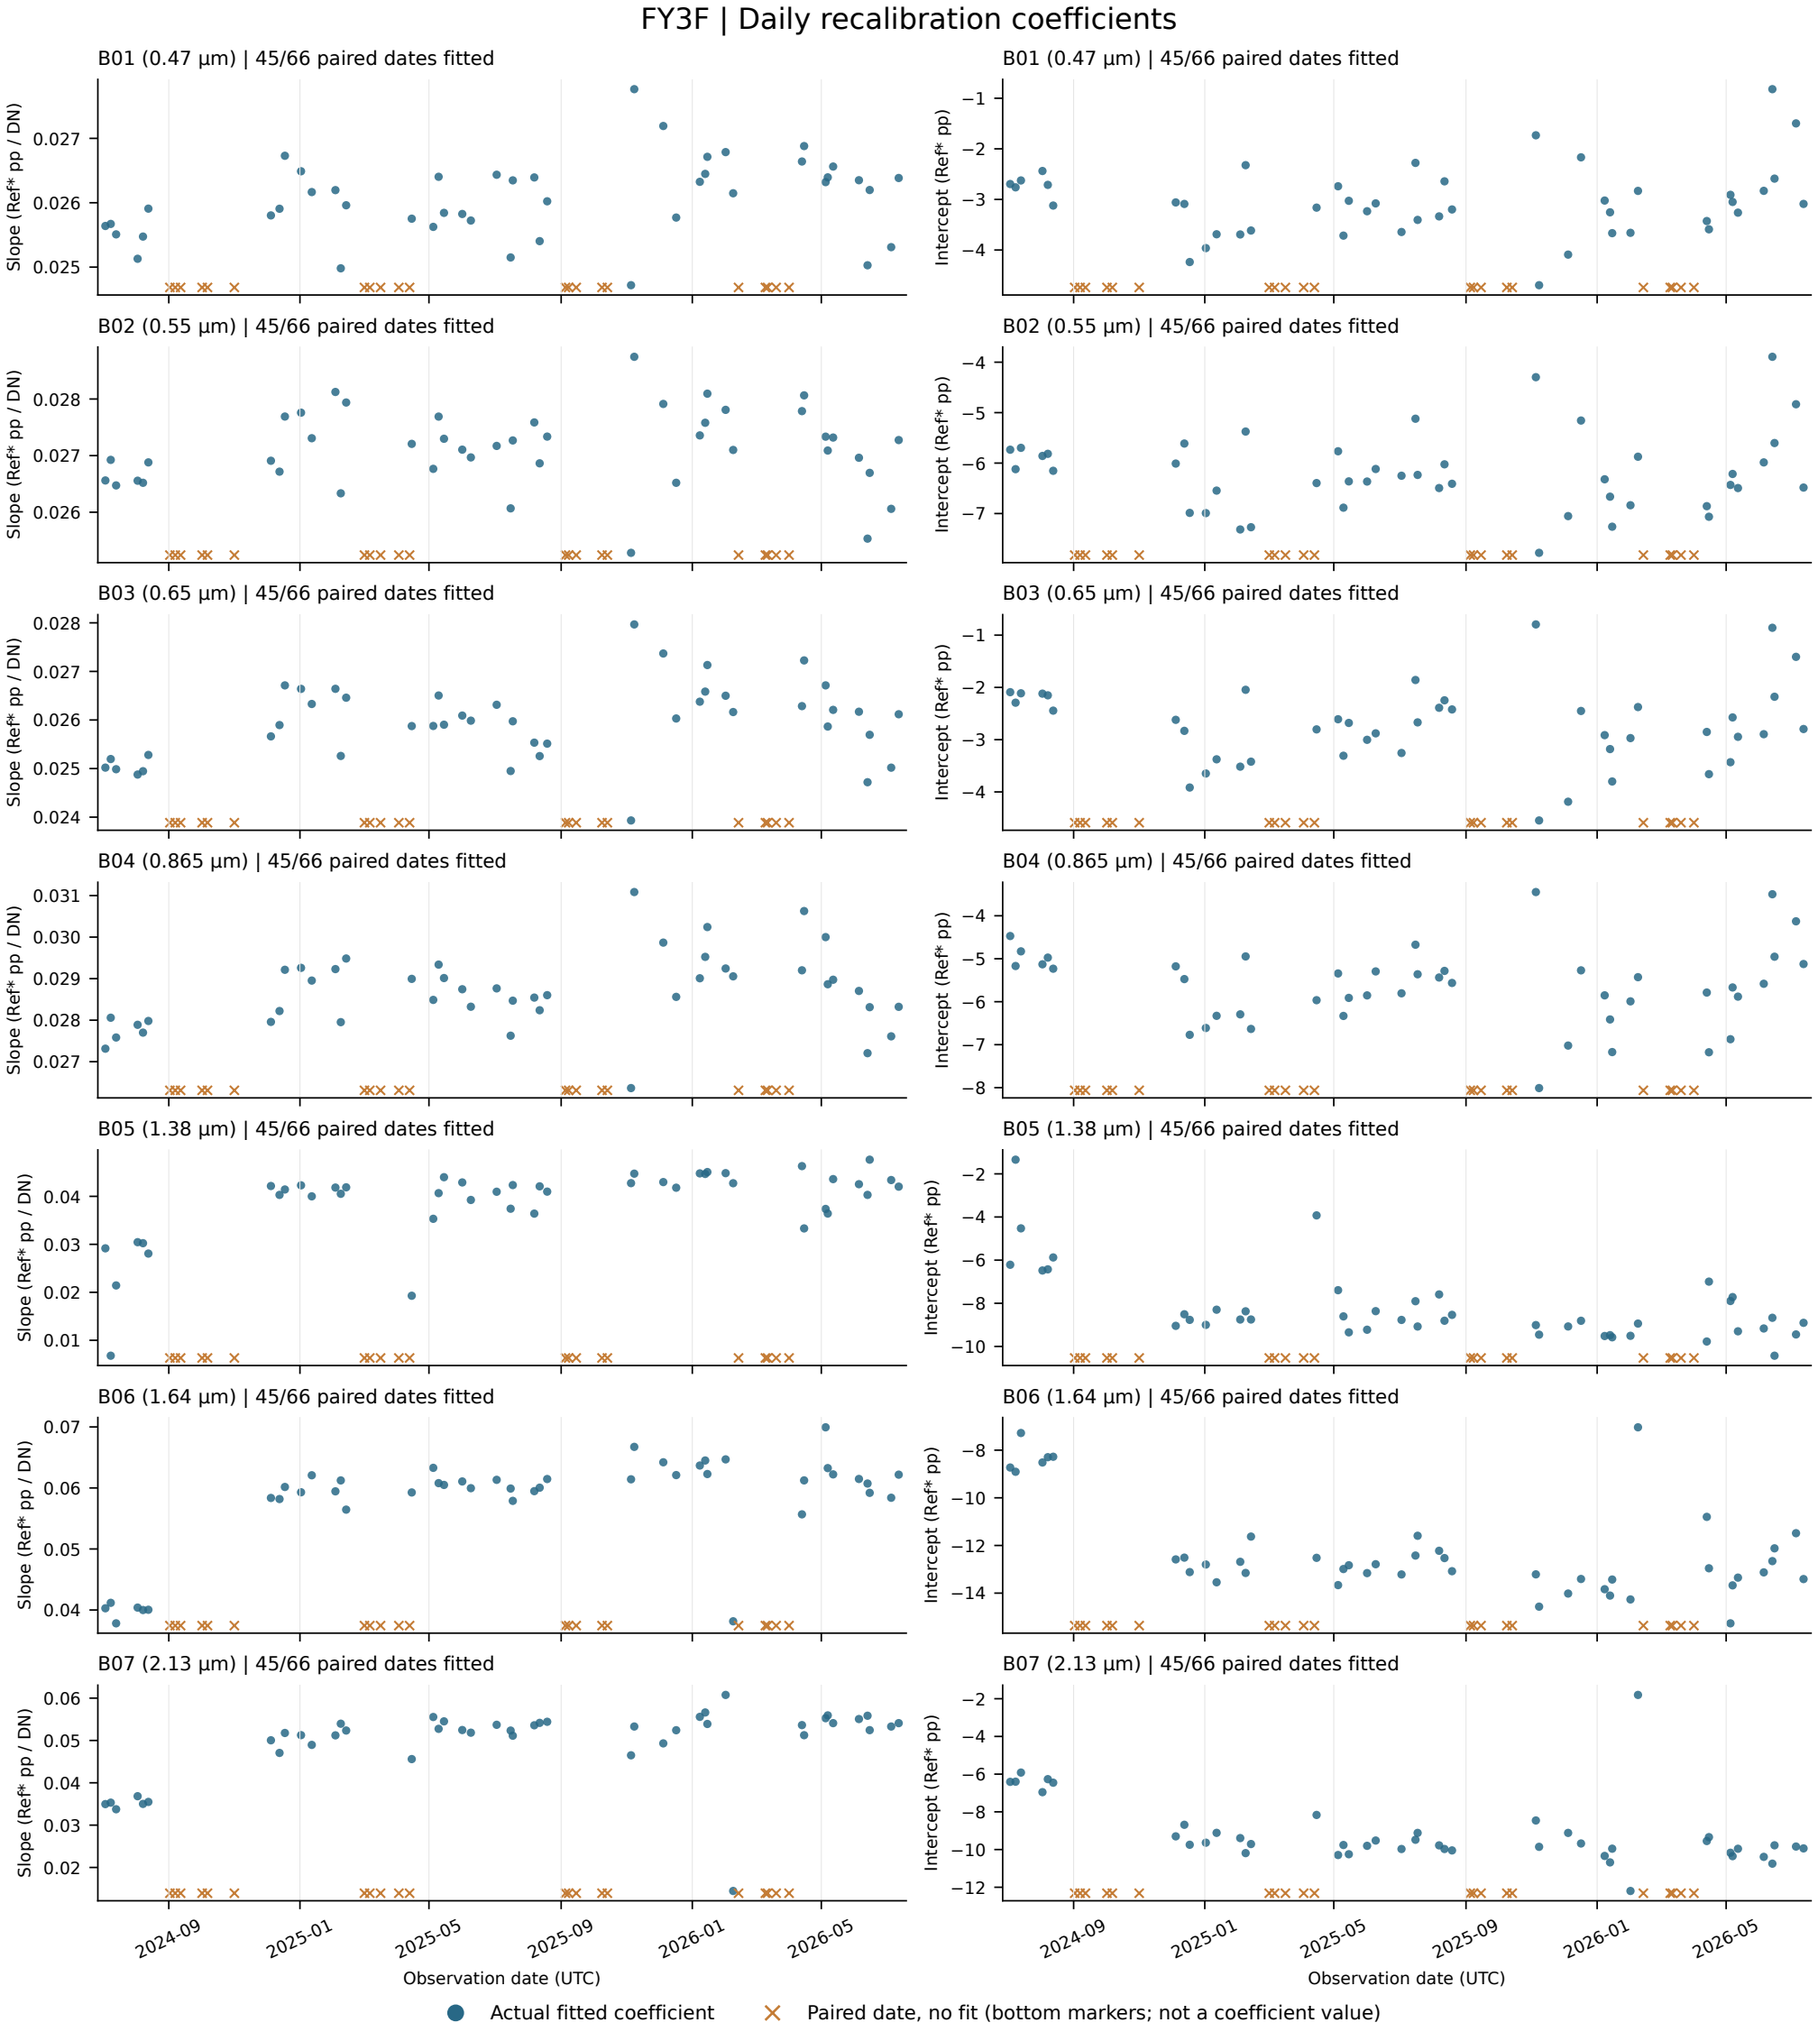
FY3F | Daily recalibration coefficients
B01 (0.47 µm) | 45/66 paired dates fitted
B01 (0.47 µm) | 45/66 paired dates fitted
B02 (0.55 µm) | 45/66 paired dates fitted
B02 (0.55 µm) | 45/66 paired dates fitted
B03 (0.65 µm) | 45/66 paired dates fitted
B03 (0.65 µm) | 45/66 paired dates fitted
B04 (0.865 µm) | 45/66 paired dates fitted
B04 (0.865 µm) | 45/66 paired dates fitted
B05 (1.38 µm) | 45/66 paired dates fitted
B05 (1.38 µm) | 45/66 paired dates fitted
B06 (1.64 µm) | 45/66 paired dates fitted
B06 (1.64 µm) | 45/66 paired dates fitted
B07 (2.13 µm) | 45/66 paired dates fitted
B07 (2.13 µm) | 45/66 paired dates fitted
Slope (Ref* pp / DN)
Intercept (Ref* pp)
2024-09
2025-01
2025-05
2025-09
2026-01
2026-05
Observation date (UTC)
Actual fitted coefficient
Paired date, no fit (bottom markers; not a coefficient value)