
The Dutch grid in 2035 (v29-2035-amir)

The 2026 grid (v29) plus the Dutch IP2026 projects commissioned by 2035: TenneT's rule (projects in realisation) and Amir's rule (also those in preparation). Stripes mark what changes; dotted stripes = Amir's rule only.

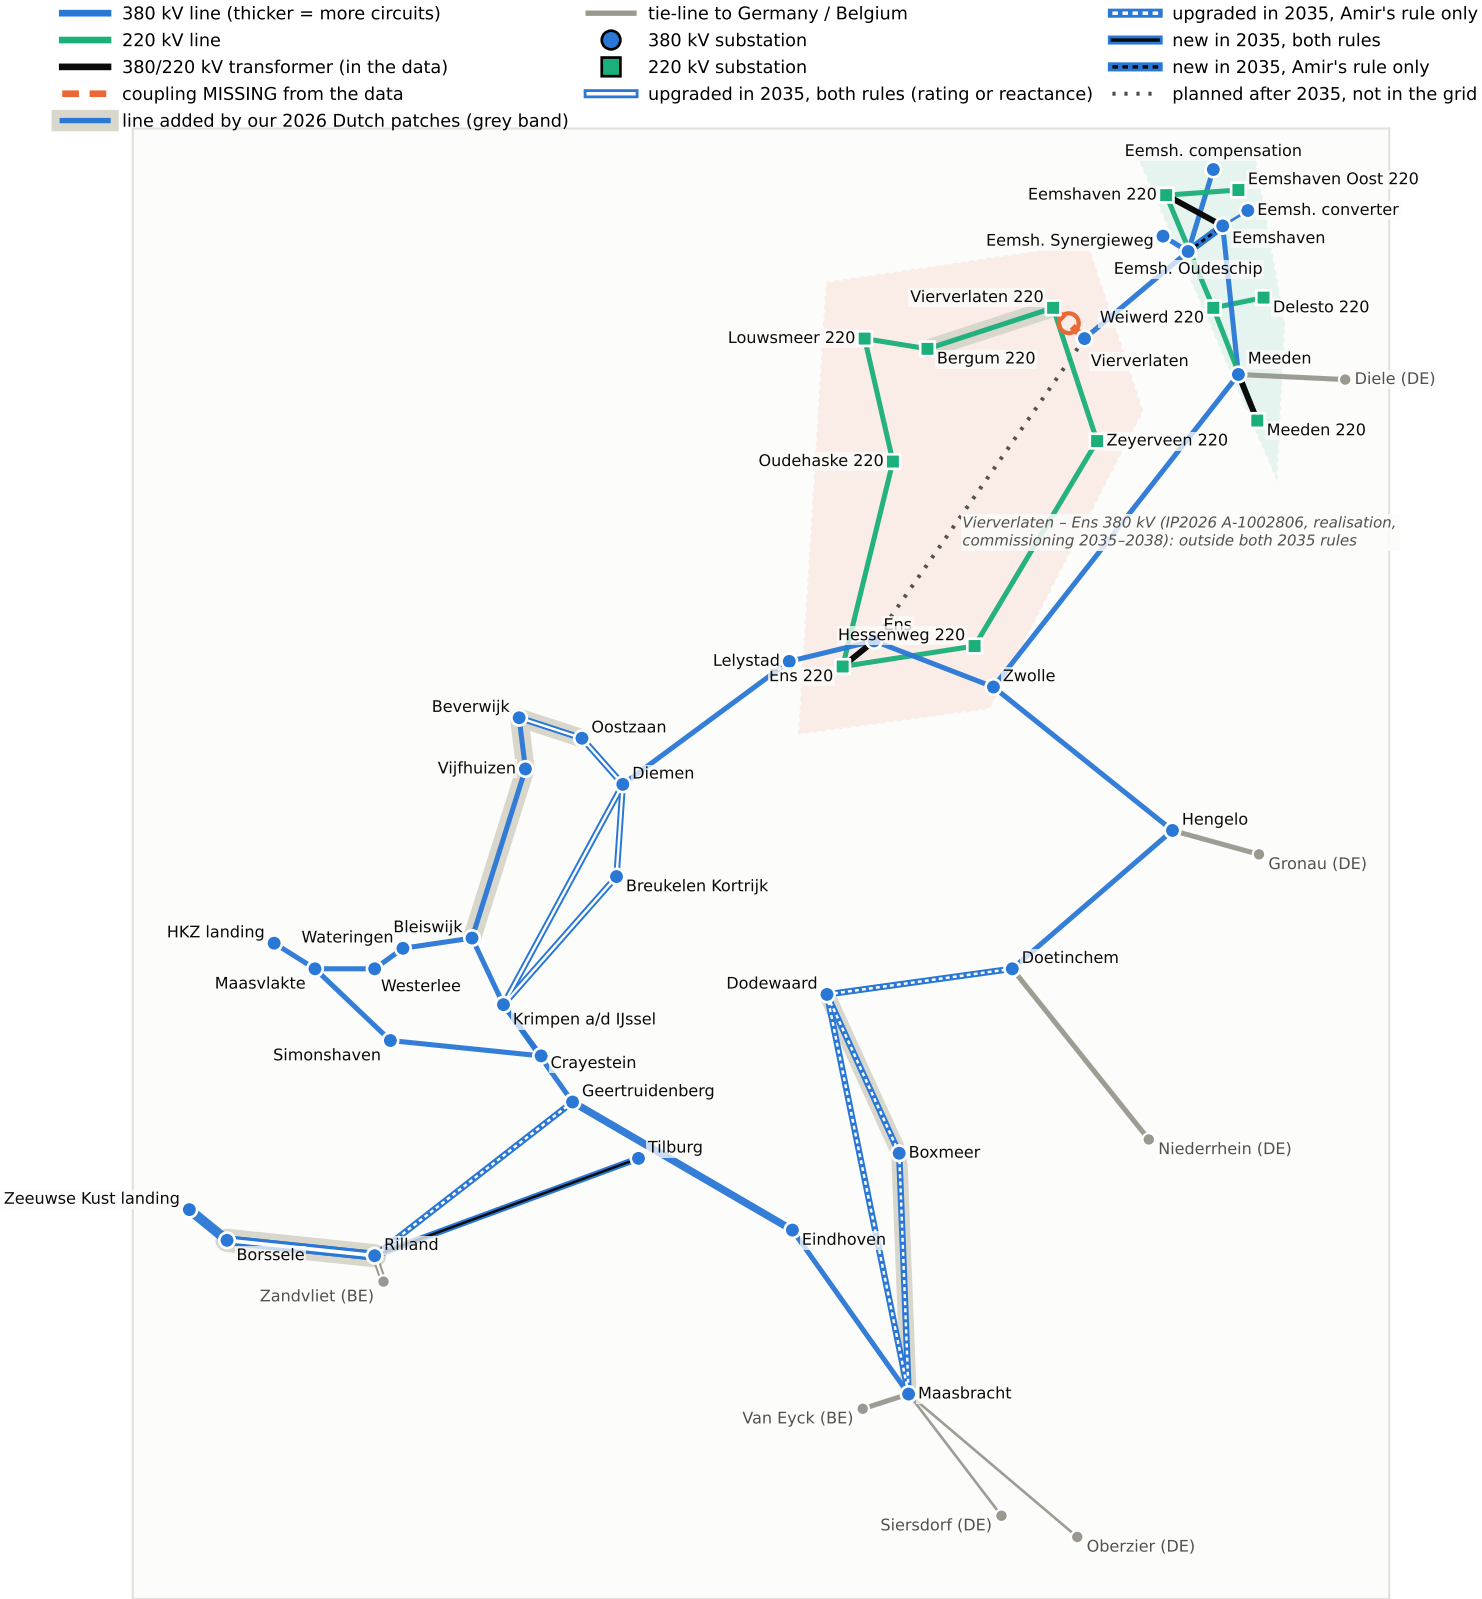


What changes against the 2026 grid

- Upgraded under both rules (higher rating, or lower reactance on Borssele – Rilland): Beverwijk – Oostzaan (2 circuits); Borssele – Rilland (2 circuits); Breukelen Kortrijk – Diemen; Breukelen Kortrijk – Krimpen a/d IJssel; Diemen – Krimpen a/d IJssel; Diemen – Oostzaan (2 circuits); Rilland – Zandvliet (2 circuits).
- New under both rules: the Tilburg 380 kV station on Rilland – Tilburg (2 circuits) (a spur from Rilland).
- Only under Amir's rule: upgrades of Boxmeer – Dodewaard; Boxmeer – Maasbracht; Dodewaard – Doetinchem (2 circuits); Dodewaard – Maasbracht; Geertruidenberg – Rilland (2 circuits); new Eemsh. Oudeschip – Eemshaven.
- The topology barely changes (one spur, one extra short circuit), so the country-level network is identical to 2026 to four decimals; the projects add capacity INSIDE the Netherlands, which only the nodal model can show.
- Still missing in 2035, as in 2026: the Vierverlaten 380/220 kV transformers (orange). The new Vierverlaten – Ens 380 kV line (dotted grey, IP2026 A-1002806, realisation phase, commissioning 2035–2038) falls just outside both rules (window ends 2038). The 220 kV ring reinforcements are outside too.

The north in 2035

The 380/220 kV picture of 2026 is unchanged in the 2035 grids. What IP2026 plans here mostly comes after 2035.

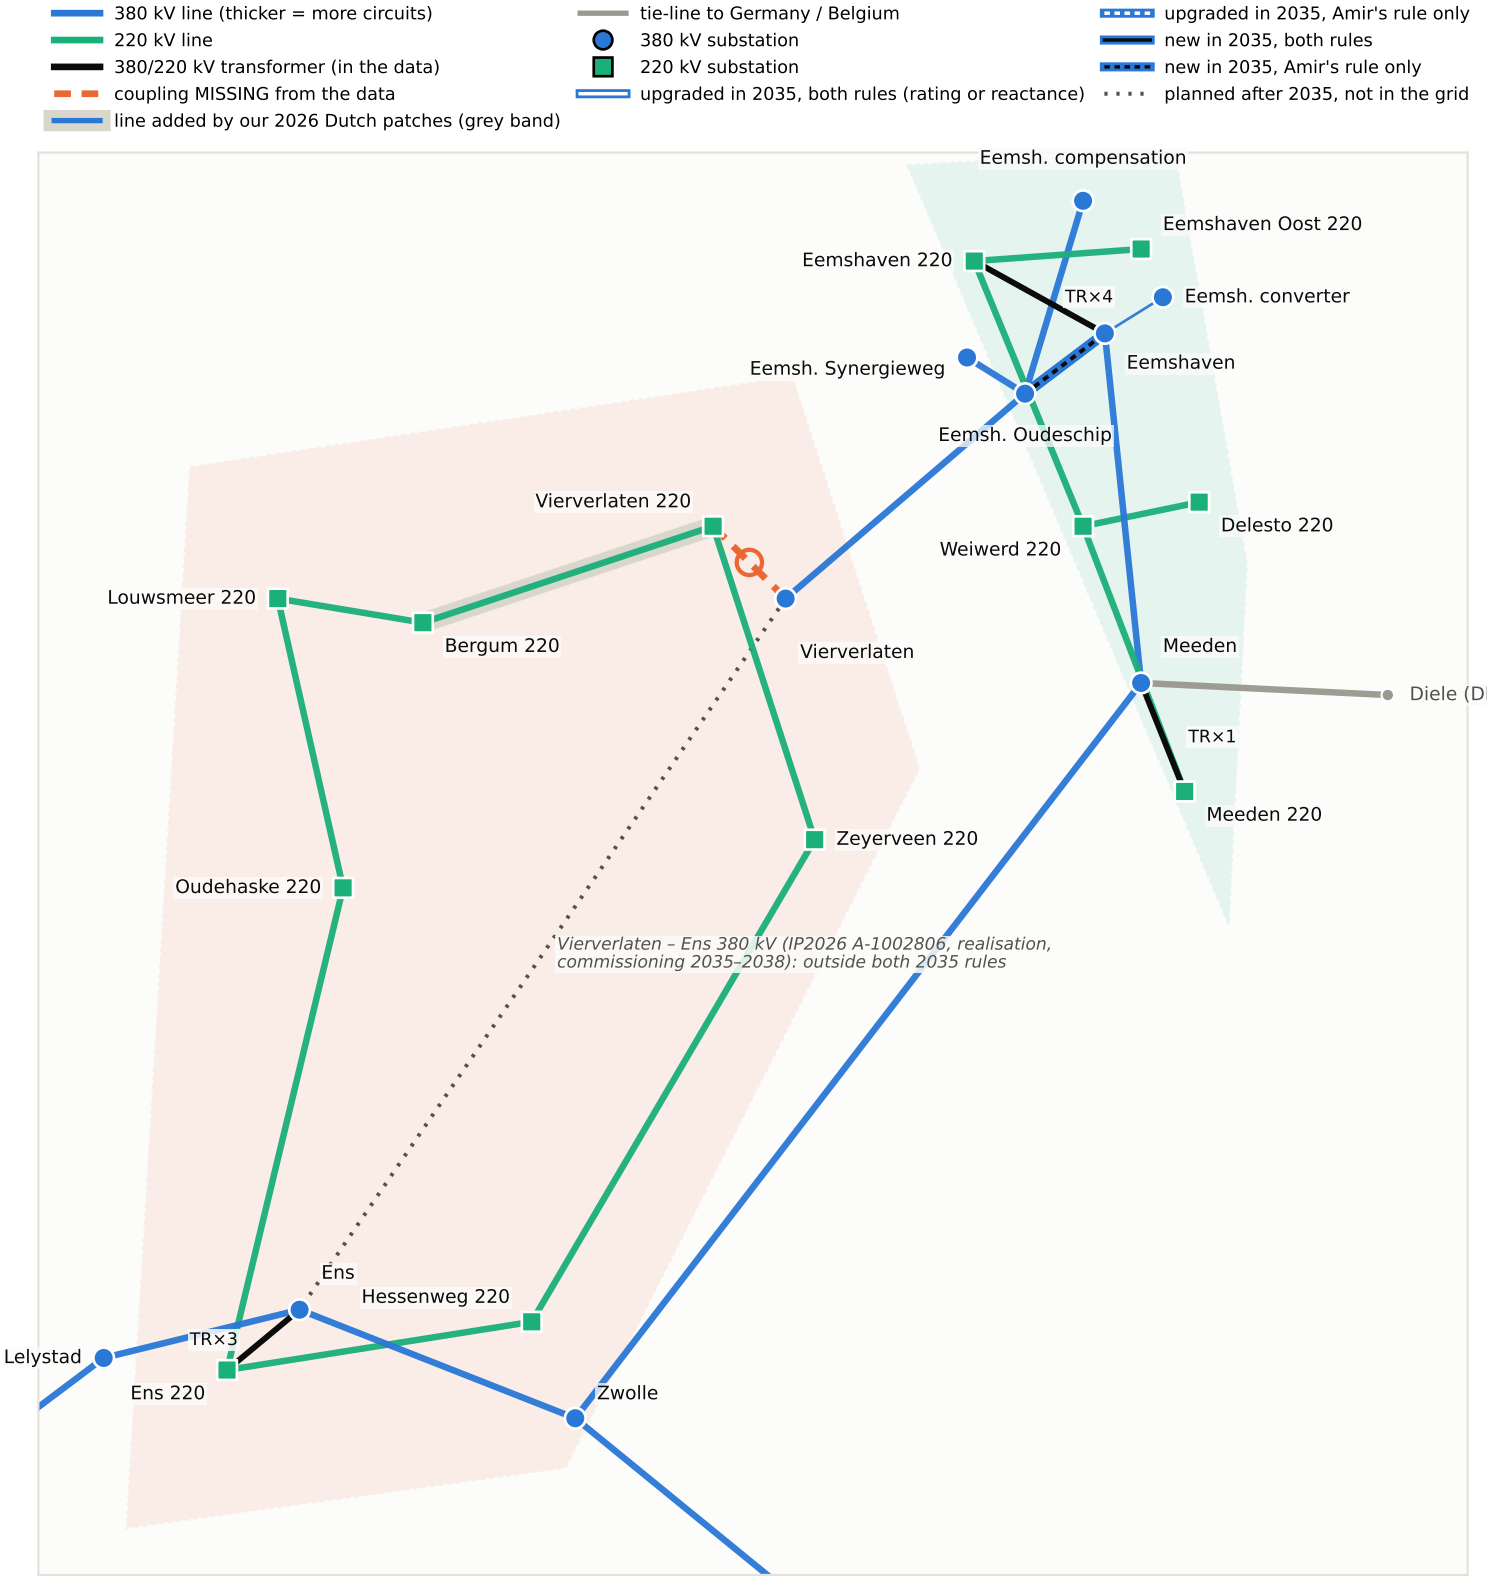

What IP2026 says about the north

- Vierverlaten 380/220 kV: the transformer exists (IP2026 bottleneck 1578 "Vierverlaten 380/220 kV-transformatoren"; asset register: "VVL TR426", fails the n-2 and n-1 criteria by 2035), but no file gives its rating, reactance or number of units, so it is still not in the model.
- TenneT's solution is the new Vierverlaten – Ens 380 kV line (A-1002806, 2035–2038, dotted grey): a second 380 kV route from Groningen to Ens, parallel to Meeden – Zwolle – Ens. Inside a 2040 grid (or as a 2035 sensitivity) it would change the northern flows far more than any project inside the 2035 grids.
- Zwolle 380 kV and Hessenweg 220 kV share a site but are NOT coupled (confirmed by the user, 2026-10-19), so the ring couples to 380 kV at Ens and, once added, Vierverlaten only.
- Amir's rule adds a third Eemshaven Oudeschip – Eemshaven circuit (dotted black stripe) inside the Groningen piece; it changes nothing outside it.