Separating requested dose from available substrate

Performed native extension: fixed physical width 3; unchanged basals, kinetics and input channel.

Eight peak levels per size; WP pulse 240, Goryachev pulse 1600; then 10000 cue-free native units.

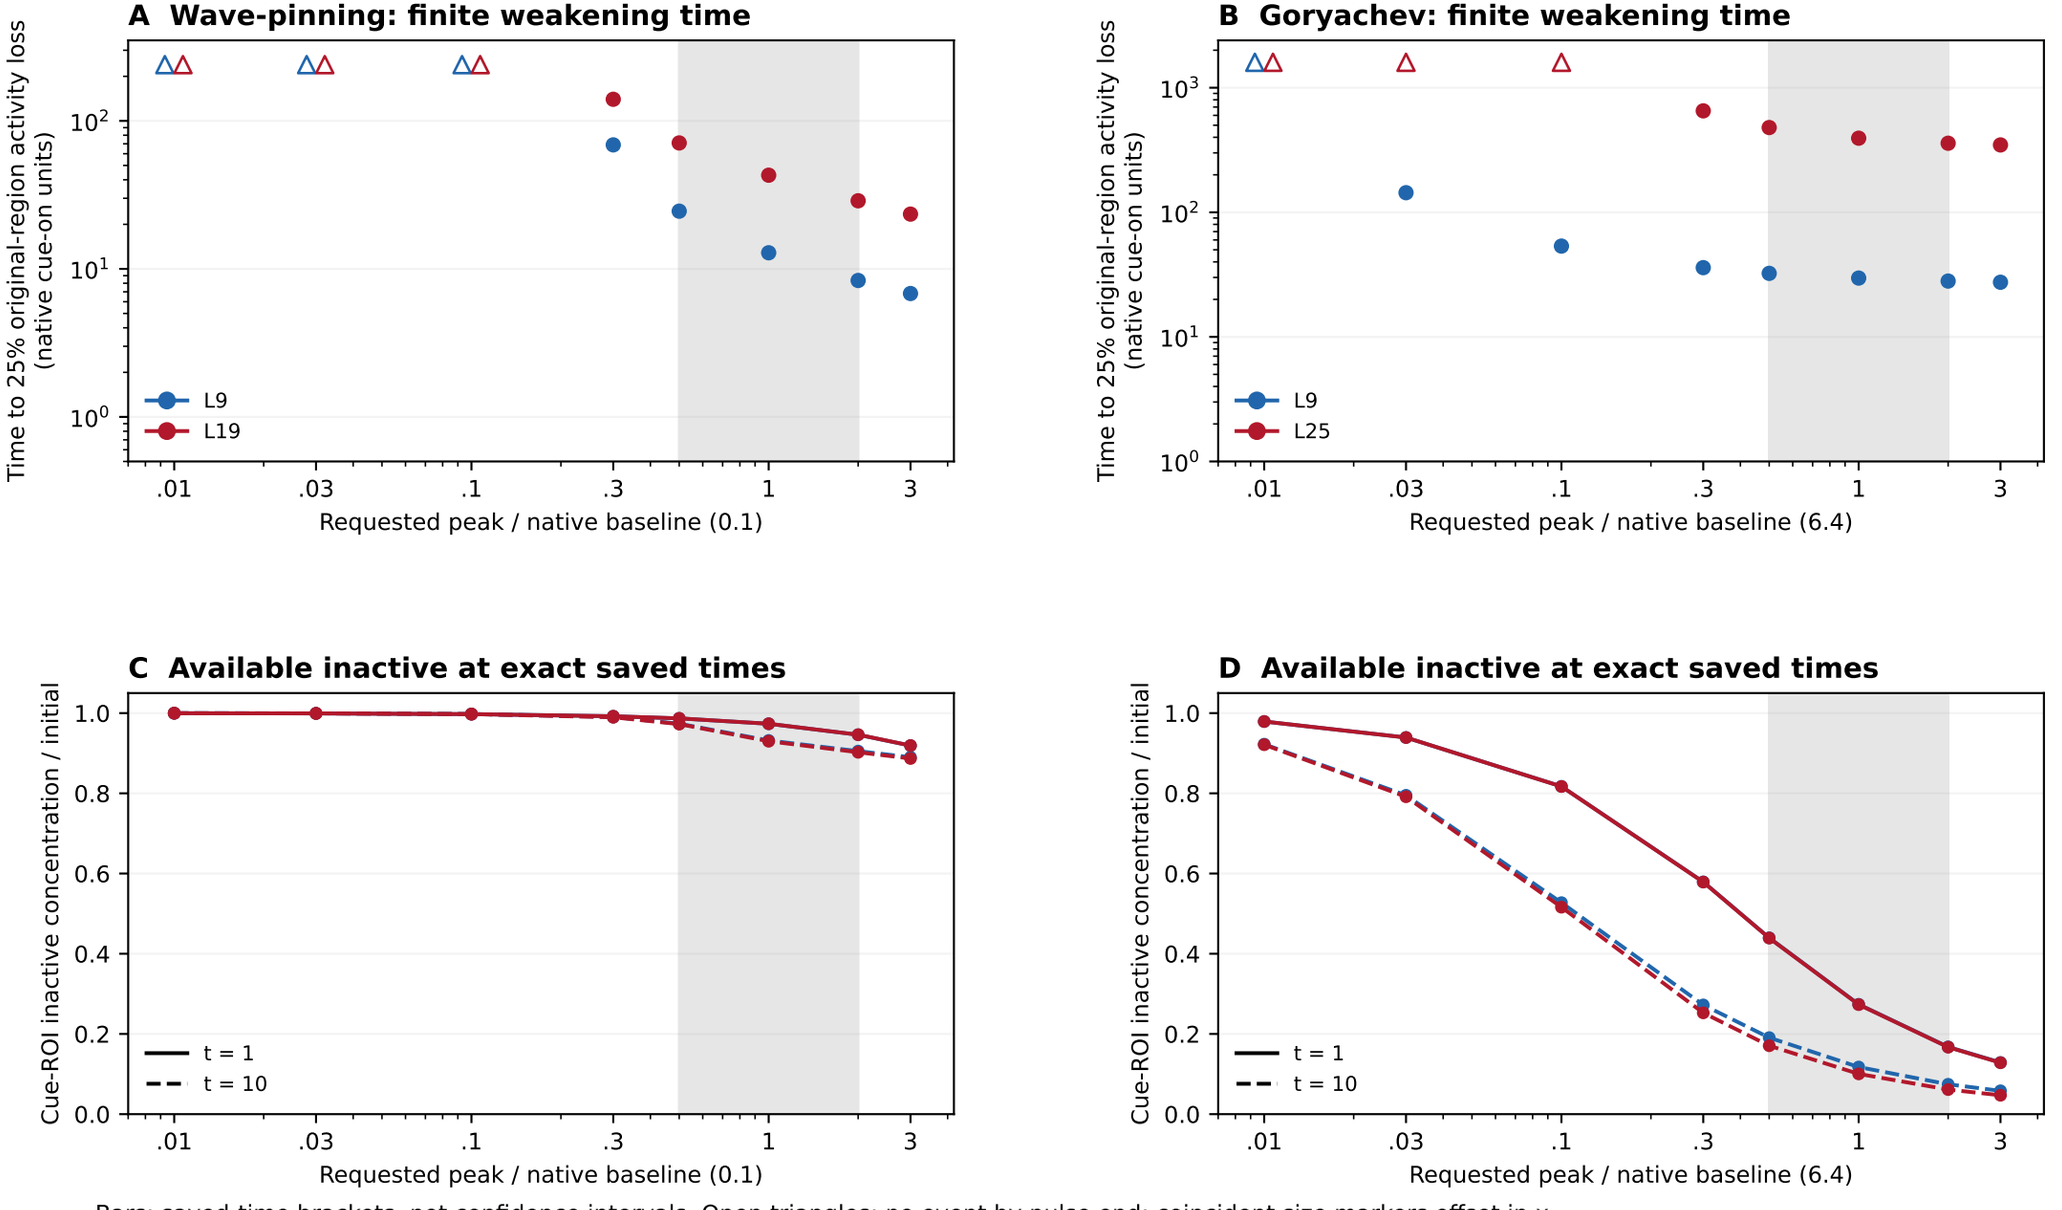

Bars: saved-time brackets, not confidence intervals. Open triangles: no event by pulse end; coincident size markers offset in x.

Grey band: prior 0.5–2 peak range. Exact inactive endpoint samples are observations; legacy channel integrals remain cadence-unqualified.

Native stimulus × inactive; fractional peak matching does not match effective actuation. N = 201; no optical-clock, actuator or spatial-convergence claim.