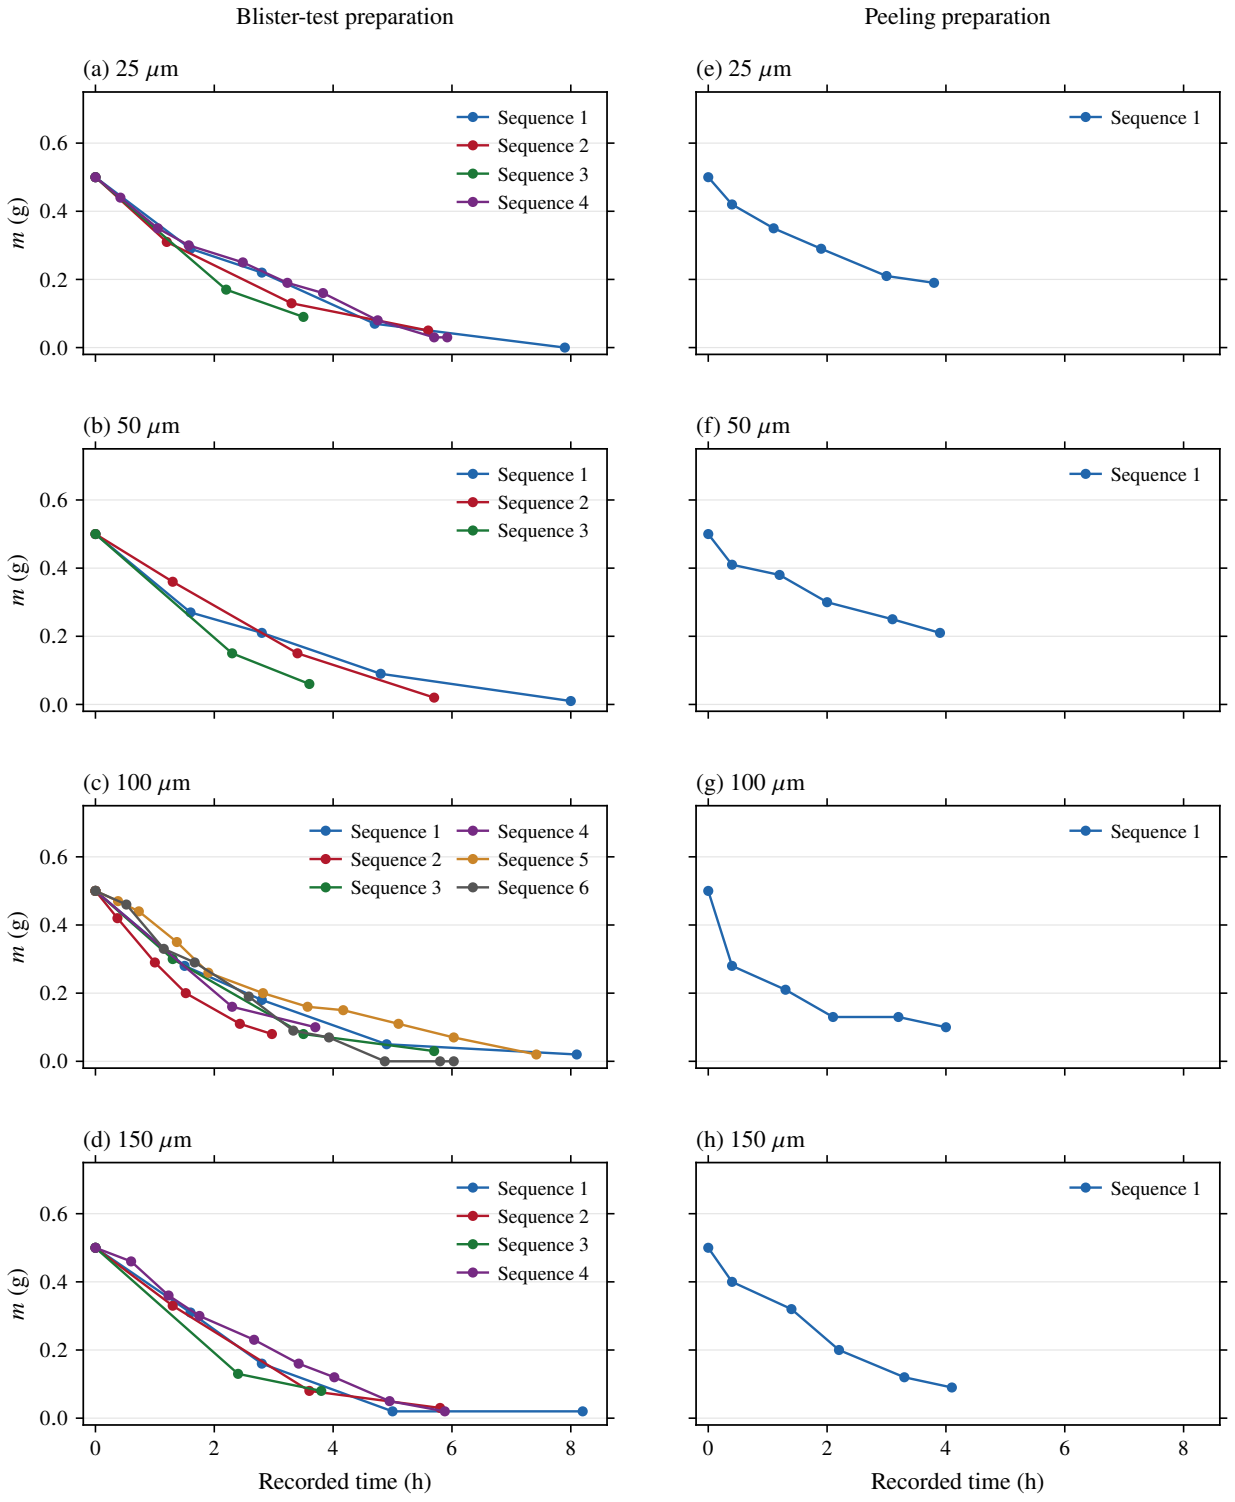

Blister-test preparation
Peeling preparation
(a) 25 μm
(b) 50 μm
(c) 100 μm
(d) 150 μm
(e) 25 μm
(f) 50 μm
(g) 100 μm
(h) 150 μm
m (g)
Recorded time (h)
Sequence 1
Sequence 2
Sequence 3
Sequence 4
Sequence 5
Sequence 6