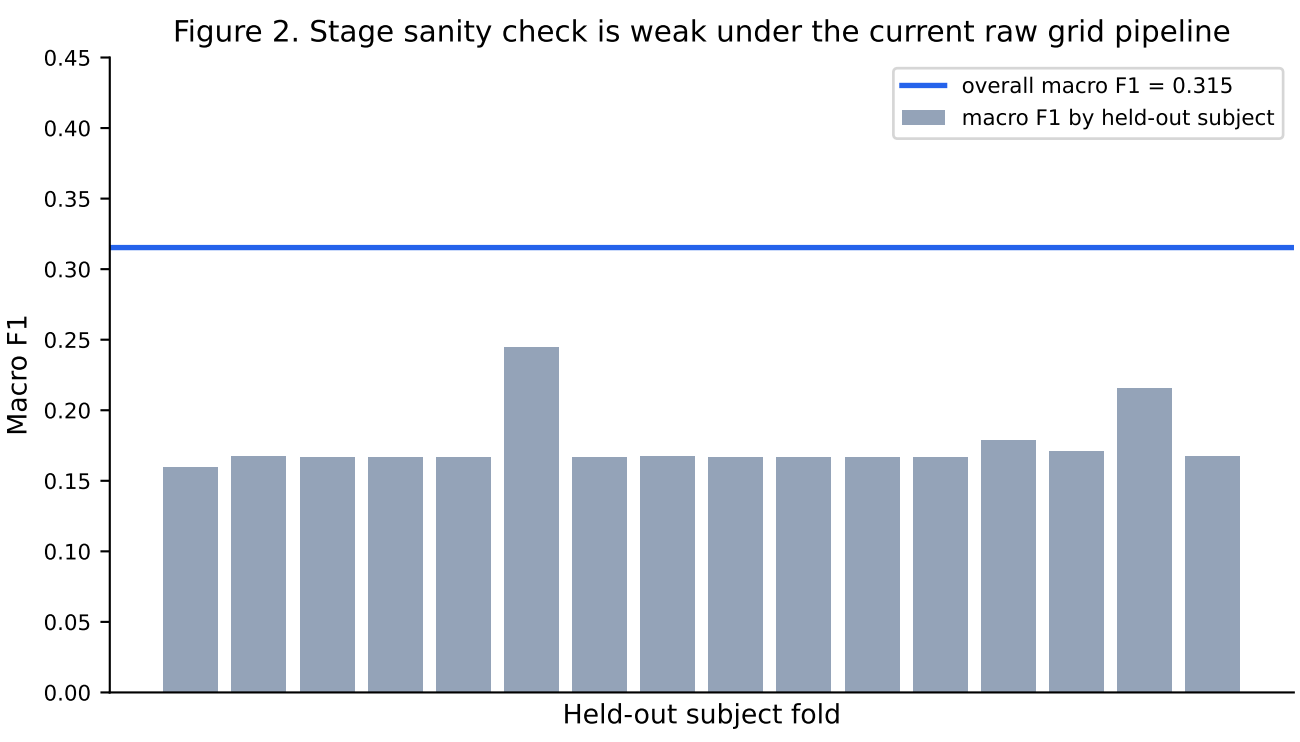
Figure 2. Stage sanity check is weak under the current raw grid pipeline
overall macro F1 = 0.315
macro F1 by held-out subject
Macro F1
0.45
0.40
0.35
0.30
0.25
0.20
0.15
0.10
0.05
0.00
Held-out subject fold