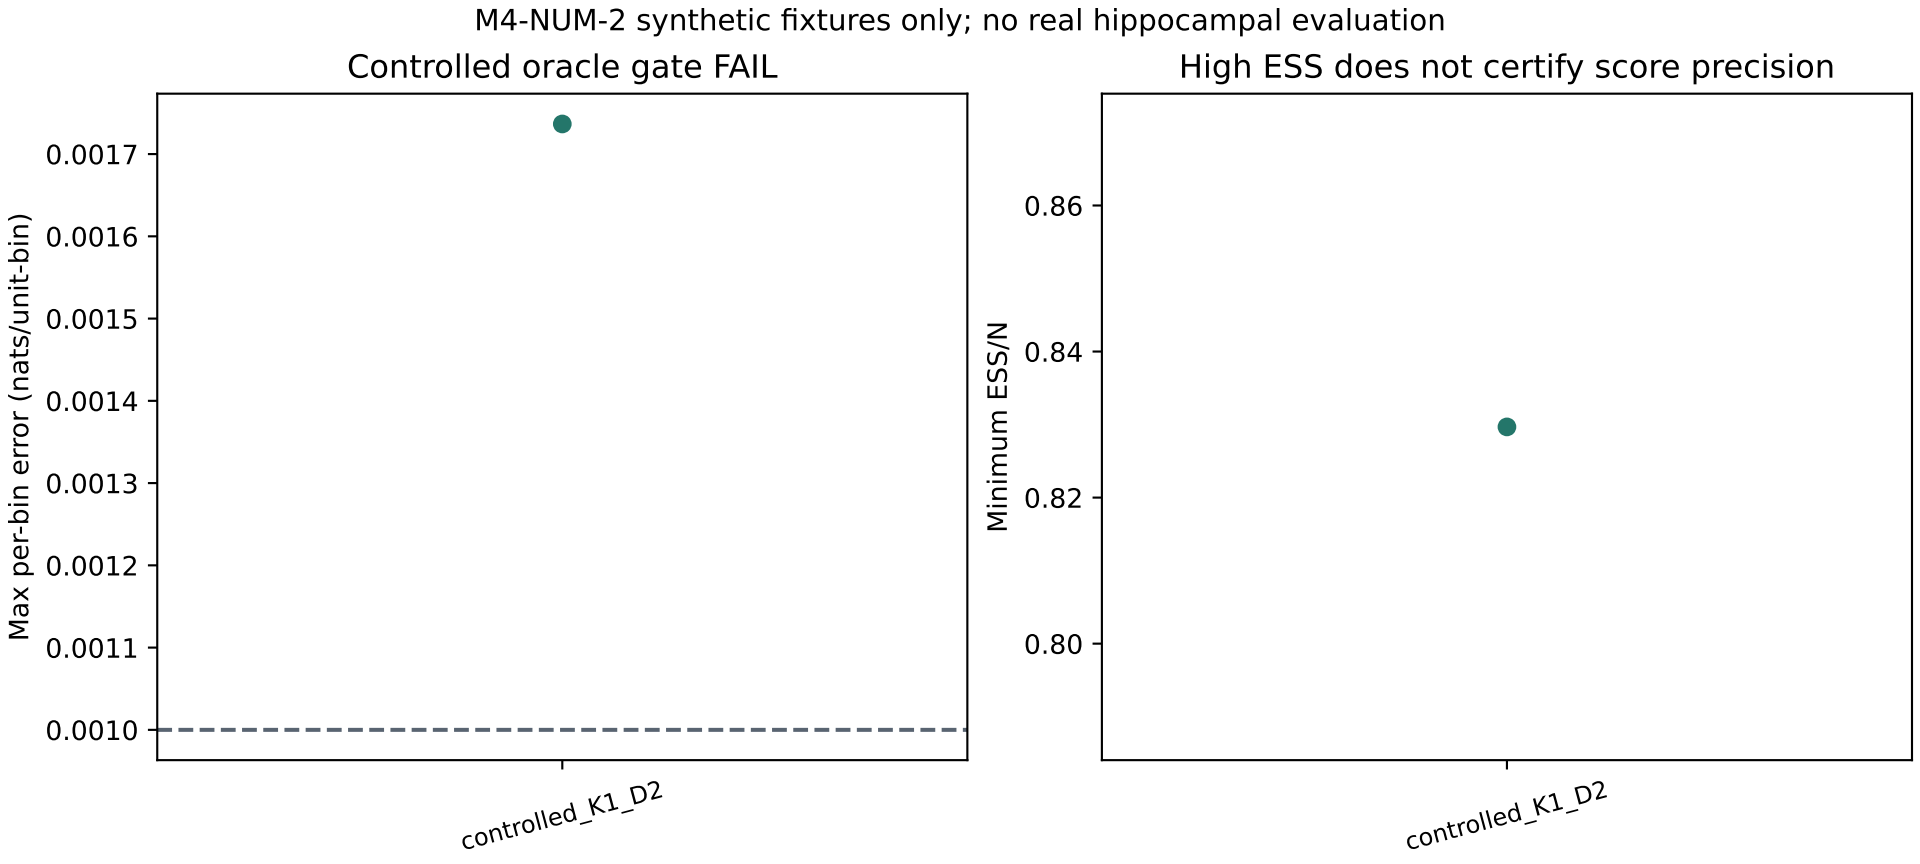
M4-NUM-2 synthetic fixtures only; no real hippocampal evaluation
Controlled oracle gate FAIL
Max per-bin error (nats/unit-bin)
0.0017
0.0016
0.0015
0.0014
0.0013
0.0012
0.0011
0.0010
controlled_K1_D2
High ESS does not certify score precision
Minimum ESS/N
0.86
0.84
0.82
0.80
controlled_K1_D2