



LISTING INFORMATION OF

# **Eurocon - Alubond USA - FR-A2 Aluminium Composite Panel**

SPEC ID: 89375

Eurocon Building Industries FZE  
P.O. Box 49990, Plot 2E-03, 2E-08  
Hamriyah Free Zone  
Sharjah  
United Arab Emirates

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

LISTING INFORMATION

PRODUCT DESCRIPTION

The Eurocon Alubond USA – FR-A2 is a 4 mm thick aluminum composite panel (ACP), consisting of a 3.1 mm thick mineral-filled fire-resistant core bonded between two 0.5 mm thick aluminum skins. The exposed face is finished with a polyvinylidene fluoride (PVDF) coating, and the rear surface is finished with a protective service coat.

FIRE RATING

| Test Standard | Rating                         | Design Number |
|---------------|--------------------------------|---------------|
| CAN/ULC-S134  | Meets Conditions of Acceptance | EBI/CWP 25-01 |

Refer to Design Listing for further information.

| Attribute                                | Value                          |
|------------------------------------------|--------------------------------|
| Certificate Date of Expiry               | December 31, 2026              |
| Certificate Date of Initial Registration | June 05, 2026                  |
| Certificate Number                       | WHI26-26553703                 |
| Criteria                                 | CAN / ULC S134 (2013) (R2018)  |
| CSI Code                                 | 07 42 43 Composite Wall Panels |
| CSI Code                                 | 07 42 00 Wall Panels           |
| Listing Section                          | WALL ASSEMBLIES                |
| Spec ID                                  | 89375                          |

## DRAWING INDEX

EBI/CWP 25-01

EBI/CWP 25-01



Division 07 – Thermal and Moisture Protection  
07 42 00 Wall Panels  
07 42 43 Composite Wall Panels

Eurocon Building Industries FZE  
Design No. EBI/CWP 25-01  
Exterior Cladding  
4 mm Alubond USA FR-A2 Panels  
CAN/ULC S134  
Rating: Meets Conditions of Acceptance

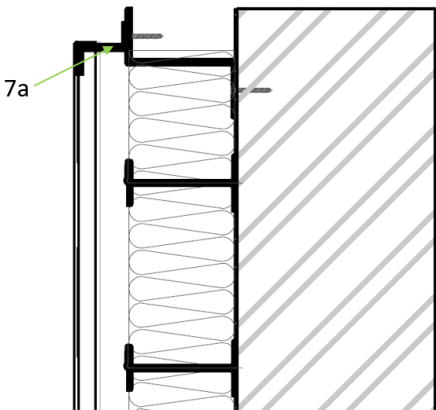


Figure 1. Top of Wall Assembly

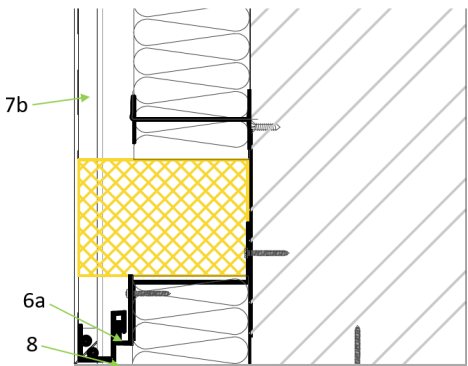


Figure 2. Top of Opening

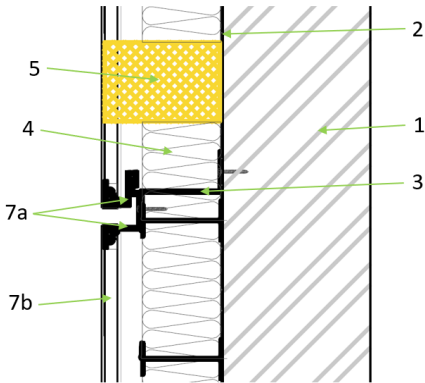


Figure 3. Wall Assembly

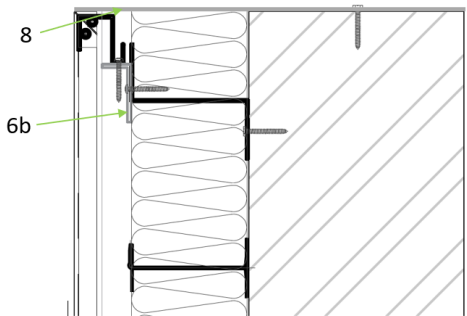


Figure 4. Bottom of Opening

EBI/CWP 25-01 (2 OF 4)



Division 07 – Thermal and Moisture Protection  
07 42 00 Wall Panels  
07 42 43 Composite Wall Panels

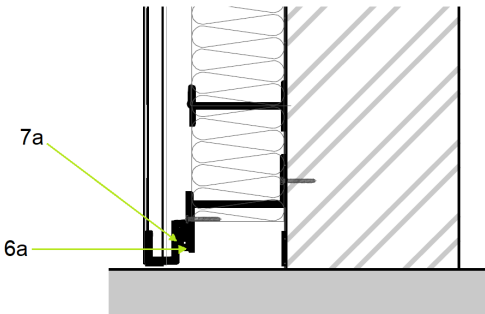


Figure 5. Bottom of Wall Assembly

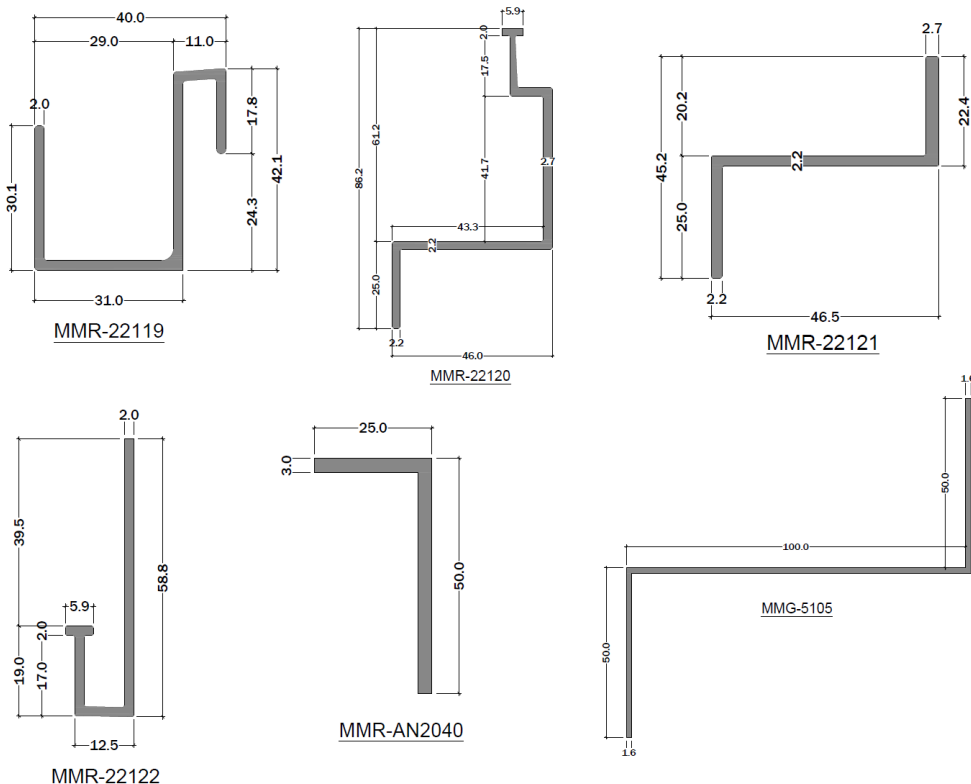


Figure 6. Extrusions (All dimensions are in mm)

## EBI/CWP 25-01 (3 OF 4)



Division 07 – Thermal and Moisture Protection  
07 42 00 Wall Panels  
07 42 43 Composite Wall Panels

1. **SUPPORTING WALL CONSTRUCTION:** The supporting wall construction must be constructed in accordance with the applicable Building Code and the following provisions of this Design Listing.

EXTERIOR SHEATHING – Where the construction is framed walls, the sheathing shall be min. 1/2 in. Type X Gypsum Board onto supporting construction.

2. **WEATHER BARRIER:** Adhere one layer of Henry® BlueskinVP®160 to the surface of the exterior sheathing per manufacturer's installation instructions.
3. **Z-GIRTS:** MMG-5105 Z-girts (ASTM A653/A653M G90), installed horizontally at the header of any opening and at the top section of wall. Z-girts are spaced a max. of 933 mm apart starting from the top of the opening. The spacing varies depending on the height of the panels. Z-girts are secured to the supporting wall or frame with 4.8 mm x 44.5 mm fasteners spaced 406 mm on center (oc).
4. **INSULATION:** Install nominal 100 mm thick Semi-Rigid Thermafiber Rainbarrier Insulation (Ref. UL Listing file no. R4739) over the weather barrier with steel pins and washers, spaced equidistantly across each piece. The insulation is fitted between the Z-girts. The density of the insulation is 72 kg/m<sup>3</sup>.
5. **CAVITY BARRIER:** Install Siderise CH Horizontal Cavity Barrier (Ref. Intertek Spec ID 55890) measuring 127 mm x 152 mm horizontally across the top of any opening at a max. height of 2.75 m above the opening. The cavity barrier must span the entire width of the wall assembly.
6. **WALL MOUNTING CLIPS:** Install the following extrusions to the Z-girts using 19 mm pan-head self-tapping screws, spaced 406 mm oc:

- a. MMR-22122 J-wall mounting clips (Aluminum Alloy 6063 - T6) to the base Z-girt and to the Z-girt installed immediately above an opening.
- b. MMR-AN2040 L-trim (Aluminum Alloy 6063 - T6) secured to the Z-girt immediately below an opening.

## 7. EXTERIOR CLADDING SYSTEM:

**CERTIFIED PRODUCT:** Alubond USA FR-A2 Panels

Install the Alubond USA FR-A2 panels, consisting of the following elements:

- a. **PRE-INSTALLED ALUMINUM EXTRUSIONS –** Aluminum extrusions MMR-22119, MMR-22120, and MMR-22121 (Aluminum Alloy 6063 - T6) are riveted into the panel on the upper and lower edges. The extrusions are riveted to the aluminum composite panel using 4.8 mm x 12.7 mm long stainless-steel rivets with a max. spacing of 350 mm oc.
  - b. **ALUMINUM COMPOSITE PANEL –** Secure the 4 mm Alubond USA FR-A2 Panels to the wall mounting clips and Z-girts using 19 mm pan-head self-tapping screws, spaced at 406 mm through the pre-installed aluminum extrusions on the upper edge of the panel. The panels are installed in a manner to leave a 20 mm gap between panel edges, vertically and horizontally. The nominal distance (air gap) between the panel and insulation is 25.4 mm.
8. **OPENING FLASHING:** 26 GA Steel Plates are secured to the supporting wall at the top and bottom portion of the window opening using 4.75 mm x 44.5 mm fasteners spaced 406 mm oc.

## EBI/CWP 25-01 (4 OF 4)



Division 07 – Thermal and Moisture Protection  
07 42 00 Wall Panels  
07 42 43 Composite Wall Panels

Consult the listing report on the Directory of Building Products (<https://bpdirectory.intertek.com>) for the edition of the standard(s) evaluated.

*Compliance of the assembly described in this Design Listing with the referenced standard relies on verification that the assembly constructed in the field is consistent with that described herein. Intertek certified products may be verified by the approved Intertek label; other products must be verified by the Authority Having Jurisdiction as meeting the specifications stated herein.*

---

Date Issued: March 25, 2026

Page 4 of 4

Spec ID: 89375

Version: 09 June 2021

SFT-BC-OP-19i