

POWER CODED NOTES

- ① EXISTING LIGHT FIXTURES SHALL BE DEMOLISHED, ROUTE ALL CIRCUITS BACK TO SOURCE.
- ② E.G. SHALL ROUTE EMERGENCY LIGHT FIXTURES AHEAD OF LOCAL CONTROLS.
- ③ SWITCH BANK LOCATION, COORDINATE EXACT LOCATION PRIOR TO INSTALLATION. REFER TO SWITCH BANK DETAIL ON THE SHEET FOR ADDITIONAL INFORMATION.
- ④ ILLUMINATED SIGN, PROVIDE LOW POWER TO JUNCTION BOX, FOR AUTOMATIC CONTROLS. SEE SHEET E-307 FOR ADDITIONAL INFORMATION. VERIFY LOCATION PRIOR TO INSTALLATION.
- ⑤ EXISTING EXHAUST FAN TO BE ON A NEW SWITCH AS SHOWN, WIRE TO NEW LIGHTING CIRCUIT SERVING RESTROOM.

NOTE:
EXTERIOR LIGHT FIXTURES SHALL REMAIN.


SWITCH BANK LOCATION	TYPE	SIZE	DIAMETER TYPE
SWITCH 1-A	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-B	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-C	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-D	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-E	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-F	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-G	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-H	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-I	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-J	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-K	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-L	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-M	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-N	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-O	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-P	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-Q	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-R	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-S	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-T	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-U	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-V	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-W	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-X	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-Y	STANDARD SWITCH	200M	8-1/2"
SWITCH 1-Z	STANDARD SWITCH	200M	8-1/2"

*E.G. SHALL VERIFY/TEMPLATE TYPE WITH FINAL LIGHT FIXTURE SELECTION.


GENERAL NOTE:
MAXIMUM SWITCH RISE TO BE 6" FROM BANKS. COORDINATE EXACT LOCATION WITH TENANT PRIOR TO INSTALLATION. E.G. TO COORDINATE LED AND LAMP WITH LAMP PRIOR TO PURCHASE TO ENSURE PROPER DIMMING CONTROLS.

SWITCH BANK DETAIL

N/S

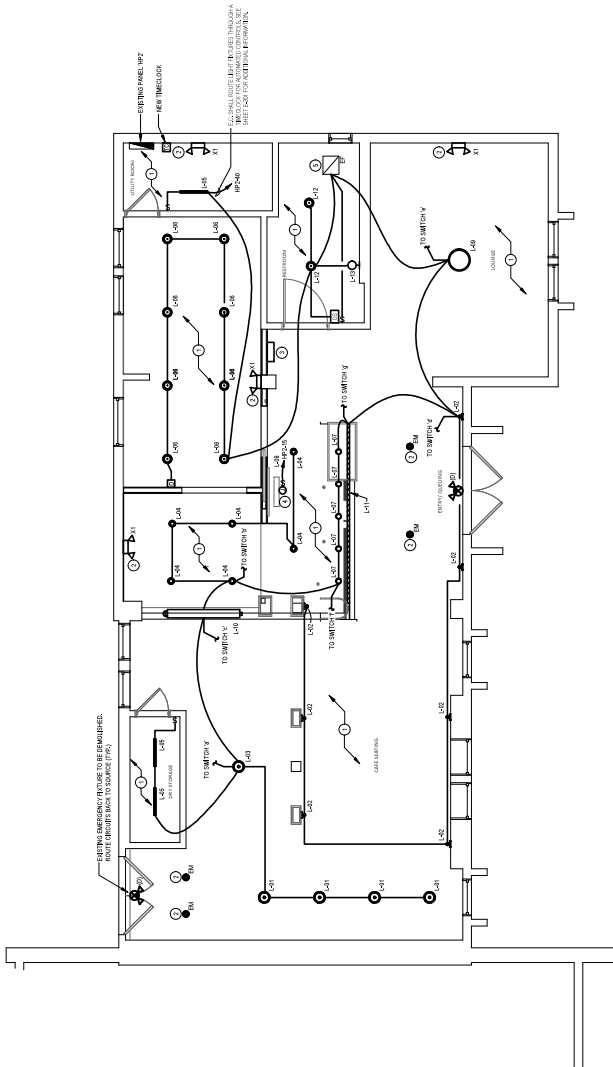


LIGHTING PLAN
SCALE: 1/8" = 1'-0"



POWER CODED NOTES

- 1 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM A 20A-P GROUND FAULT BREAKER TO A RECEPTACLE.
- 2 RELOCATE EXISTING RECEPTACLES TO FACE OF BUILT-IN BENCH, EXTEND EXISTING CONDUITS AND CONDUITS AS REQUIRED, MAINTAIN EXISTING CIRCUIT, RECEPTACLE TYPE BY OWNER.
- 3 EXISTING ELECTRICAL EQUIPMENT IN MUR & KITCHEN AREA SHALL BE DEMOLISHED, ROUTE ALL CIRCUIT BACK TO SOURCE.
- 4 UNLESS OTHERWISE NOTED, EXISTING ELECTRICAL EQUIPMENT IN AREA ARE EXTEND TO REMAIN.
- 5 DEMOLISH EXISTING 200K-10, RUN (1) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE AS SHOWN, VERIFY EXACT CONNECTION REQUIREMENTS.
- 6 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM A 20A-P GROUND FAULT BREAKER TO A RECEPTACLE.
- 7 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 8 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM A 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 9 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 10 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 11 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 12 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 13 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 14 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 15 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 16 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 17 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 18 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 19 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.
- 20 KITCHEN EQUIPMENT, 200K-10, RUN (2) #2 CU IL (1) #2 CU GRD FROM 20A-P GROUND FAULT BREAKER IN PANEL 1 TO RECEPTACLE.

PER NEC 250.118, ALL 15 AMP OR LESS BRANCH CIRCUIT RECEPTACLES SHALL BE WIRING TO GROUND THROUGH A GROUNDING PATH. THE GROUNDING PATH SHALL BE THROUGH A GROUNDING BONDING JUNCTION BOX, PROVIDED BY THE OWNER, LOCATED AT THE PANEL, OR AT THE RECEPTACLE. THE GROUNDING BONDING JUNCTION BOX SHALL BE INSTALLED PRIOR TO BEGINNING WORK.

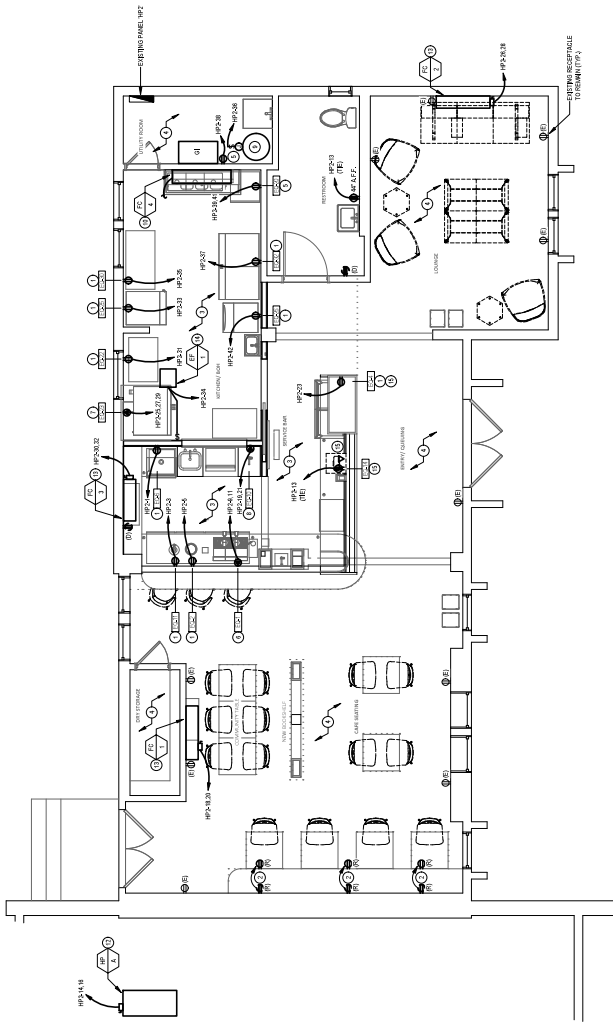

POWER PLAN
SCALE 1/8" = 1'-0"

410 STUDIO
SUE C. COLLIER, AIA
COLUMBUS, OH 43206
CARLY@410-STUDIO.COM
614.746.1183

PROJECT TITLE
SUFU CHAI HOUSE
72 N HIGHT ST. DUBLIN, OHIO
43017

PROJECT NO. 410
DATE 01/20/2020
CIP PROGRESS 100%
ISSUE DATE 01/20/2020

SHEET TITLE
POWER PLAN

SHEET NO.
E-201

© 2020 410 Studio

