

# STATE WATER AND SANITATION MISSION


Water Supply & Sanitation Dept., Govt. of Maharashtra

Scheme ID: 7940695

Scheme Name: Bidgaon Tarodi wss | Nagpur

Report Date  
15/11/2025 03:08 PM

| Total No. Of ESR                     | Total ESR Capacity | Integrated ESRs | Total No. Of Villages | Integrated Villages          | 14/11/2025 LPCD                  | No. Of Villages Achieving 55 LPCD |
|--------------------------------------|--------------------|-----------------|-----------------------|------------------------------|----------------------------------|-----------------------------------|
| 4                                    | 10.14 LL           | 4               | 2                     | 2                            | 29.85 L                          | 1                                 |
| No.Of Villages not Achieving 55 LPCD | Weekly Peak LPCD   | Weekly Low LPCD | Weekly Average LPCD   | 14/11/2025 Water Consumption | Weekly Average Water Consumption |                                   |
| 1                                    | 72.70 L            | 11.71 L         | 42.93 L               | 7.37 LL                      | 10.60 LL                         |                                   |

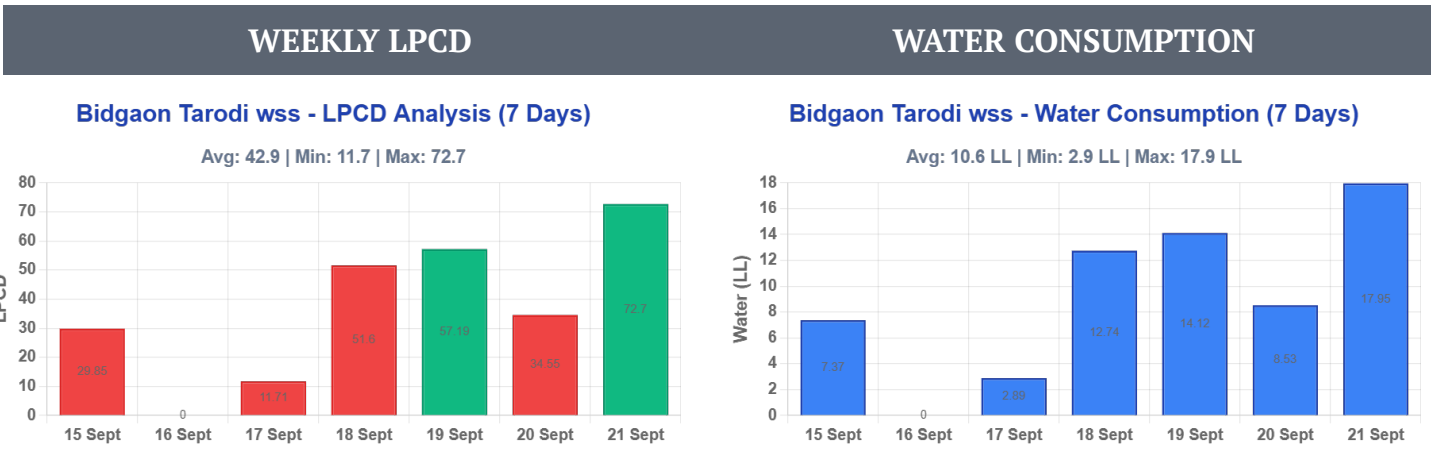

### Highlights

- Zero percent of villages meet LPCD threshold of 55 (0 of 2 villages)
- Consistent water supply last 7 days: zero percent villages (0 of 2)
- Consistent water supply last 30 days: 100% villages (2 of 2)
- Chlorine (0.2-0.5 mg/L): 0 ESRs
- Chlorine (>0.5 mg/L): 1 ESRs
- Chlorine (<0.2 mg/L): 3 ESRs
- Pressure (0.2-0.7 bar): 0 ESRs
- Pressure (>0.7 bar): 3 ESRs
- Pressure (<0.2 bar): 1 ESRs
- Weekly LPCD range: 11.7L - 72.7L (Avg: 42.9L)

### Weekly LPCD Distribution

< 25

25-40

40-55

55-80

>80

# VILLAGE PERFORMANCE REPORT


| Rank | Village Name | Population | LPCD | Water (LL) | Time (Hrs) |
|------|--------------|------------|------|------------|------------|
| 1    | Bidgaon      | 16,860     | 43.2 | 7.3        | 0          |
| 2    | Tarodi Kh.   | 7,830      | 1.0  | 0.1        | 0          |

## DETAILED PERFORMANCE ANALYSIS


| Sr | Village    | ESR                          | ESR Outlet    | Flow Meter | Water Consumption (m3) | Chlorine  | Chlorine Value (mg/L) | Pressure  | Pressure Value (bar) | Time (Hrs) |
|----|------------|------------------------------|---------------|------------|------------------------|-----------|-----------------------|-----------|----------------------|------------|
| 1  | Bidgaon    | ESR 3.73 LL - 1              | Single Outlet | Connected  | 0                      | Connected | 0.00                  | Connected | 0.10                 | 0          |
|    |            | ESR Nageshwar nagar- 3.73 LL | Single Outlet | Connected  | 0                      | Connected | 0.00                  | Connected | 1.30                 | 0          |
| 2  | Tarodi Kh. | ESR 1.34 LL - 1              | Single Outlet | Connected  | 0                      | Connected | 0.00                  | Connected | 1.86                 | 0          |
|    |            | ESR Ganganagar - 1.34 LL     | Single Outlet | Connected  | 0                      | Connected | 0.60                  | Connected | 1.17                 | 0          |

## BIDGAON - VILLAGE PERFORMANCE CHARTS

Bidgaon - Water Consumption (7 Days)

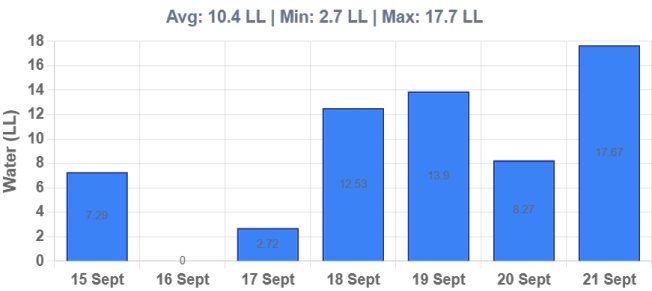

Bidgaon - LPCD Analysis (7 Days)

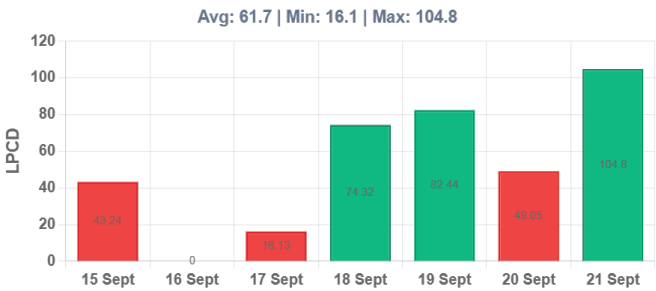

Average Water Consumption

8.9 LL

Past 7 Days Average

Average LPCD (Last 7 Days)

52.9 L


BELOW THRESHOLD

# ESR MONITORING DATA

## ESR 3.73 LL - 1


| Flow Meter | Chlorine  | Pressure  |
|------------|-----------|-----------|
| Connected  | Connected | Connected |

### ESR 3.73 LL - 1 - Water Consumption (7 Days)

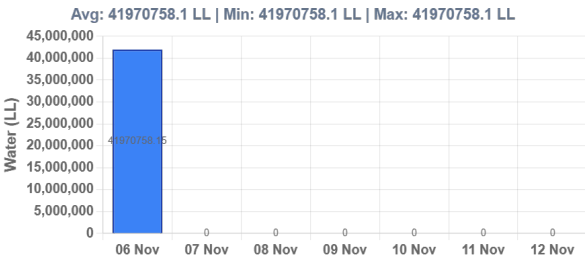


|                         |             |             |
|-------------------------|-------------|-------------|
| Current                 | Peak        | Min         |
| 41970758.15             | 41970758.15 | 41970758.15 |
| LL                      | 7-Day       | 7-Day       |
| Water Consumption (LL)  |             |             |
| Average: 41970758.15 LL |             |             |

### ESR 3.73 LL - 1 - Chlorine Levels (7 Days)

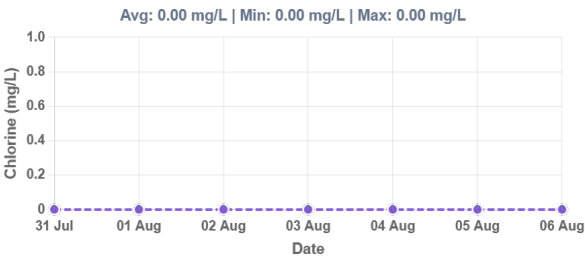

### ESR 3.73 LL - 1 - Pressure Levels (7 Days)

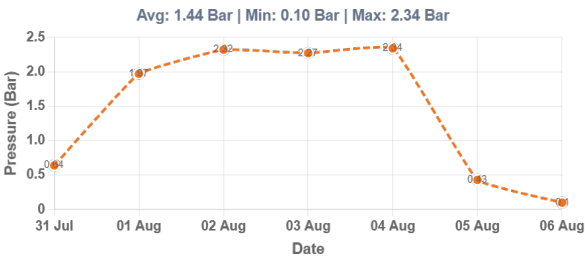


|                         |       |       |                           |       |       |
|-------------------------|-------|-------|---------------------------|-------|-------|
| Current                 | Peak  | Min   | Current                   | Peak  | Min   |
| 0.00                    | 0.00  | 0.00  | 0.64                      | 2.34  | 0.10  |
| mg/L                    | 7-Day | 7-Day | Bar                       | 7-Day | 7-Day |
| Chlorine Quality (mg/L) |       |       | Pressure Monitoring (Bar) |       |       |
| Average: 0.00 mg/L      |       |       | Average: 1.44 Bar         |       |       |

## ESR Nageshwarnagar- 3.73 LL


| Flow Meter | Chlorine  | Pressure  |
|------------|-----------|-----------|
| Connected  | Connected | Connected |

### ESR Nageshwarnagar- 3.73 LL - Water Consumption (7 Days)

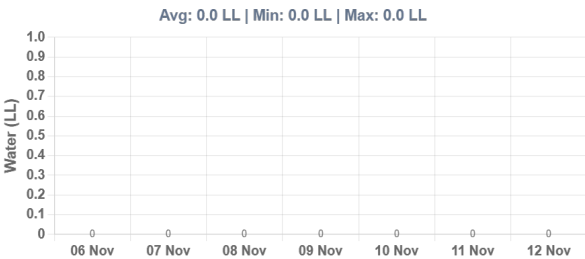


|                        |       |       |
|------------------------|-------|-------|
| Current                | Peak  | Min   |
| 0.00                   | 0.00  | 0.00  |
| LL                     | 7-Day | 7-Day |
| Water Consumption (LL) |       |       |
| Average: 0.00 LL       |       |       |

ESR Nageshwarnagar- 3.73 LL - Chlorine Levels (7 Days)

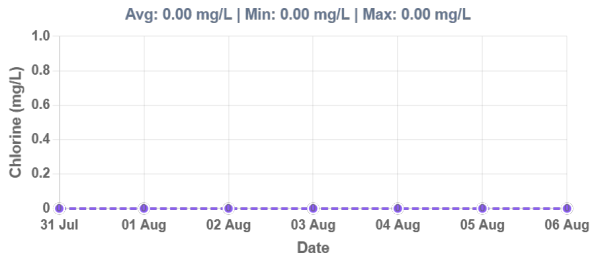


ESR Nageshwarnagar- 3.73 LL - Pressure Levels (7 Days)

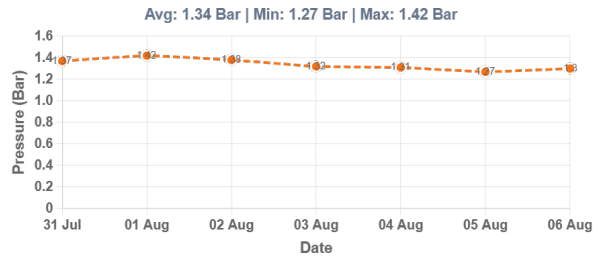


|                                               |                              |                             |                                                |                              |                             |
|-----------------------------------------------|------------------------------|-----------------------------|------------------------------------------------|------------------------------|-----------------------------|
| Current<br><b>0.00</b><br>mg/L                | Peak<br><b>0.00</b><br>7-Day | Min<br><b>0.00</b><br>7-Day | Current<br><b>1.37</b><br>Bar                  | Peak<br><b>1.42</b><br>7-Day | Min<br><b>1.27</b><br>7-Day |
| Chlorine Quality (mg/L)<br>Average: 0.00 mg/L |                              |                             | Pressure Monitoring (Bar)<br>Average: 1.34 Bar |                              |                             |

## TARODI KH. - VILLAGE PERFORMANCE CHARTS

Tarodi Kh. - Water Consumption (7 Days)

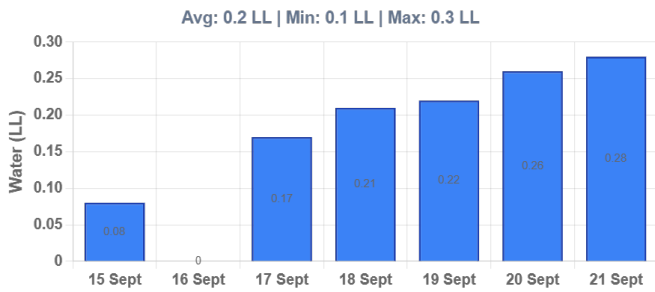

Tarodi Kh. - LPCD Analysis (7 Days)

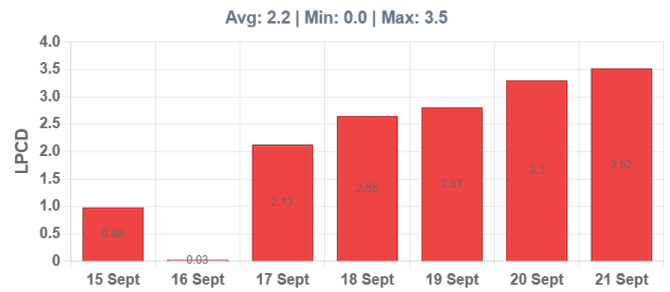

Average Water Consumption

**0.2 LL**

Past 7 Days Average

Average LPCD (Last 7 Days)

**2.2 L**


BELOW THRESHOLD

# ESR MONITORING DATA

## ESR 1.34 LL - 1


| Flow Meter | Chlorine  | Pressure  |
|------------|-----------|-----------|
| Connected  | Connected | Connected |

ESR 1.34 LL - 1 - Water Consumption (7 Days)

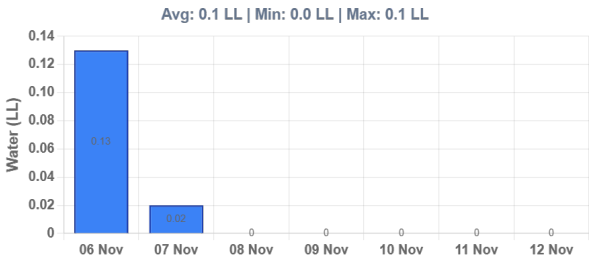


|                        |             |             |
|------------------------|-------------|-------------|
| Current                | Peak        | Min         |
| <b>0.13</b>            | <b>0.13</b> | <b>0.02</b> |
| LL                     | 7-Day       | 7-Day       |
| Water Consumption (LL) |             |             |
| Average: 0.07 LL       |             |             |

ESR 1.34 LL - 1 - Chlorine Levels (7 Days)

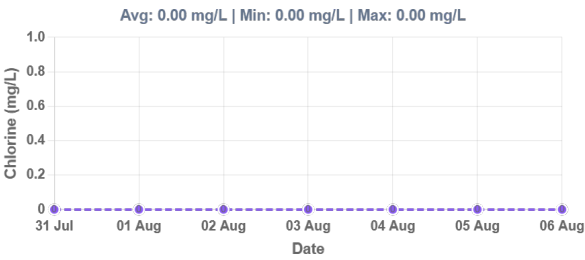

|                         |             |             |                           |             |             |
|-------------------------|-------------|-------------|---------------------------|-------------|-------------|
| Current                 | Peak        | Min         | Current                   | Peak        | Min         |
| <b>0.00</b>             | <b>0.00</b> | <b>0.00</b> | <b>2.15</b>               | <b>2.15</b> | <b>1.86</b> |
| mg/L                    | 7-Day       | 7-Day       | Bar                       | 7-Day       | 7-Day       |
| Chlorine Quality (mg/L) |             |             | Pressure Monitoring (Bar) |             |             |
| Average: 0.00 mg/L      |             |             | Average: 2.02 Bar         |             |             |


ESR 1.34 LL - 1 - Pressure Levels (7 Days)

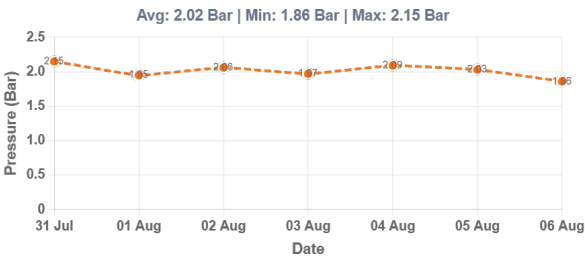

## ESR Ganganagar - 1.34 LL


| Flow Meter | Chlorine  | Pressure  |
|------------|-----------|-----------|
| Connected  | Connected | Connected |

ESR Ganganagar - 1.34 LL - Water Consumption (7 Days)

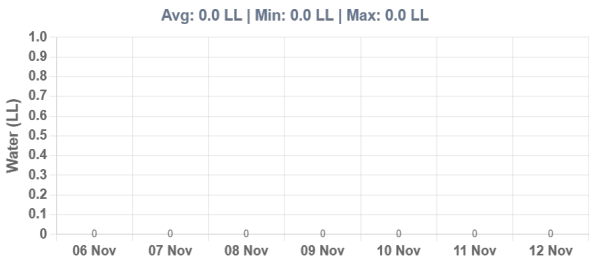


|                        |             |             |
|------------------------|-------------|-------------|
| Current                | Peak        | Min         |
| <b>0.00</b>            | <b>0.00</b> | <b>0.00</b> |
| LL                     | 7-Day       | 7-Day       |
| Water Consumption (LL) |             |             |
| Average: 0.00 LL       |             |             |

ESR Ganganagar - 1.34 LL - Chlorine Levels (7 Days)

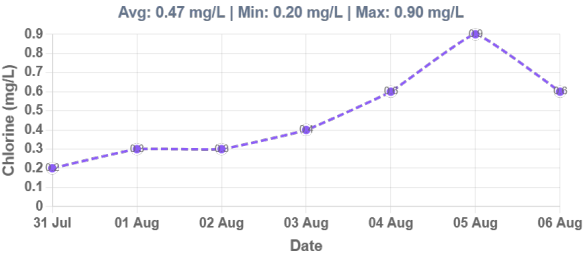

ESR Ganganagar - 1.34 LL - Pressure Levels (7 Days)

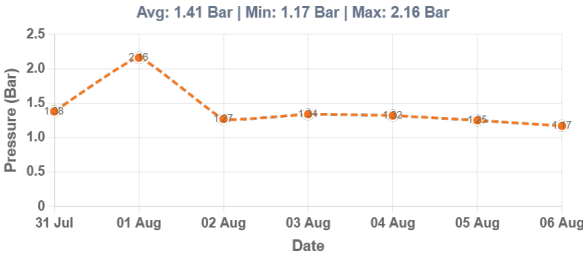

|                                               |                              |                             |                                                |                              |                             |
|-----------------------------------------------|------------------------------|-----------------------------|------------------------------------------------|------------------------------|-----------------------------|
| Current<br><b>0.20</b><br>mg/L                | Peak<br><b>0.90</b><br>7-Day | Min<br><b>0.20</b><br>7-Day | Current<br><b>1.38</b><br>Bar                  | Peak<br><b>2.16</b><br>7-Day | Min<br><b>1.17</b><br>7-Day |
| Chlorine Quality (mg/L)<br>Average: 0.47 mg/L |                              |                             | Pressure Monitoring (Bar)<br>Average: 1.41 Bar |                              |                             |

# SCHEME PERFORMANCE OVERVIEW

The AVERAGE SCORE combines quantitative analysis of three key performance indicators: LPCD (40% weight), Chlorine Quality (30% weight), and Pressure Quality (30% weight). These metrics are evaluated using standardized benchmarks.



## Overall Scheme Score: 6.5

Based on weighted average of LPCD, Chlorine Quality, and Pressure Quality metrics

### KEY INSIGHTS & RECOMMENDATIONS

- GOOD PERFORMANCE: Scheme operates effectively with minor areas for improvement in specific parameters
- LPCD GAP IDENTIFIED: Significant portion of villages below 55 LPCD threshold, review water distribution and supply patterns
- SUPPLY IRREGULARITY DETECTED: Frequent water supply interruptions affecting service reliability - investigate root causes
- WATER QUALITY CONCERN: Significant number of ESRs outside optimal chlorine range - review chlorination processes
- ADEQUATE PRESSURE MANAGEMENT: Generally acceptable pressure levels with minor fluctuations observed
- HIGH CONSUMPTION VARIABILITY: Significant fluctuations in LPCD suggesting irregular water usage patterns
- FULLY INTEGRATED OPERATIONS: Comprehensive system integration enabling complete monitoring and control capabilities
- PRIORITY AREA - WATER QUALITY: Enhance chlorination processes to ensure consistent water safety standards