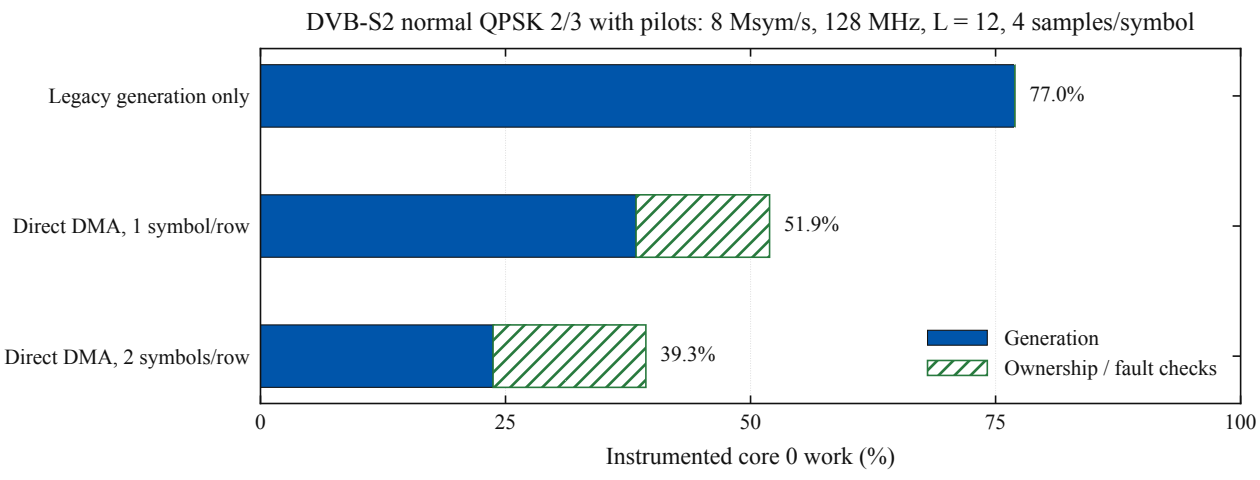


Legacy housekeeping was not instrumented. Direct DMA includes generation and monitored control work.
Idle waits and untimed overhead are excluded; IRQ time counts only inside timed regions. Same UF2 snapshot for all bars.