

NOTE:
ALL EXISTING CONDITIONS ARE ASSUMED TO THE BEST INFORMATION MADE AVAILABLE TO THE ENGINEER. AFTER DEMOLITION, CONTRACTOR SHALL VERIFY ALL EXISTING DIMENSIONS AND CONDITIONS AS SHOWN. IF THESE CONDITIONS DO NOT MATCH, NOTIFY THE ENGINEER OF RECORD AS SOON AS POSSIBLE AS THE DESIGN MAY CHANGE.


ELEVATED FLOOR SCHEDULE									
MARK	TYPE	MODEL	GAGE	SLAB REINFORCEMENT	WELDED FASTENER PATTERN		P.A.F. FASTENER PATTERN		COMMENTS
					SUPPORT PATTERN	SIDELAP PATTERN	SUPPORT PATTERN	SIDELAP PATTERN	
S6	4" N.W. CONCRETE ON 2" METAL DECK. TOTAL THICKNESS = 6"	VULCRAFT 2.0VLR COMPOSITE DECK	20	#3 @ 16" EACH WAY	5/8" DIA. PUDDLE WELDS AT 36/4 PATTERN	#10 SCREWS @ 12" O.C.	HILTI X-ENP-19 P.A.F.S AT 36/4 PATTERN	HILTI S-SLC CONNECTORS OR #10 SCREWS @ 12" O.C.	DO NOT USE HILTI X-ENP-19 P.A.F.S FOR BASE METAL THICKNESSES LESS THAN 1/4"

MASONRY WALL SCHEDULE					
MARK	THICKNESS	WALL REINFORCEMENT			COMMENTS
		HORIZONTAL	VERTICAL	BOND BEAM REINF. & SPACING	
M8	7 5/8"	9 GA. JOINT TIES @ 16" O.C.	#5 @ 24"	BOND BEAMS @ 10'-0" MAX & AT FLOORS & ELEVATOR RAILS (COORDINATE W/ ELEVATOR CONTRACTOR)	SOLID GROUTED WALL

MAT FOOTING SCHEDULE						
MARK	FOOTING DIMENSIONS			FOOTING REINFORCEMENT		COMMENTS
	LENGTH	WIDTH	THICKNESS	LONGITUDINAL REINF.	TRANSVERSE REINF.	
MF20	7'- 4"	8'- 8"	1'- 8"	#5 @ 12", TOP & BOTTOM	#5 @ 12", TOP & BOTTOM	


PIER SCHEDULE					
MARK	PIER DIMENSIONS		PIER REINFORCEMENT		COMMENTS
	DEPTH	WIDTH	VERTICAL	TIES	
P18	1'- 6"	1'- 6"	(4) #5	(2) #4 TIES TOP, BALANCE @ 12"	

LEGEND	
1.	— DENOTES MOMENT CONNECTION
2.	(# - #") BEAM AT ELEV. ABOVE OR BELOW PLAN ELEV. (SEE PLAN NOTES)
3.	S# — SPAN ELEVATED SLAB: ARROWS INDICATE SPAN DIRECTION # = SLAB MARK (SEE ELEVATED SLAB SCHEDULE)
4.	M# MASONRY WALL MARK: SEE WALL SCHEDULE
5.	S# — SLAB-ON-GRADE: ARROWS INDICATE LIMITS # = SLAB MARK
6.	SPOT ELEVATION INDICATES DEPTH BELOW F.F.E. (DATUM ELEVATION 0'-0")
7.	--- CONTROL/CONSTRUCTION JOINT

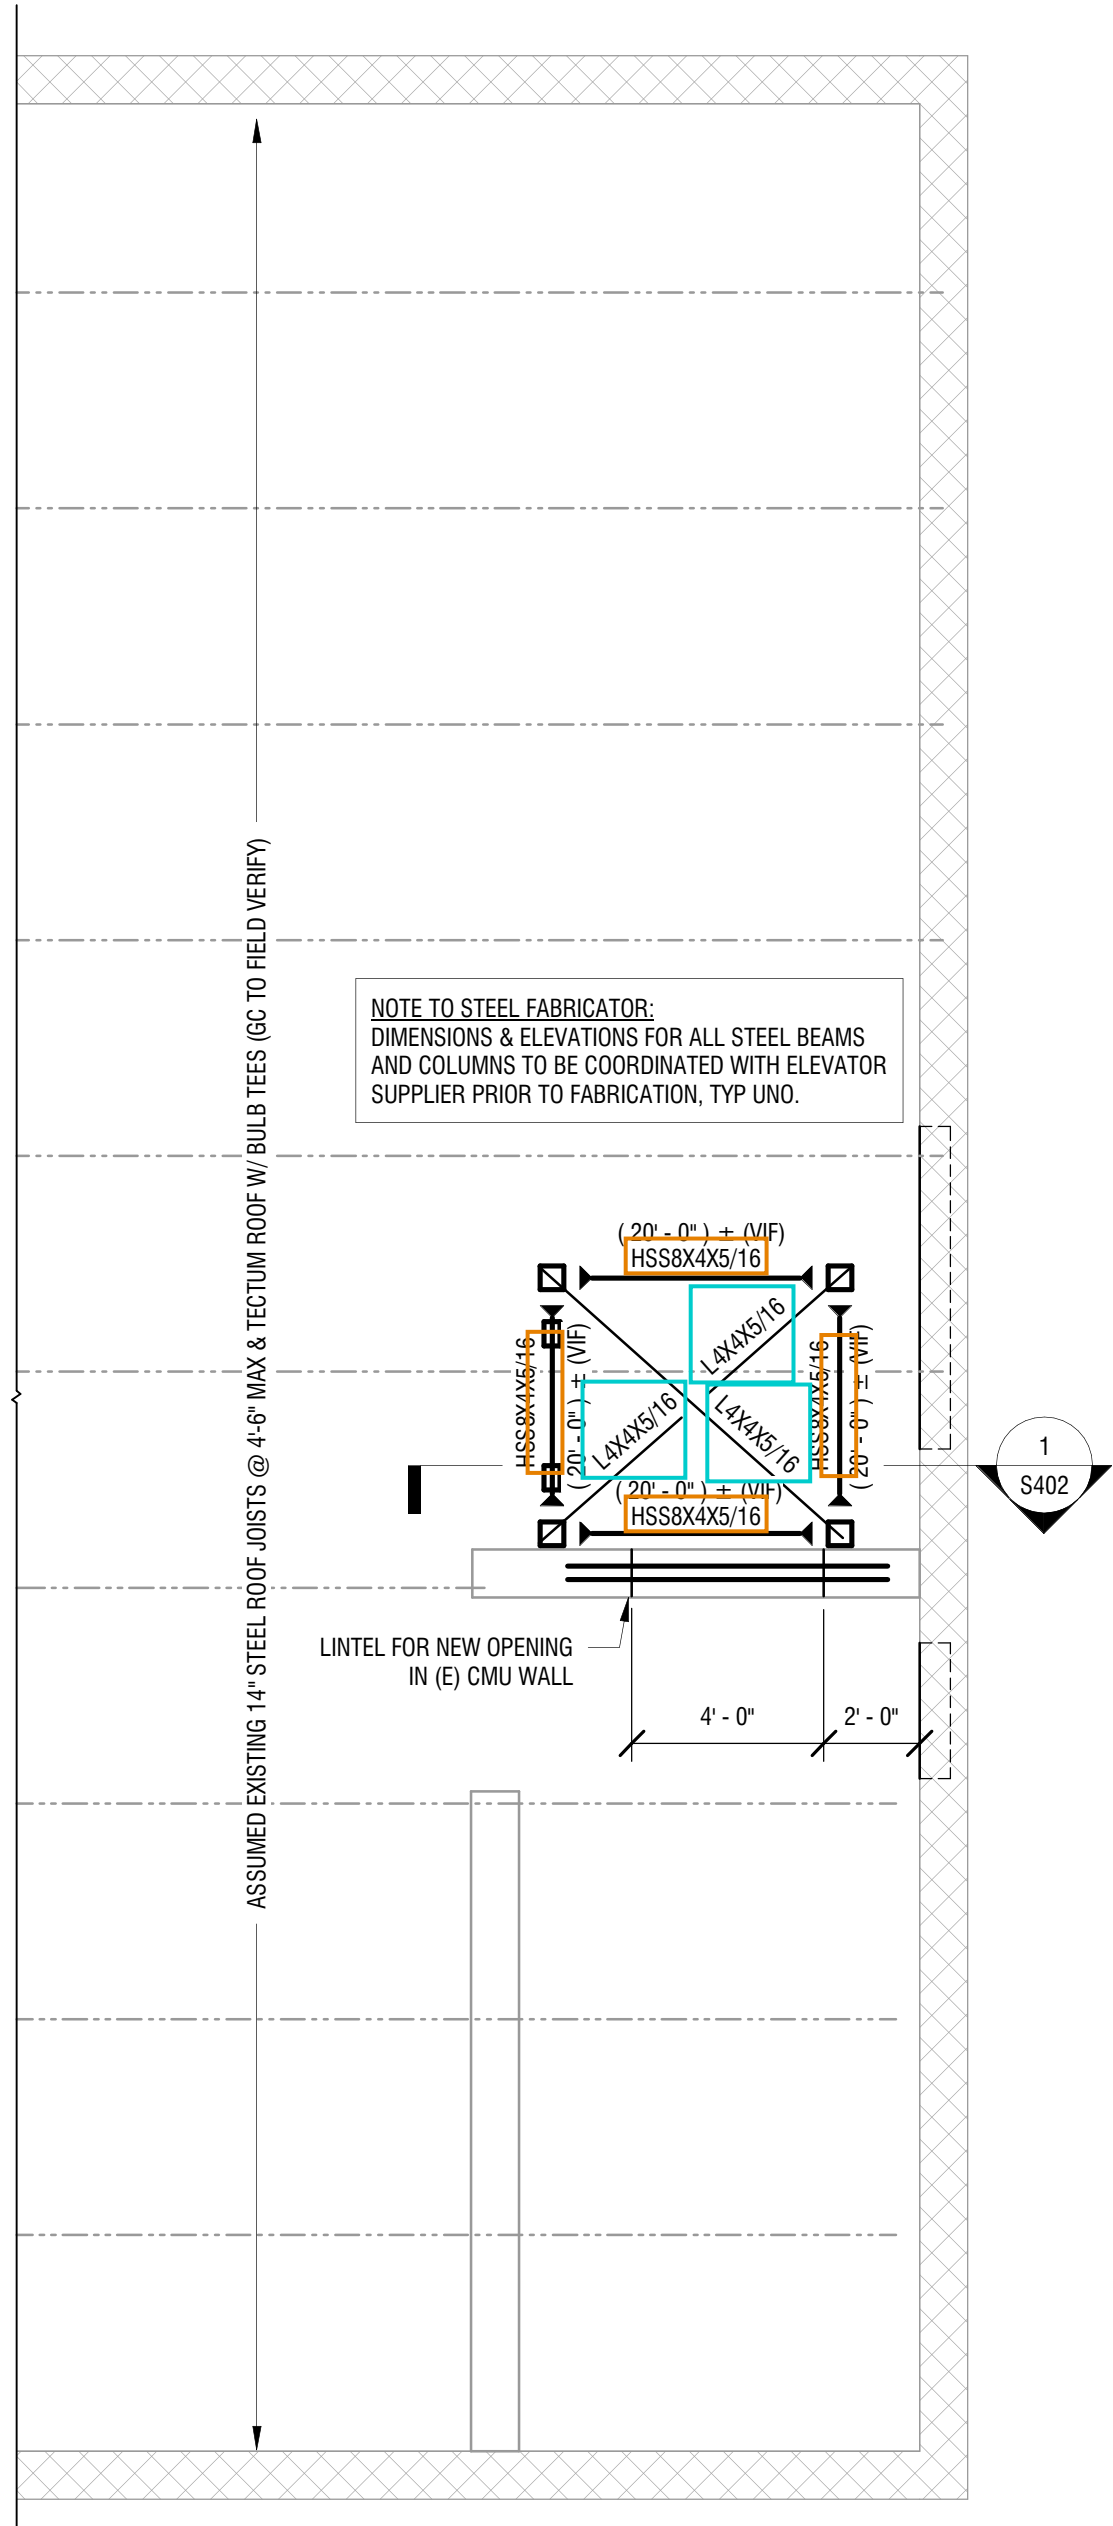


4 ROOF FRAMING PLAN- ALTERNATE #1
1/4" = 1'-0"

- ROOF FRAMING PLAN NOTES:
1. TOP OF STEEL ELEVATIONS ARE REFERENCED FROM LEVEL 1 FINISHED FLOOR ELEVATION 0' - 0' AND ARE NOTED ON PLAN THUS (# - #")
 2. SEE MECHANICAL/ELECTRICAL DRAWINGS FOR THE BALANCE OF ALL EQUIPMENT, FLOOR PENETRATIONS, ETC. REQUIRED AT THIS LEVEL.
 3. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL FLOOR PLANS FOR DIMENSIONS NOT INDICATED ON STRUCTURAL DRAWINGS.
 4. SECTIONS INDICATED ON PLAN ARE TYPICAL FOR SIMILAR CONDITIONS.
 5. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF ARCHITECTURALLY EXPOSED STEEL (AESS).

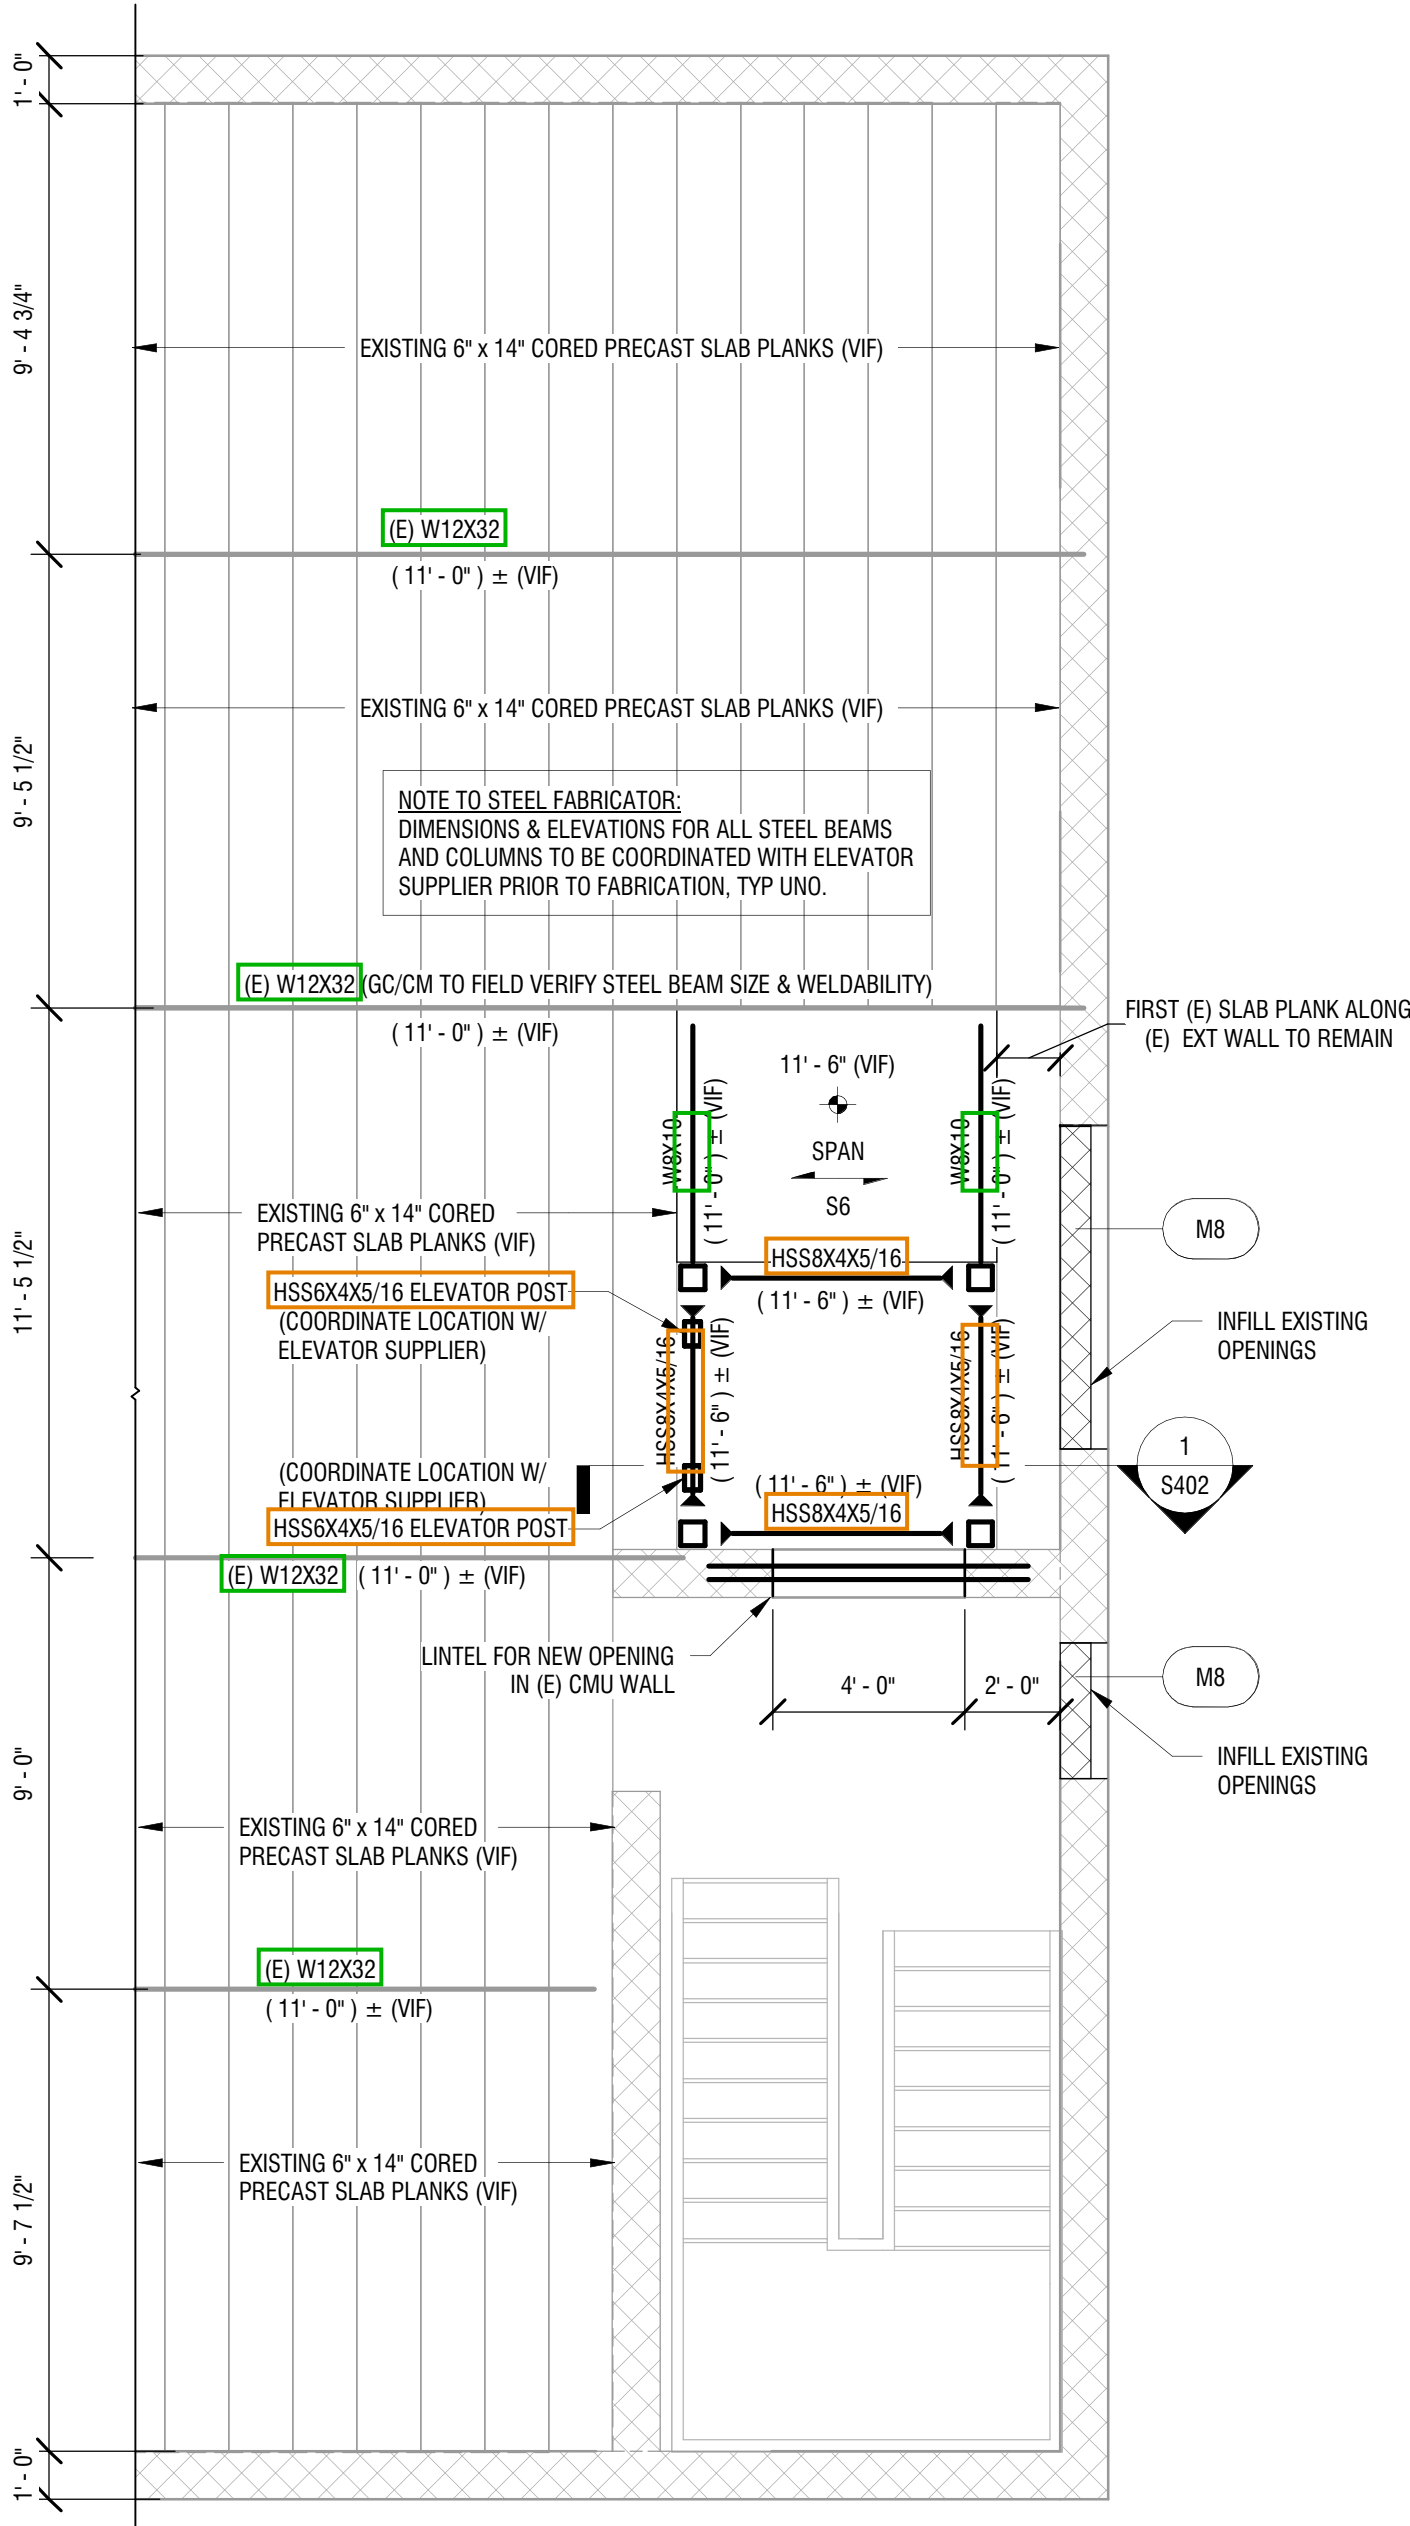


3 LEVEL 2 FRAMING PLAN- ALTERNATE #1
1/4" = 1'-0"

- ELEVATED FLOOR PLAN NOTES:
1. TOP OF STEEL ELEVATIONS ARE REFERENCED FROM LEVEL 1 FINISHED FLOOR ELEVATION 0' - 0' AND ARE NOTED ON PLAN THUS (# - #")
 2. THE NUMBER OF 3/4" DIA. x 4" LONG SHEAR STUDS REQUIRED AT EACH BEAM IS NOTED THUS: (#) ON PLAN. UNLESS OTHERWISE INDICATED, WHERE NO SHEAR CONNECTORS ARE NOTED FOR A BEAM WHICH SUPPORTS A CONCRETE SLAB, PROVIDE SHEAR CONNECTORS AT 24" O.C.
 3. SEE M.E.P. DRAWINGS FOR THE BALANCE OF ALL EQUIPMENT, FLOOR PENETRATIONS, ETC. REQUIRED AT THIS LEVEL.
 4. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL FLOOR PLANS FOR DIMENSIONS NOT INDICATED ON STRUCTURAL DRAWINGS.
 5. SECTIONS INDICATED ON PLAN ARE TYPICAL FOR SIMILAR CONDITIONS.
 6. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF ARCHITECTURALLY EXPOSED STEEL (AESS).

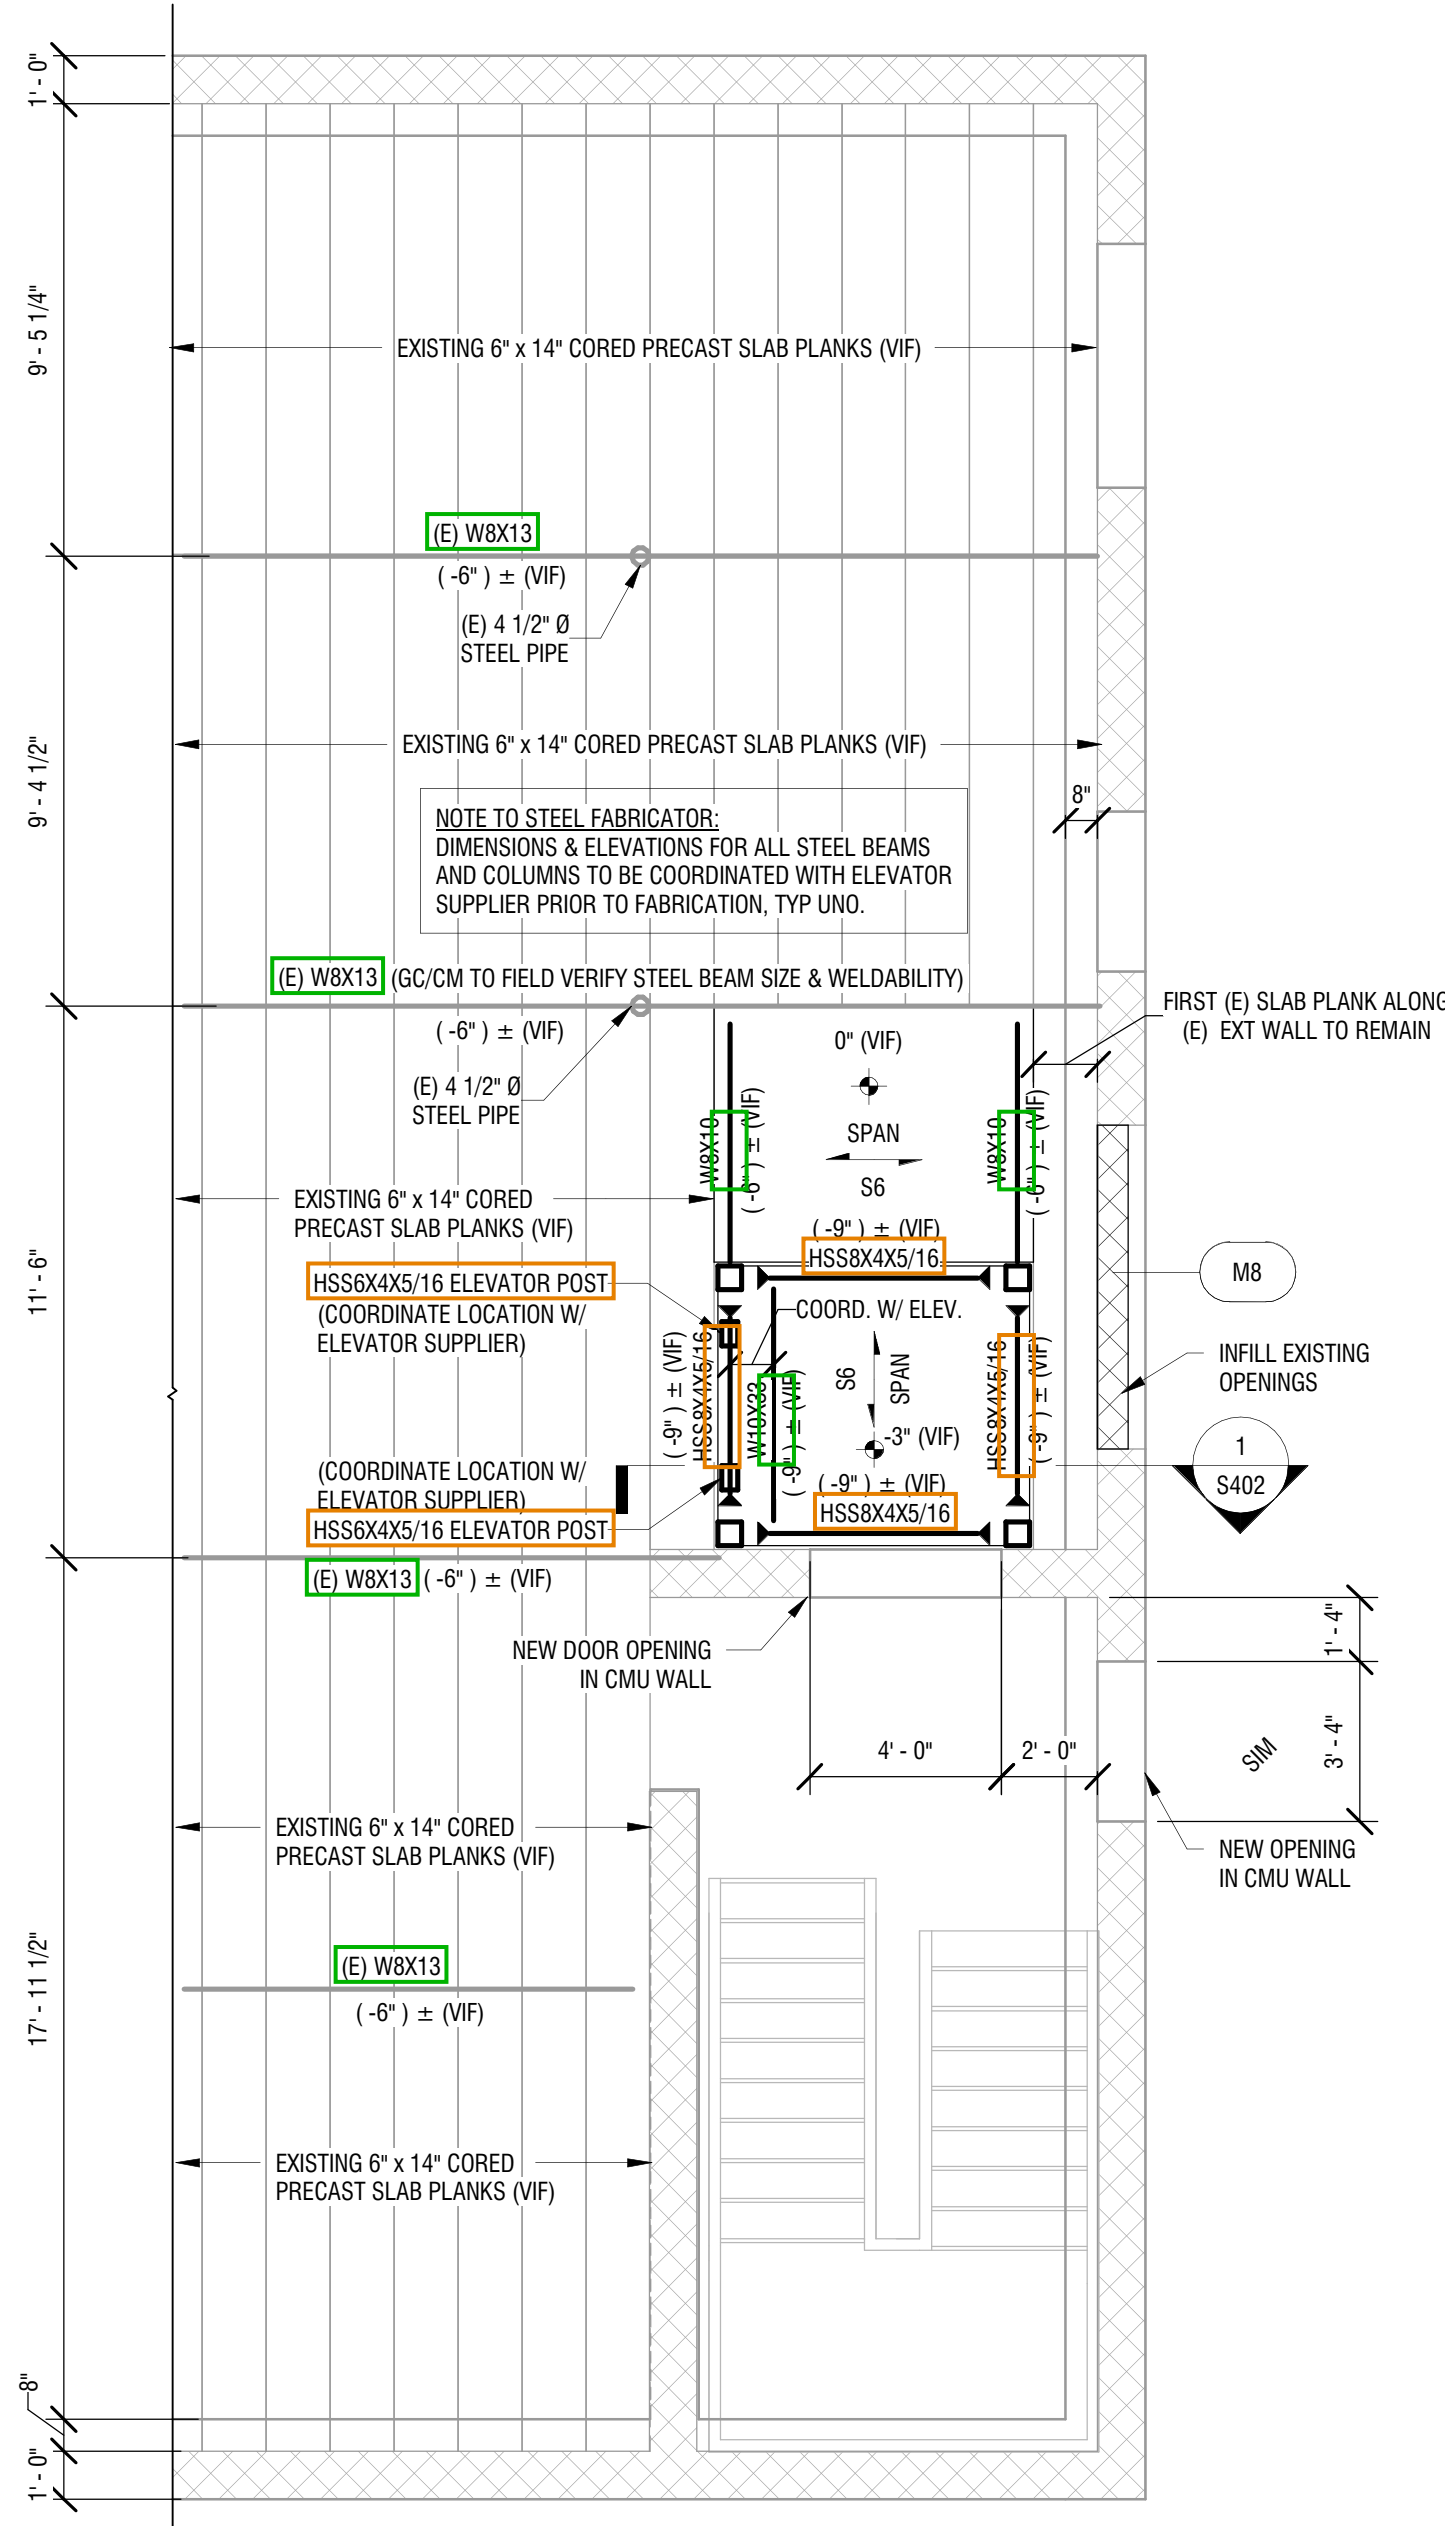

2 LEVEL 1 FRAMING PLAN- ALTERNATE #1
1/4" = 1'-0"

- ELEVATED FLOOR PLAN NOTES:
1. TOP OF STEEL ELEVATIONS ARE REFERENCED FROM LEVEL 1 FINISHED FLOOR ELEVATION 0' - 0' AND ARE NOTED ON PLAN THUS (# - #")
 2. THE NUMBER OF 3/4" DIA. x 4" LONG SHEAR STUDS REQUIRED AT EACH BEAM IS NOTED THUS: (#) ON PLAN. UNLESS OTHERWISE INDICATED, WHERE NO SHEAR CONNECTORS ARE NOTED FOR A BEAM WHICH SUPPORTS A CONCRETE SLAB, PROVIDE SHEAR CONNECTORS AT 24" O.C.
 3. SEE M.E.P. DRAWINGS FOR THE BALANCE OF ALL EQUIPMENT, FLOOR PENETRATIONS, ETC. REQUIRED AT THIS LEVEL.
 4. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL FLOOR PLANS FOR DIMENSIONS NOT INDICATED ON STRUCTURAL DRAWINGS.
 5. SECTIONS INDICATED ON PLAN ARE TYPICAL FOR SIMILAR CONDITIONS.
 6. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF ARCHITECTURALLY EXPOSED STEEL (AESS).

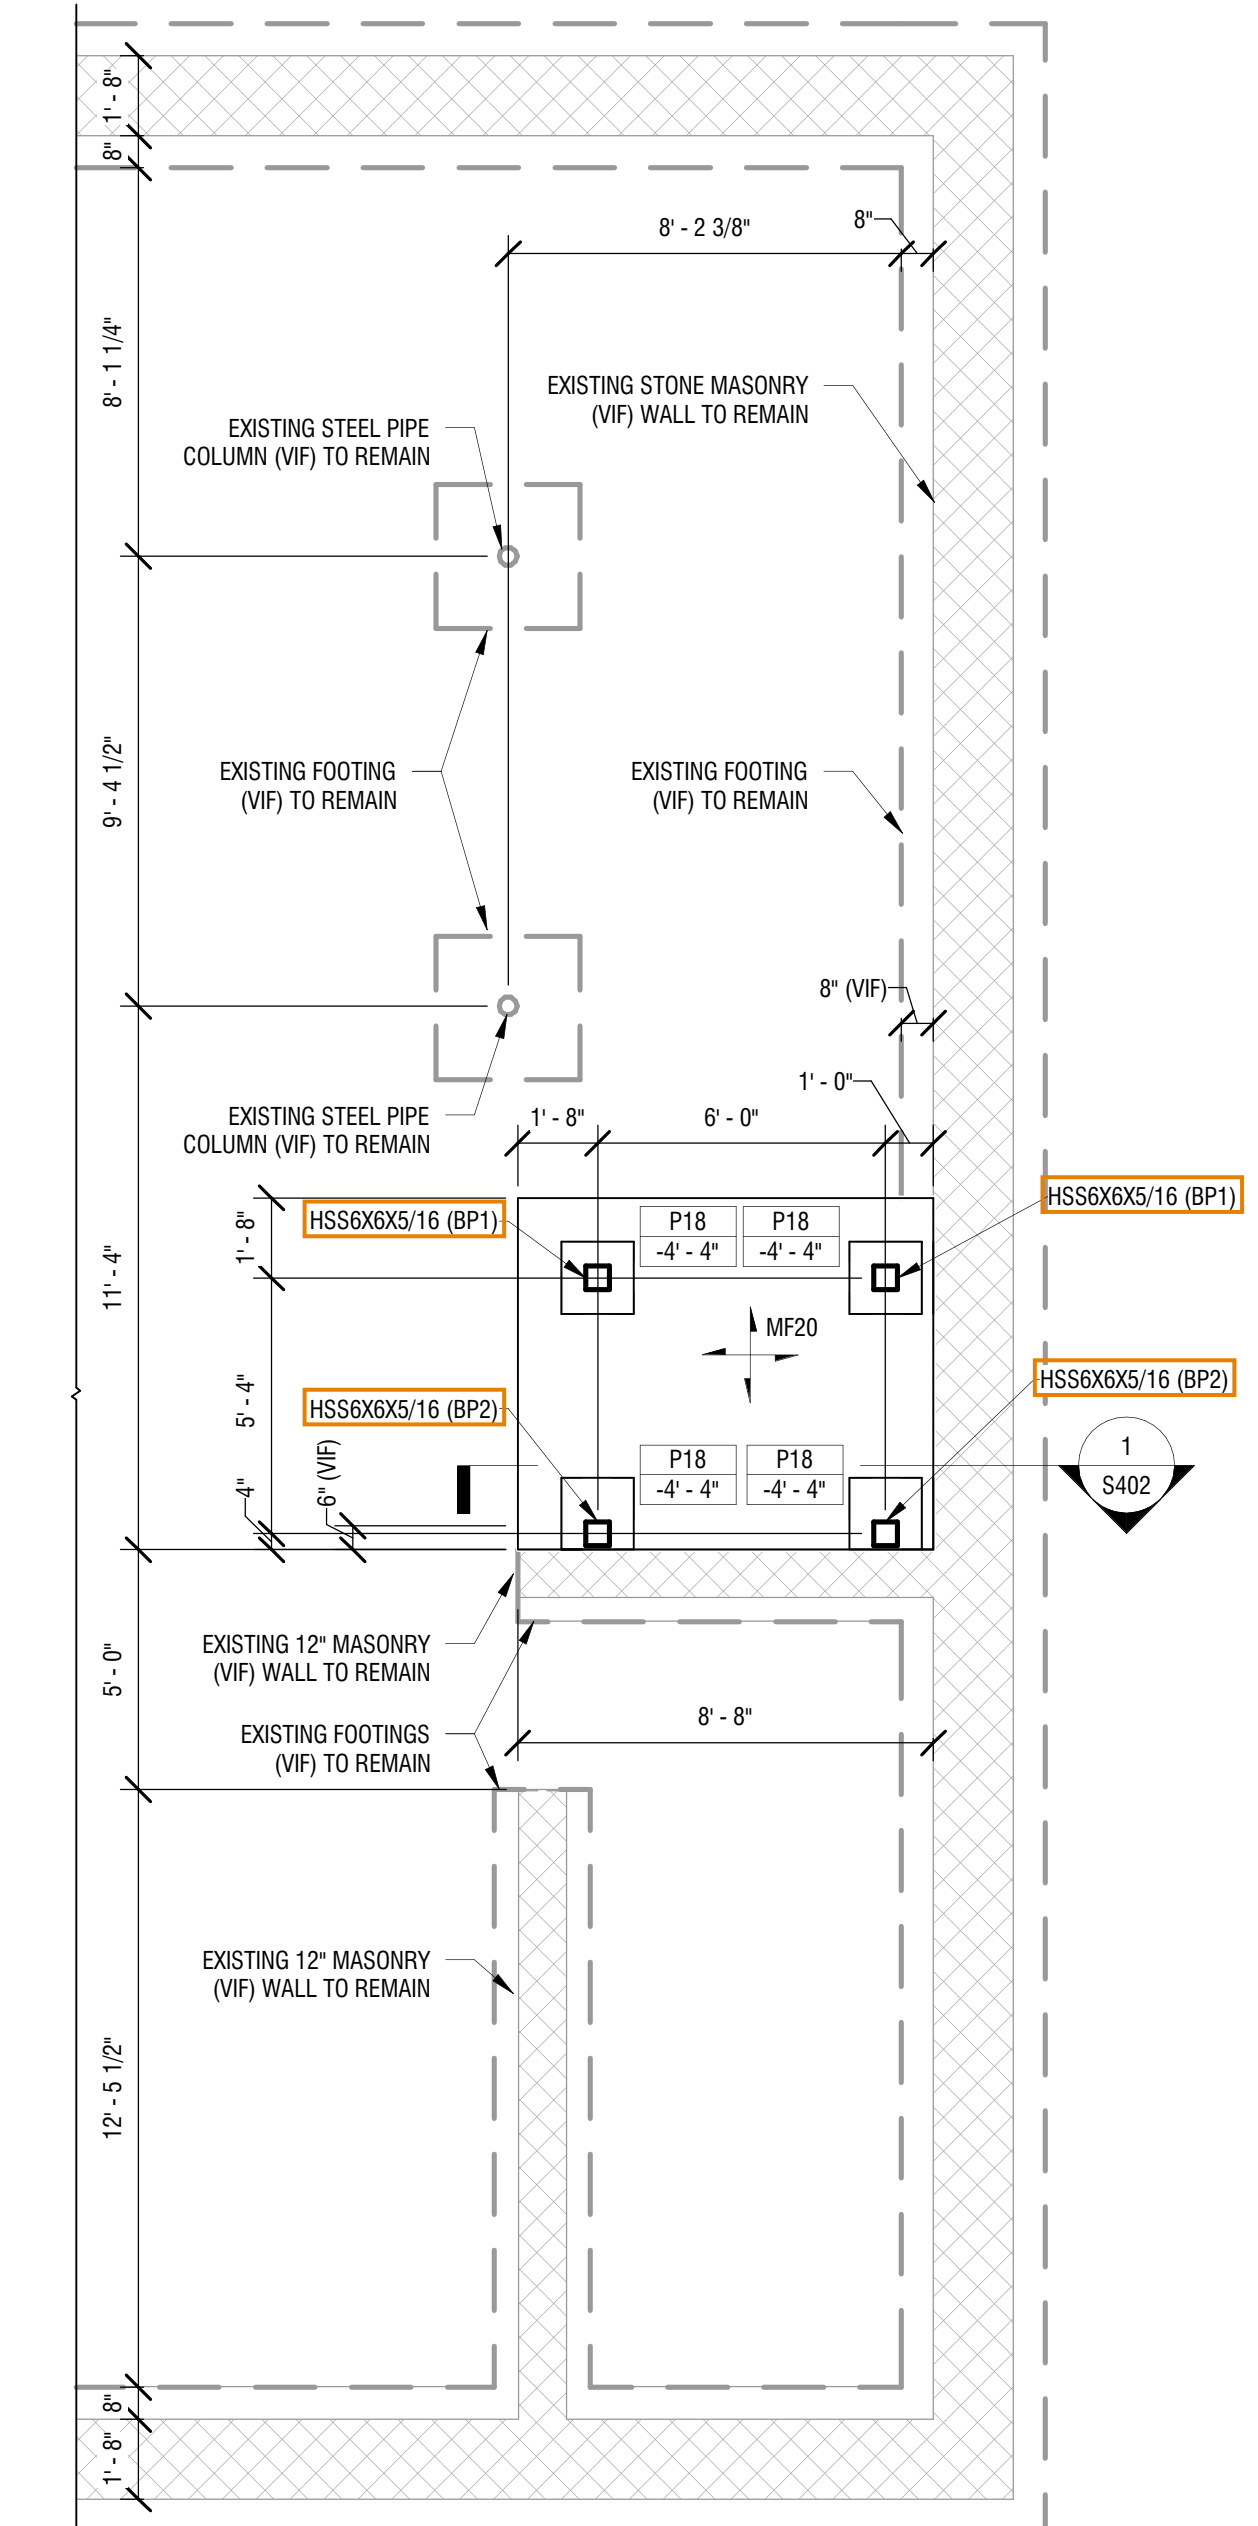

1 FOUNDATION PLAN- ALTERNATE #1
1/4" = 1'-0"

- SLAB PLAN NOTES:
1. ALL ELEVATIONS ARE REFERENCED FROM LEVEL 1 FINISHED FLOOR ELEVATION 0' - 0' AND ARE NOTED ON PLAN.
 2. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL FLOOR PLANS FOR DIMENSIONS NOT INDICATED ON STRUCTURAL DRAWINGS.
 3. SECTIONS INDICATED ON PLAN ARE TYPICAL FOR SIMILAR CONDITIONS.
 4. SEE M.E.P. DRAWINGS FOR THE BALANCE OF ALL EQUIPMENT, HOUSEKEEPING PADS, FLOOR PENETRATIONS, ETC. REQUIRED AT THIS LEVEL.
 5. BALANCE OF SLAB REINF. FOR REENTRANT CORNERS AND OPENINGS NOT SHOWN FOR CLARITY. SEE TYPICAL DETAILS.

The Village of Attica

9 Water Street
Attica, NY 14011

VILLAGE HALL ELEVATOR REPLACEMENT

9 Water Street
Attica, NY 14011

NO.	DATE:	DESCRIPTION:
Revisions		

PROJECT NUMBER: 22250195

DRAWN BY: HJN

REVIEWED BY: APK

ISSUED FOR: CONSTRUCTION DOCUMENTS

DATE: AUGUST 2025

DRAWING NAME:

ALTERNATE #1 FOUNDATION & FRAMING PLANS

DRAWING NUMBER:

S401