

S101.1A2


TABLE 1 NOTES:

A. (MC) DENOTES MECHANICAL COUPLER DEVELOPING 125% OF THE BAR YIELD STRENGTH. NO OTHER SPLICE WILL BE ACCEPTED.

B. WHEN LAPPING TWO DIFFERENT SIZE BARS, USE THE LAP DIMENSION OF THE SMALLER BAR OR THE ANCHORAGE DIMENSION OF THE LARGER BAR. USE WHICHEVER DIMENSION IS LARGER.

C. TOP BARS SHALL BE DEFINED AS BEAM AND SLAB HORIZONTAL REINFORCEMENT SO PLACED THAT MORE THAN 12" OF FRESH CONCRETE IS CAST IN THE MEMBER BELOW THE TOP REINFORCEMENT. HORIZONTAL REINFORCING IN WALLS SHALL BE CONSIDERED TOP BARS.



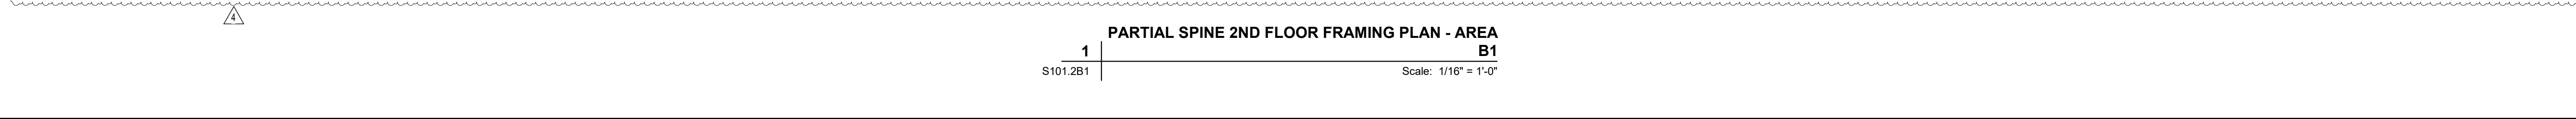

1 © 2024 AECOM Corporation

SHEET NUMBER

6101.2B1