

**2023 CAPITAL IMPROVEMENT
PROJECT PHASE 2
CONSTRUCTION DOCUMENTS**




- ## 2 NEW BEAM BEARING AT EXISTING CMU

SCALE: 3/4" = 1'-0"



SCALE: 3/4" = 1'-0"

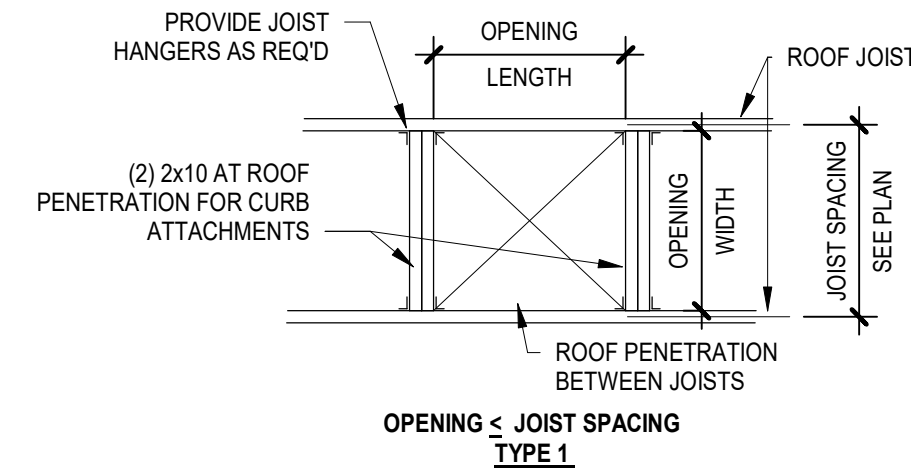

4 BEAM SPLICE

SCALE: 1" = 1'-0"




SCALE: 1/2" = 1'-0"



SCALE: 3/8" = 1'-0"



SCALE: 1" = 1'-0"

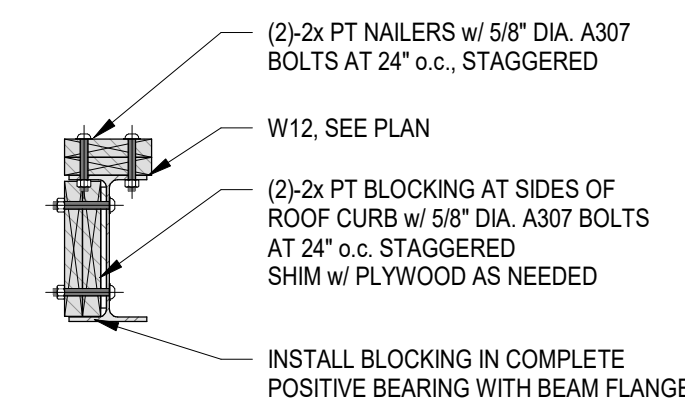

8 SECTION AT FRAMING

SCALE: 3/4" = 1'-0"

8A BLOCKING AND NAILER FASTENING

SCALE: 3/4" = 1'-0"

NOTES:


1. LINTELS IN EXTERIOR WALLS SHALL BE HOT-DIPPED GALVANIZED
2. ANGLES SHALL BE LONG LEG VERTICAL UNLESS NOTED OTHERWISE
3. BEARING LENGTH AT EACH END SHALL BE 8" MINIMUM
4. LINTELS IN EXTERIOR WALLS SHALL HAVE A MINIMUM THICKNESS OF 5/16"
5. COORDINATE EXACT SIZE, LOCATION AND QUANTITY WITH ARCHITECTURAL MECHANICAL AND ELECTRICAL DWG's.

9 TYPICAL NON-BEARING-WALL LOOSE LINTEL SCHEDULE


SCALE: 3/4" = 1'-0"




SCALE: 1" = 1'-0"

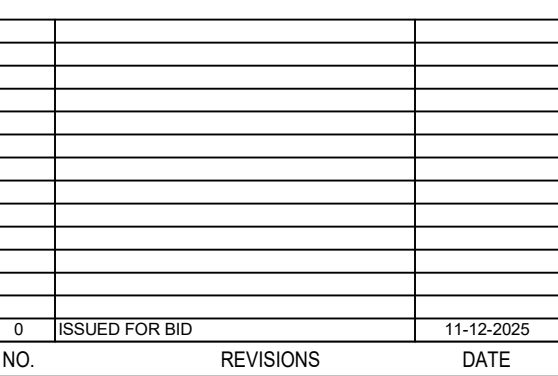

ROOF FRAMING PLAN AND DETAILS

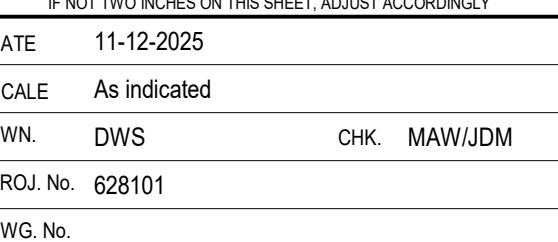

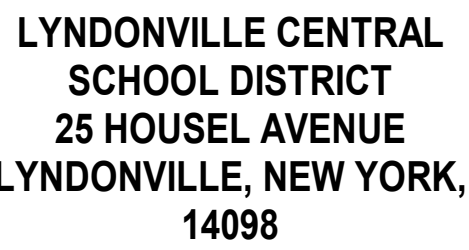

2023 CAPITAL IMPROVEMENT
PROJECT PHASE 2
CONSTRUCTION DOCUMENTS

