


7.3 Drain hole position

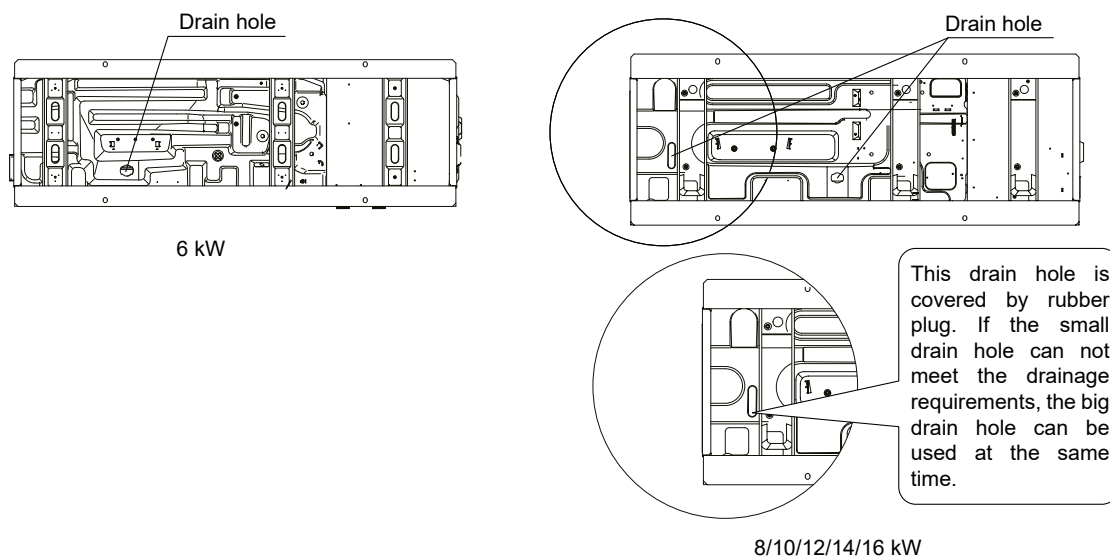


NOTE

It's necessary to install an electrical heating belt if water can't drain out in cold weather even the big drain hole has opened.

7.4 Servicing space requirements

7.4.1 In case of stacked installation

1) In case obstacles exist in front of the outlet side

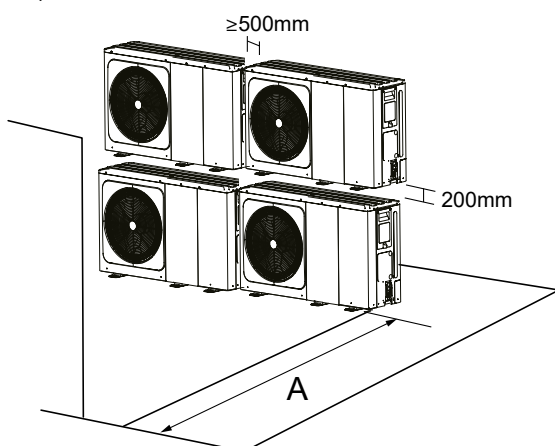

Unit	A(mm)
6kW	1000
8~16kW	1500

2) In case obstacles exist in front of the air inlet

