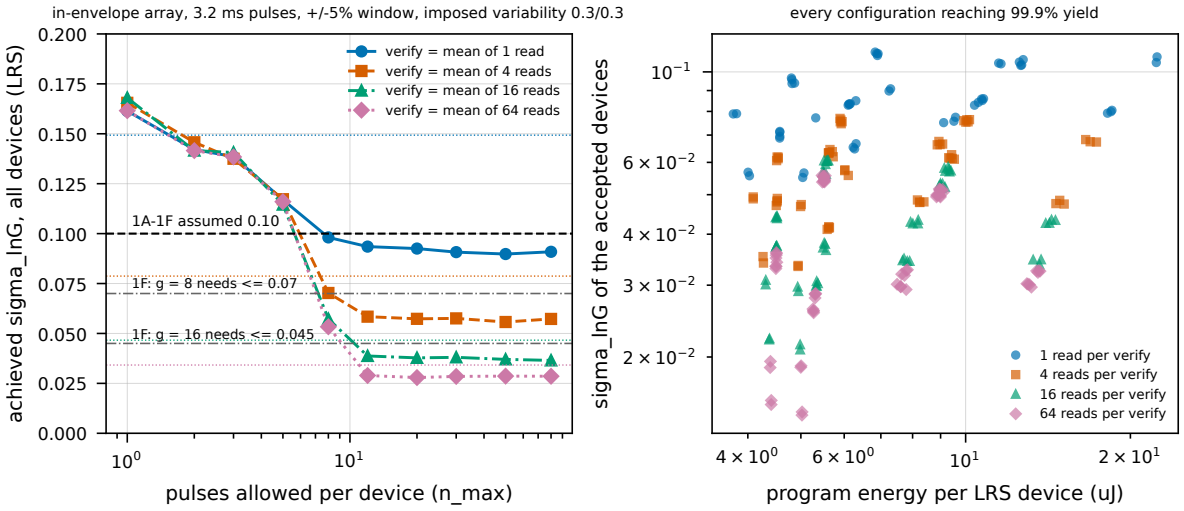
in-envelope array, 3.2 ms pulses, +/-5% window, imposed variability 0.3/0.3
achieved sigma_lnG, all devices (LRS)
pulses allowed per device (n_max)
verify = mean of 1 read
verify = mean of 4 reads
verify = mean of 16 reads
verify = mean of 64 reads
1A-1F assumed 0.10
1F: g = 8 needs <= 0.07
1F: g = 16 needs <= 0.045
every configuration reaching 99.9% yield
sigma_lnG of the accepted devices
program energy per LRS device (uJ)
1 read per verify
4 reads per verify
16 reads per verify
64 reads per verify